


VAYU-NET Enforcement Evidence Pack


Ward: M/E (Mumbai) Source: burning fireworks Confidence: 45%
At-risk facilities in ward: 38 schools, 22 hospitals
Priority score: 0.607 Events: 7 Mean PM2.5: 107 ug/m3 (max 152)
Window: 2025-12-27 01:30:00 to 2025-12-31 15:30:00

RECOMMENDED ACTION: Anti-burning patrol during evening/night hours; locate and extinguish open burning points
LEGAL BASIS: Air Act 1981 s.19(5) & applicable court orders on fireworks; open burning ban (NGT)

Ward PM2.5 (hourly mean, station data)

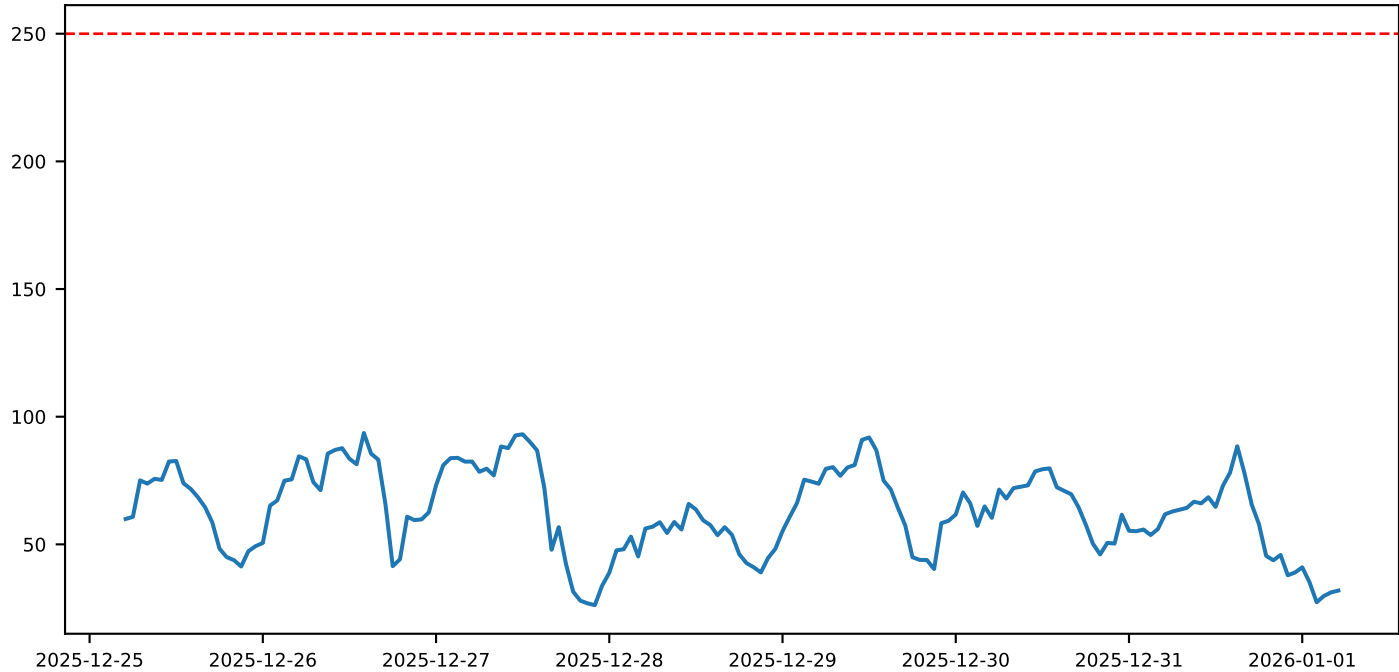

Pollution rose (mean PM2.5 by wind dir)

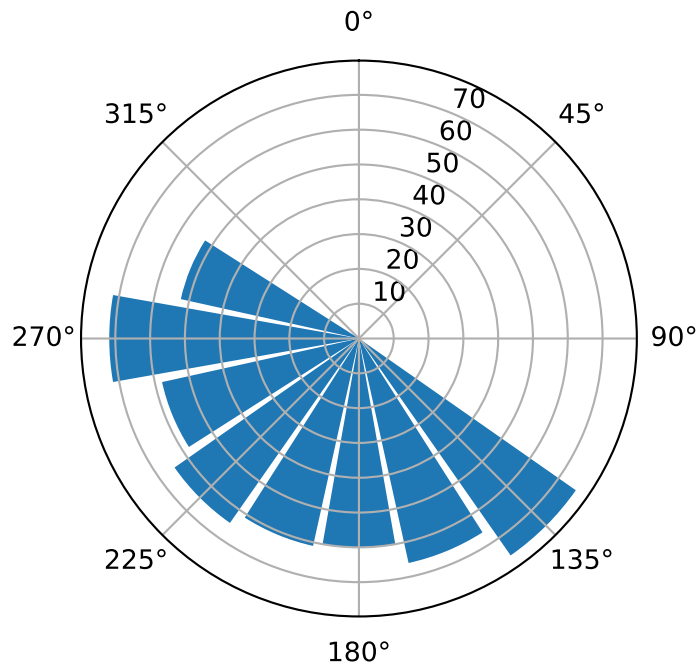

EVIDENCE (auto-generated, traceable):

- SO2 11 above station's 75th percentile (11)
- NH3 31 above station's 75th percentile (27)
- Event at 10:00 — rush-hour window
- New Year period — fireworks prior
- Calm winds (0.9 m/s) — accumulation/inversion conditions