


VAYU-NET Enforcement Evidence Pack


Ward: Nelagadderanahalli (Bengaluru) Source: burning_fireworks Confidence: 47%
At-risk facilities in ward: 5 schools, 1 hospitals
Priority score: 0.586 Events: 1 Mean PM2.5: 341 ug/m3 (max 341)
Window: 2025-12-28 01:30:00 to 2025-12-28 01:30:00

RECOMMENDED ACTION: Anti-burning patrol during evening/night hours; locate and extinguish open burning points
LEGAL BASIS: Air Act 1981 s.19(5) & applicable court orders on fireworks; open burning ban (NGT)

Ward PM2.5 (hourly mean, station data)

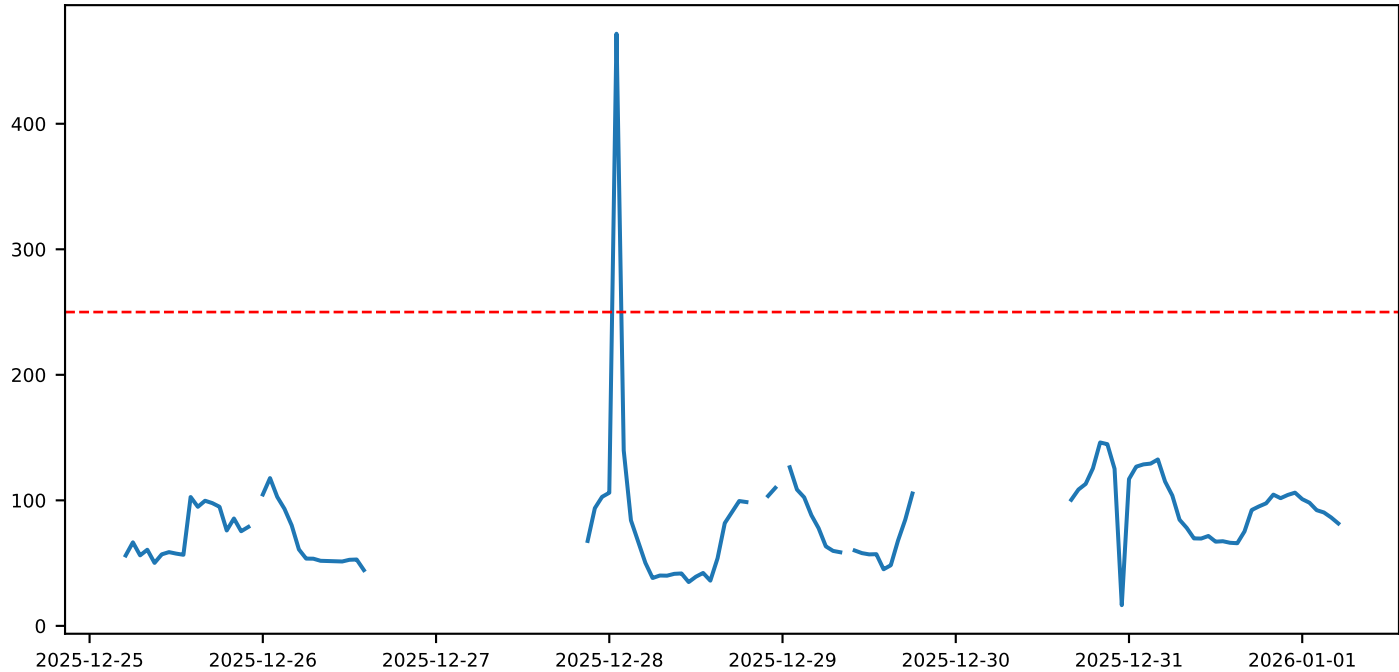

Pollution rose (mean PM2.5 by wind dir)

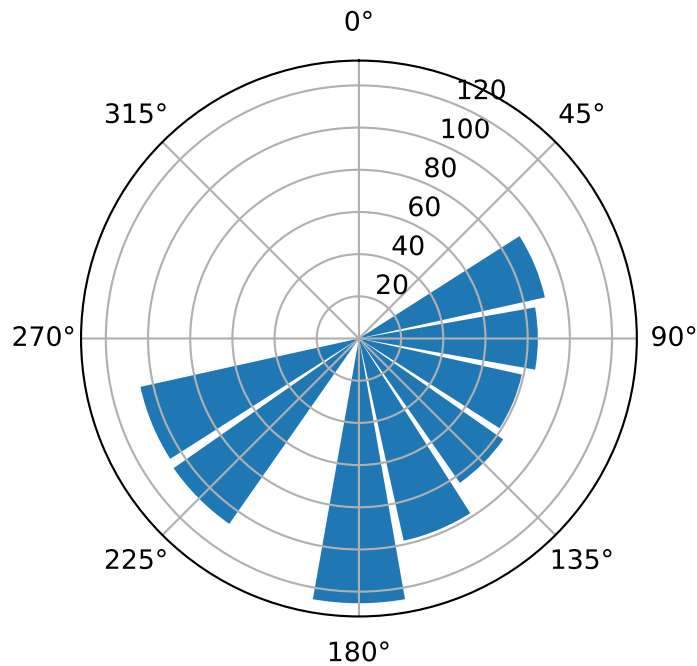

EVIDENCE (auto-generated, traceable):

- PM2.5/PM10 ratio 1.65 > 0.65 — combustion-dominated aerosol
- NH3 16 above station's 75th percentile (16)
- Event at 20:00 — rush-hour window
- Calm winds (0.5 m/s) — accumulation/inversion conditions
- VIIRS fire activity 1.5x the period average within ~50 km (7 detections vs 5/day baseline, NASA FIRMS)