


VAYU-NET Enforcement Evidence Pack


Ward: NARELA (Delhi) Source: burning_fireworks Confidence: 68%
At-risk facilities in ward: 0 schools, 4 hospitals
Priority score: 7.096 Events: 16 Mean PM2.5: 468 ug/m3 (max 686)
Window: 2025-12-26 03:30:00 to 2025-12-31 22:30:00

RECOMMENDED ACTION: Anti-burning patrol during evening/night hours; locate and extinguish open burning points
LEGAL BASIS: Air Act 1981 s.19(5) & applicable court orders on fireworks; open burning ban (NGT)

Ward PM2.5 (hourly mean, station data)

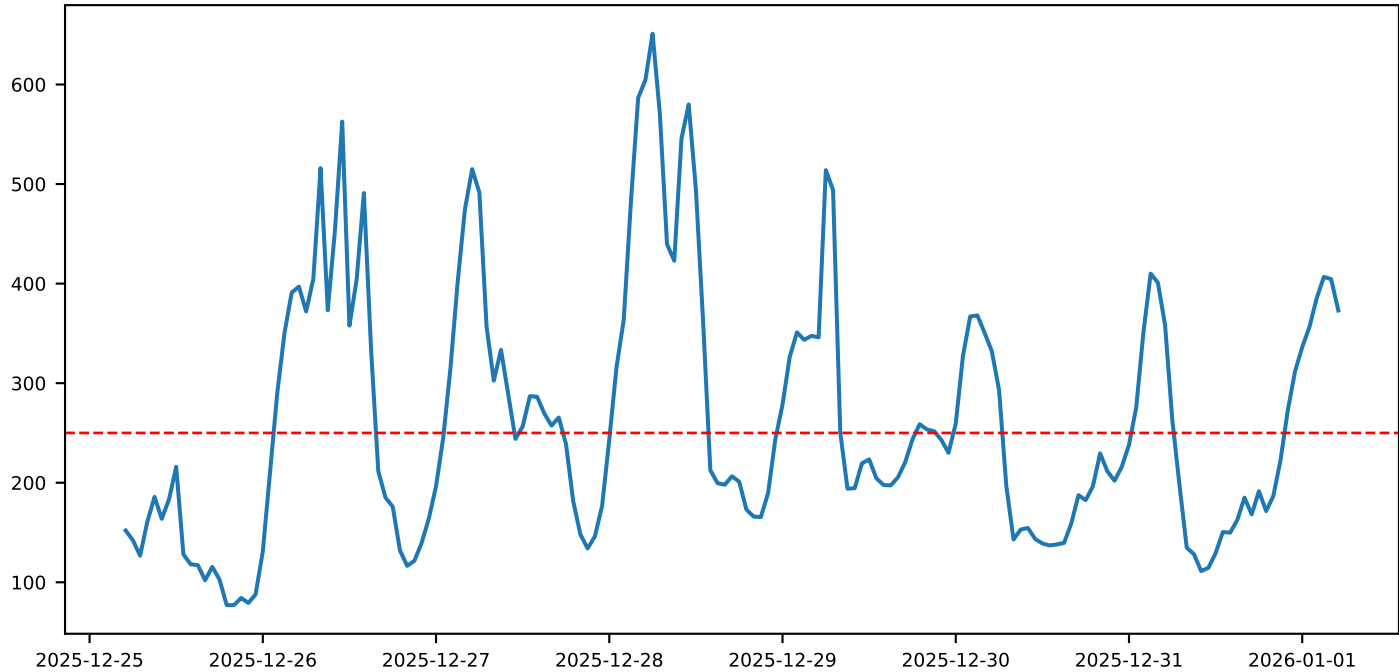

Pollution rose (mean PM2.5 by wind dir)

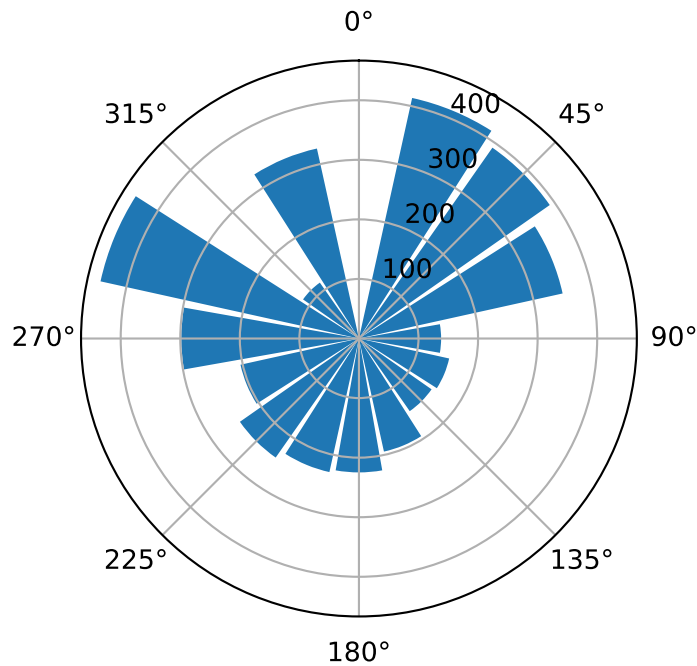

EVIDENCE (auto-generated, traceable):

- PM2.5/PM10 ratio 0.78 > 0.65 — combustion-dominated aerosol
- CO 2 above station's 75th percentile (2)
- SO2 18 above station's 75th percentile (17)
- NH3 56 above station's 75th percentile (42)
- Event at 01:00 — late-night window (burning/fireworks typical)
- Calm winds (0.3 m/s) — accumulation/inversion conditions
- VIIRS fire activity 2.1x the period average within ~50 km (5 detections vs 2/day baseline, NASA FIRMS)