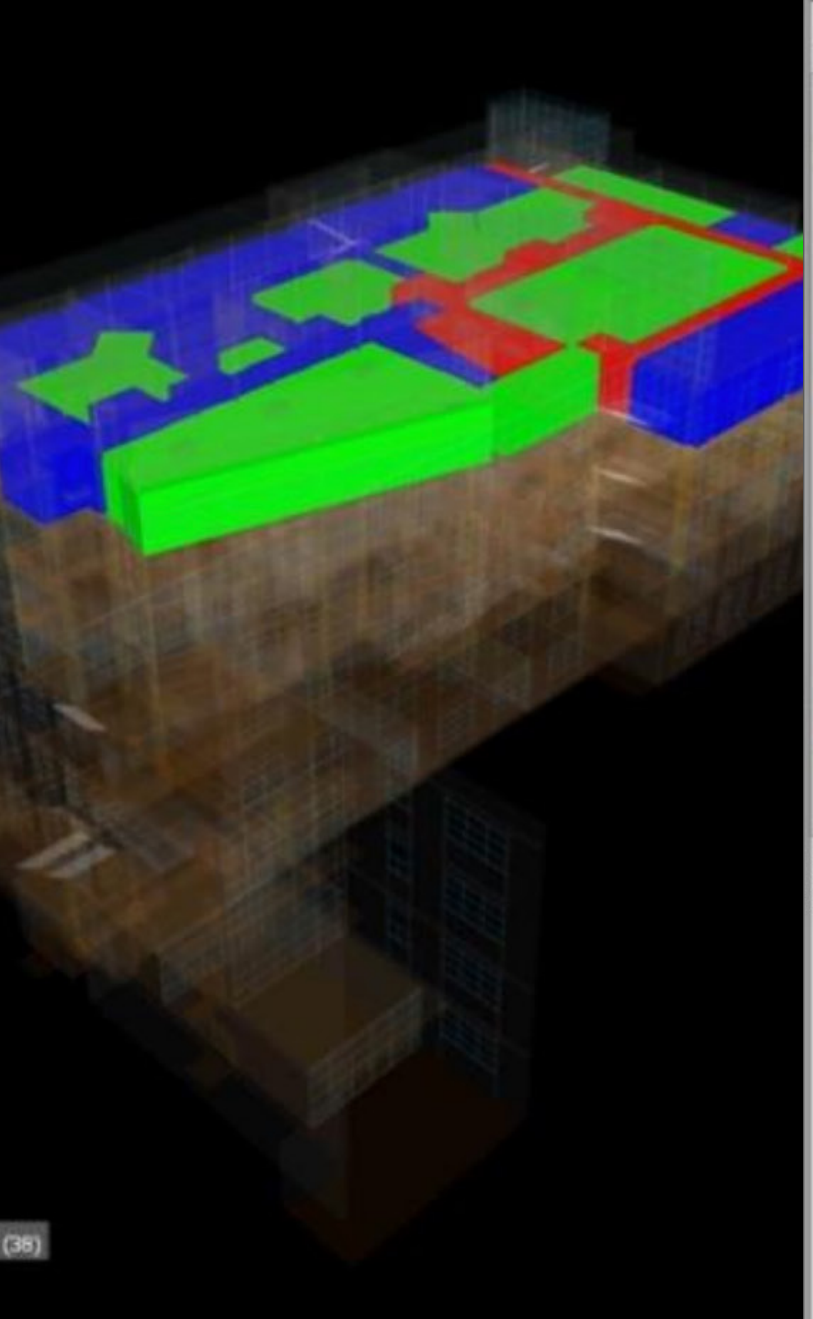


File Edit Help

Project Information | Temperature | Search Asset | System | Room Temperature | CO2 | Room CO2

Building Name : E2

Select Level

<No level>
Level 100 (+96,950)
Level 200
Level 300
Level 400
Level 500
Level 600

October /04/2017

Check Temperature

<21

21 - 23

>23

UNIVERSITY OF MANITOBA

Temperature

Select Level