

Lakeshore Hall C: AHU-3 Air System

1 Description

This note describes the arrangement of air handling unit AHU-3, which conditions Hall C, and the devices that drive, power and control it.

2 Arrangement

Figure 1 shows the arrangement. Air enters at the outdoor air damper, passes the mixing box, the supply fan in turn, and reaches the supply duct. AHU-3 houses the supply fan. The supply fan is driven by the motor M-3. The outdoor air damper is modulated by the controller DDC-3. The motor M-3 is modulated by the controller DDC-3. The sensor TS-1 reports to the controller DDC-3. The sensor TS-1 sits on the supply duct. The motor M-3 is rated 61 hp. The sensor TS-1 holds the supply air at 52 °F.

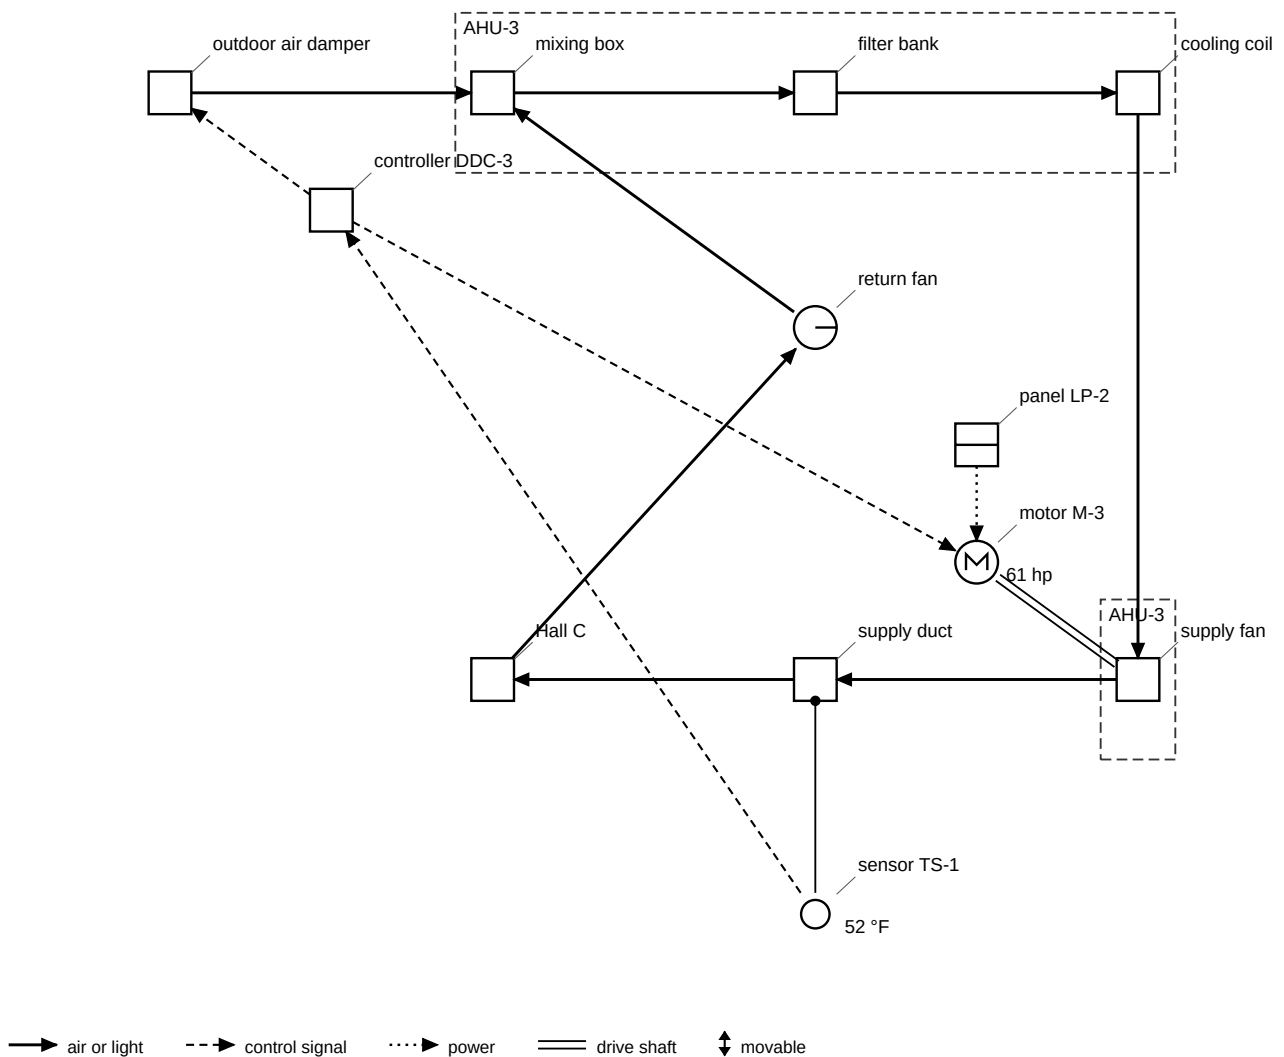


Figure 1. AHU-3 air system schematic