

Lakeshore Hall C: AHU-3 Air System

1 Description

This note describes the arrangement of air handling unit AHU-3, which conditions Hall C, and the devices that drive, power and control it.

2 Arrangement

Figure 1 shows the arrangement. From the outdoor air damper, the air passes to the mixing box. From the mixing box, the air passes to the filter bank. From the filter bank, the air passes to the cooling coil. From the cooling coil, the air passes to the supply fan. From the supply fan, the air passes to the supply duct. From the supply duct, the air passes to Hall C. From Hall C, the air passes to the return fan. From the return fan, the air passes to the mixing box. The mixing box is part of AHU-3. The filter bank is part of AHU-3. The cooling coil is part of AHU-3. The supply fan is part of AHU-3. The motor M-3 drives the supply fan. The panel LP-2 powers the motor M-3. The controller DDC-3 controls the outdoor air damper. The controller DDC-3 controls the motor M-3. The sensor TS-1 is connected to the controller DDC-3. The sensor TS-1 is mounted on the supply duct. The motor M-3 is rated 61 hp. The sensor TS-1 holds the supply air at 52 °F.

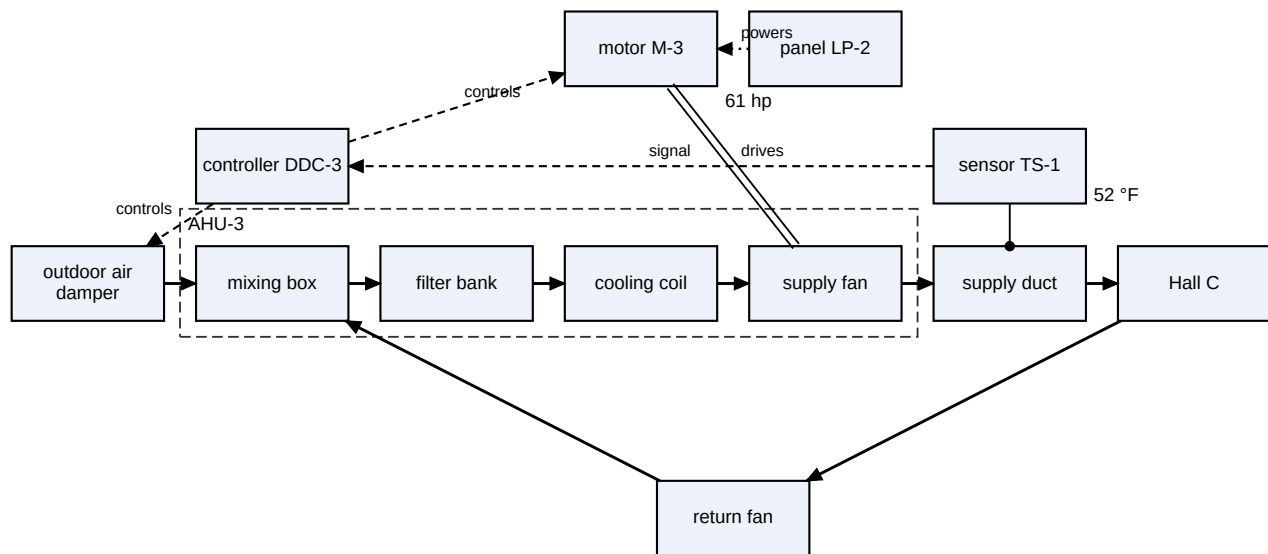


Figure 1. AHU-3 air system schematic