

Lakeshore Convention Center: Metered Electricity

1 Electricity Use

Over the year the North substation delivered 7,275 MWh and the South substation 3,400 MWh. Figure 1 gives each substation's use month by month.

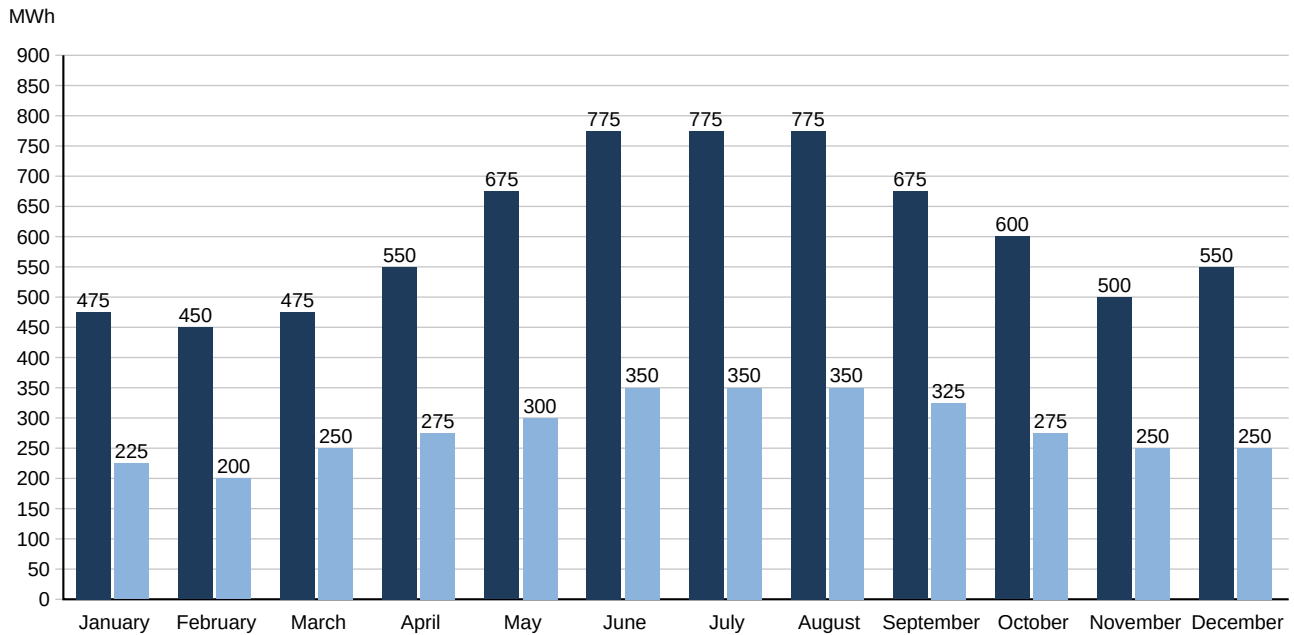


Figure 1. Monthly electricity use by substation (dark bars: North substation; light bars: South substation)

2 Peak Demand

The utility contract caps the center's demand at 3,519 kW. Figure 2 gives each substation's peak demand in each month; the two peaks seldom fall in the same hour, so their sum overstates the center's.

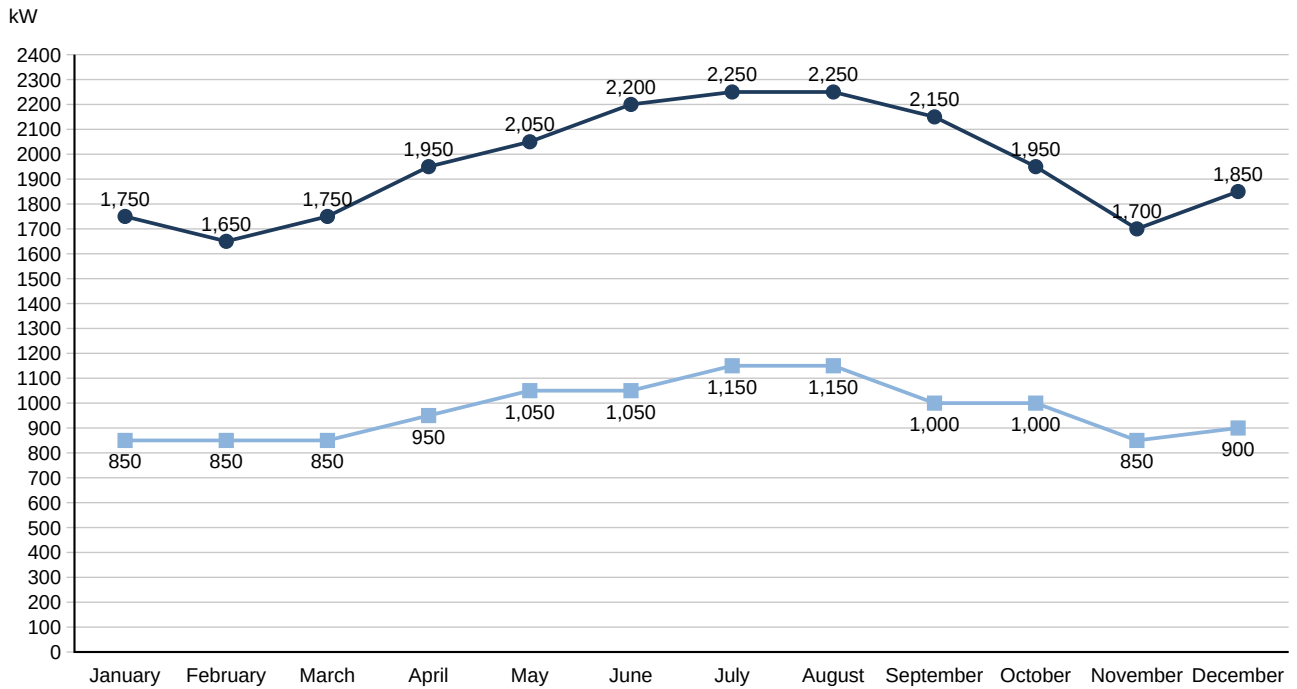


Figure 2. Monthly peak demand by substation (circles: North substation; squares: South substation)