

Lakeshore Hall C: Energy by End Use

1 Energy by End Use

Over the cooling season, Hall C's cooling uses 1,375 MWh, its fans 350 MWh and its lighting 200 MWh, as Figure 1 shows month by month. Figure 2 compares the two cooling options' peak loads.

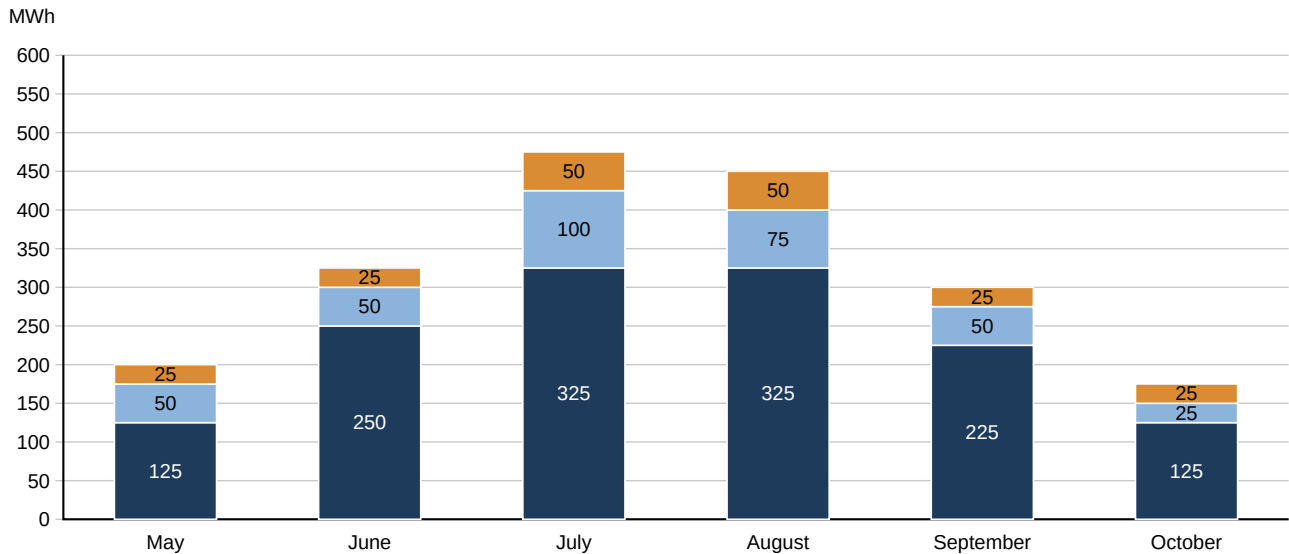


Figure 1. Hall C monthly energy by end use, May to October (dark: cooling; light: fans; orange: lighting)

2 Peak Loads

The two options' peak loads follow the season, rising to midsummer and falling after it.

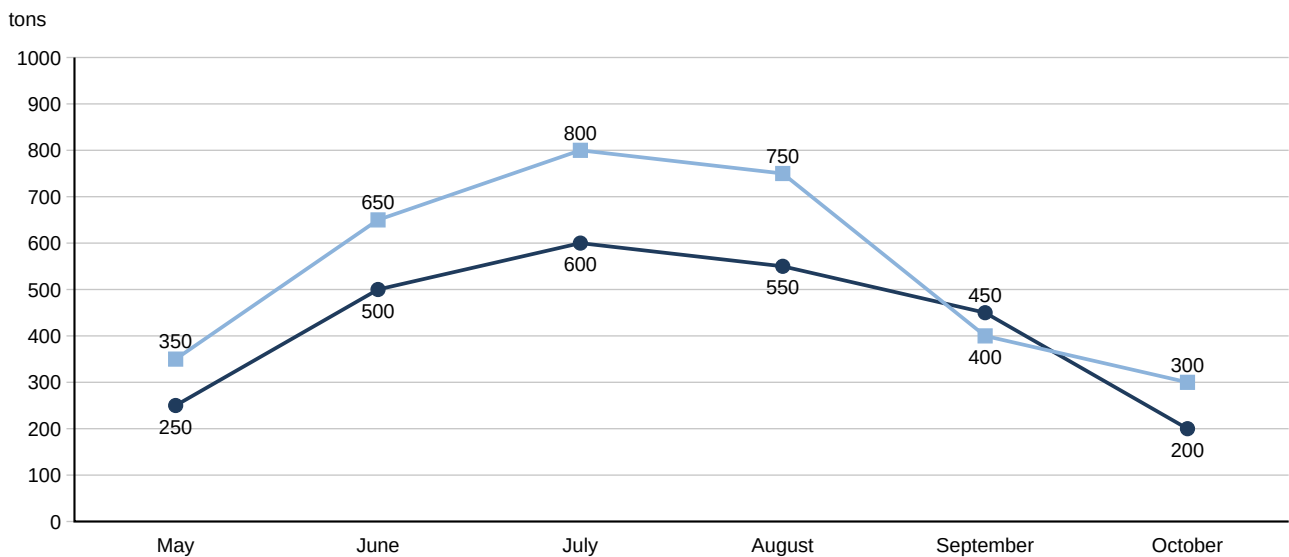


Figure 2. Monthly peak cooling load of the two options (circles: Option 1, chilled beams; squares: Option 2, VAV baseline)