MR. D´s DONUTS RESTAURANT - BUILDING SHELL

CODE ANALYSIS:

EXTENT OF WORK
THIS PROJECT INVOLVES A FREESTANDING RESTAURANT WITH INTERIOR AND EXTERIOR DINING AREAS. THE BUILDING IS A SINGLE STORY FACILITY, SLAB ON GRADE.

BUILDING CODES
BUILDING WAS DESIGNED UNDER THE FOLLOWING CODES:
AMERICANS WITH DISABILITIES ACT (ADA-AG)
2018 INTERNATIONAL BUILDING CODE
2018 INTERNATIONAL FIRE CODE
2018 INTERNATIONAL PLUMBING CODE
2018 INTERNATIONAL MECHANICAL CODE
2018 INTERNATIONAL FUEL GAS CODE
2018 INTERNATIONAL ENERGY CONSERVATION CODE
2017 NATIONAL ELECTRIC CODE
ACCESSIBLITY CODE: ANSI A117.1 2009

OCCUPANCY CLASSIFICATION
A-2 RESTAURANT (ASSEMBLY) BUILDING SHELL ONLY

CONSTRUCTION TYPE
REMODEL V B UNPROTECTED CONSTRUCTION (NON- SPRINKLED)
NO FIRE ALARM PROPOSED

ALLOWABLE AREA
A-2 RESTAURANT (ASSEMBLY) V B CONSTRUCTION

GROSS BUILDING AREA
2,102 SQ. FT. GROSS AREA

FUTURE OCCUPANT LOAD
T.B.D. WITH TENANT FINISH SUBMITTAL

TRASH ENCLOSURE
THIS BUILDING WILL SHARE A TRASH ENCLOSURE THAT IS ATTACHED TO THE ADJACENT RESTAURANT BUILDING.

DRAWING INDEX:

GENERAL NOTES:

1. THE GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION, AIA DOCUMENT A-201, LATEST EDITION, IS TO BE CONSIDERED A PART OF THESE BUILDING PLANS ALTHOUGH NOT ENCLOSED HEREIN. ALL CONTRACTORS SHALL BE HELD RESPONSIBLE FOR THE KNOWLEDGE OF ALL ARTICLES OF THE DOCUMENT AND SHALL BE BOUND BY THEM. CONTRACTOR SHALL PROVIDE CONTRACTS AT THEIR EXPENSE.
2. ALL WORK SHALL CONFORM TO THE REQUIREMENTS OF ALL LOCAL LAWS, CODES AND REGULATIONS OF ALL AUTHORITIES HAVING JURISDICTION. IN CASE OF CONFLICT BETWEEN REQUIREMENTS, THE MOST RESTRICTVE SHALL APPLY.
3. CONTRACTOR AND SUBCONTRACTORS AND AGENTS SHALL HOLD ALL APPLICABLE AND REQUIRED LICENSES FOR THE JURISDICTION WHERE THE WORK WILL BE PERFORMED.
4. CONTRACTOR SHALL AQUAINT THEMSELVES WITH ALL LANDLORD / DEVELOPER REQUIREMENTS AND SHALL COMPLY FULLY WITH SUCH.
5. TO ENSURE COORDINATION BETWEEN DISCIPLINES, CONTRACTOR SHALL SUPPLY EACH SUBCONTRACTOR OR AGENT WITH A FULL SET OF CONSTRUCTION DOCUMENTS FOR THEIR USE.
6. MAINTAIN SAFE EXITING AND APPROPIATE FIRE PREVENTION PROCEDURES AT ALL TIMES DURING THE CONSTRUCTION PROCESS.
7. CONTRACTOR SHALL PROVIDE ADEQUATE PROTECTION OF WORK, MATERIALS, FIXTURES, ETC. FROM LOSS, DAMAGE, FIRE, THEFT, ETC.
8. ALL AREAS OF EXISTING LANDSCAPING DISTURBED DURING CONSTRUCTION SHALL BE RESTORED TO ORIGINAL CONDITION. PROVIDE NEW PLANTS IN SPECIES TO MATCH EXISTING THAT WAS DAMAGED OR REMOVED
9. CONTRACTOR SHALL VERIFY AND PROVIDE ALL UTILITY CONNECTIONS (PLUMBING, ELECTRICAL, GAS, ETC. IN THE FORM OF SUPPLY AND DRAIN PIPES, CONDUIT AND PULLING WIRES, ETC.) RELATED TO EQUIPMENT AND APPLIANCES.
10. DIMENSIONS ARE TO FACE OF FINISHED MATERIAL UNLESS NOTED OTHERWISE.
11. CONTRACTOR SHALL VERIFY ALL EXISTING UTILITIES IN THE FIELD AND PROVIDE ADDITIONAL UTILITY SERVICE AS REQUIRED TO MEET THE SCOPE AND INTENT OF THE WORK.
12. PROVIDE FIRE EXTINGUISHERS PER APPLICABLE CODES. VERIFY FINAL LOCATION WITH A.H.J. PRIOR TO INSTALLING
13. CONTRACTOR SHALL COORDINATE ALL WORK THAT AFFECTS THE ROOF WITH THE OWNER/LANDLORD AND CONTRACT WITH THE SHELL ROOFING SUBCONTRACTOR TO PERFORM ALL WORK OF PENETRATING THE ROOF FOR ANY AND ALL ITEMS ADDED ON THE ROOF AND PATCHING/SEALING OF SUCH PENETRATIONS DURING AND AFTER EQUIPMENT INSTALLATION.
14. CONTRACTOR SHALL REVIEW THE DIMENSIONS OF ALL EQUIPMENT IN THE PROJECT REGARDLESS OF THE SOURCE AND COORDINATE ACCESS TO THE SPACE AND VERIFY CLEAR FLOOR SPACE IS PROVIDED AS REQUIRED TO ENSURE EASE OF INSTALLATION.
15. CONTRACTOR TO VERIFY THAT EQUIPMENT HAS APPROPRIATE CLEARANCES DURING INSTALLATION INCLUDING MAINTENANCE CLEARANCES; VERIFY THOSE WHICH INVOLVE CONFLICTING UTILITIES.
16. PROVIDE AND INSTALL ALL NECESSARY IN-WALL FRAMING REQUIRED TO CARRY SHELF, HANGING, AND VALANCE LOADS, RAILINGS, KITCHEN EQUIPMENT, RESTROOM ACCESSORIES ETC. AS PER PLANS.
17. ALL SURFACES WHICH ARE INDICATED TO BE FINISHED OR PAINTED SHALL BE PREPARED, SANDED, TREATED, AND PRIMED IN STRICT ACCORDANCE WITH COMMERCIAL QUALITY STANDARDS, AND IN STRICT ACCORDANCE WITH FINISH MATERIAL MANUFACTURER'S INSTRUCTIONS.
18. ALL FINISH SURFACES PENETRATED SUCH AS CEILING TILES AND MILLWORK COUNTERS FOR ANY REASON MUST HAVE AN ASSOCIATED GROMMET APPROVED FOR THAT USE.
19. PROVIDE OCCUPANCY SIGN IN A CONSPICUOUS LOCATION IN ACCORDANCE WITH STATE & LOCAL CODES. DESIGN TO BE APPROVED BY ARCHITECT.
20. CONTRACTOR SHALL PROVIDE NECESSARY BRACING TO STRUCTURE FOR INTERIOR PARTITIONS, SOFFITS, CEILINGS, PLATFORMS, ETC. WHETHER SHOWN ON THE DRAWINGS OR NOT.
21. PRIOR TO CUTTING OR MODIFYING UTILITY LINES WITHIN THE SPACE, WHETHER SHOWN IN THESE DOCUMENTS OR NOT, COORDINATE WITH LANDLORD.
22. ALL BLOCKING MUST BE FRT OR OTHERWISE INCOMBUSTIBLE WHERE NON-COMBUSTIBLE CONSTRUCTION TYPE IS LISTED IN THE CODE ANALYSIS.
23. PROVIDE ALL CUTTING AND PATCHING OF EXISTING CONSTRUCTION TO ACCOMMODATE NEW CONSTRUCTION WORK
24. VERIFY LOCATIONS OF EXISTING UTILITY SERVICE CONNECTIONS AND MAKE ALL CONNECTIONS REQUIRED. LOCATIONS OF EXISTING UTILITIES INDICATED IN THE DRAWINGS ARE APPROXIMATE, ARE BASED ON INFORMATION PROVIDED, BUT HAVE NOT BEEN FIELD VERIFIED.
25. PERFORM WORK BY MEANS THAT WILL NOT PRODUCE NOISE, VIBRATION, ODORS OR DUST WHICH COULD AFFECT OPERATIONS OR USE BY OTHER TENANTS.
26. PROTECT EXISTING CONSTRUCTION FROM DAMAGE AND REPAIR DAMAGE DUE TO CONSTRUCTION OPERATIONS AT NO COST TO OWNER.

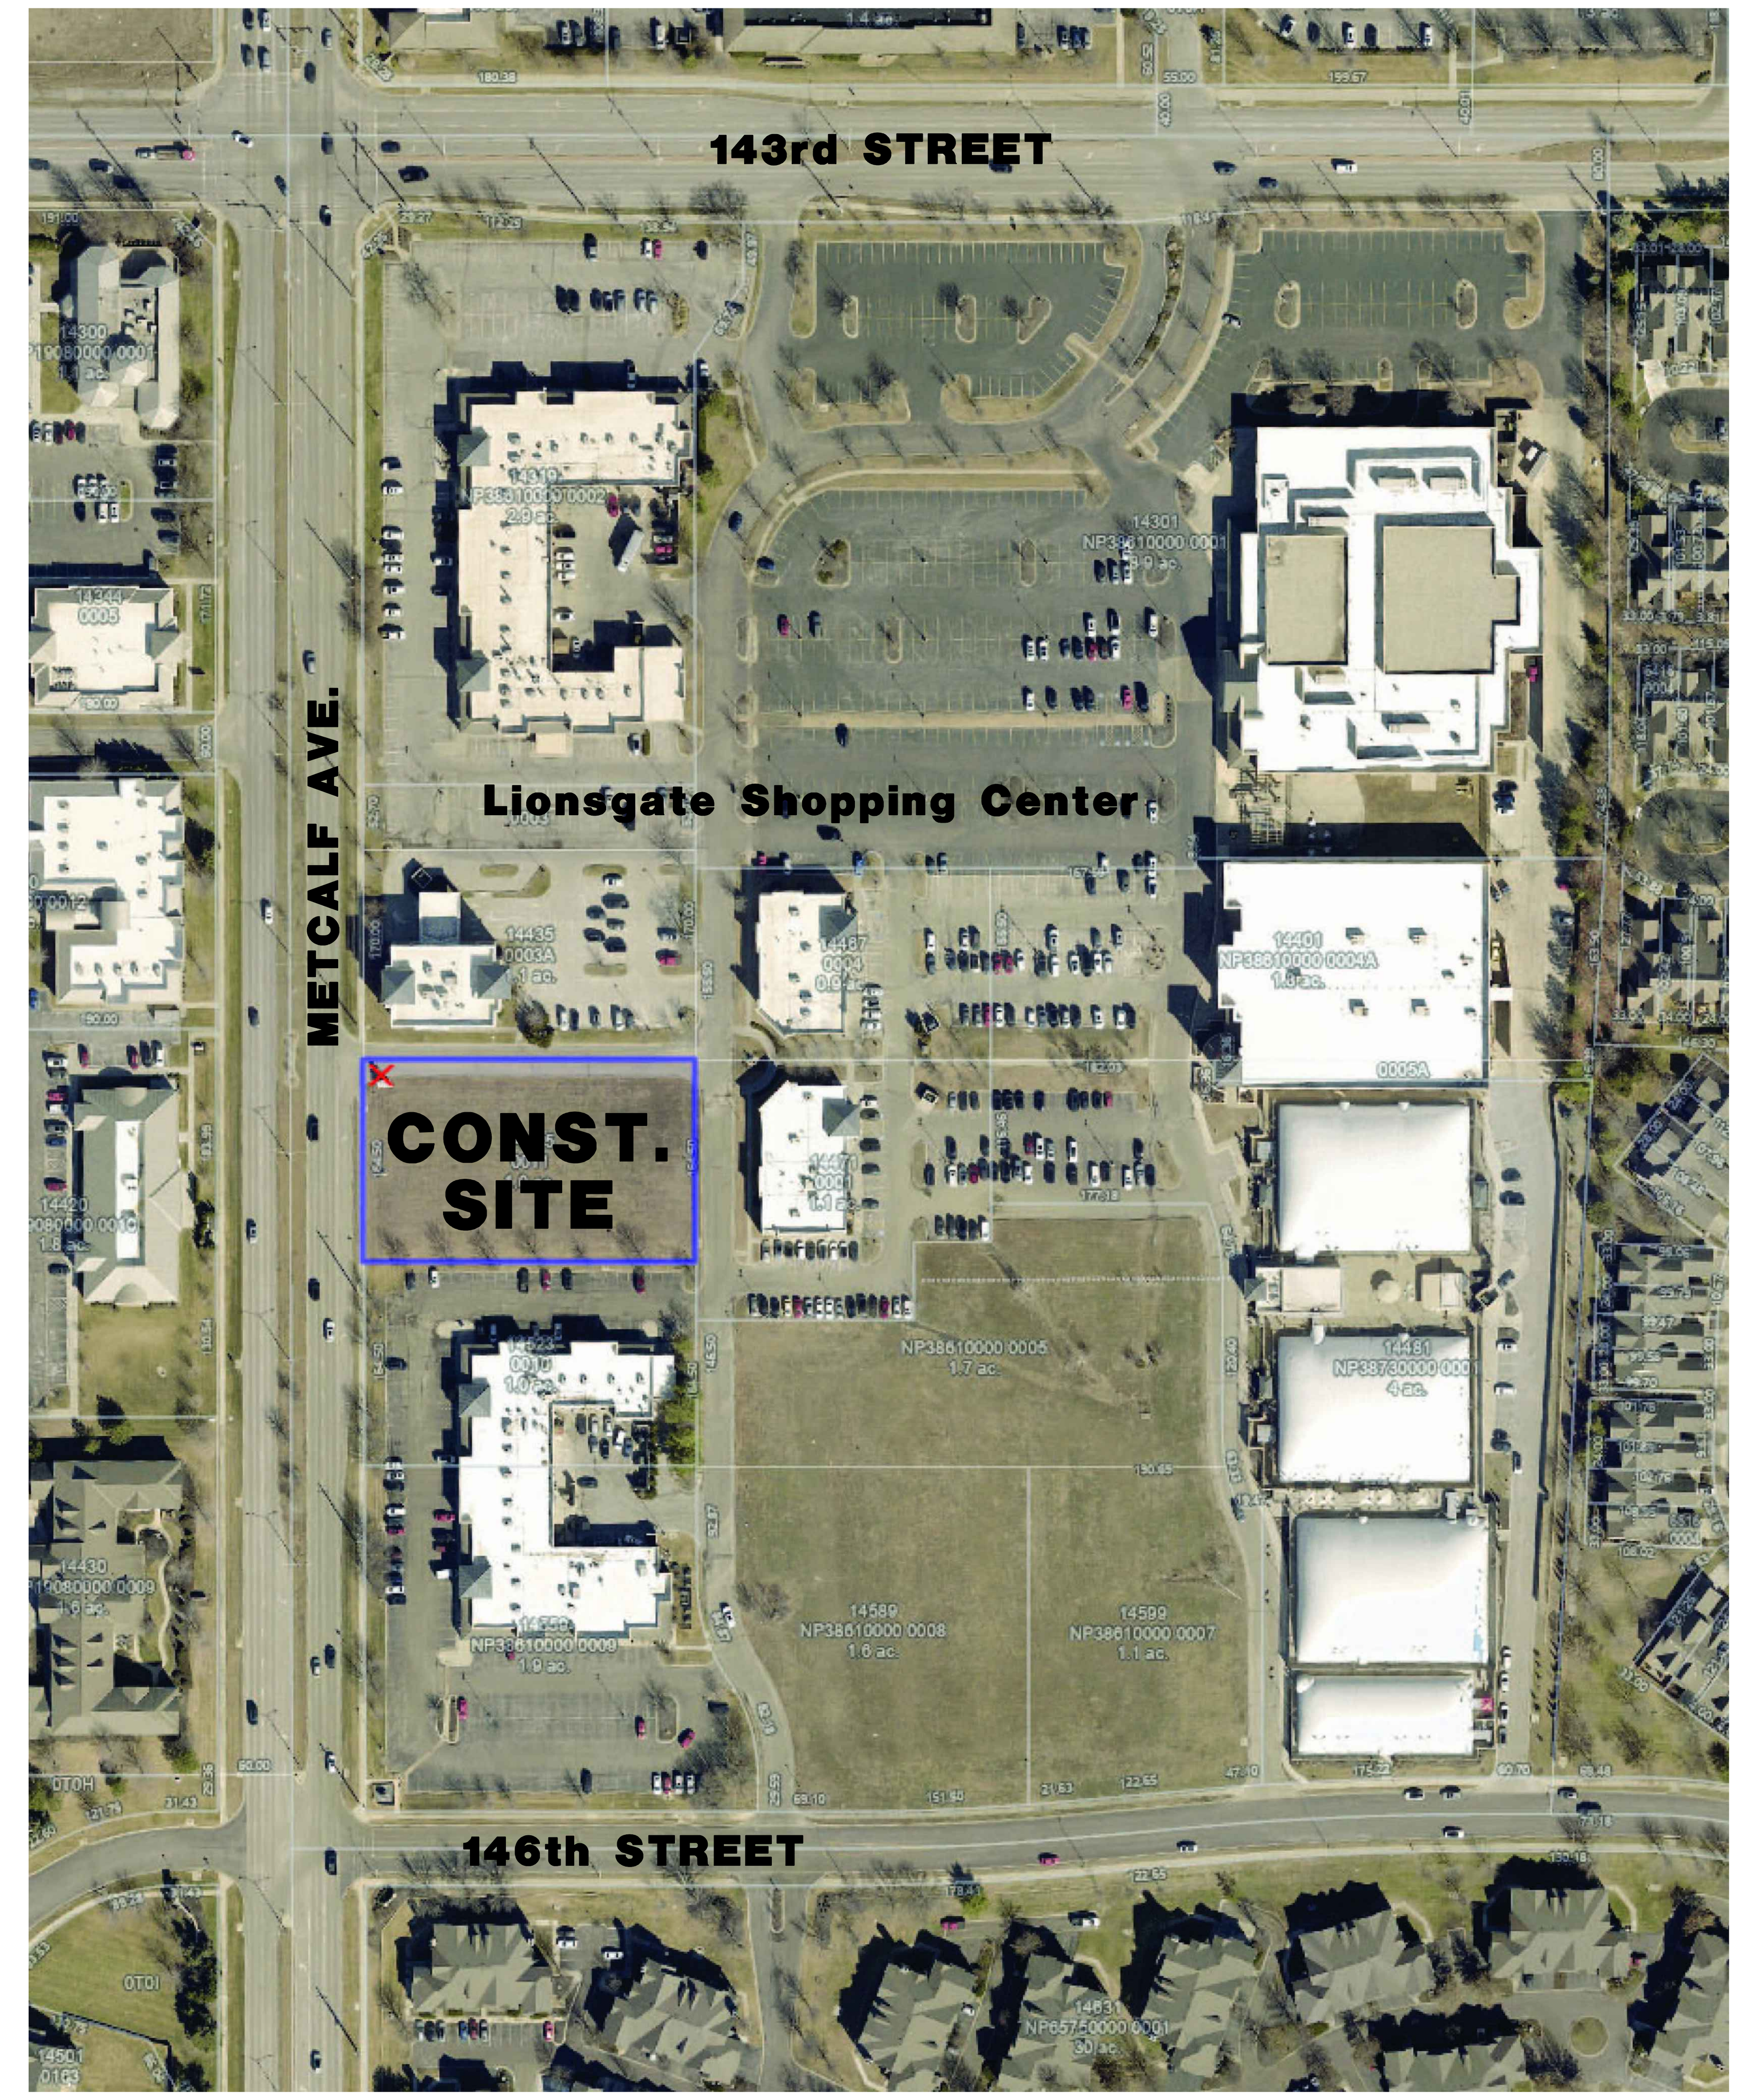

N

KEY PLAN
SCALE // NTS

LIFE SAFETY MAINTENANCE

The general contractor for this building will oversee and maintain on–site control of the above referenced project during construction.

The procedures that are to be followed are started below,but are not limited to:

1. Daily notification of the Fire Dept. when fire safety systems are taken out of service and reinstated.
2. Tagging of valves and disconnects of life safety systems.
3. Removal and replacement of smoke detectors to prevent false alarms.
4. Continual supervision by property managers and building engineers.

NOTES:

1. Any changes or considerations which affect the design intent must be called to the attention of the Project Architect and Project Coordinator immediately.
2. All dimensions are critical, any discrepancies or revisions from dimensions indicated on these drawings must be called to the attention of the Architect immediately.
3. Contractor shall examine site, field verify all dimensions and field conditions. Sub-contractors shall become familiar with conditions affecting the construction prior to submitting a bid. Failure to do so shall no be considered a just cause for future extras.
4. Contractor shall provide all necessary permits and fees.
5. Contractor shall provide all necessary temporary protection to ensure the safety of the general public during the construction phase.
6. Contractor shall meet all local governmental code requirements for performance of all construction work.
7. All construction shall be non-structural. There are no changes or alterations to the building superstructure.
8. Construction must be complete prior to ____N/A____ and ready for installation of furniture.
9. Contractor shall provide all labor, materials, equipment, and service required to execute and complete all items as shown or indicated on the drawings and as specified, including incidental items to effect a finished and complete job.
10. All work shall comply with state and local codes and ordinances, and shall be done to the highest standards of craftsmanship.
11. All waste materials, rubbish, debris, etc. shall be removed from the tenant's premises as soon as possible and not allowed to accumulate.
12. The General Conditions of the Contract for Construction, AIA Document A-201, 1987 Edition, is to be considered a part of these Specifications although not enclosed herein. All Contractors shall be held responsible for the knowledge of all Articles of this document and shall be bound by them. Copies will be available at the Architects office for study upon request.
13. Unless noted otherwise, all cabinets shall be plastic laminate tops, backsplashes, doors and units- all interiors of cabinets shall be melamine unless noted otherwise.
14. All wallcovering and carpet to have a flamespread not-to-exceed 75.
15. All tenant spaces shall have a lay-in acoustical ceiling set at 10'-0" A.F.F. unless noted otherwise.

DAVID A. KASTER
LICENSED
3649
KANSAS
PROFESSIONAL ARCHITECT
NOV. 24, 2025

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC
ARCHITECTURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center
Mr. D´s DONUTS
14485 METCALF AVE.
OVERLAND PARK, KANSAS

DATE	NOV. 24, 2025
REVISED	
SHEET NUMBER	A1.0
OF SHEETS	

KAI JOB NO. 2506-C

DOOR CYLINDERS MAY NOT BE I.C. CORE WHICH IS INCOMPATIBLE WITH OWNER CORE REPLACEMENT

PROVIDE DOOR STOPS FOR ALL DOORS IN LOCATIONS WHERE THEY WOULD NORMALLY BE NEEDED

ALL WOOD DOORS SHALL BE SOLID CORE PREMIUM GRADE WITH PARTICLE CORE (GPC) W/ PAINT GRADE BIRCH VENEER

ALL NEW LOCKS AND HARDWARE SHALL BE MANUF. BY SCHLAGE OR EQ. ALL EGRESS DOORS SHALL BE READILY OPENED FROM THE SIDE OF EGRESS WITHOUT THE USE OF KEY OR SPECIAL KNOWLEDGE. ALL FLUSH/DEAD BOLTS SHALL BE PROHIBITED.

HARDWARE SUPPLIER SHALL BE RESPONSIBLE TO SEE THAT ALL HARDWARE MEETS OR EXCEEDS THE 2012 INTERNATIONAL BUILDING CODE. HARDWARE AND HOLLOWMETAL SUPPLIER SHALL BE THE SAME.

FIRE DOORS SHALL BE LABELED: LABEL SHALL INDICATE NAME OF THE MANUFACTURER, NAME OF THE THIRD-PARTY INSPECTION AGENCY, FIRE PROTECTION RATING, AND IN NON-SPRINKLED BUILDINGS, MAX. TRANSMITTED TEMPERATURE END POINT. THE LABEL SHALL BE APPLIED AT THE FACTORY WHERE FABRICATION AND ASSEMBLY ARE DONE. INSPECTION SHALL BE MADE BY AN APPROVED AGENCY.

ALL GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL ADJACENT TO A DOOR WHERE THE NEAREST EXPOSED EDGE OF THE GLAZING IS WITHIN A 24" ARC OF EITHER VERTICAL EDGE OF THE DOOR IN A CLOSED POSITION AND WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60" ABOVE THE WALKING SURFACE SHALL BE TEMPERED GLASS. ALL GLASS DOORS TO HAVE TEMPERED GLASS.

ALL EXIT DOORS TO MEET ANSI A117 1-1998 SECTION 404.2.10 DOOR SURFACE. DOOR SURFACES WITHIN 10" OF THE FLOOR OR GROUND MEASURED VERTICALLY SHALL BE A SMOOTH SURFACE ON THE PUSH SIDE EXTENDING THE FULL WIDTH OF THE DOOR. PARTS CREATING HORIZONTAL OR VERTICAL JOINTS IN SUCH SURFACE SHALL BE WITH 1/16" OF THE SAME PLANE AS THE OTHER. CAVITIES CREATED BY ADDED KICK PLATES SHALL BE CAPPED.

EXCEPTIONS:
1. TEMPERED GLASS DOORS WITHOUT STILES AND HAVING A BOTTOM RAIL OR SHOE WITH THE TOP LEADING EDGE TAPERED AT NO LESS THAN 60 DEGREES FROM THE HORIZONTAL SHALL NOT BE REQUIRED TO MEET THE 10" BOTTOM RAIL HEIGHT REQUIREMENT.
2. DOORS WHICH DO NOT EXTEND TO WITHIN 10" OF THE FLOOR OR GROUND.

A / A2.1 DOOR NOTES

DOOR SCHEDULE:

ALL DOORS SHALL HAVE ADA COMPLIANT HARDWARE, INCLUDING LEVER HANDLES, U.N.O.
RATED DOORS SHALL HAVE CORRESPONDING RATED FRAMES, TYP.

DOOR NUMBER	SIZE	DOOR MATERIAL	FRAME FINISH	LOCK	DOOR CLOSER	COMMENTS
A	3'-0" X 7'-0"	STORE FRONT	STORE FRONT	√	√	PROVIDE PANIC BAR DEVICE + ENTRY FUNCTION LOCK ▲

+ 1" TEMPERED, INSULATED GLAZING ● 1/4" TEMPERED GLASS ■ SMOKE SEAL ▲ THRESHOLD: TO BE NGP 896V - PROVIDE SWEEPS - NO SUBSTITUTIONS

DRY WALL SPECIFICATIONS:

ALL DRY WALL WALL'S TO RECEIVE LEVEL (4) DRY WALL SURFACE (UNLESS NOTED OTHERWISE).
WHERE GYP BOARD IS INDICATED, USE EXTERIOR GRADE GYPSUM BOARD ONLY

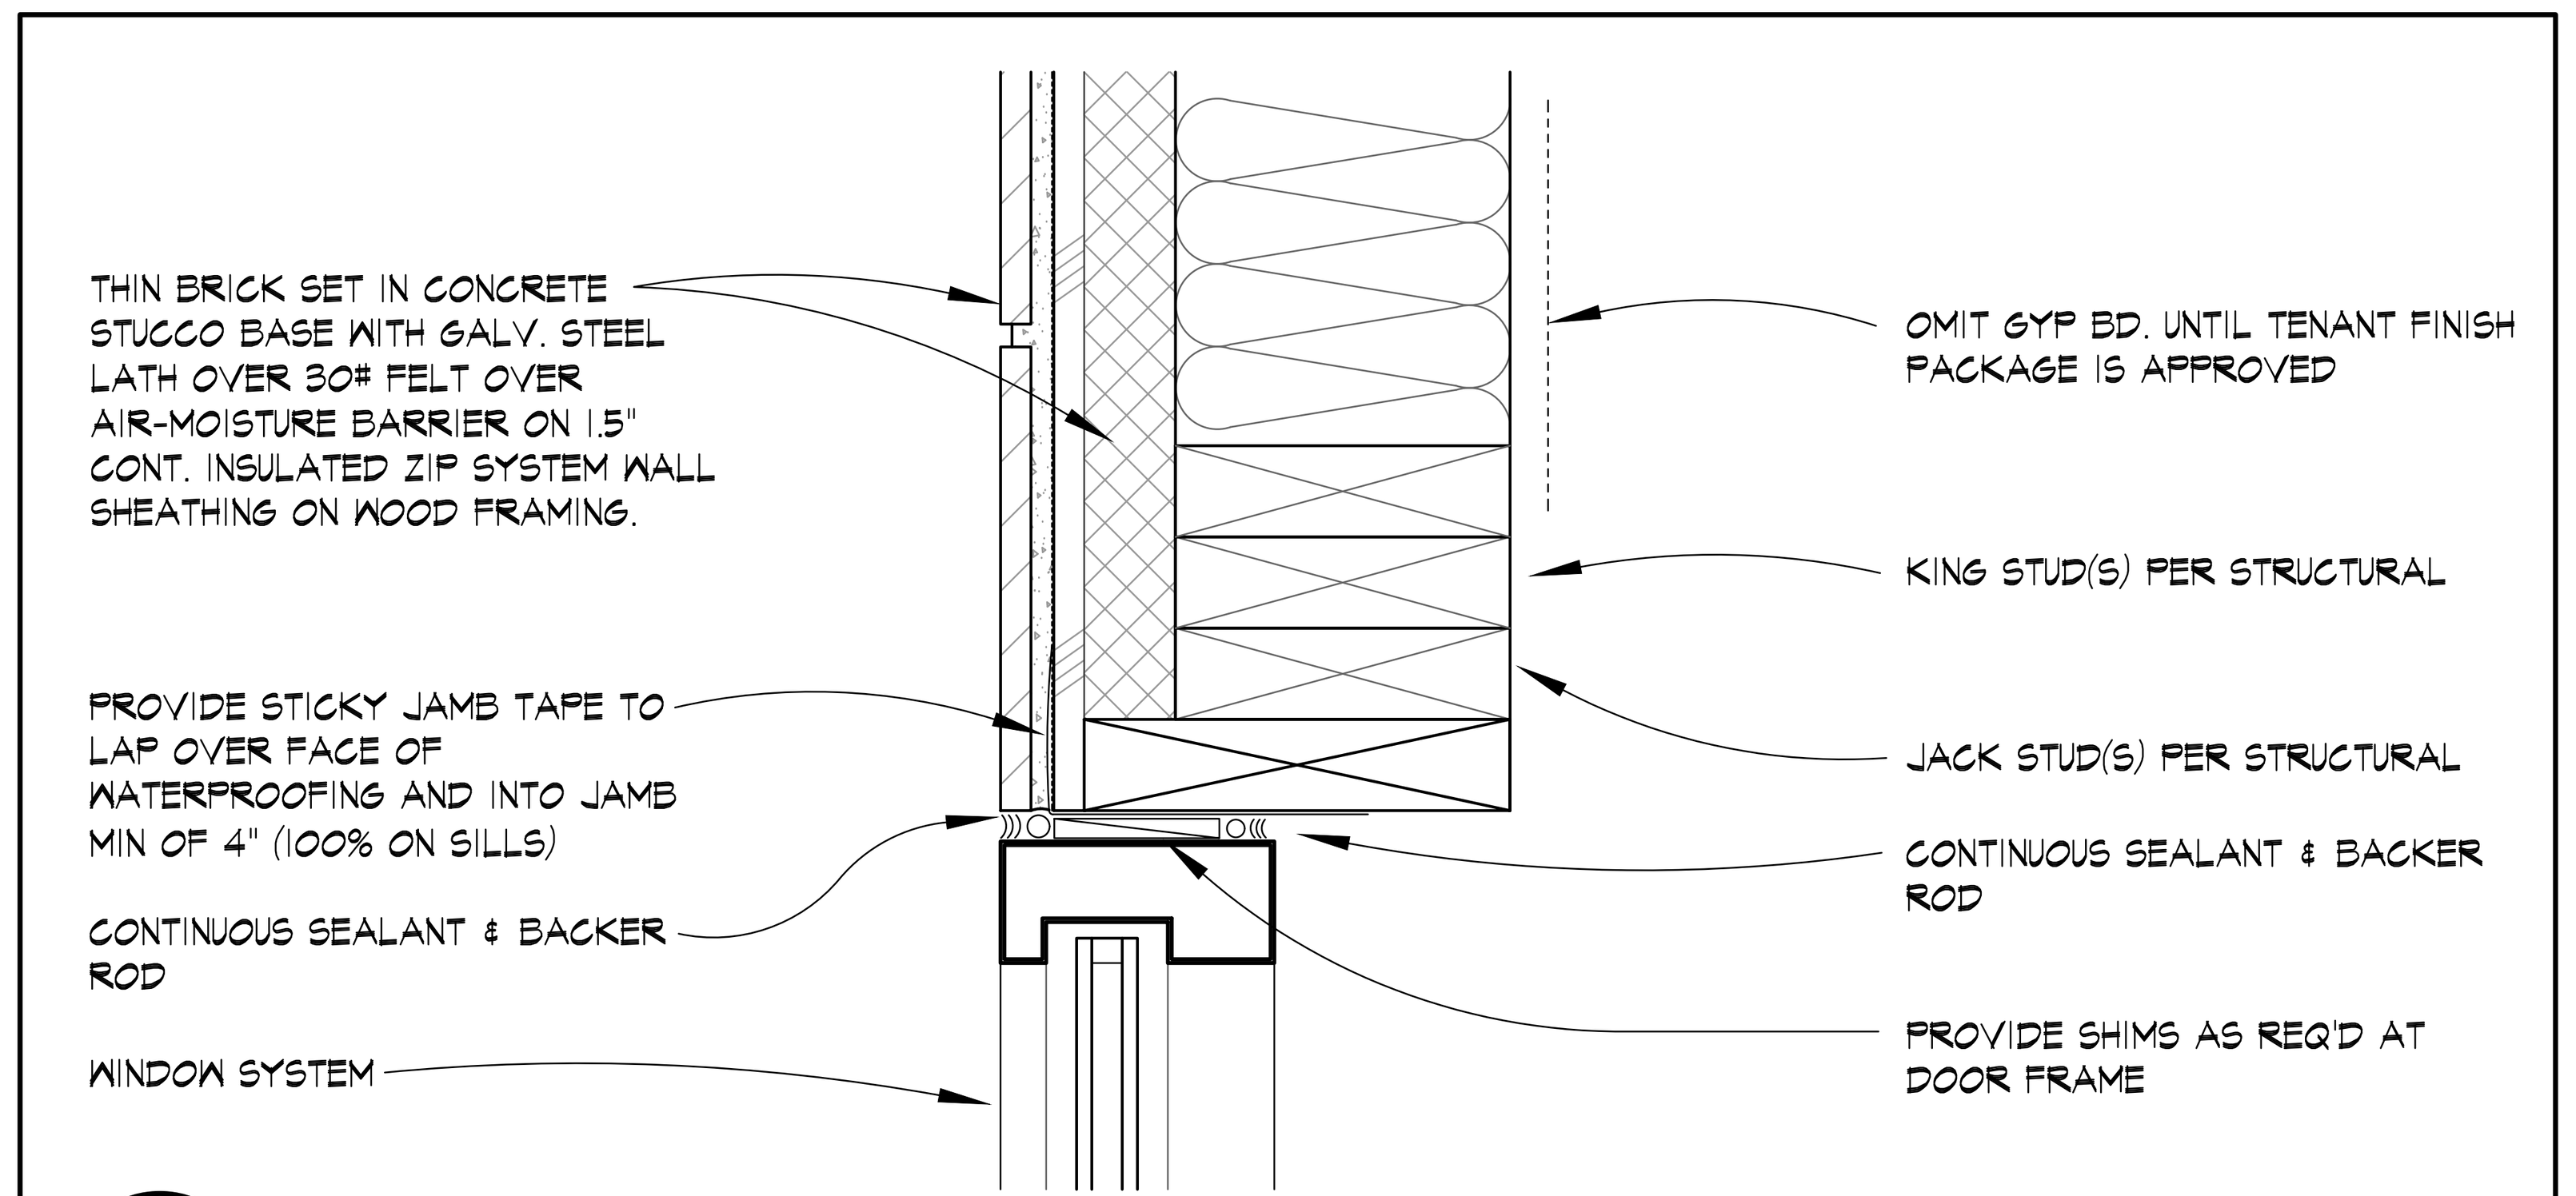

A / A2.1 DETAIL @ ENTRY

SCALE // 3" = 1'-0"

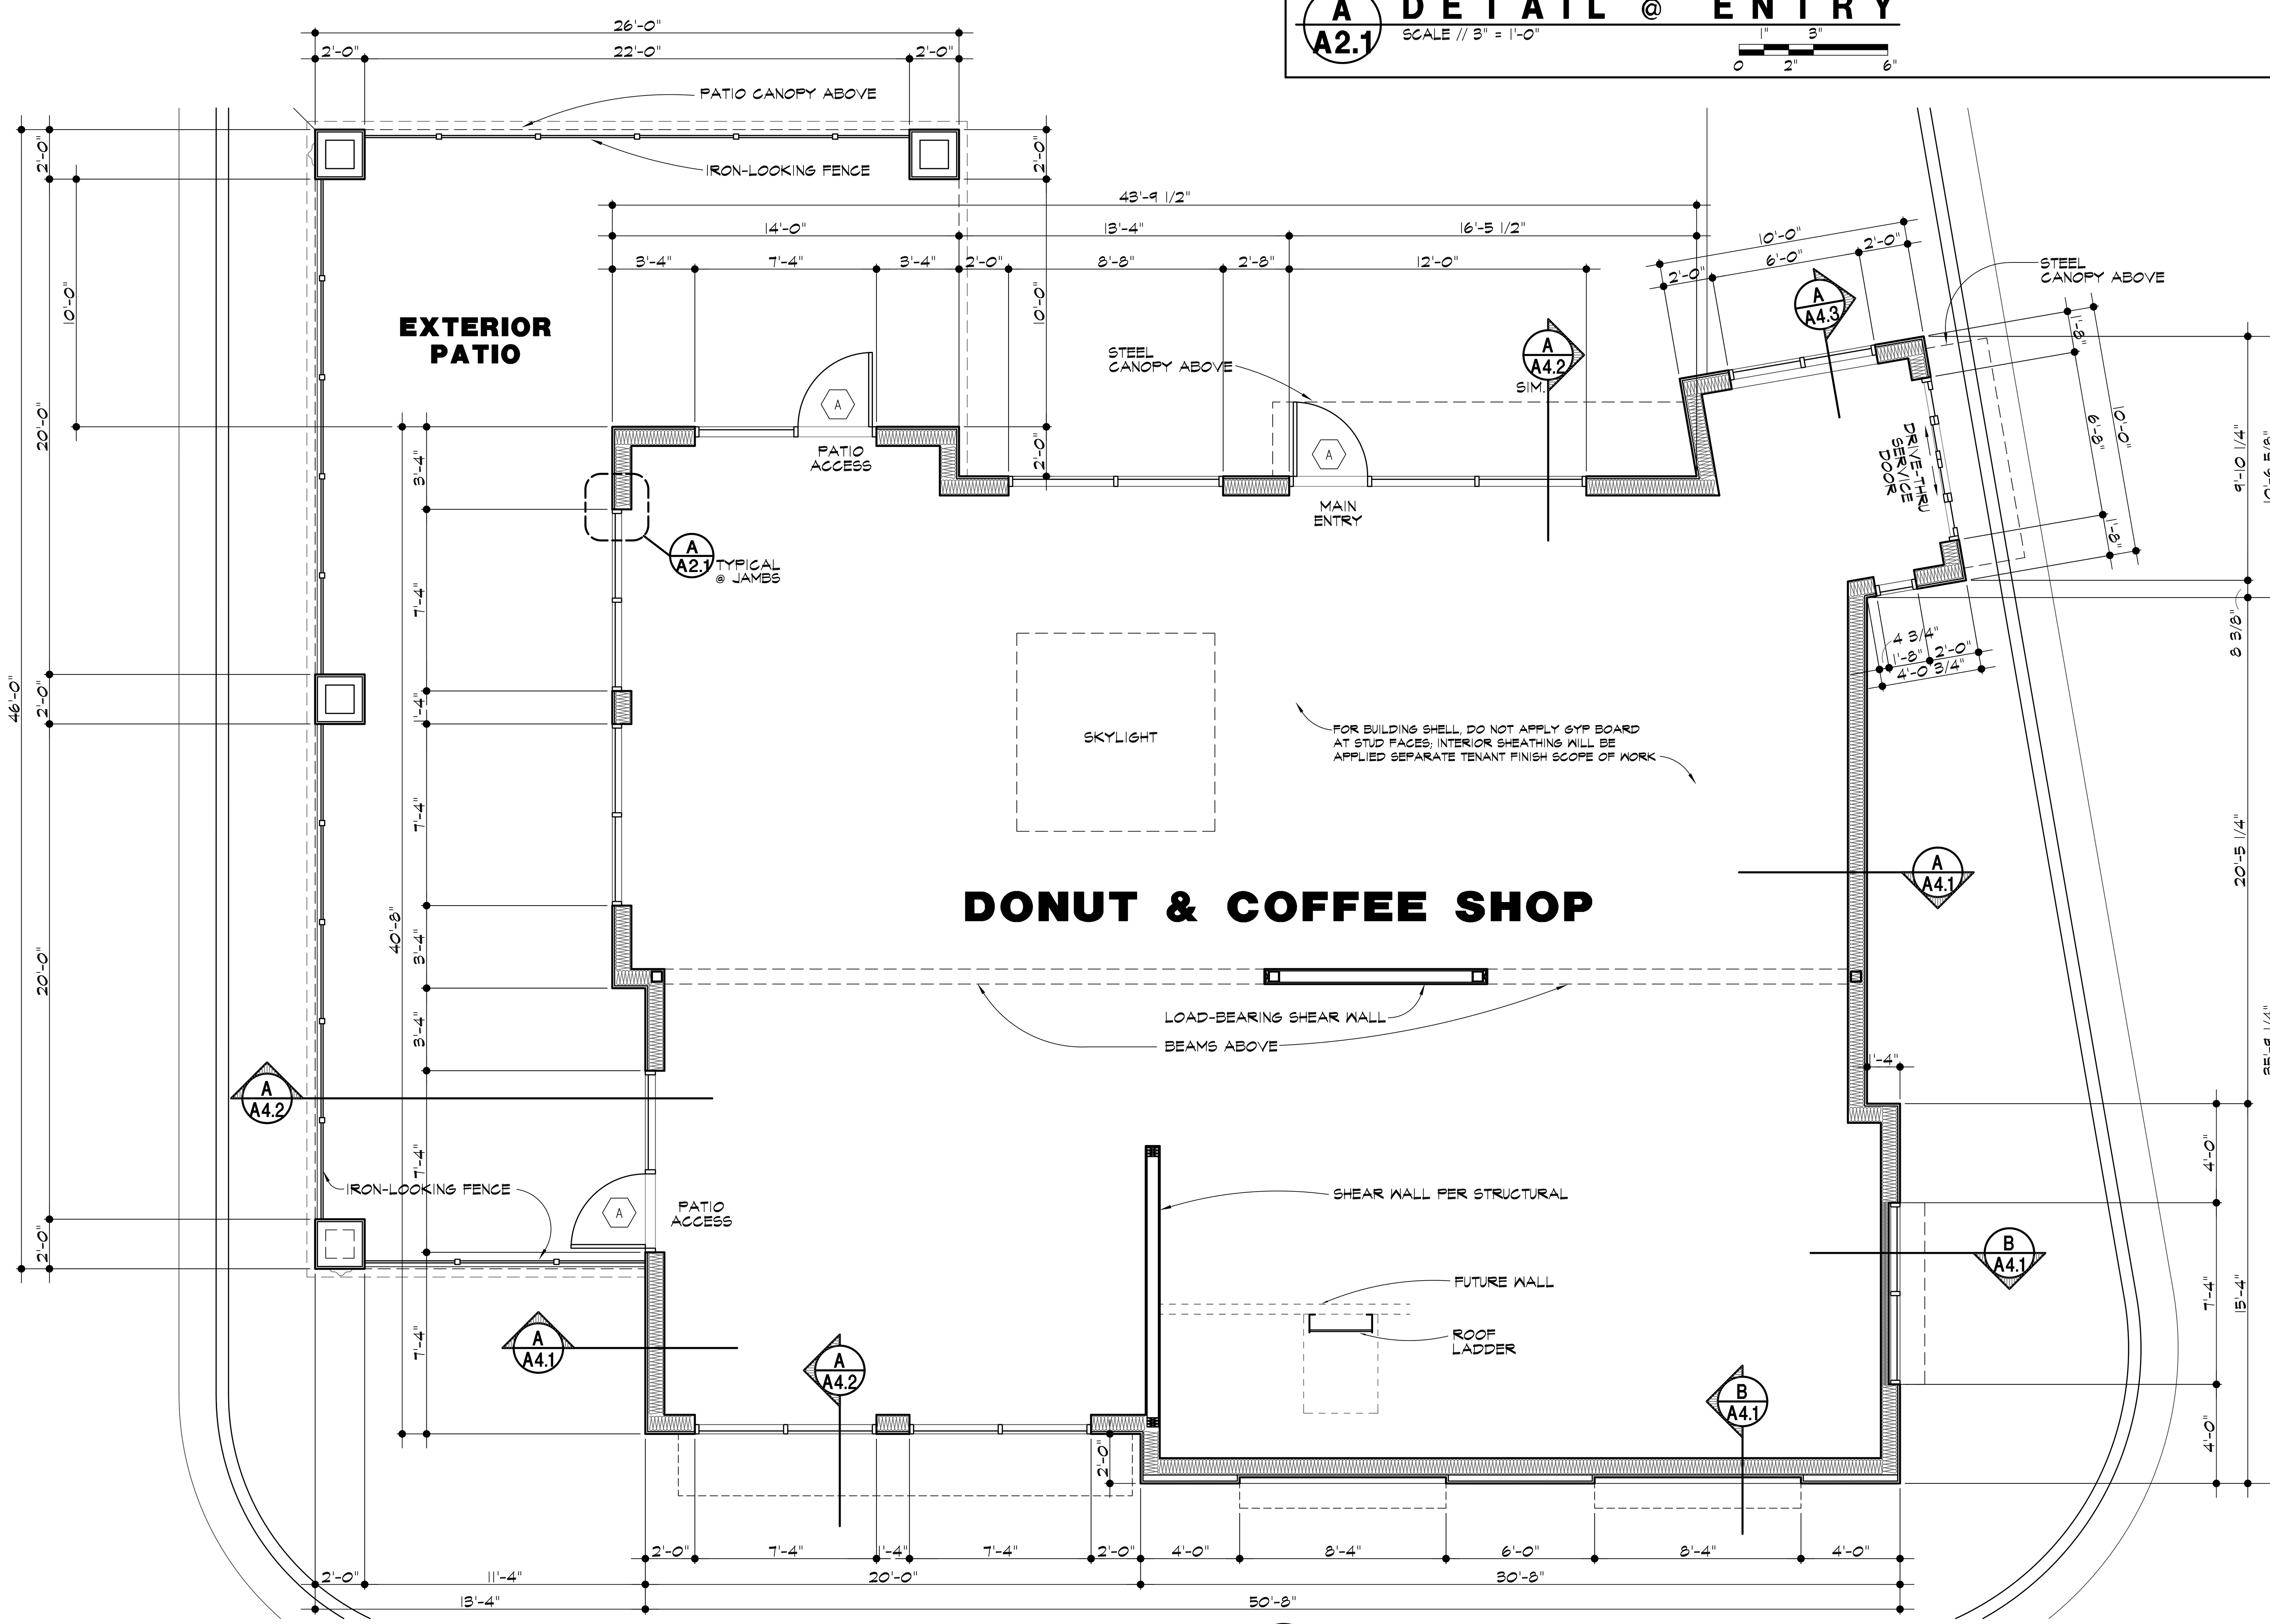

FLOOR PLAN

SCALE // 1/4" = 1'-0"
AREA: 2,102 sq.ft.

DAVID A. KASTER LICENSED 3649 KANSAS PROFESSIONAL ARCHITECT
NOV. 24, 2025

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC

ARCHITECTURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center

Mr. D's DONUTS

14485 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 24, 2025
REVISED
SHEET NUMBER
A2.1
OF SHEETS
KAI JOB NO. 2506-C

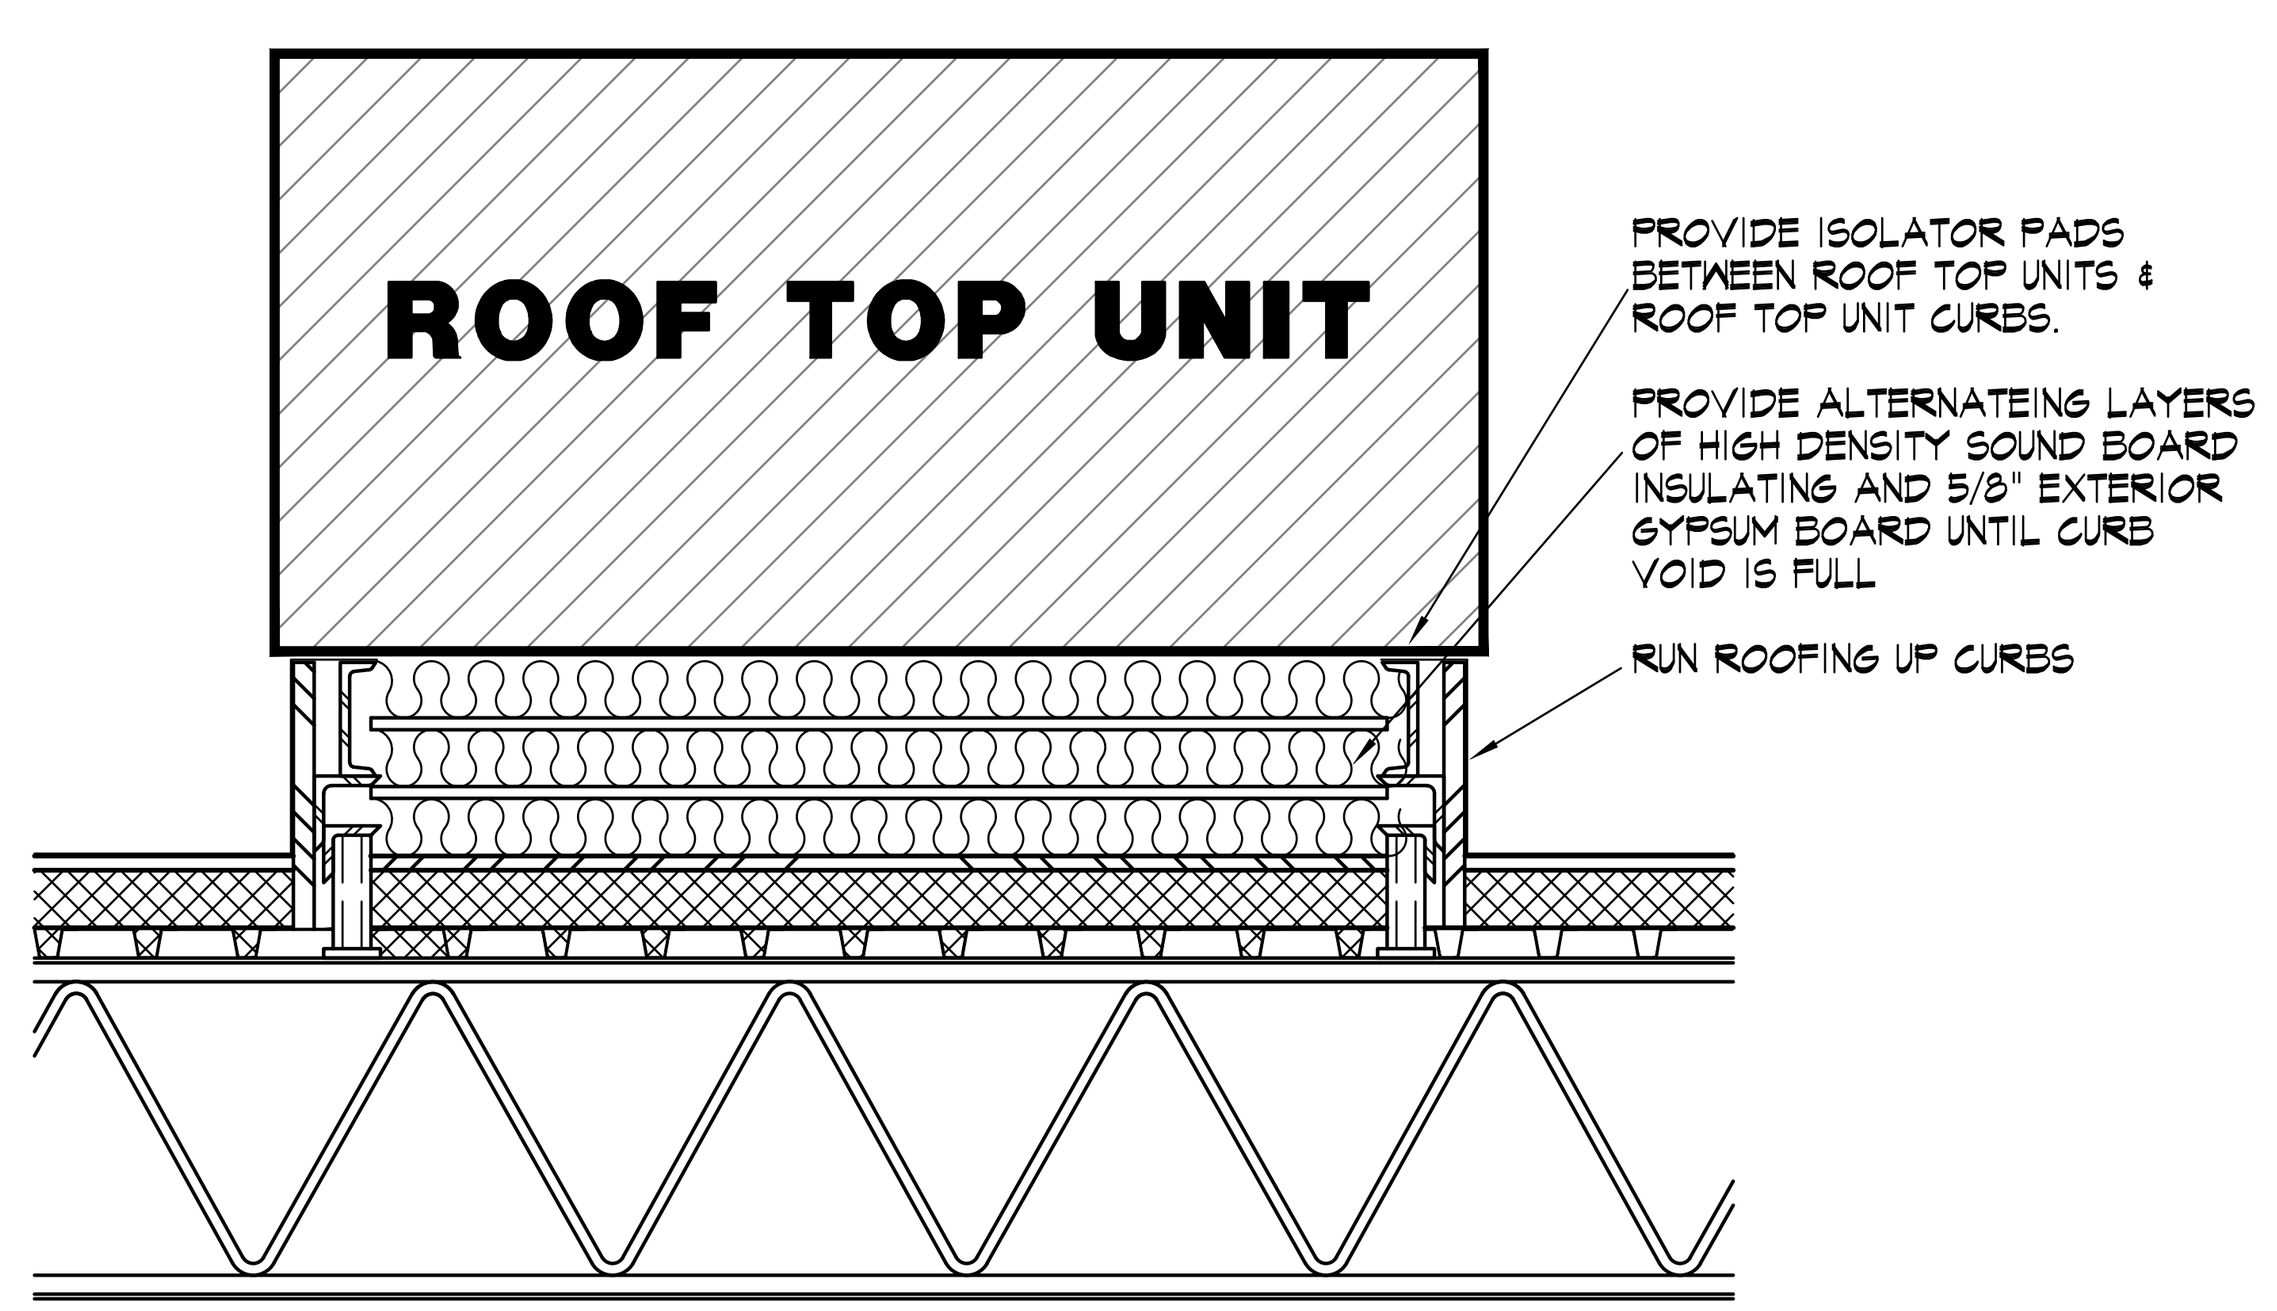

ROOF TOP EQUIPMEMT SOUND INSULATION DETAIL

SCALE // NOT TO SCALE

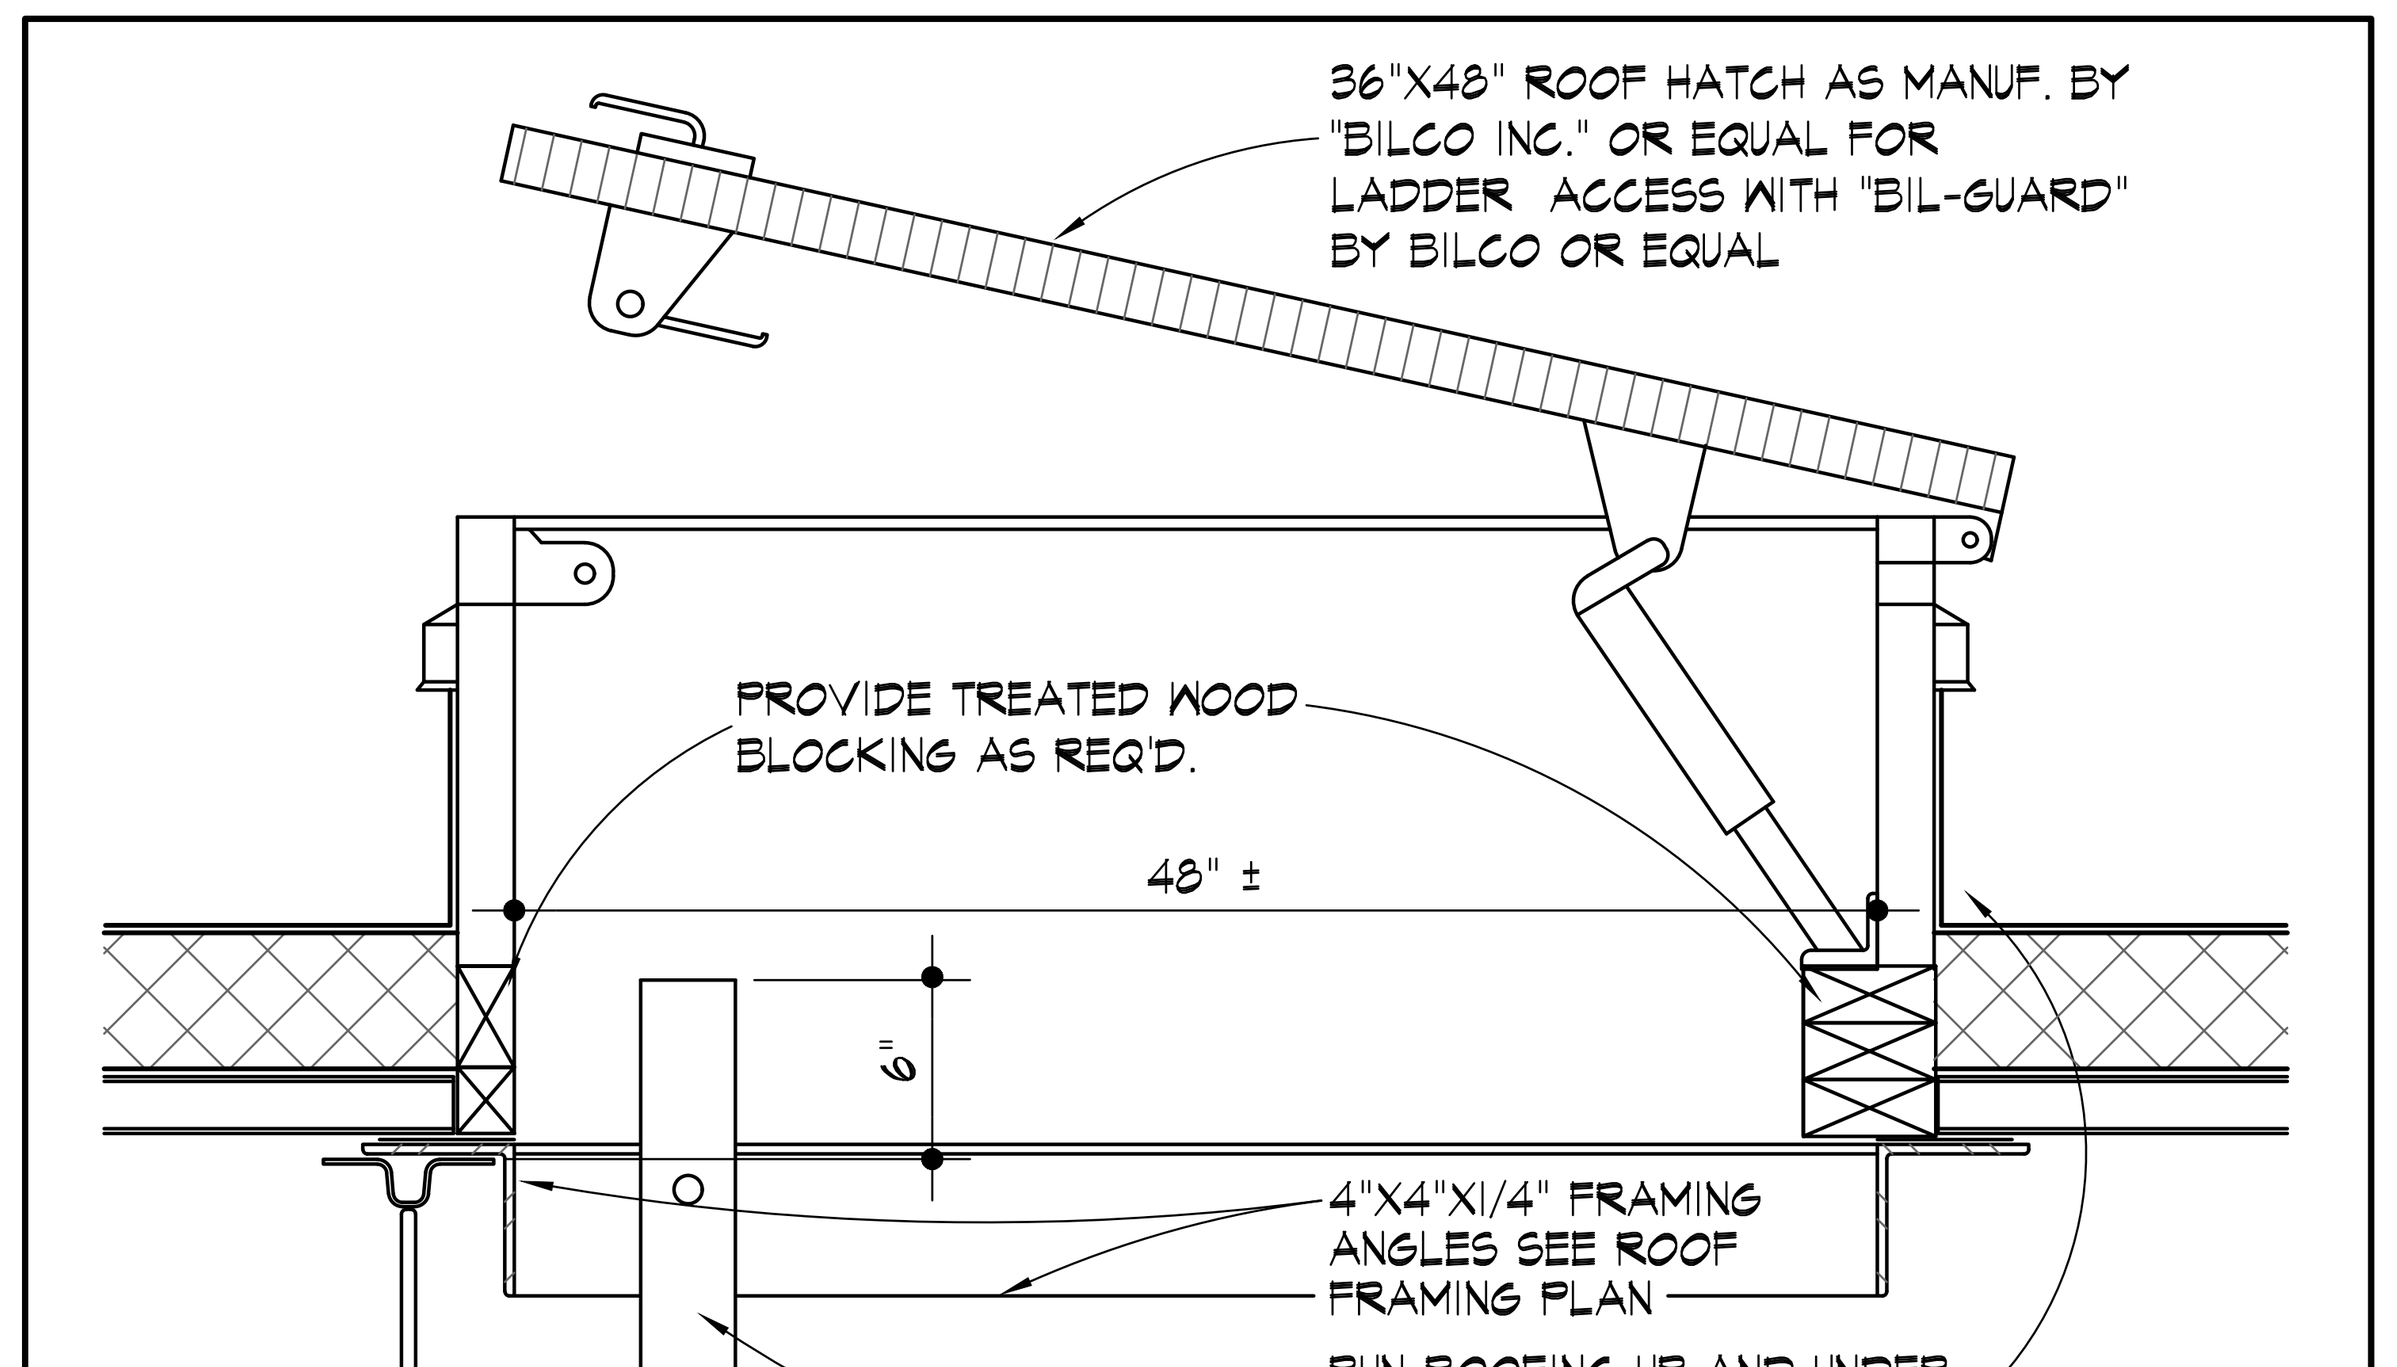

ROOF HATCH DETAIL

SCALE // NOT TO SCALE

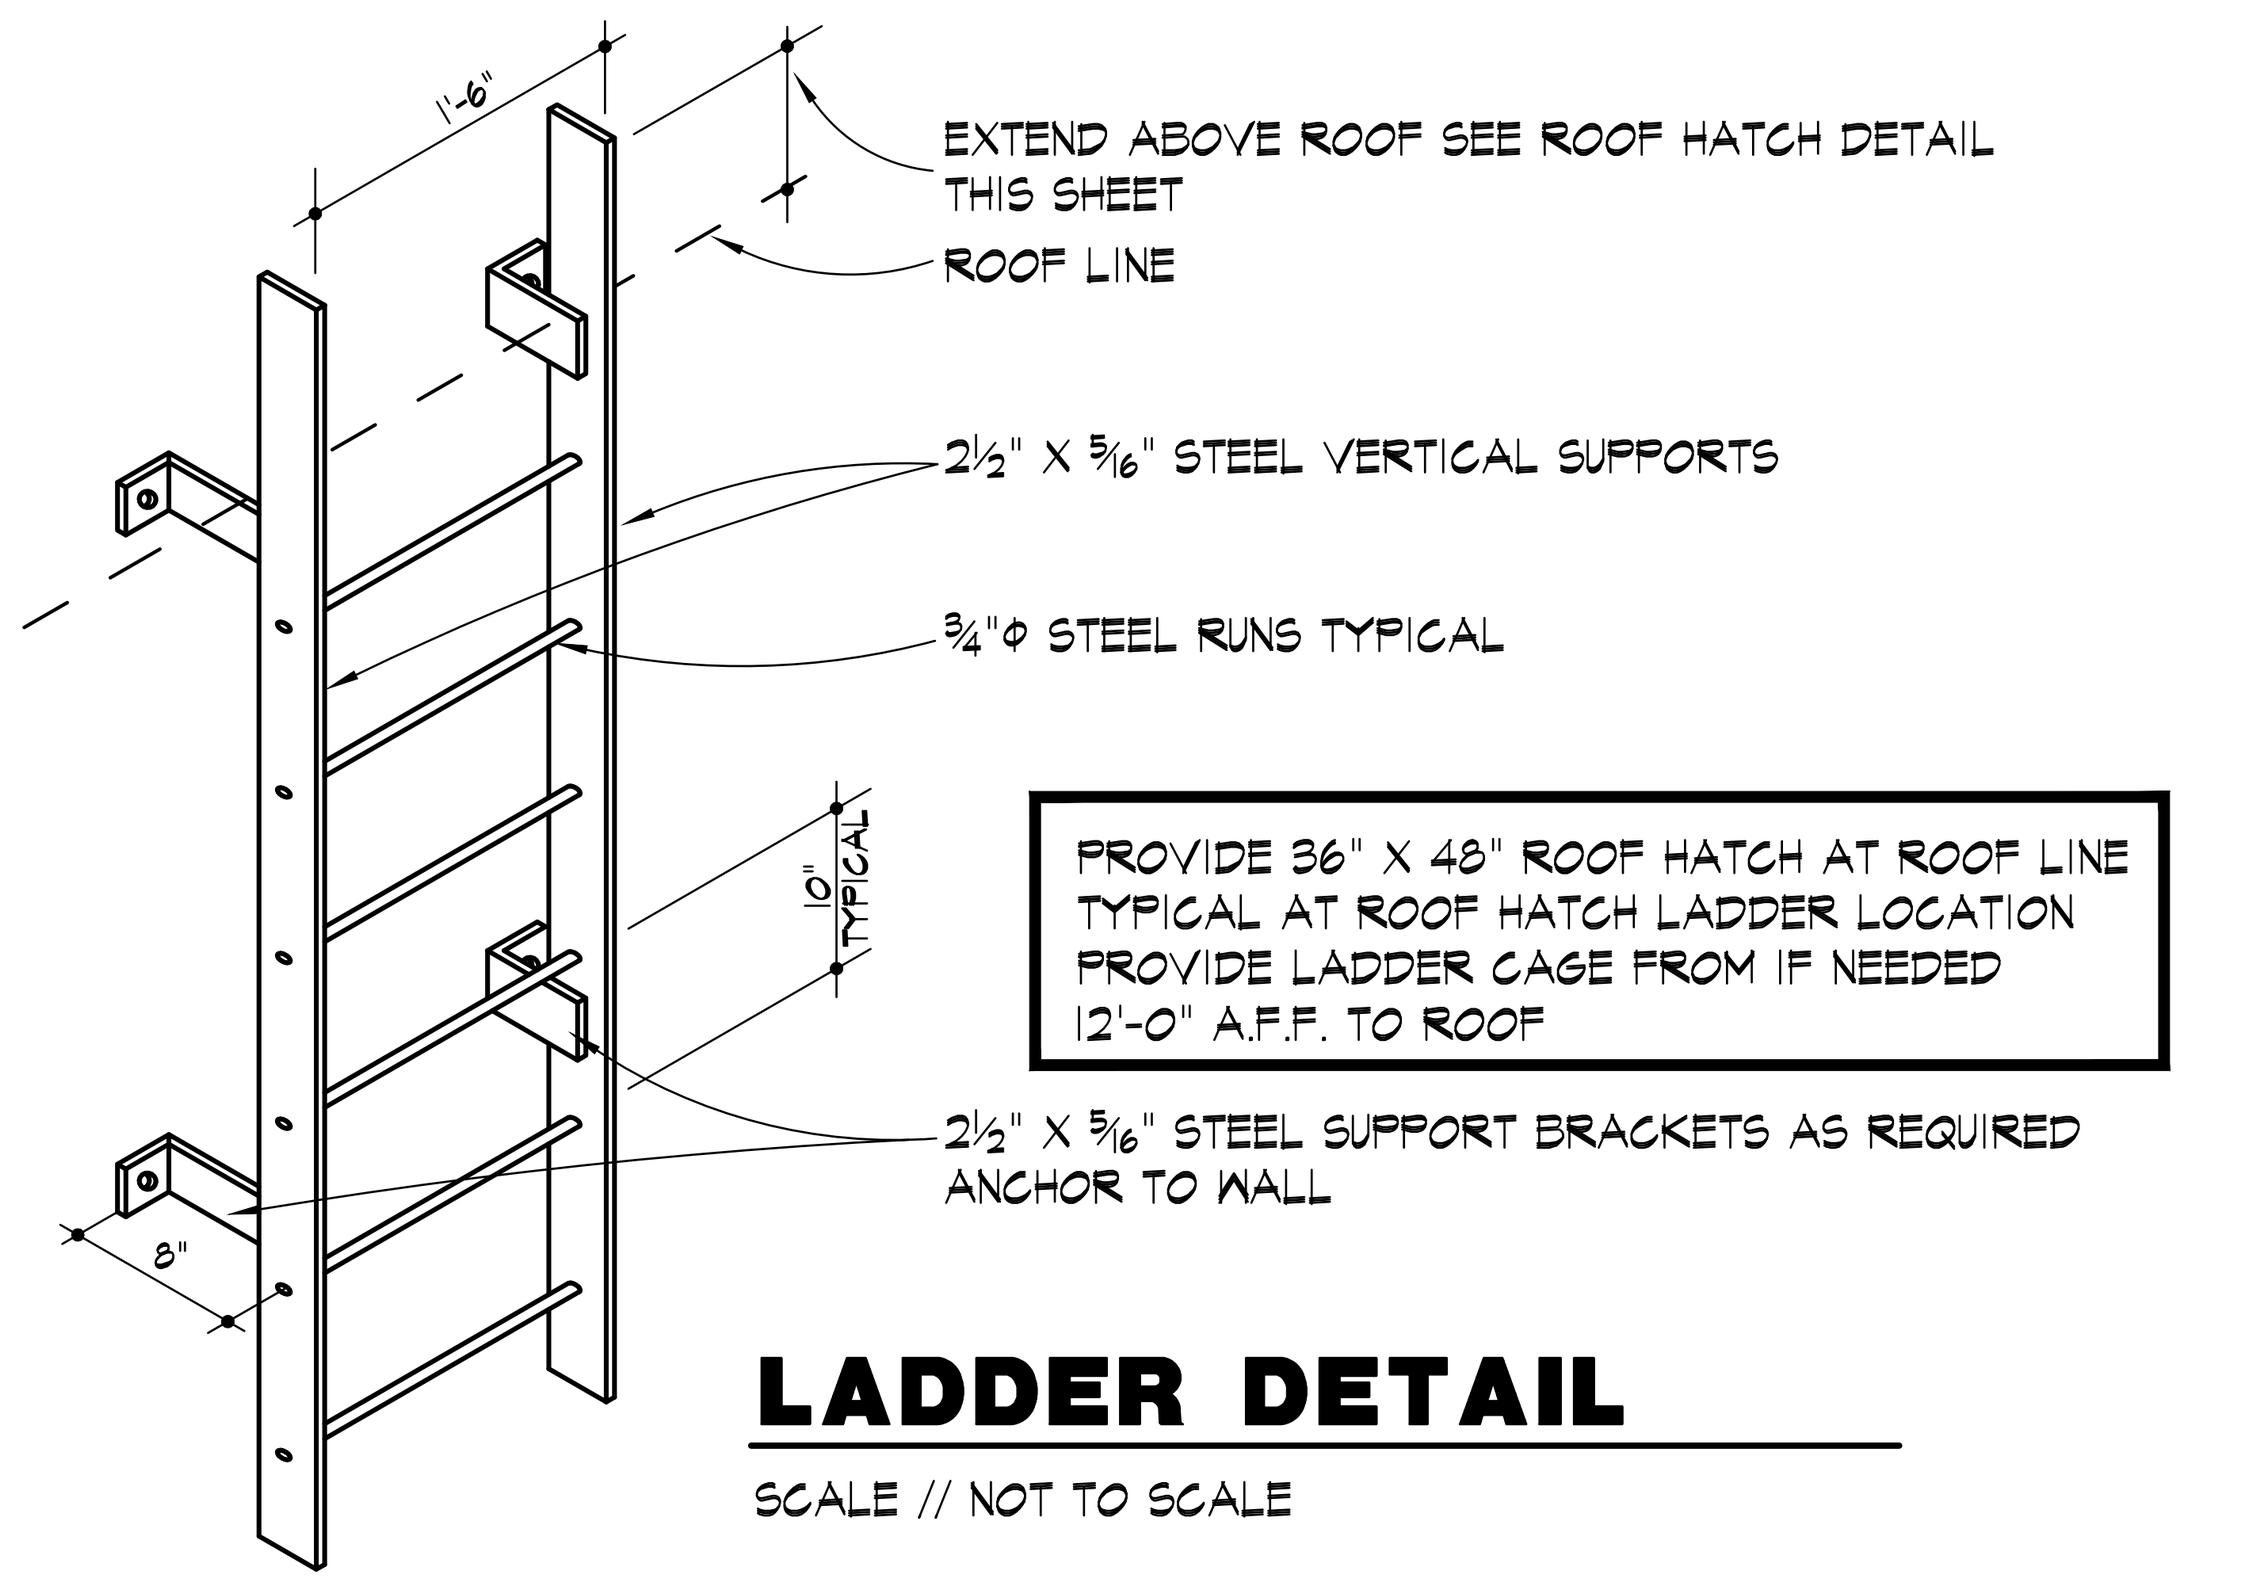

PROVIDE 36" X 48" ROOF HATCH AT ROOF LINE TYPICAL AT ROOF HATCH LADDER LOCATION PROVIDE LADDER CAGE FROM IF NEEDED 12'-0" A.F.F. TO ROOF

LADDER DETAIL

SCALE // NOT TO SCALE

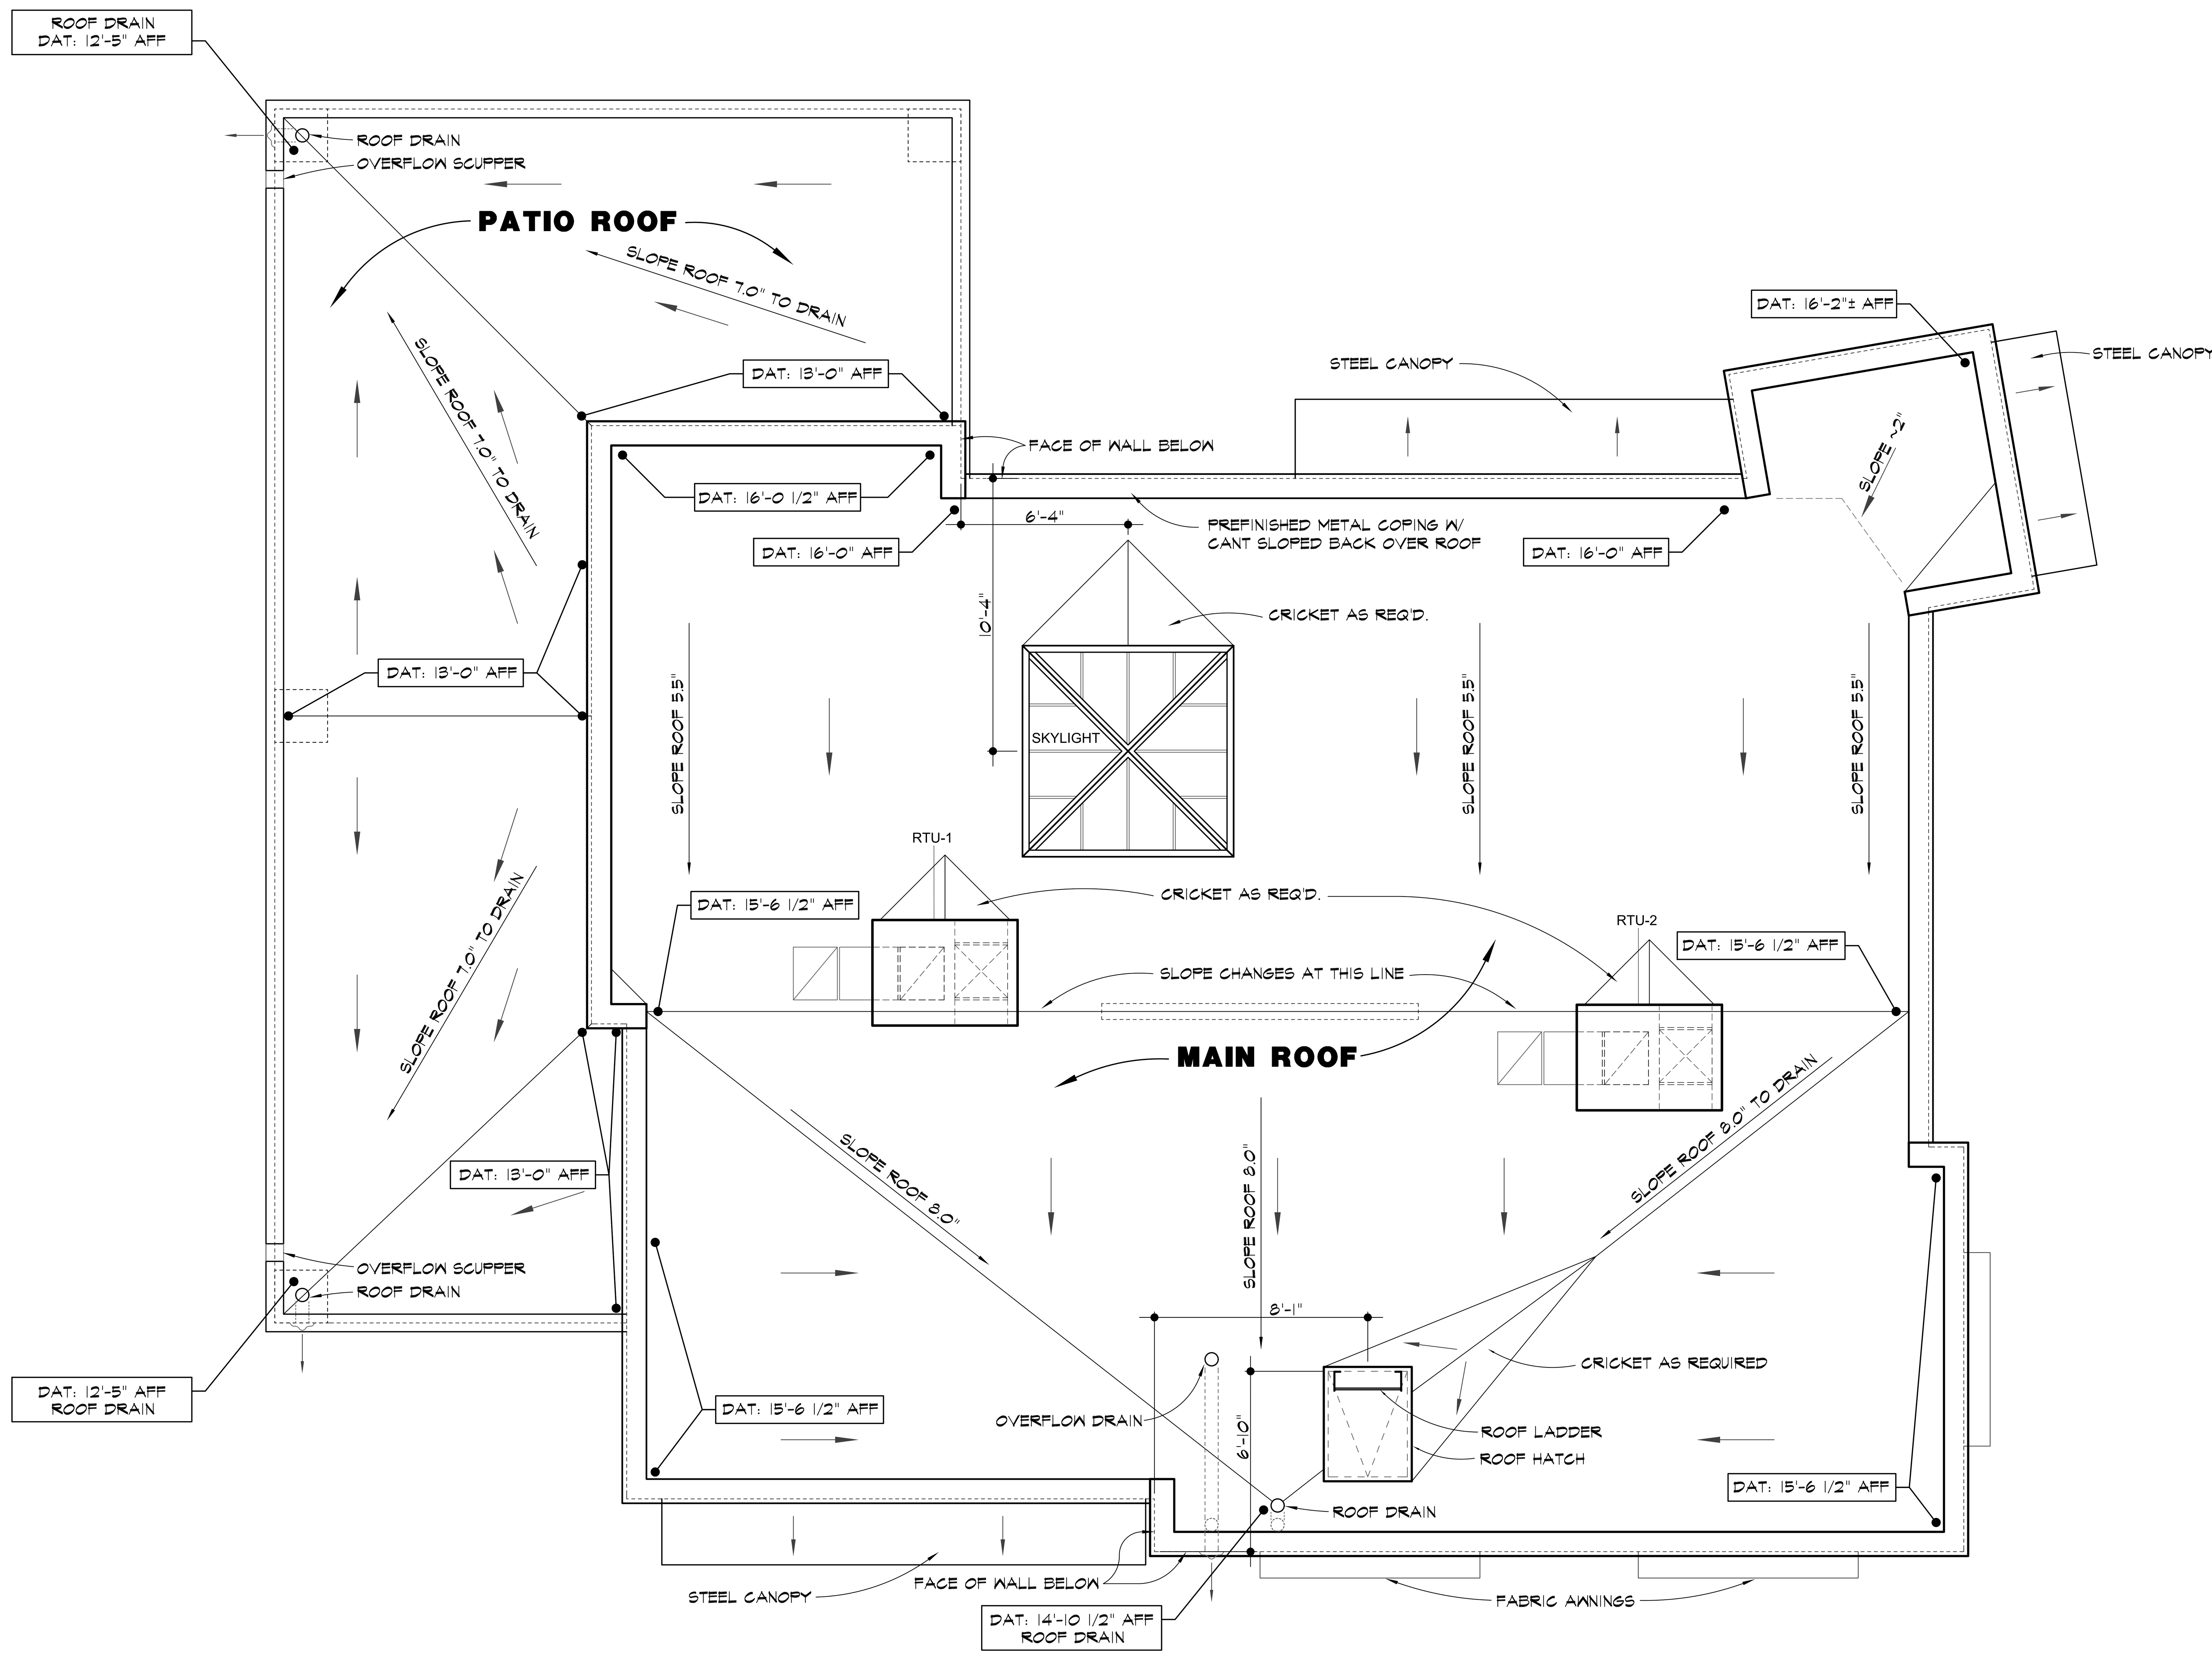

NOTE:
- ROOF STRUCTURE IS SLOPED TO DRAIN, BUT IN PLACES TAPER TILE MAY BE REQUIRED TO PROVIDE APPROPRIATE DRAINAGE OF 1/4" PER FOOT TO ROOF DRAINS.
- ALL PENETRATIONS THROUGH ROOF ARE TO BE FULLY SEALED
- ROOFING SYSTEM IS 60 MIL WHITE, FULLY ADHERED PVC ROOFING MEMBRANE OVER COVERBOARD OVER MIN. R-34 POLYISOCYANURATE BOARD INSULATION MECHANICALLY FASTENED OVER DECKING AND JOISTS PER STRUCTURAL

N

ROOF PLAN

SCALE // 1/4" = 1'-0"

1 5
0 2 10

DAVID A. KASTER LICENSED 3649 KANSAS PROFESSIONAL ARCHITECT
NOV. 24, 2025

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC

ARCHITECTURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center

Mr. D's DONUTS

14485 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 24, 2025
REVISED
SHEET NUMBER
A2.2
OF SHEETS
KAI JOB NO. 2506-C

MATERIAL PALATE:

MAIN BRICK:
LIGHT TAN; THIN BRICK TO MATCH THAI BUILDING

ACCENT BRICK:
DARK IRONSPOT BRICK; VELOUR MODULAR TO MATCH THAI BUILDING

MAIN E.I.F.S. STUCCO:
SMOOTH STUCCO FINISH IN LIGHT TAN COLOR DRYVIT #108 MANOR WHITE TO MATCH THAI BUILDING

ACCENT E.I.F.S. STUCCO:
SMOOTH STUCCO FINISH IN MEDIUM TAN COLOR DRYVIT #388 HONEY TWIST TO MATCH THAI BUILDING

WINDOW SYSTEM:
BLACK ANNODIZED STOREFRONT w/THERMAL BREAK GLASS; 1" INSUL. CLEAR LOW-E, SHGC 0.36 TO MATCH THAI BUILDING

NORTH ELEVATION

SCALE // 1/4" = 1'-0"

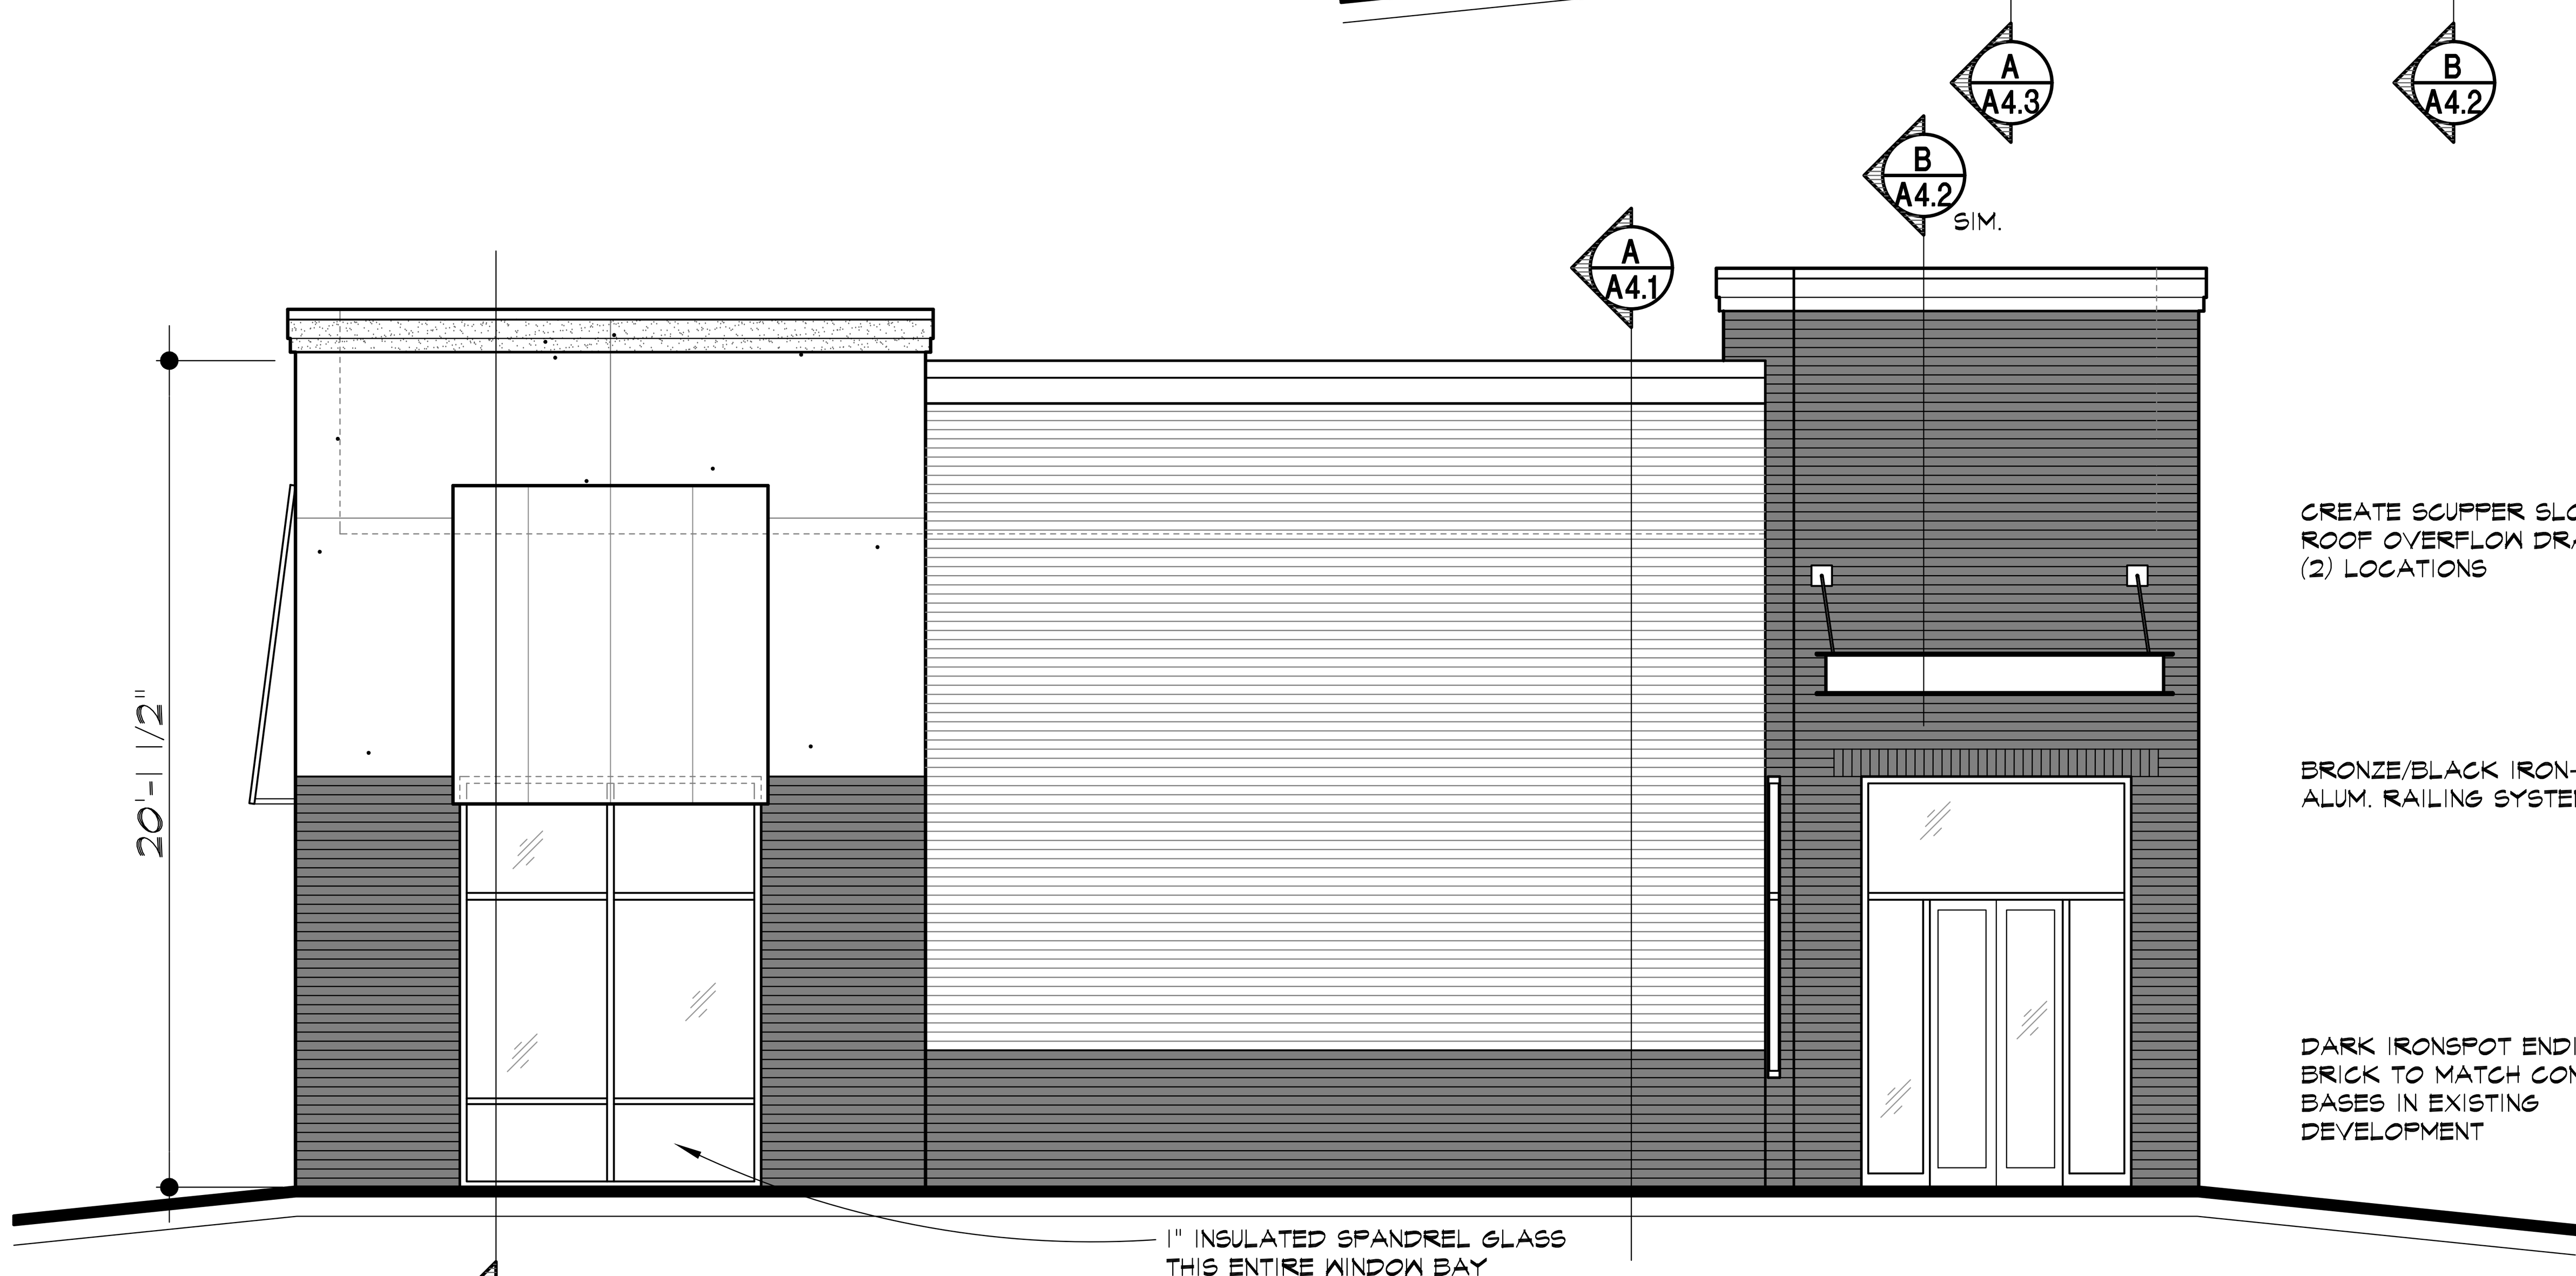

EAST ELEVATION

SCALE // 1/4" = 1'-0"

WEST ELEVATION

SCALE // 1/4" = 1'-0"

SOUTH ELEVATION

SCALE // 1/4" = 1'-0"

DAVID A. KASTER LICENSED 3649 KANSAS PROFESSIONAL ARCHITECT
NOV. 24, 2025

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC
ARCHITECTURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center
Mr. D's DONUTS
14485 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 24, 2025
REVISED
SHEET NUMBER
A3.1
OF SHEETS
KAI JOB NO. 2506-C

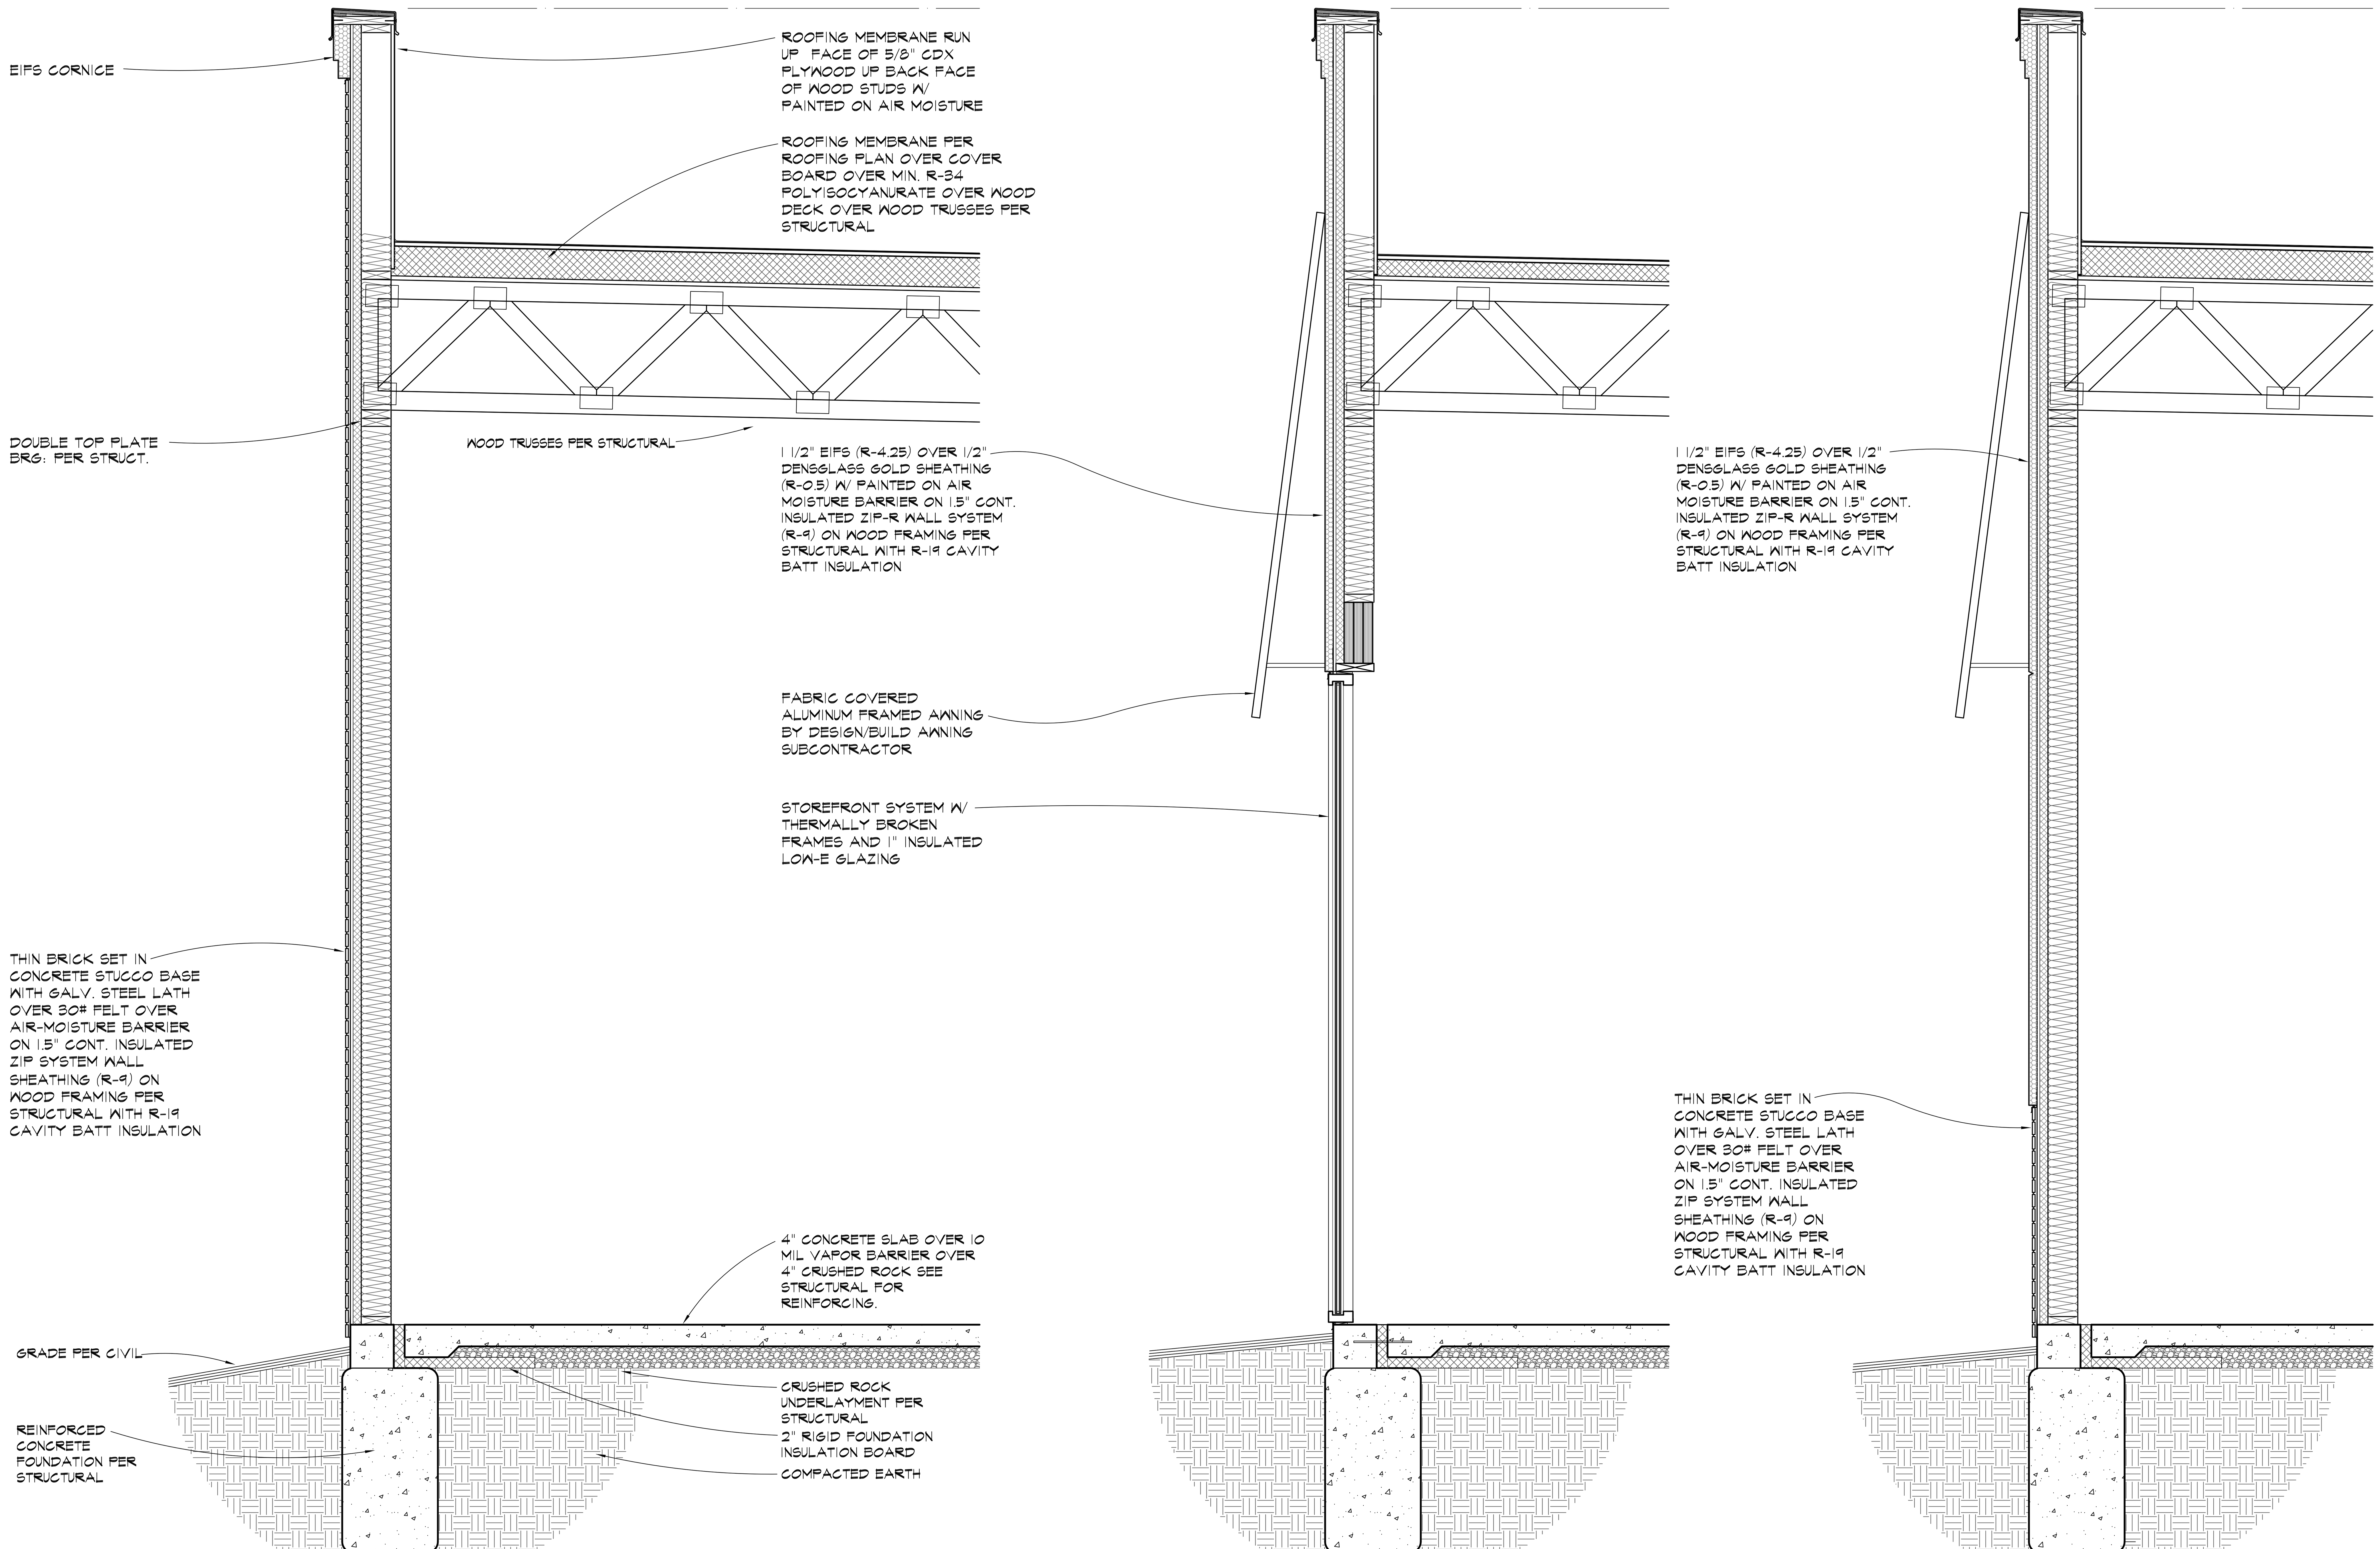

DAVID A. KASTER LICENSED 3649 KANSAS PROFESSIONAL ARCHITECT
NOV. 24, 2025

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC
ARCHITECTURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center
Mr. D's DONUTS
14485 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 24, 2025
REVISED
SHEET NUMBER
A4.1
OF SHEETS
KAI JOB NO. 2506-C

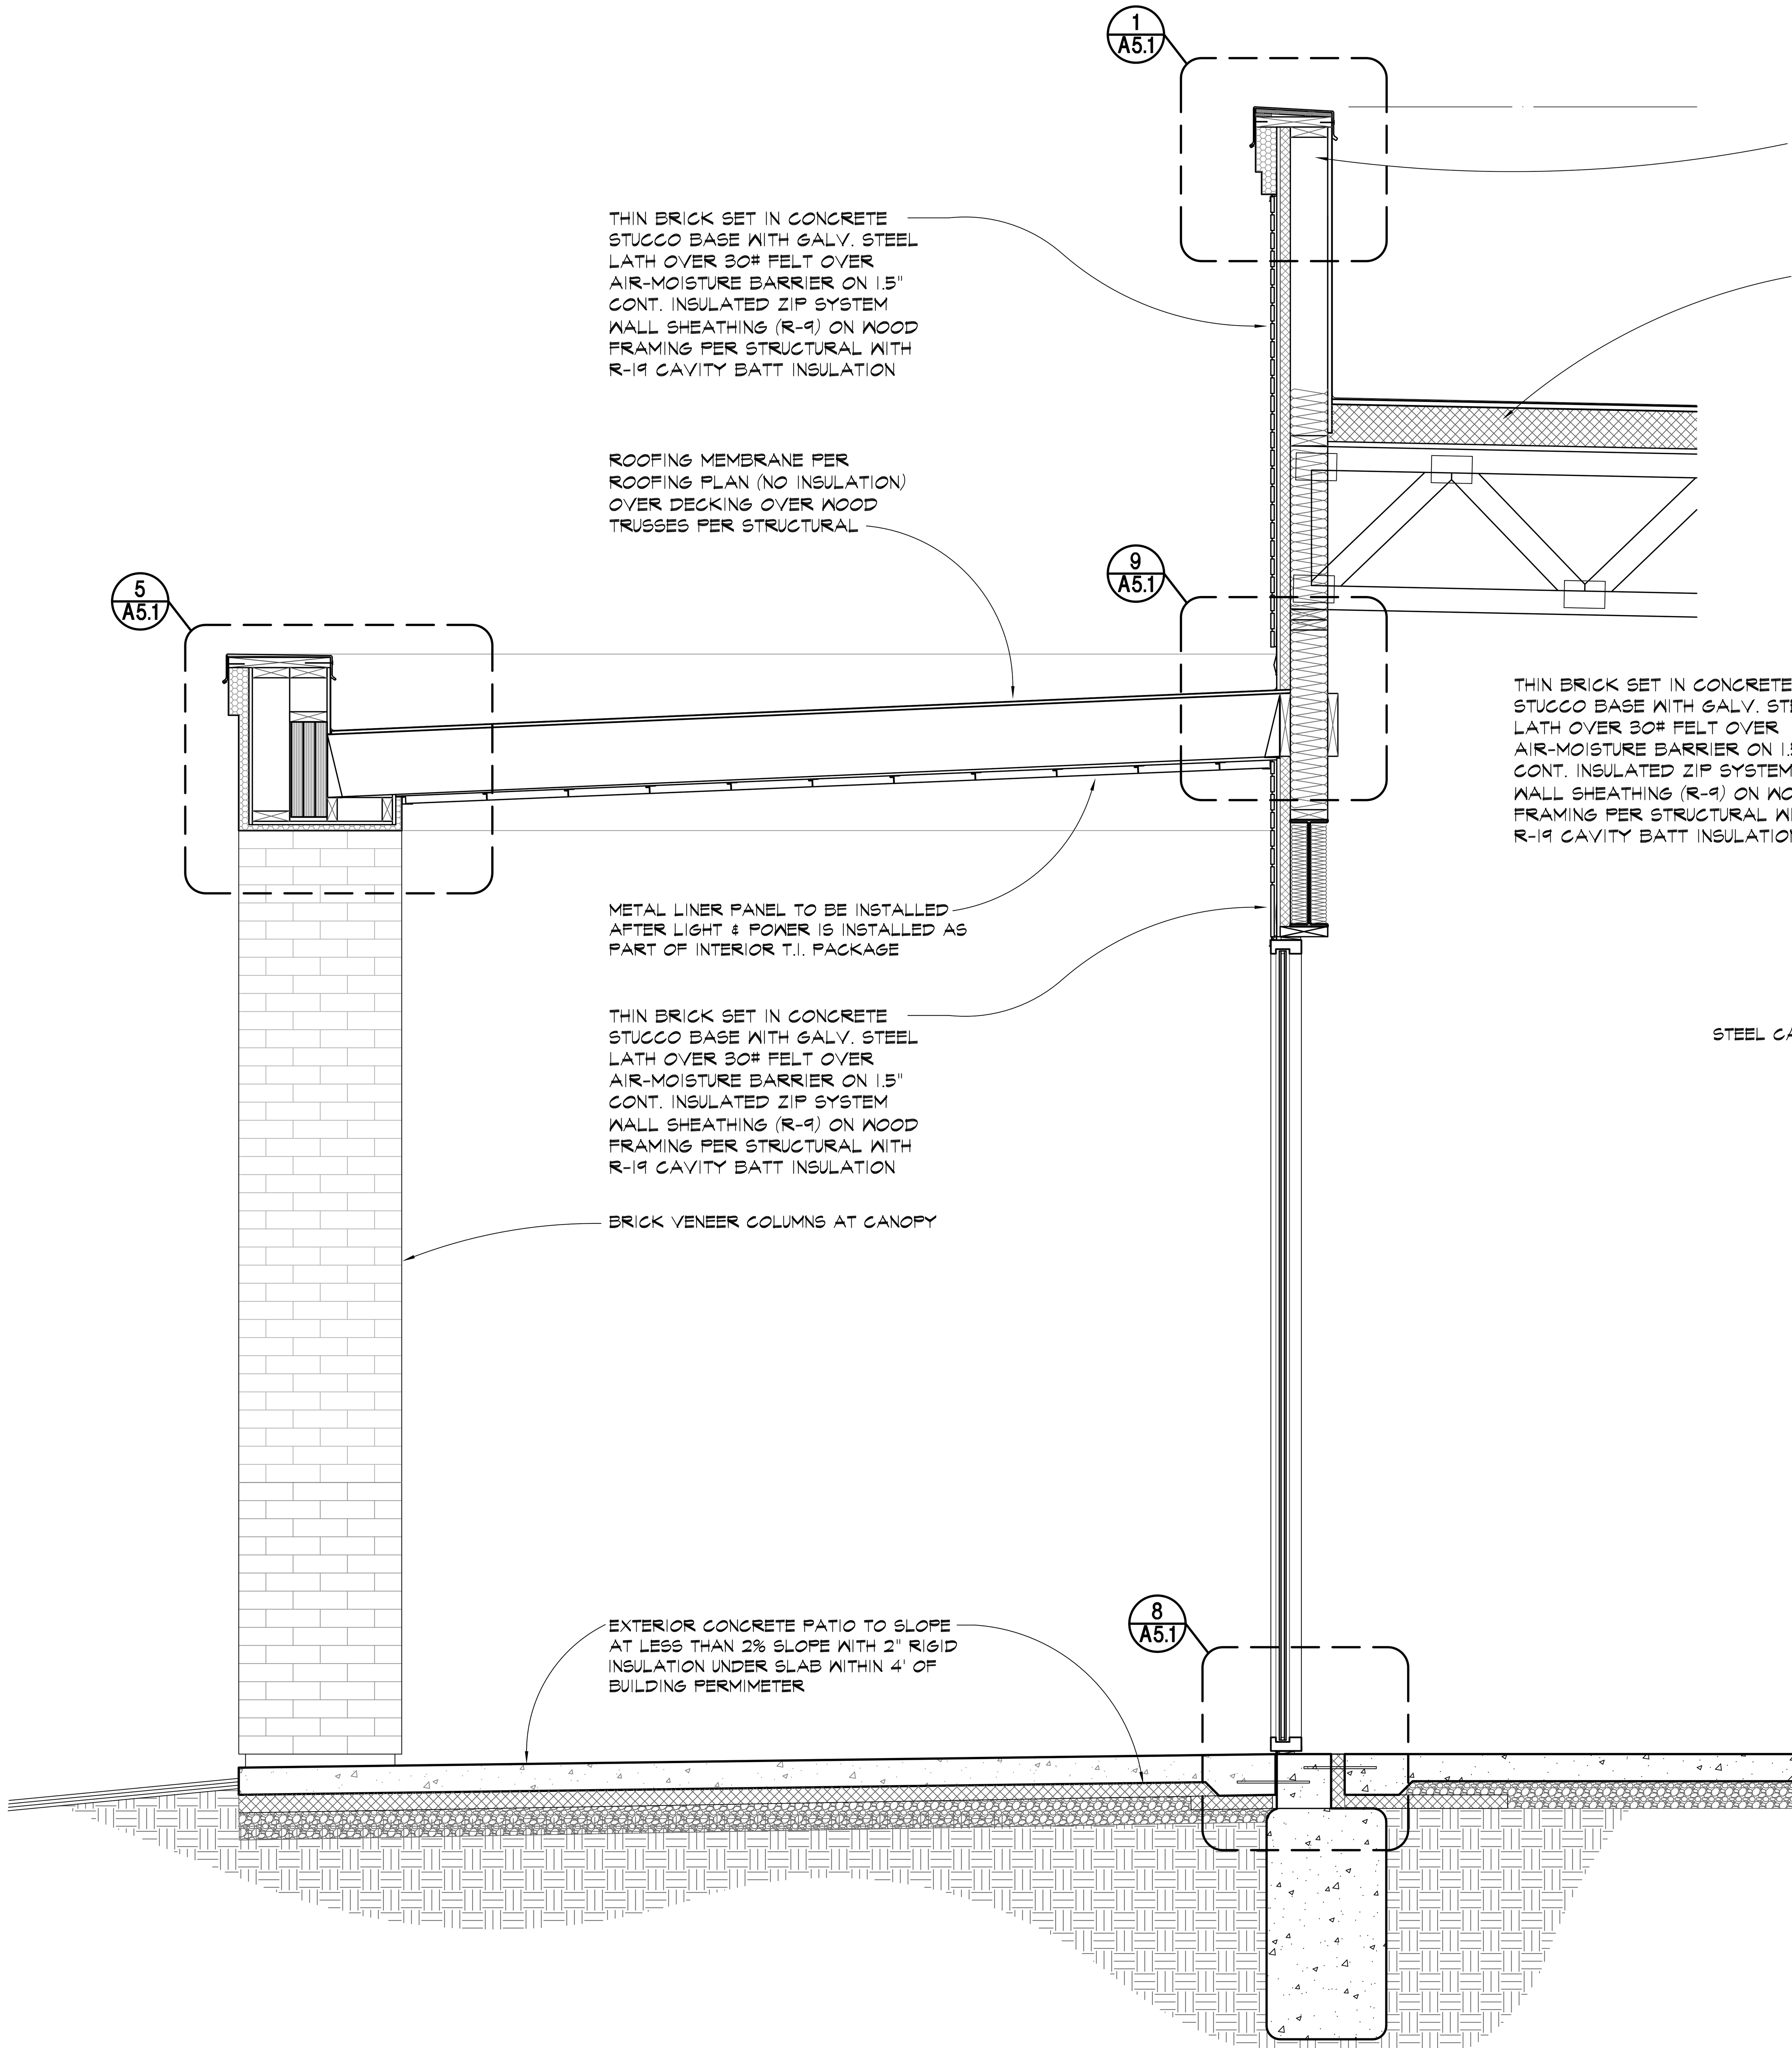

A
A4.2
SECTION@PATIO
SCALE // 3/4" = 1' - 0"

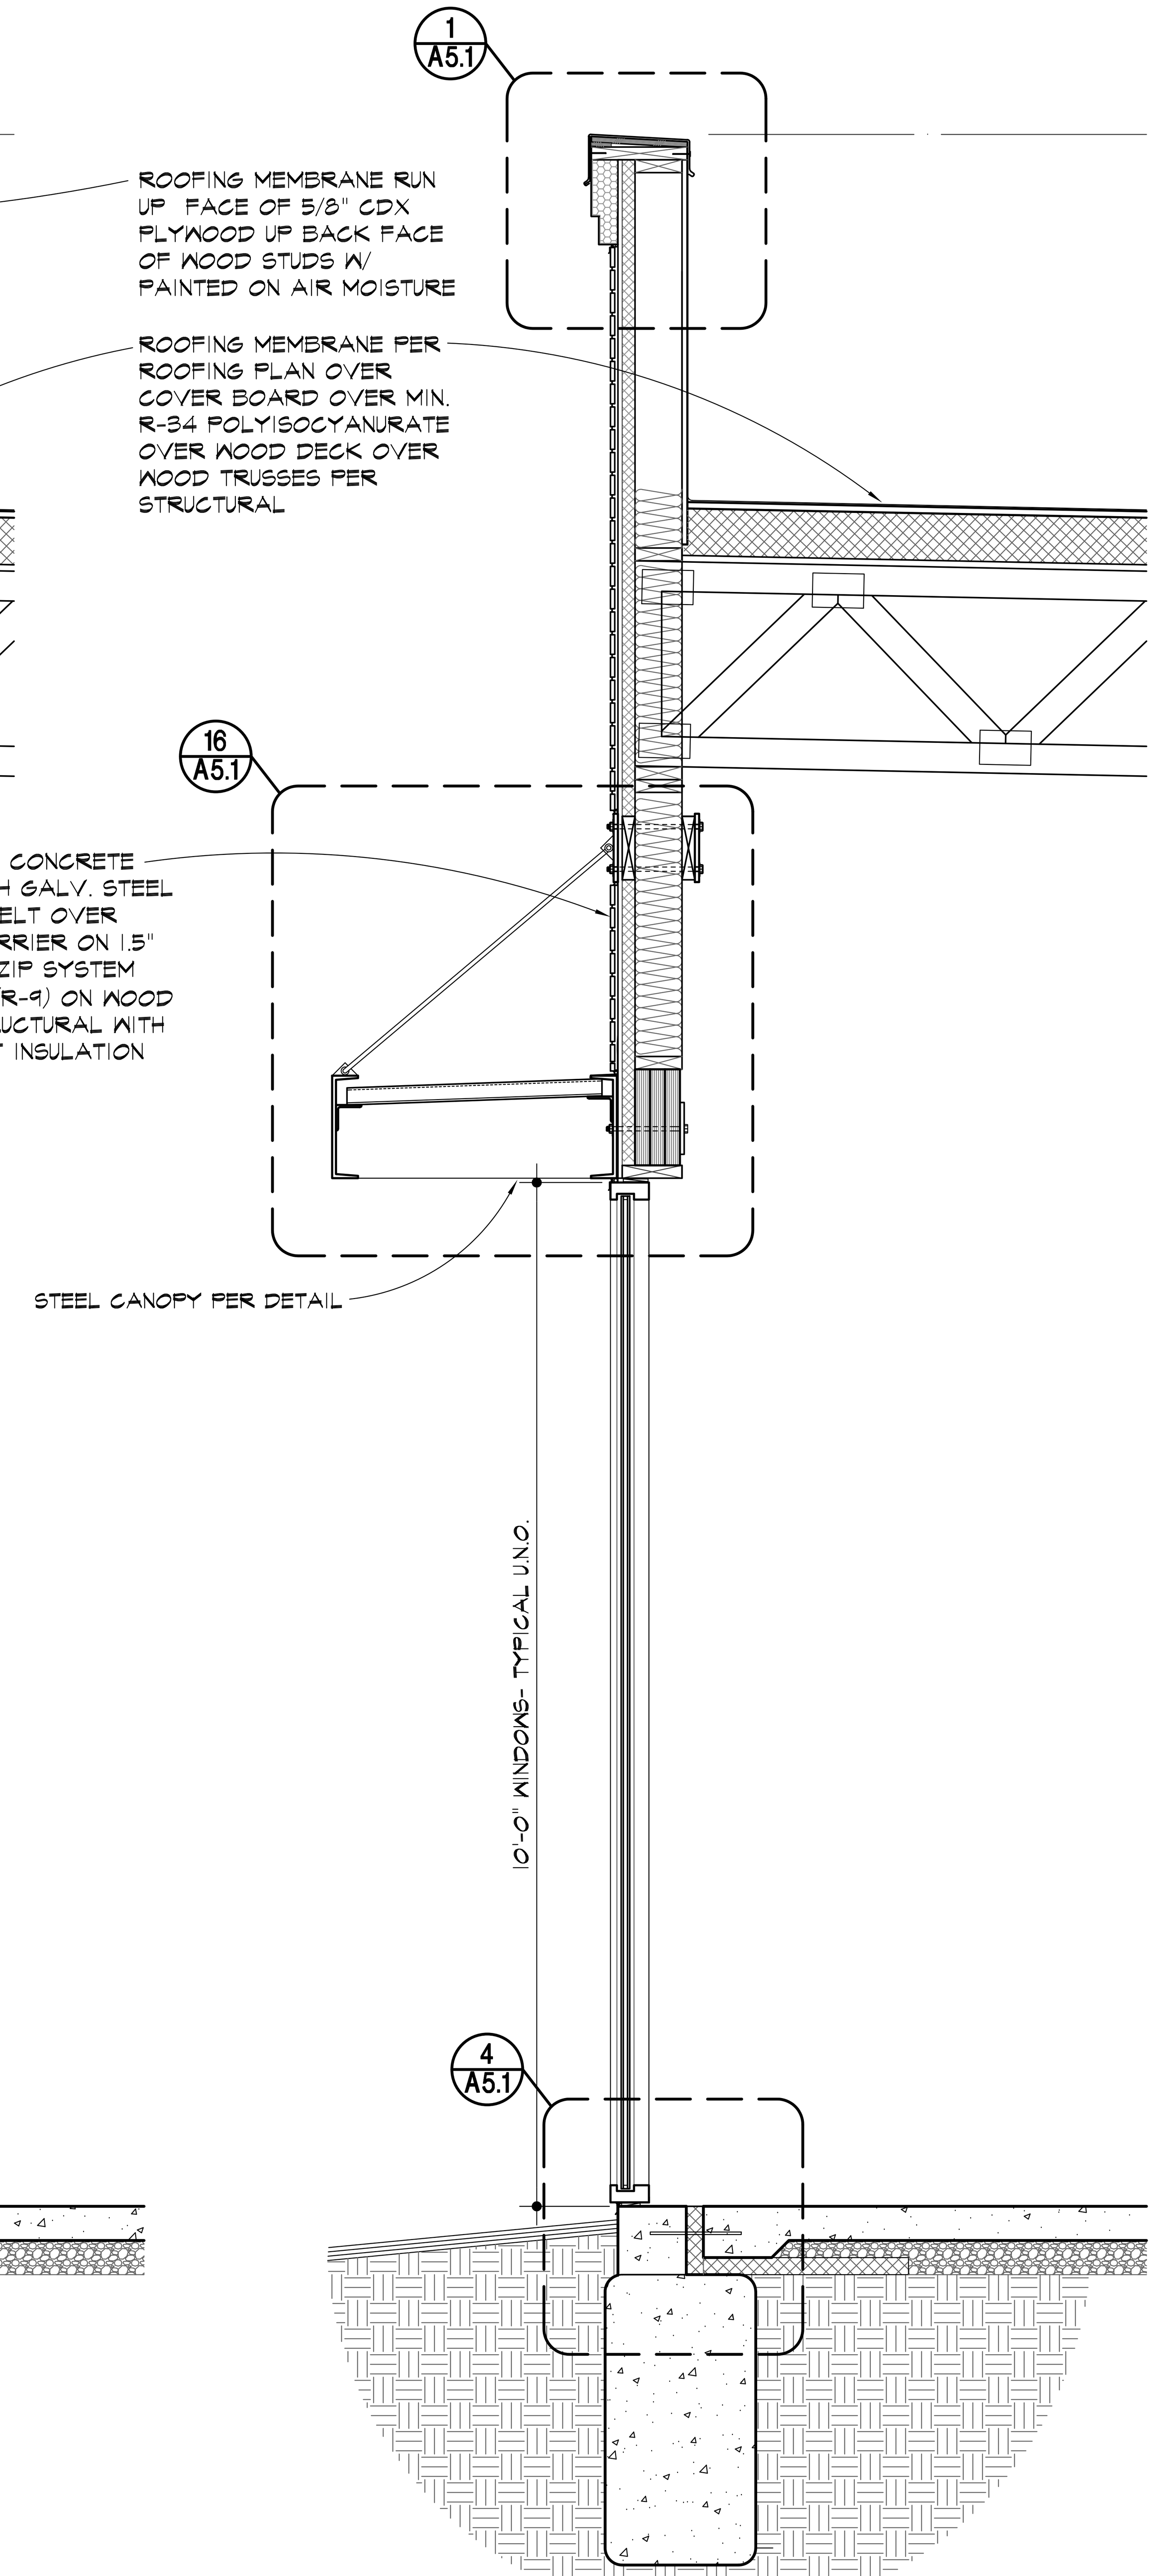

B
A4.2
SECTION
SCALE // 3/4" = 1' - 0"

DAVID A. KASTER
LICENSED
3649
KANSAS
PROFESSIONAL ARCHITECT
NOV. 24, 2025

DAVID A. KASTER RA,NCARB,LEED-AP
ROGER A. KASTER ARCHITECT
MICHAEL L. HOWARD ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC
ARCHITECTURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center
Mr. D's DONUTS
14485 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 24, 2025
REVISED
SHEET NUMBER
A4.2
OF SHEETS
KAI JOB NO. 2506-C

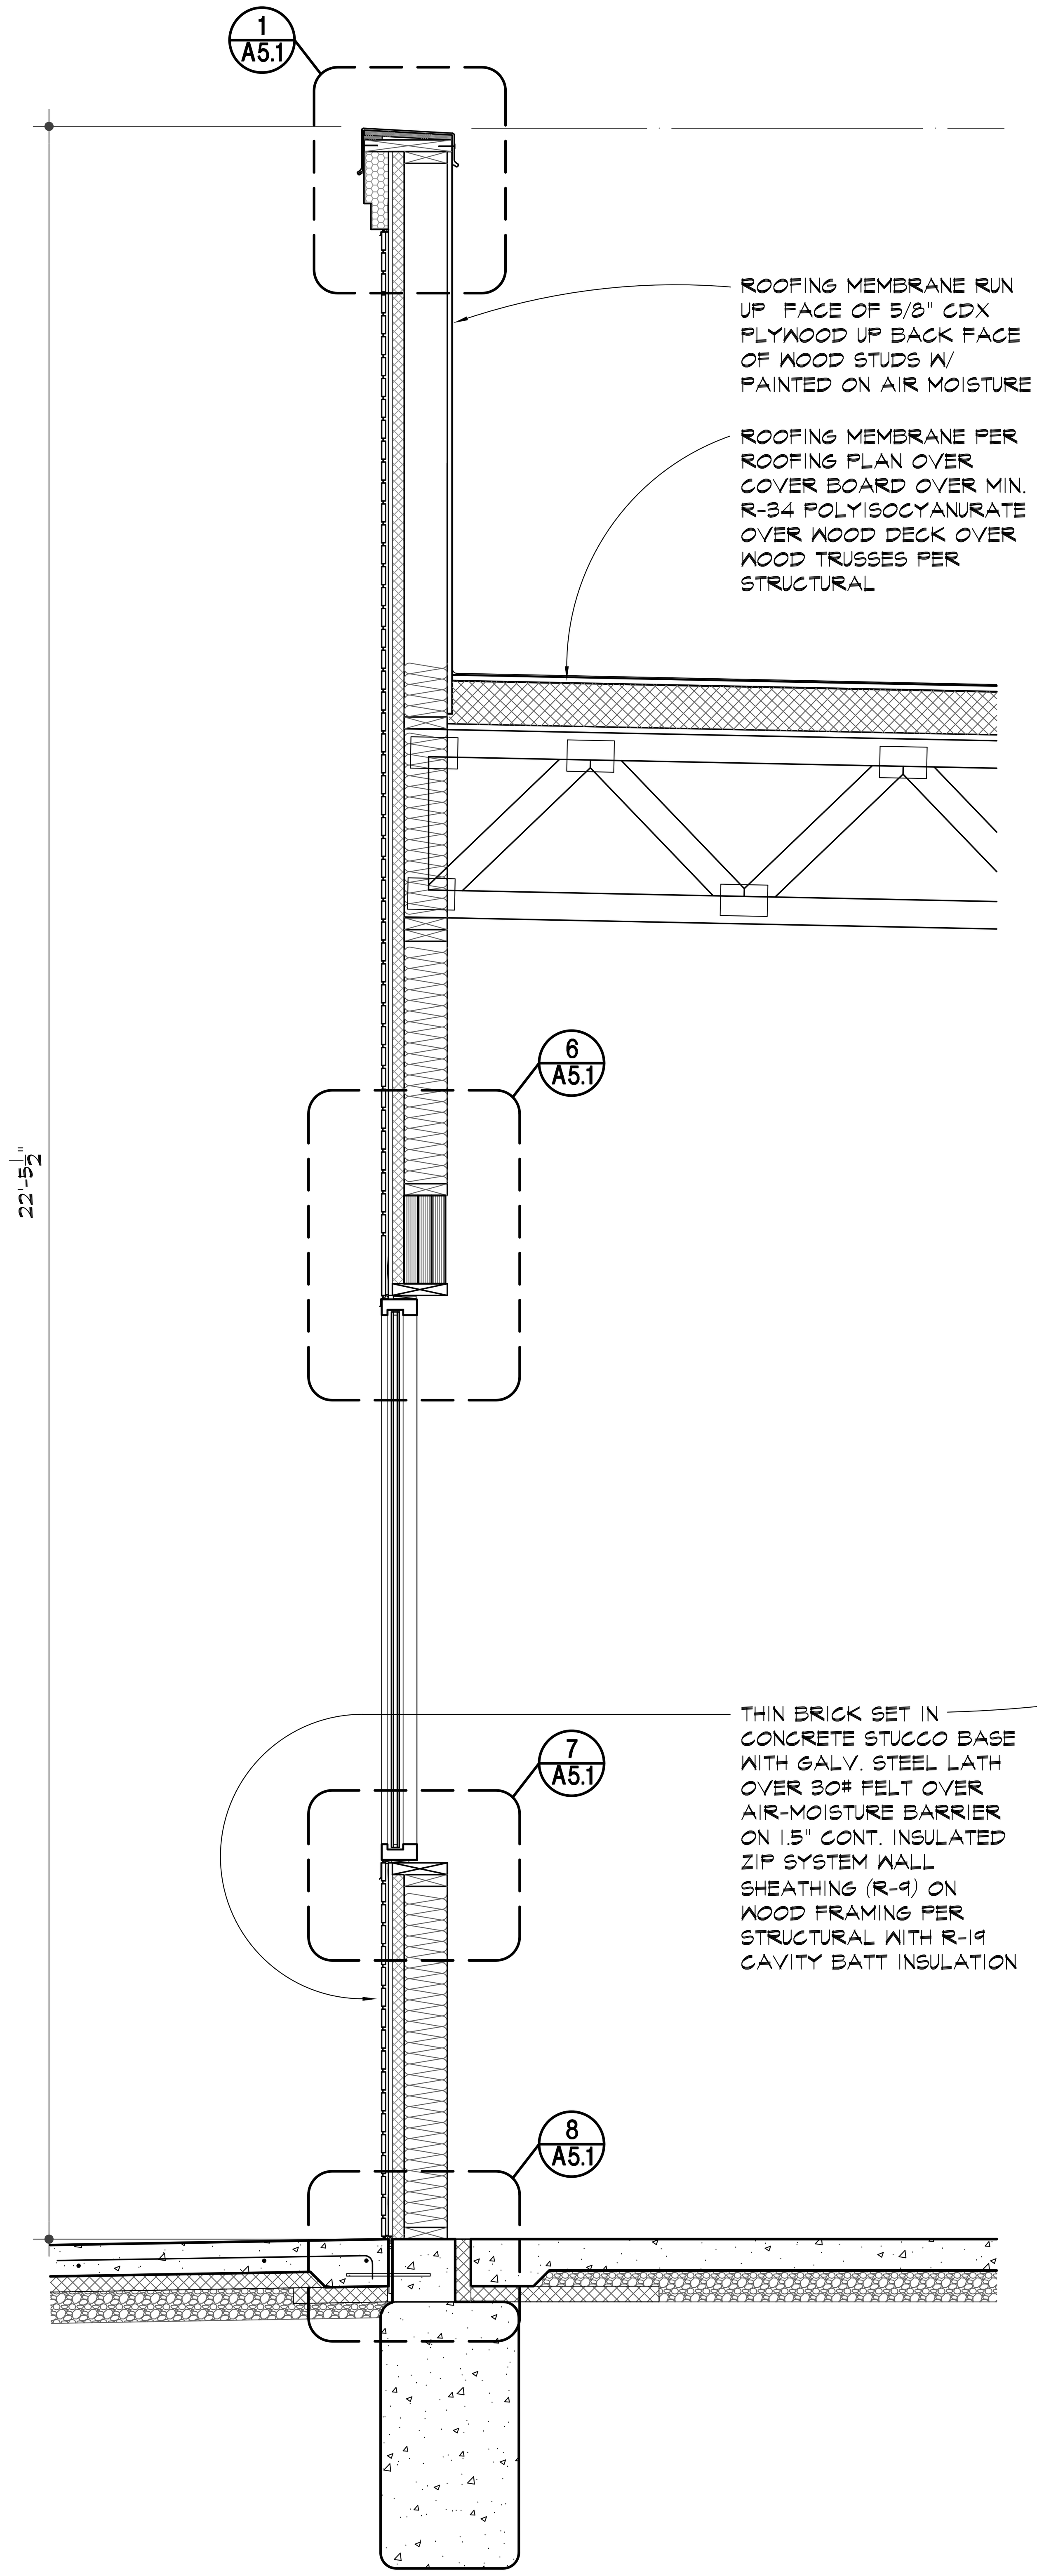

A
A4.3
SECTION
SCALE // 3/4" = 1' - 0"

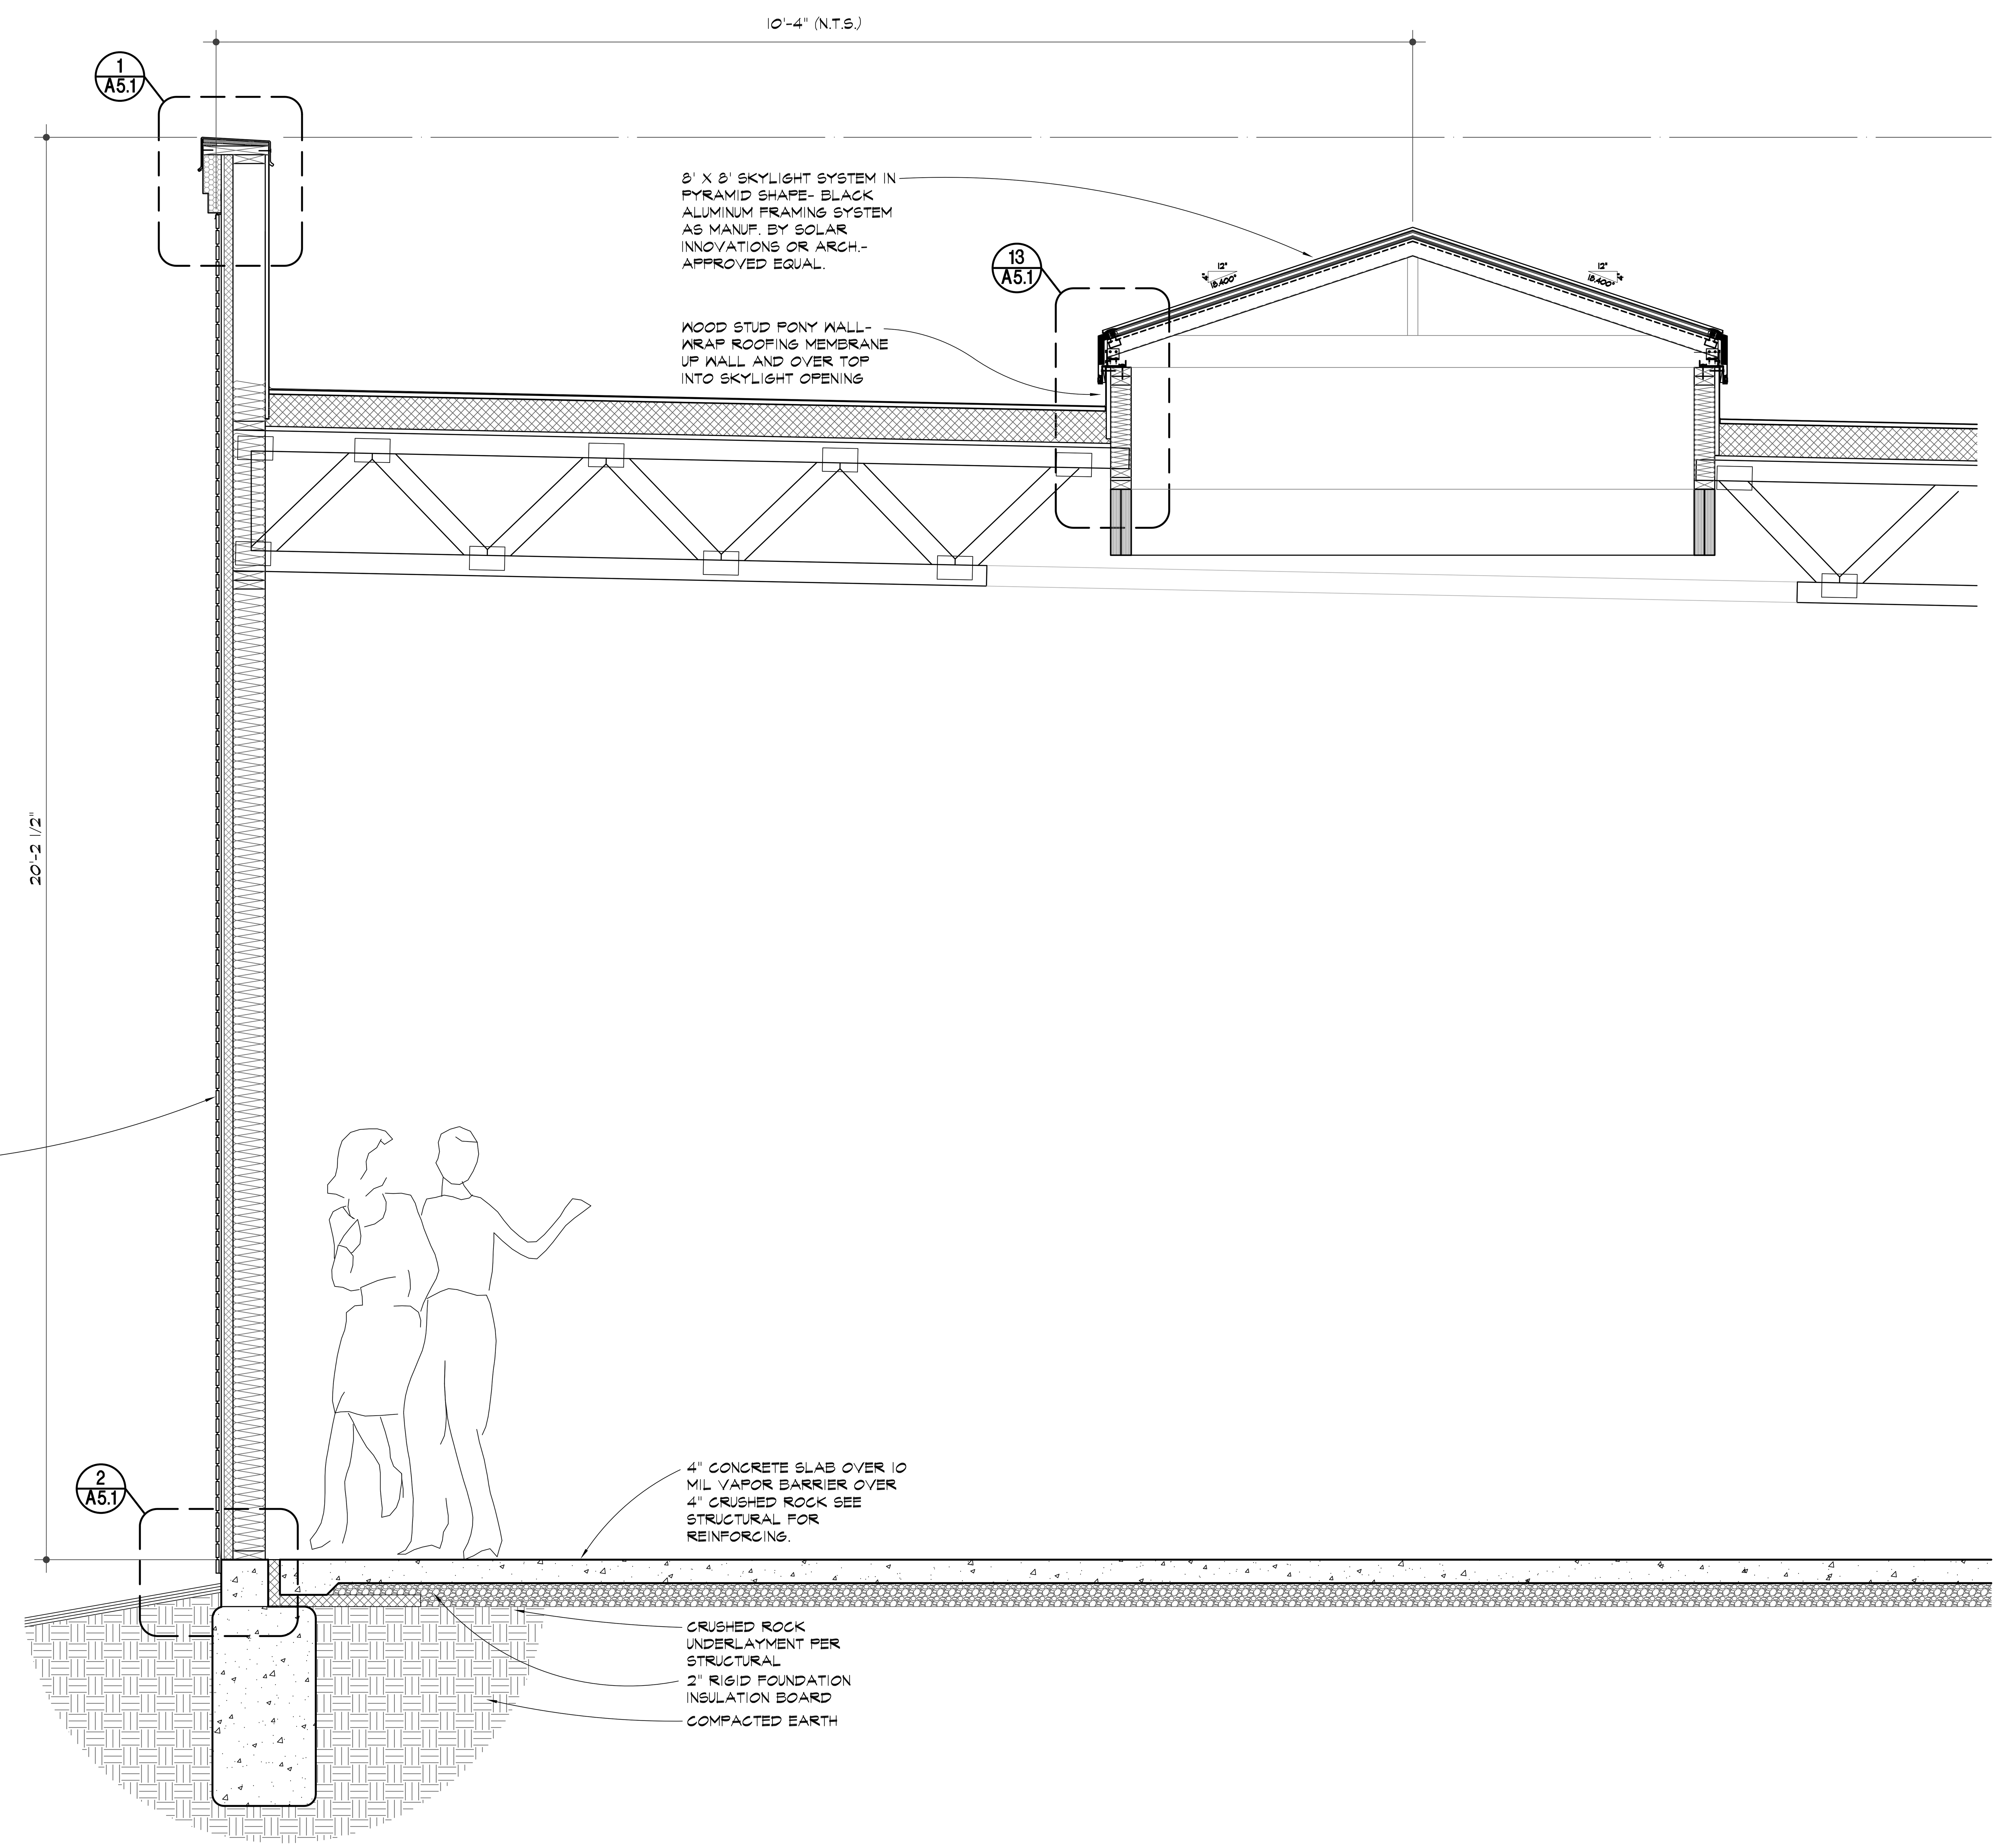

B
A4.3
SECTION
SCALE // 3/4" = 1' - 0"

DAVID A. KASTER LICENSED 3649 KANSAS PROFESSIONAL ARCHITECT
NOV. 24, 2025

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC
ARCHITECTURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center
Mr. D´s DONUTS
14485 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 24, 2025
REVISED
SHEET NUMBER
A4.3
OF SHEETS
KAI JOB NO. 2506-C

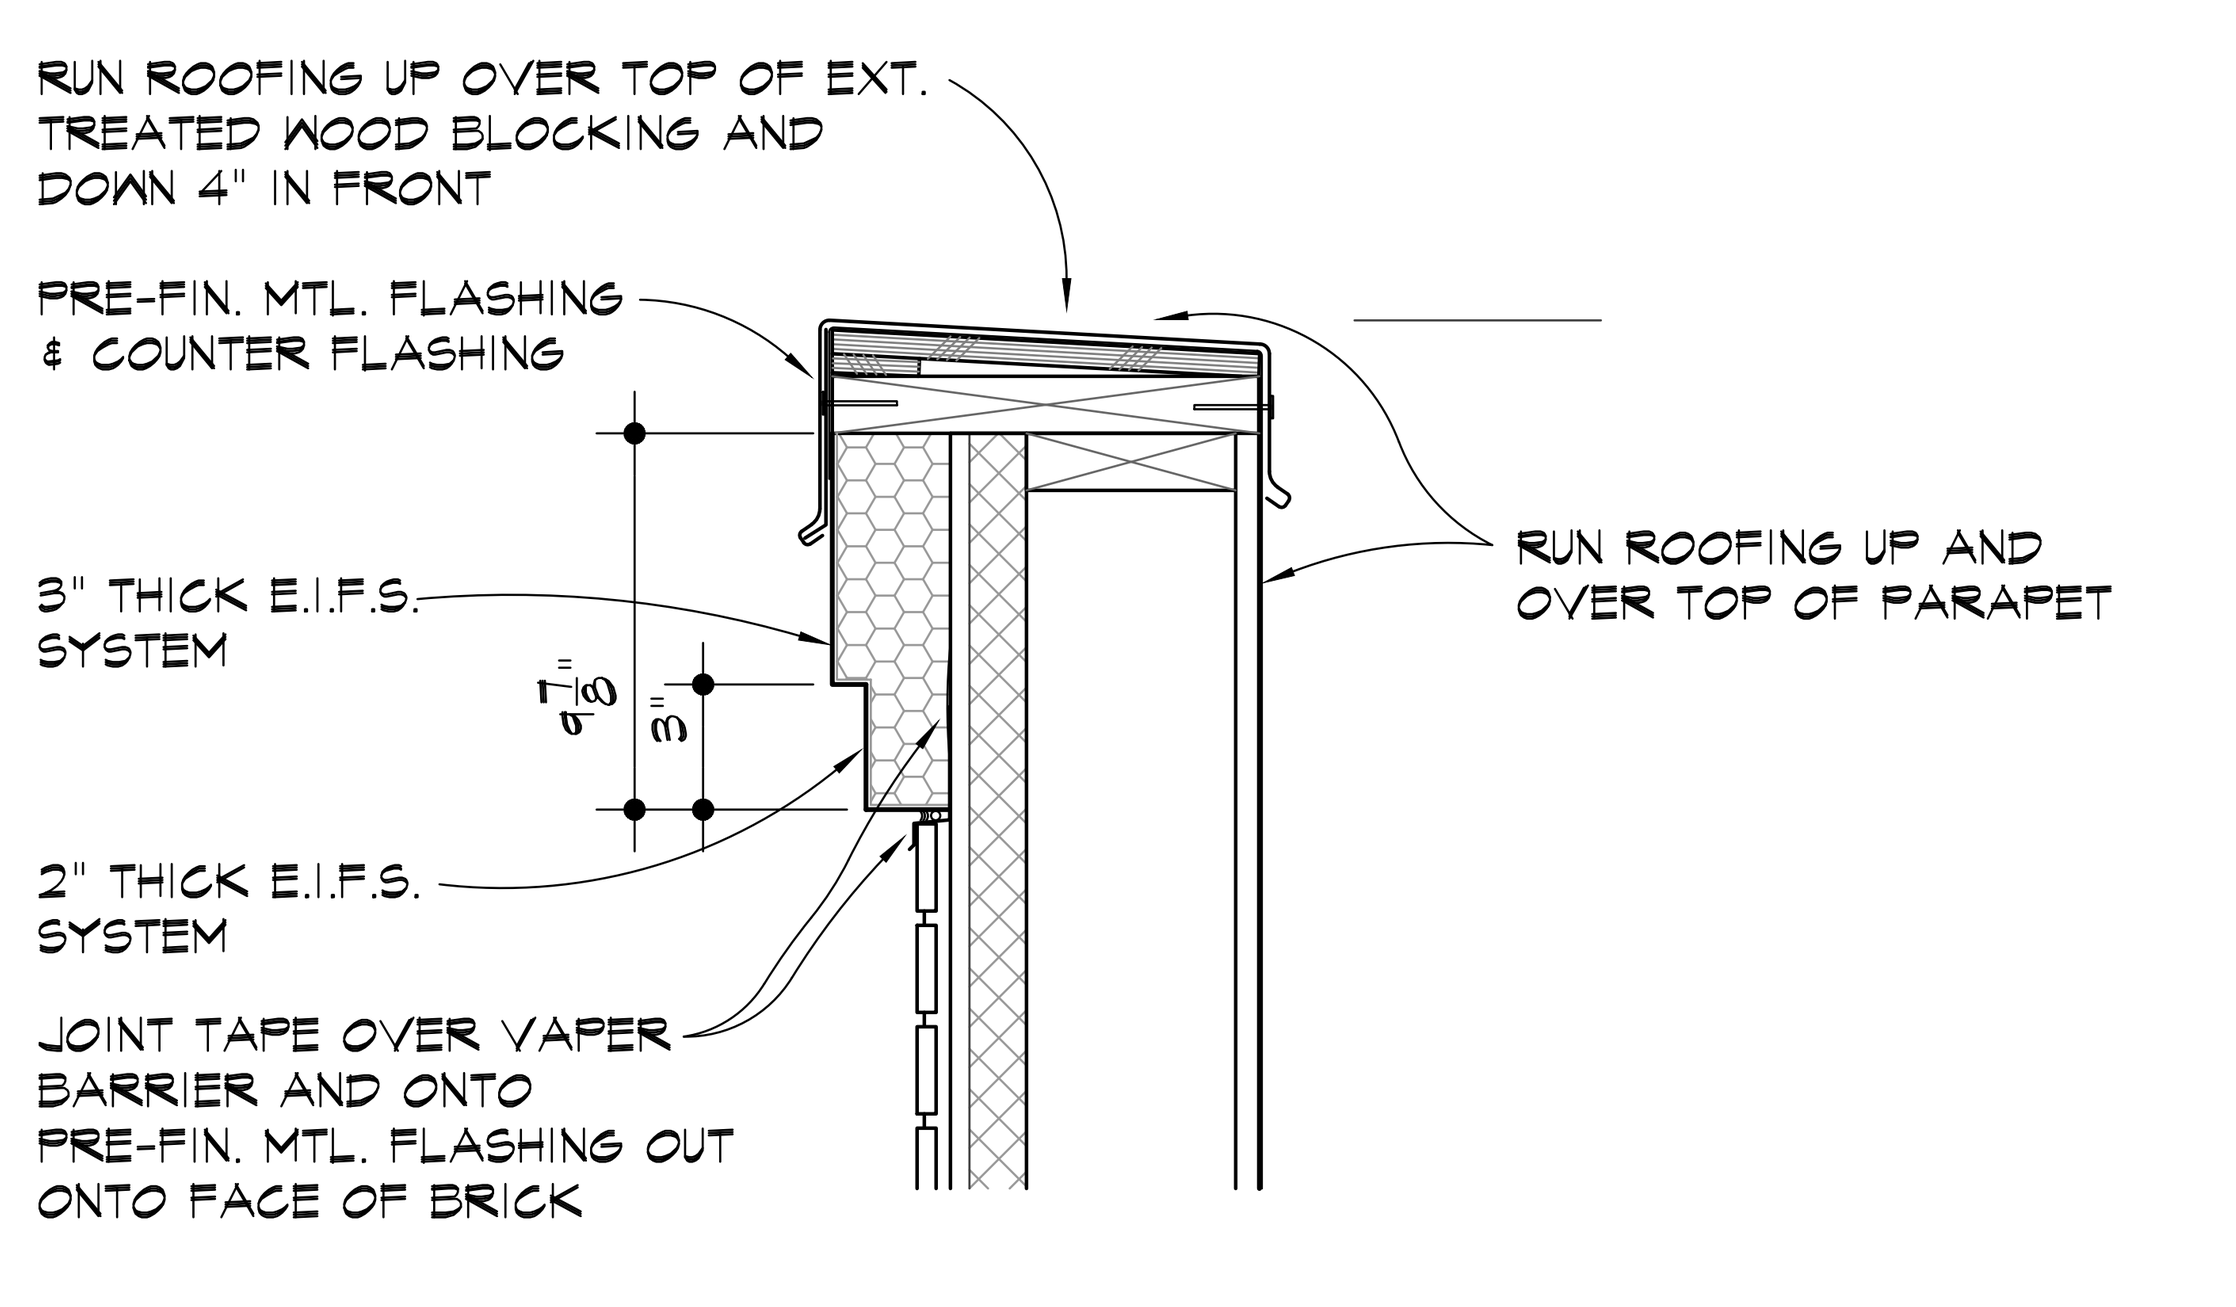

1 A5.1 **PARAPET DETAIL**
SCALE // 1 1/2" = 1'-0"

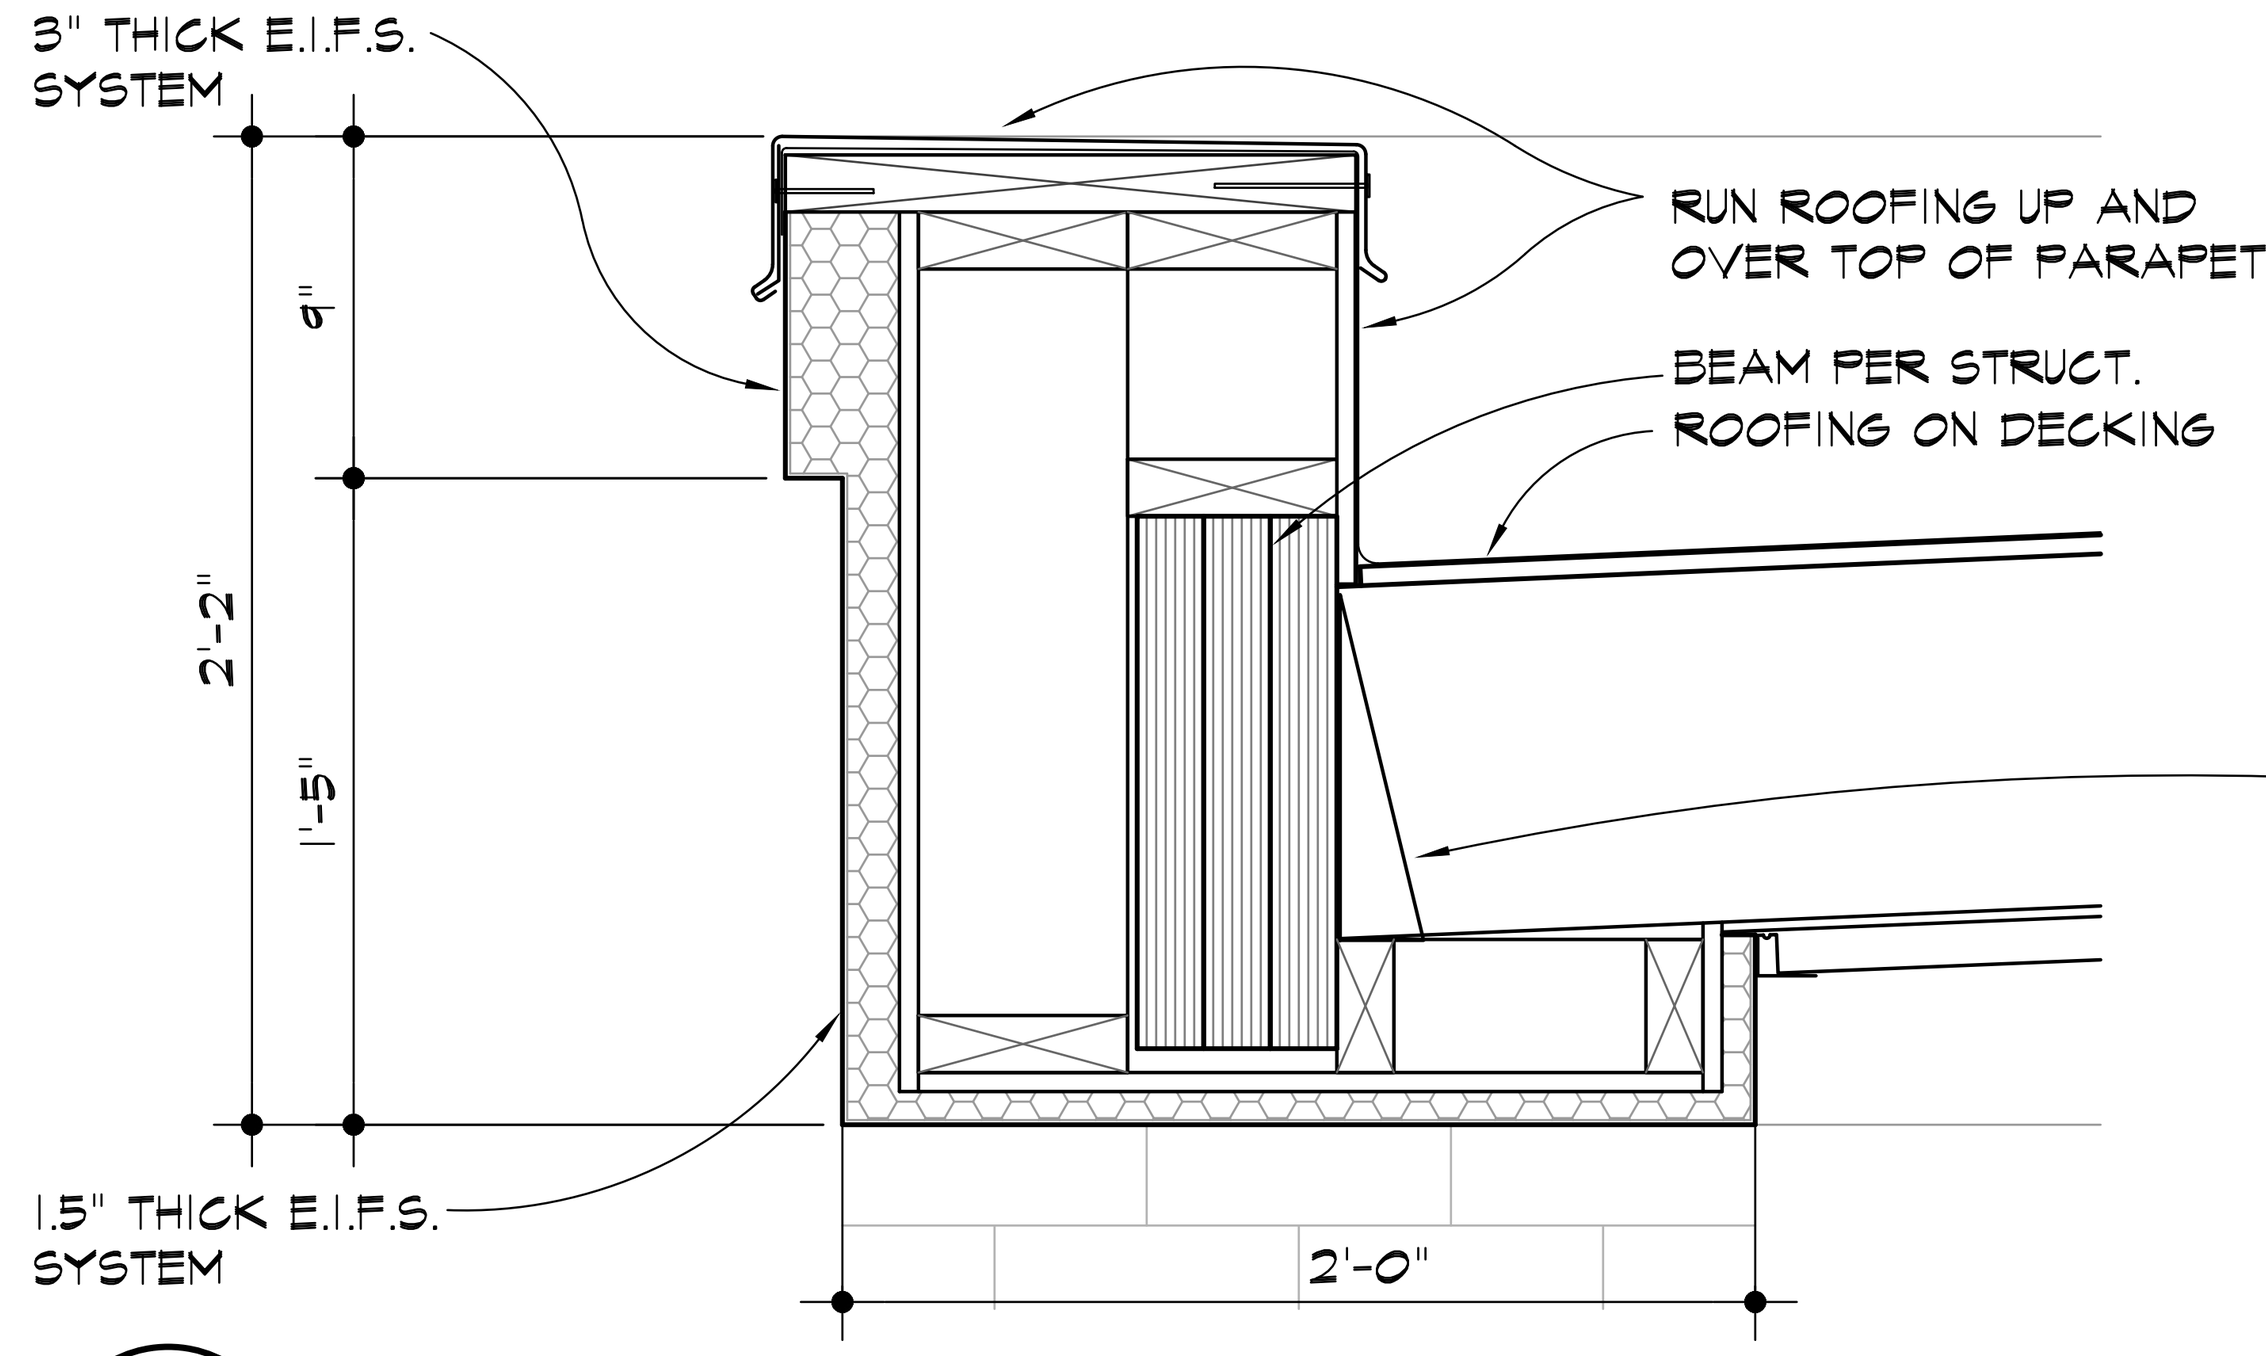

5 A5.1 **PATIO EAVE SECTION**
SCALE // 1 1/2" = 1'-0"

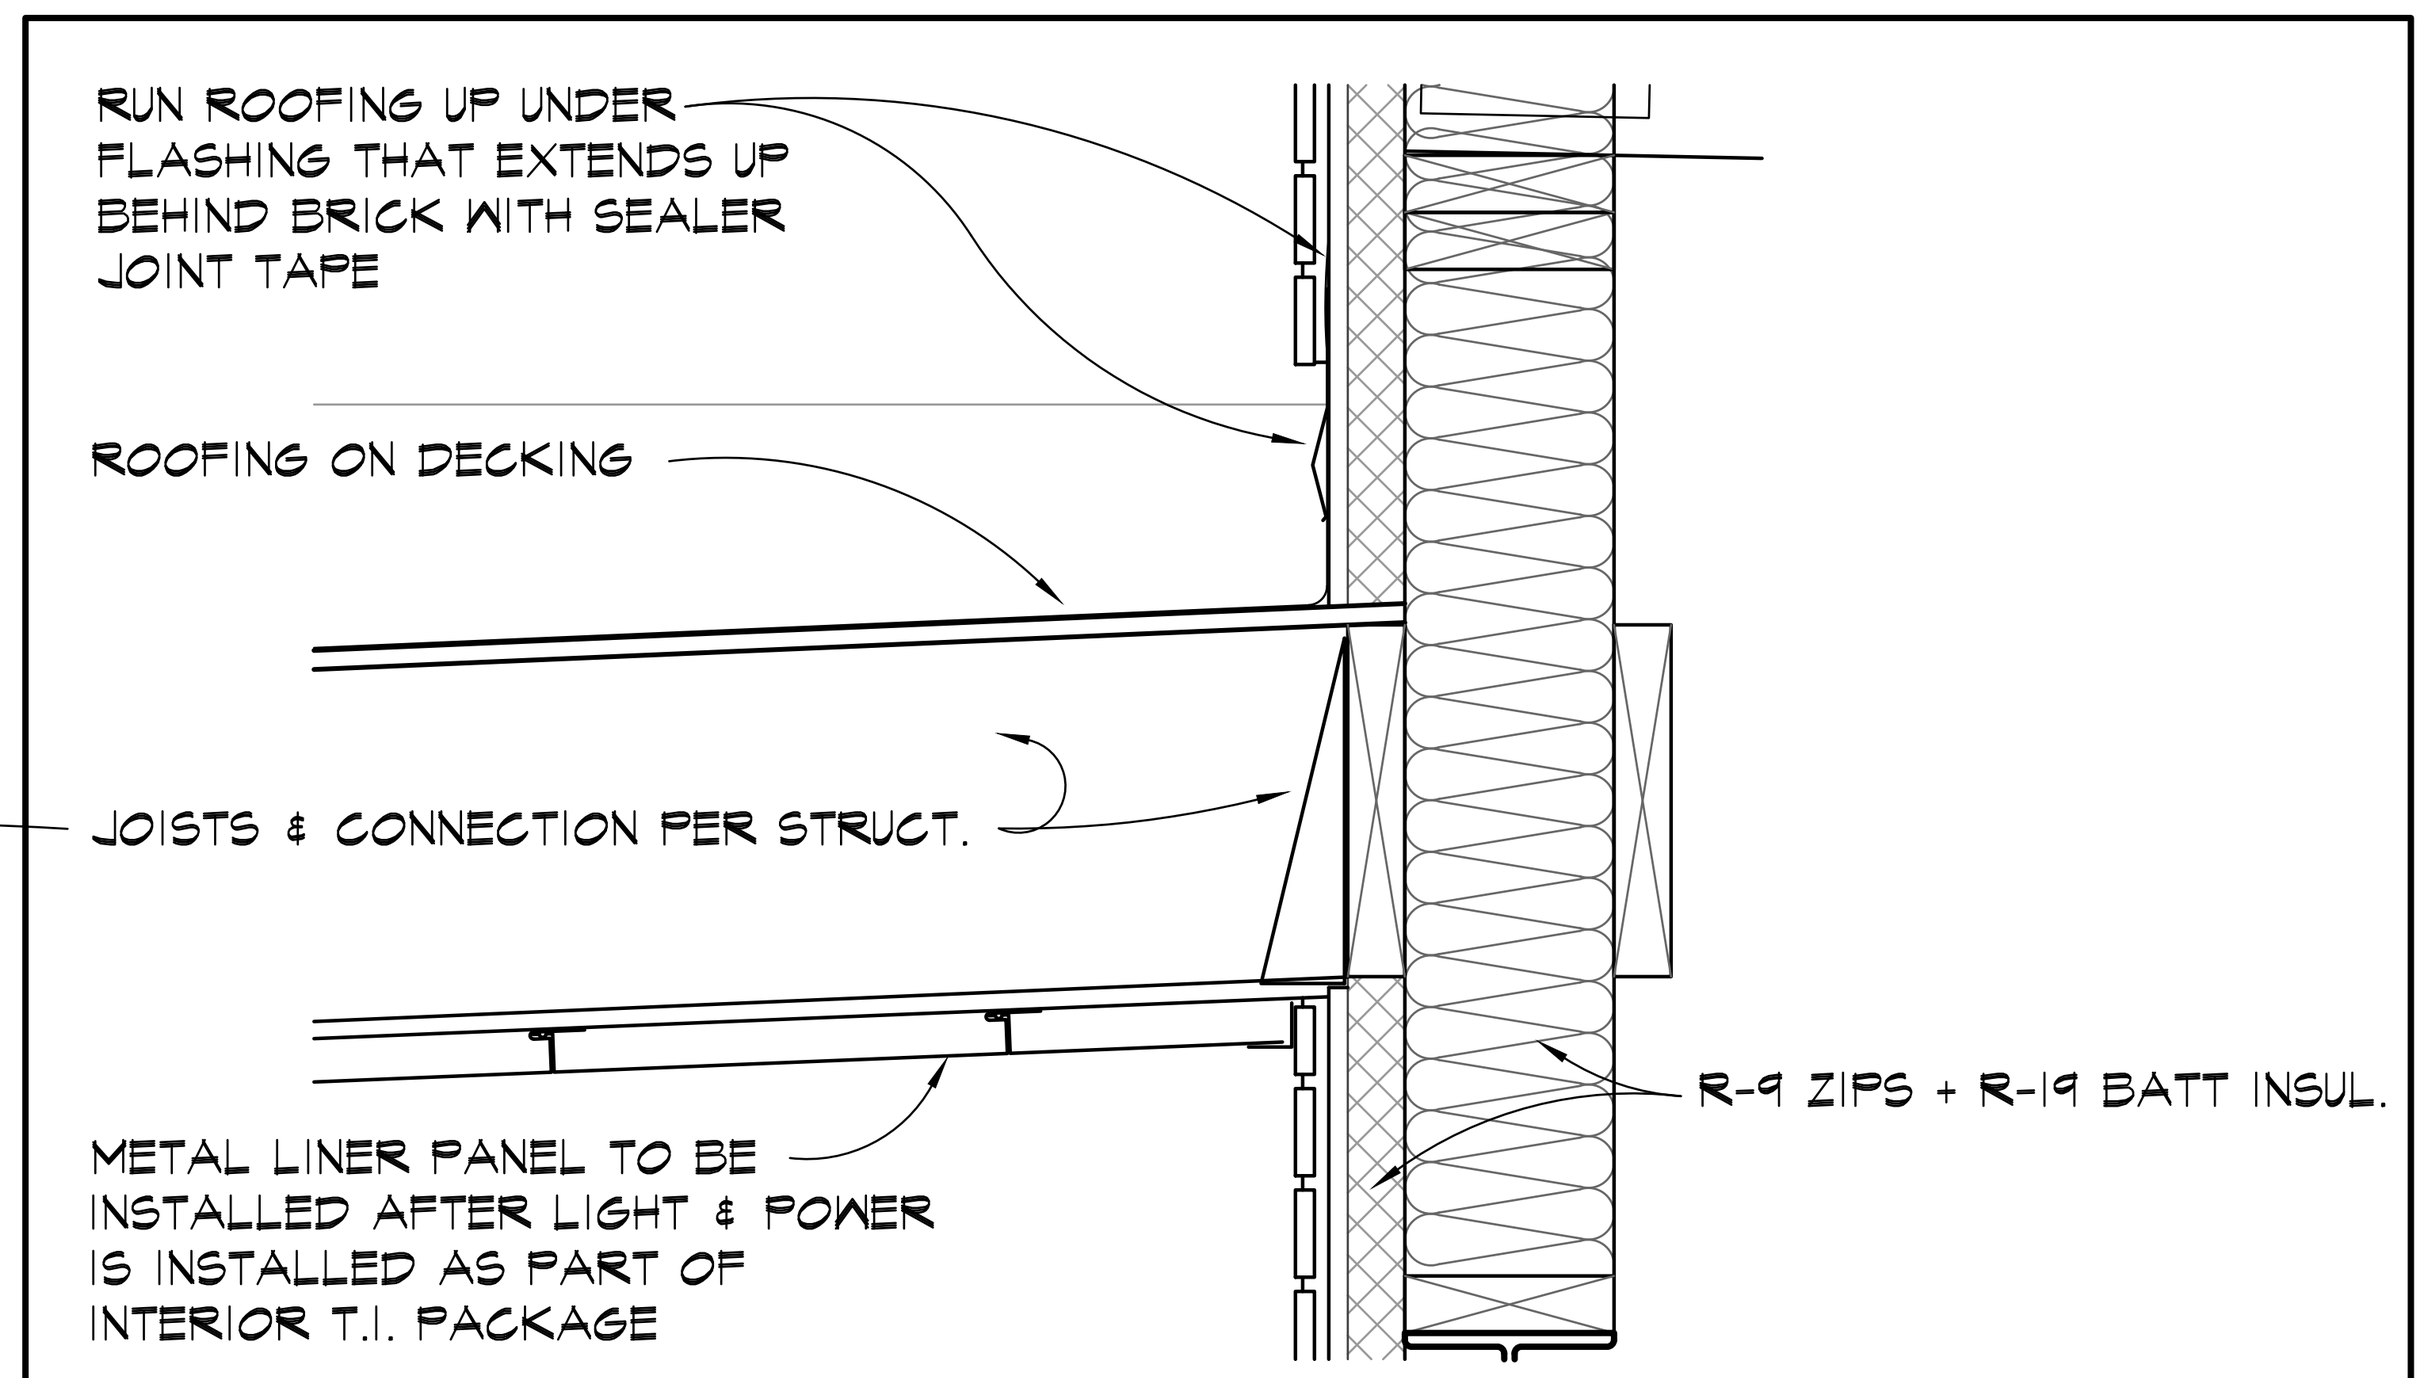

9 A5.1 **PATIO DTL. AT WALL FACE**
SCALE // 1 1/2" = 1'-0"

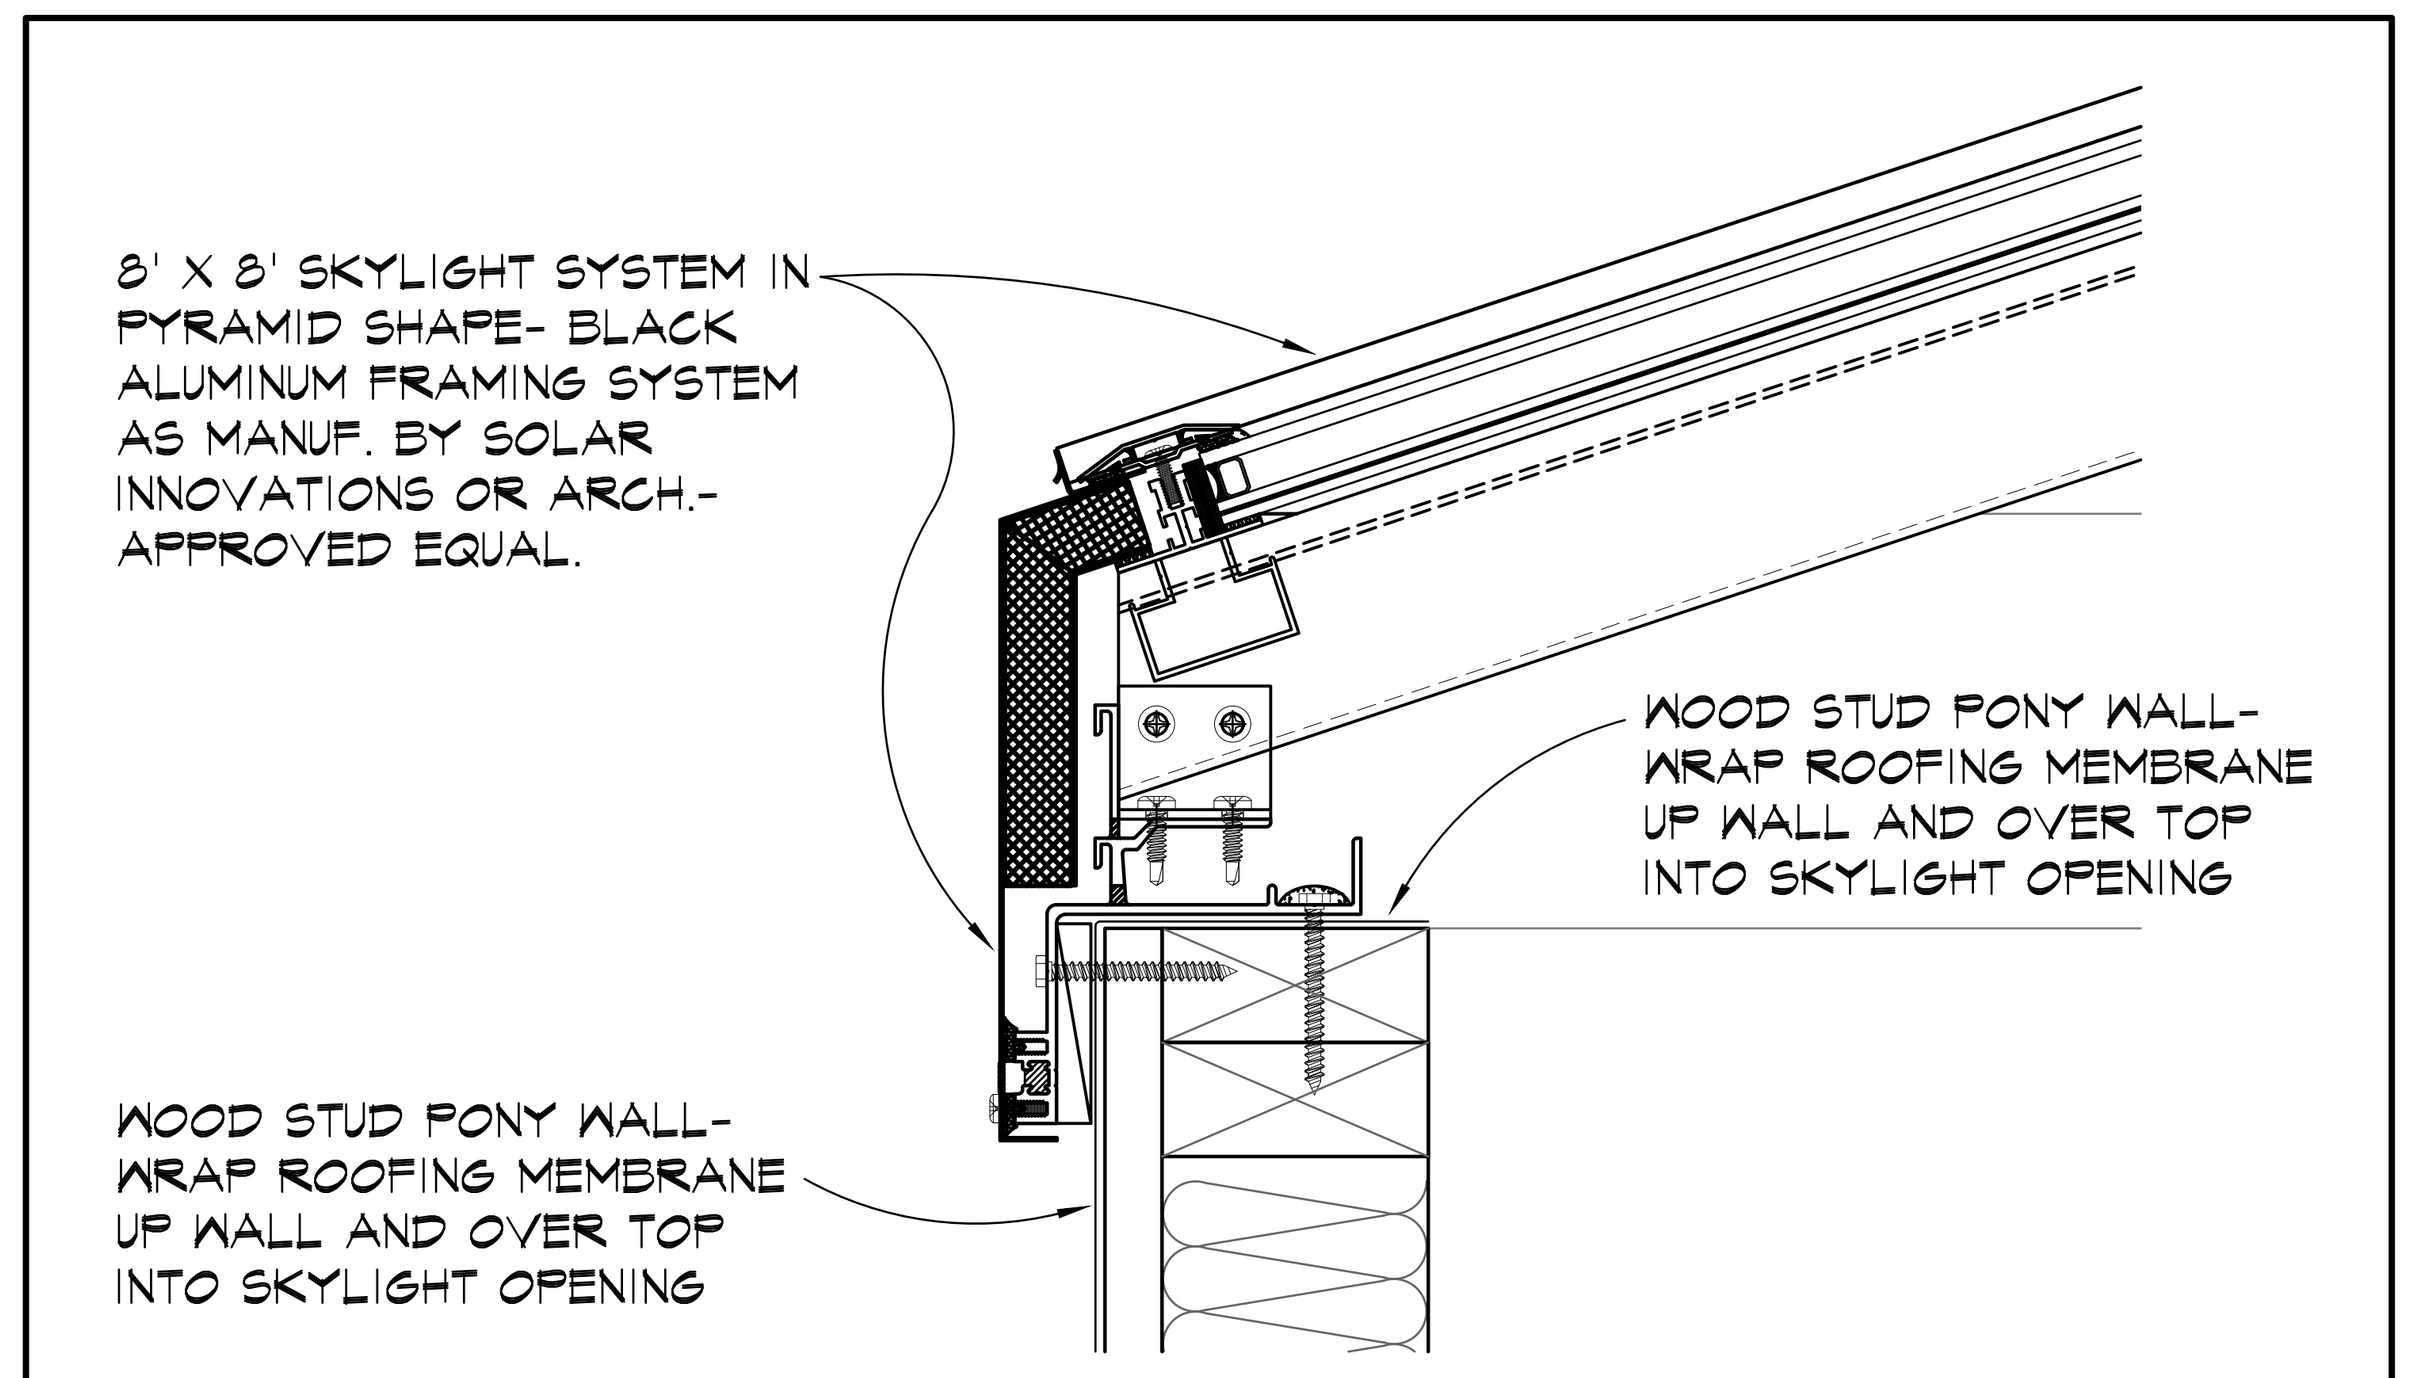

13 A5.1 **DETAIL AT SKYLIGHT**
SCALE // 3" = 1'-0"

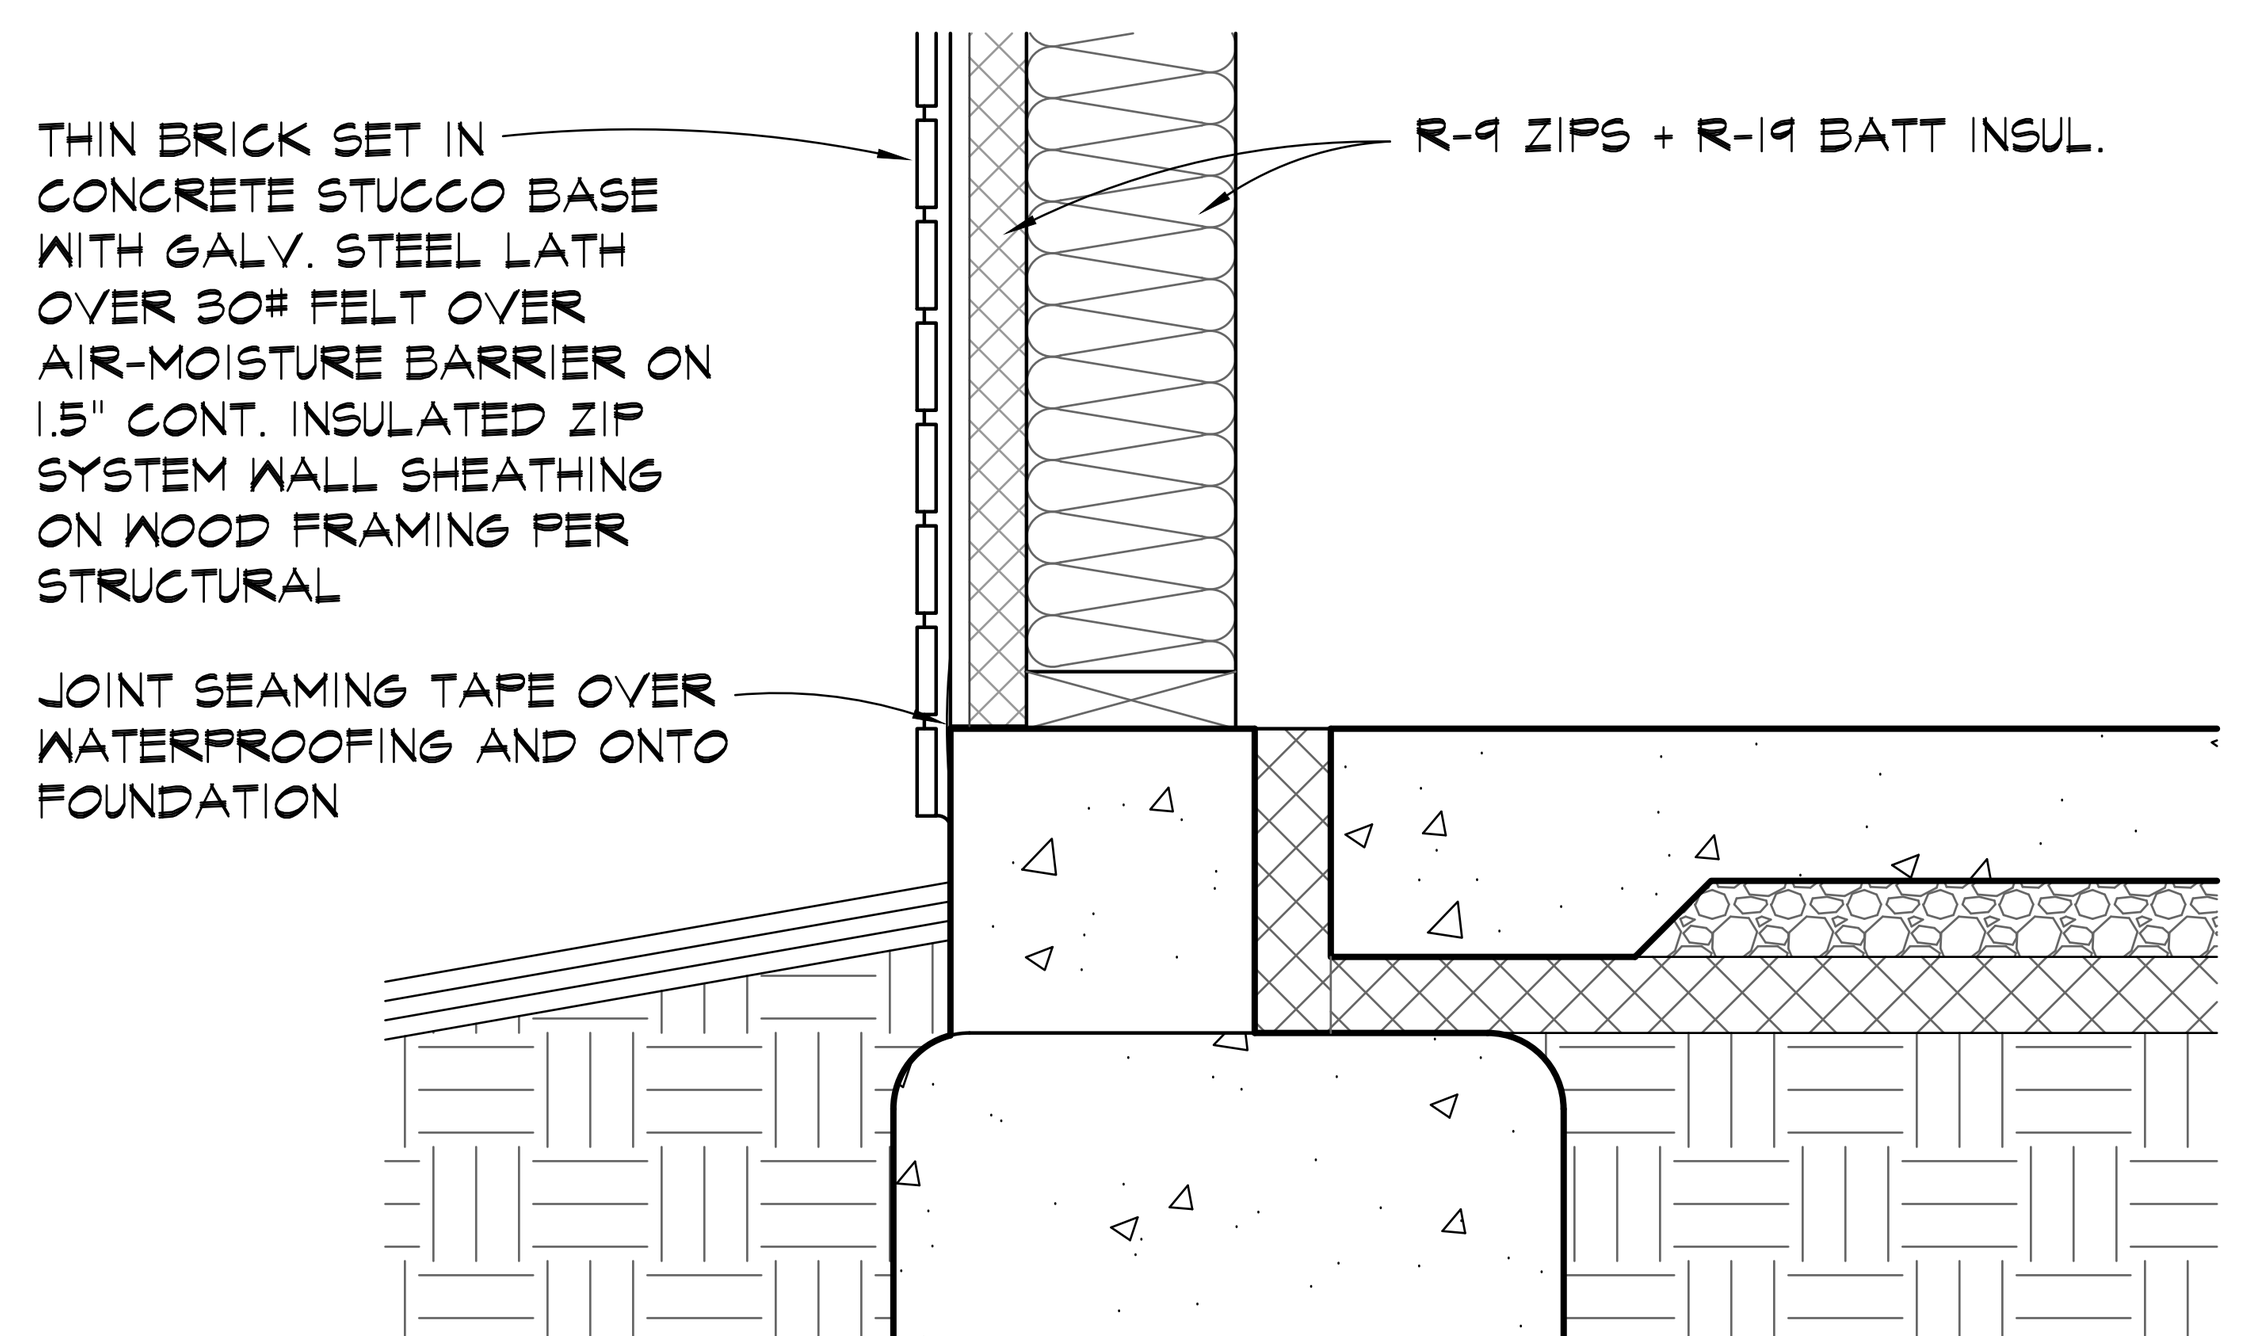

2 A5.1 **WALL BASE DETAIL**
SCALE // 1 1/2" = 1'-0"

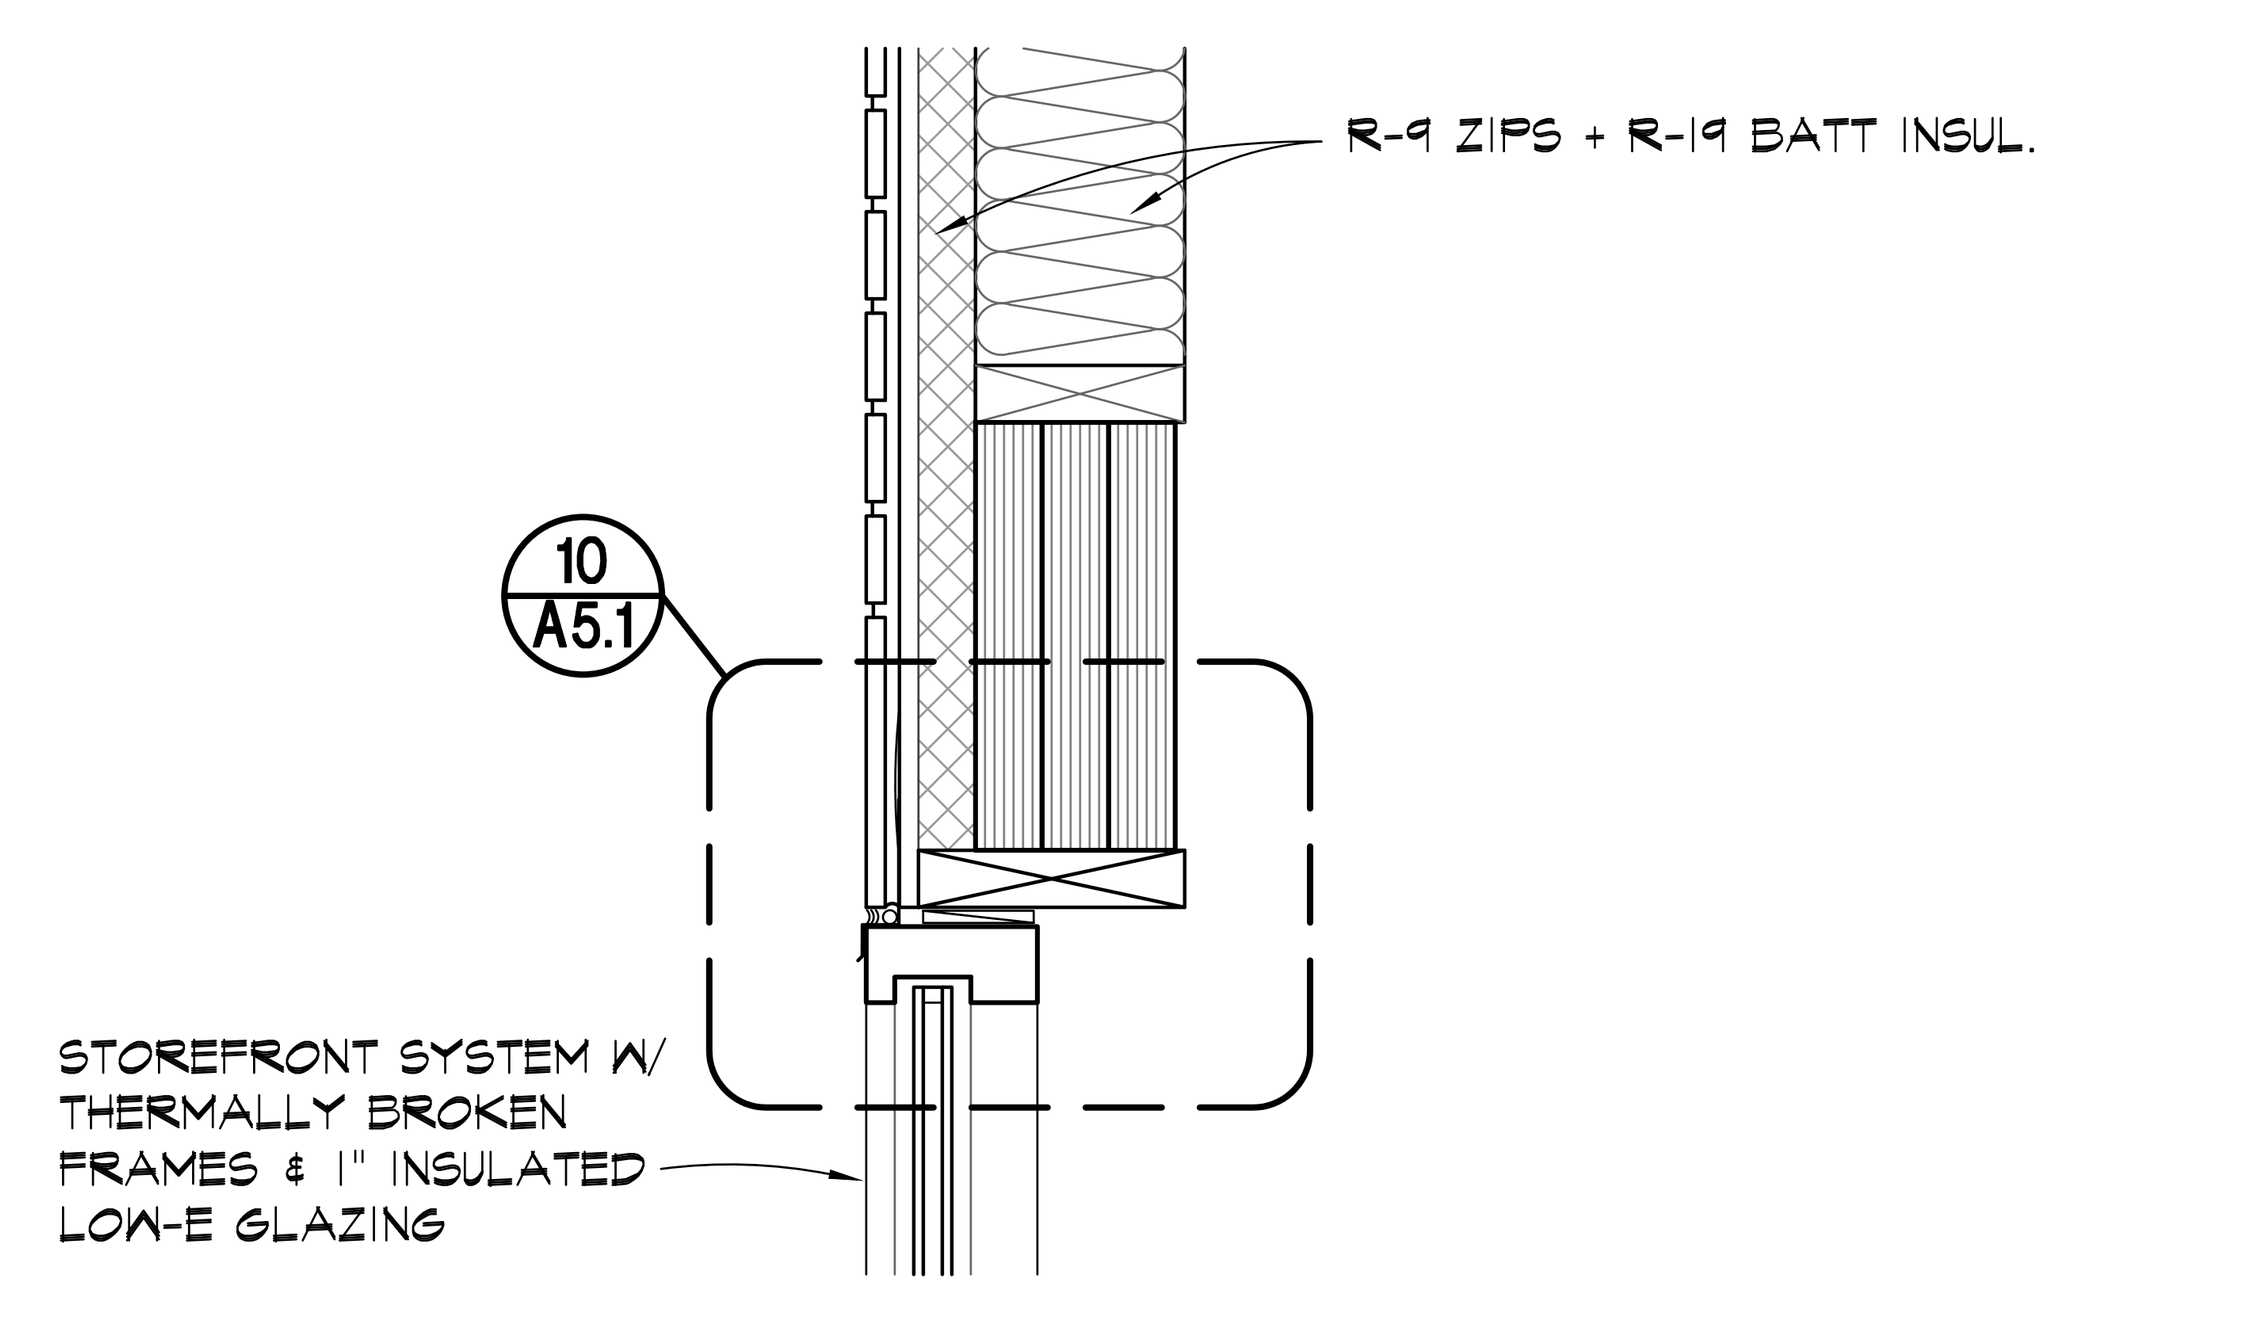

6 A5.1 **WINDOW HEAD DETAIL**
SCALE // 1 1/2" = 1'-0"

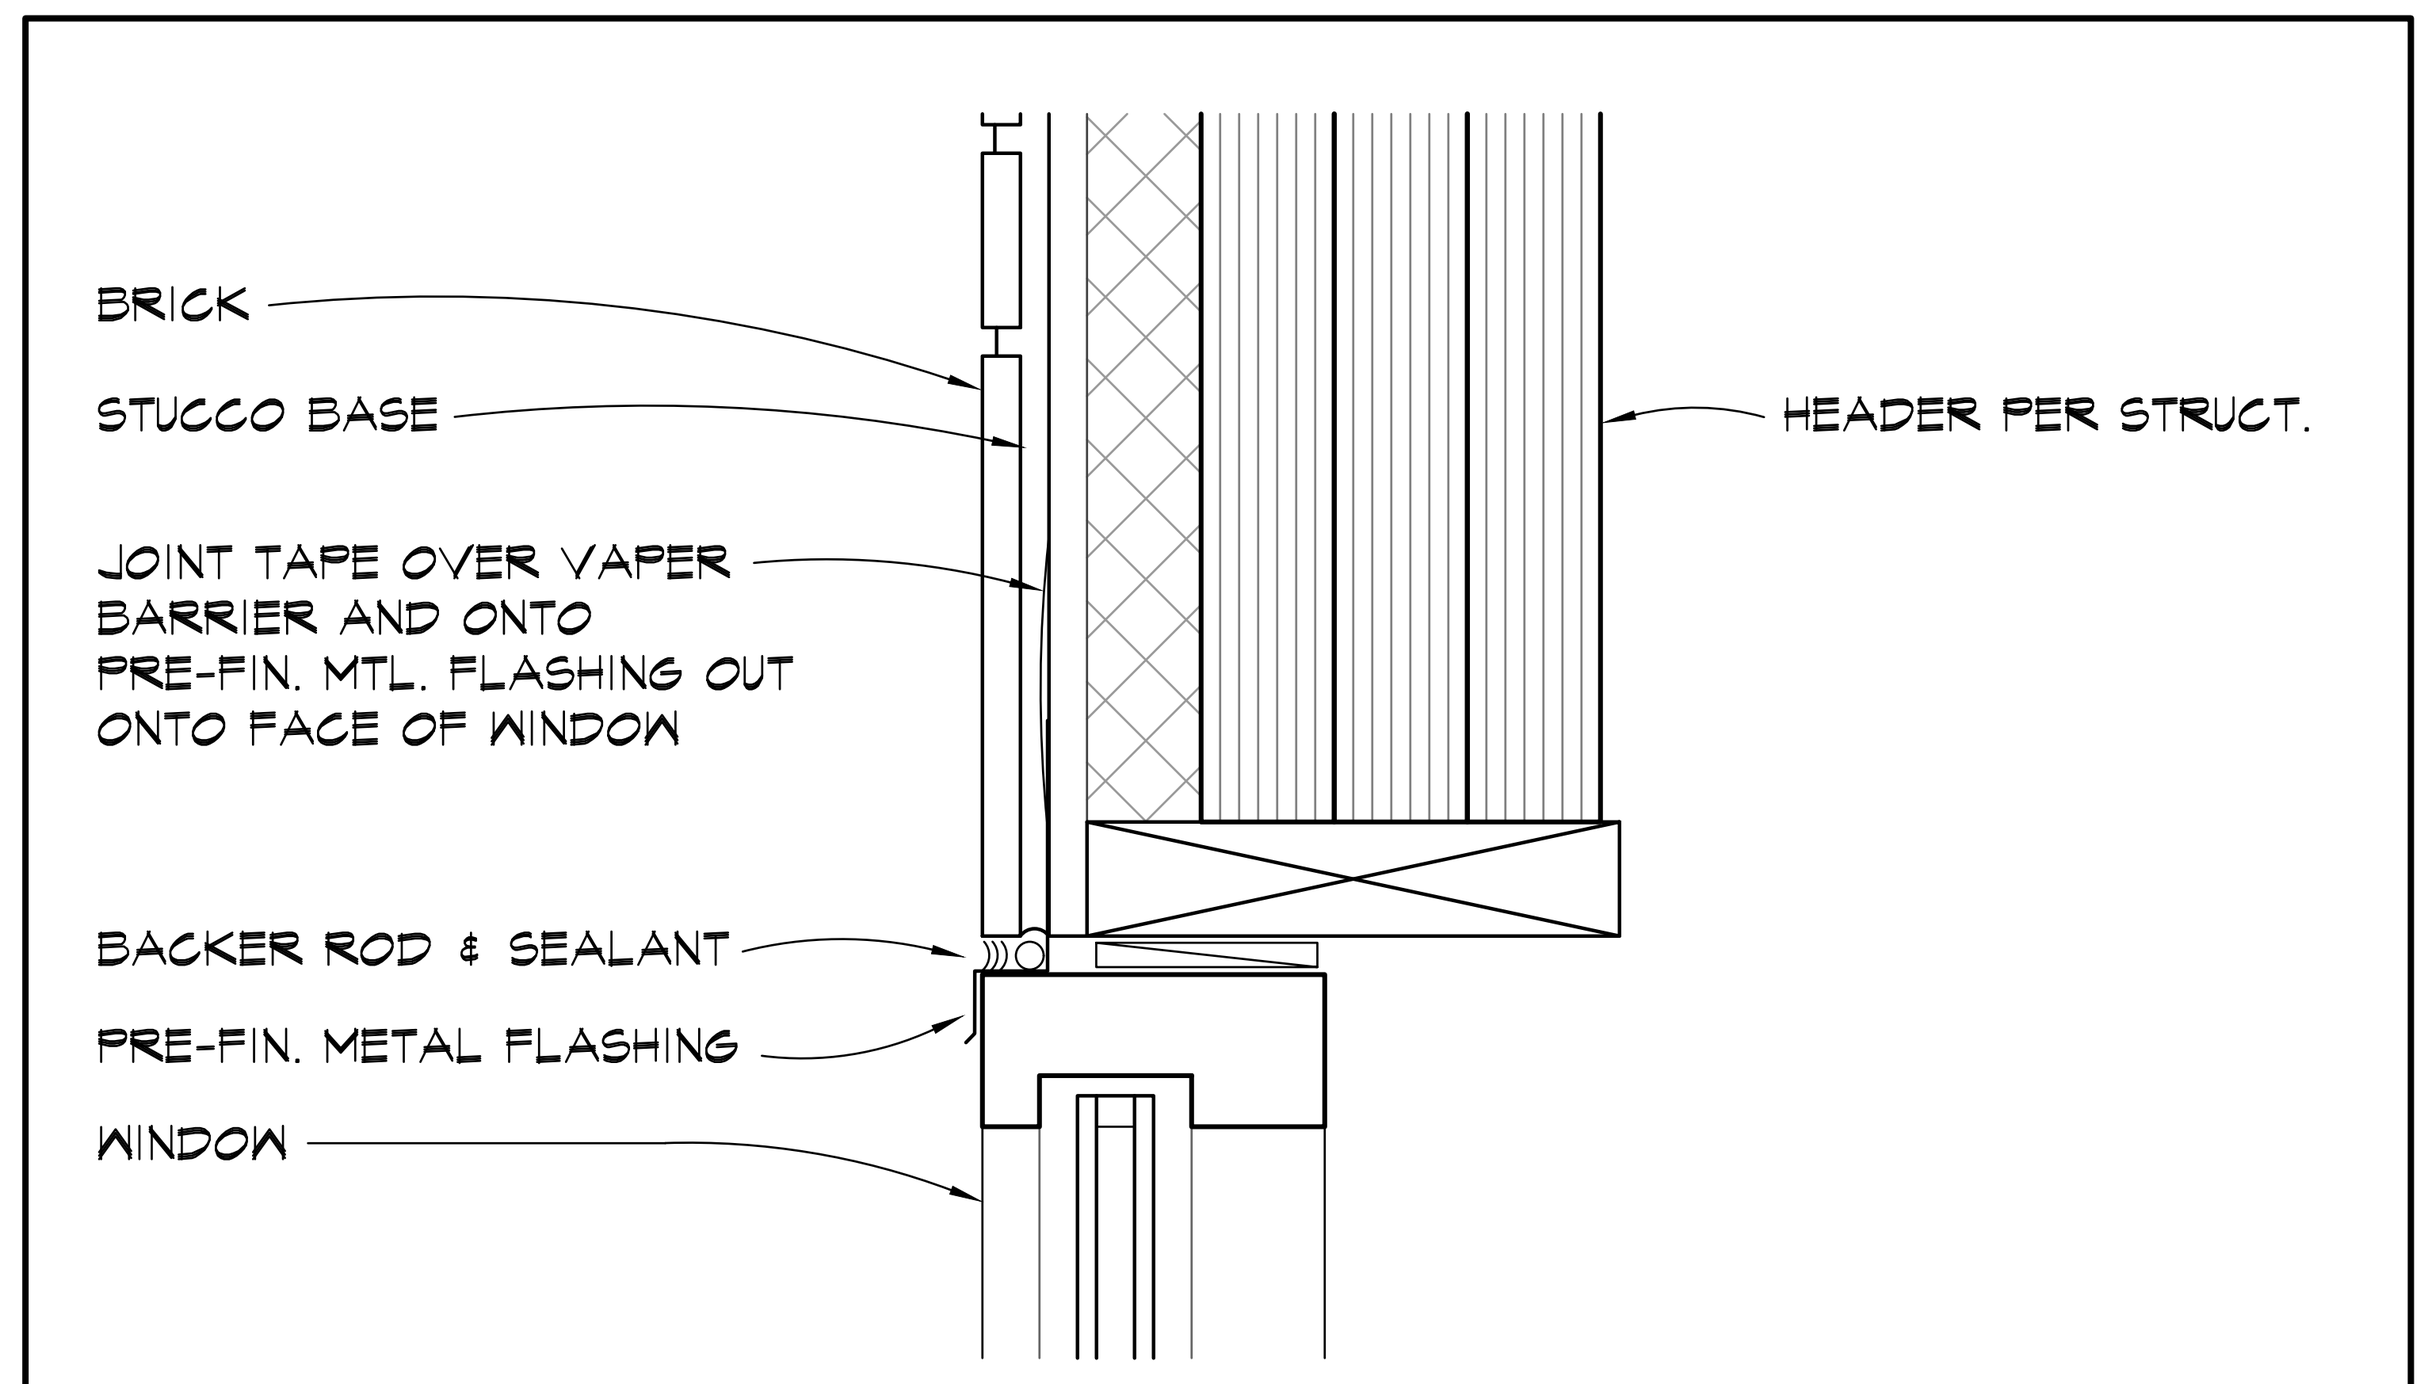

10 A5.1 **ENLARGED WINDOW HEAD DTL.**
SCALE // 3" = 1'-0"

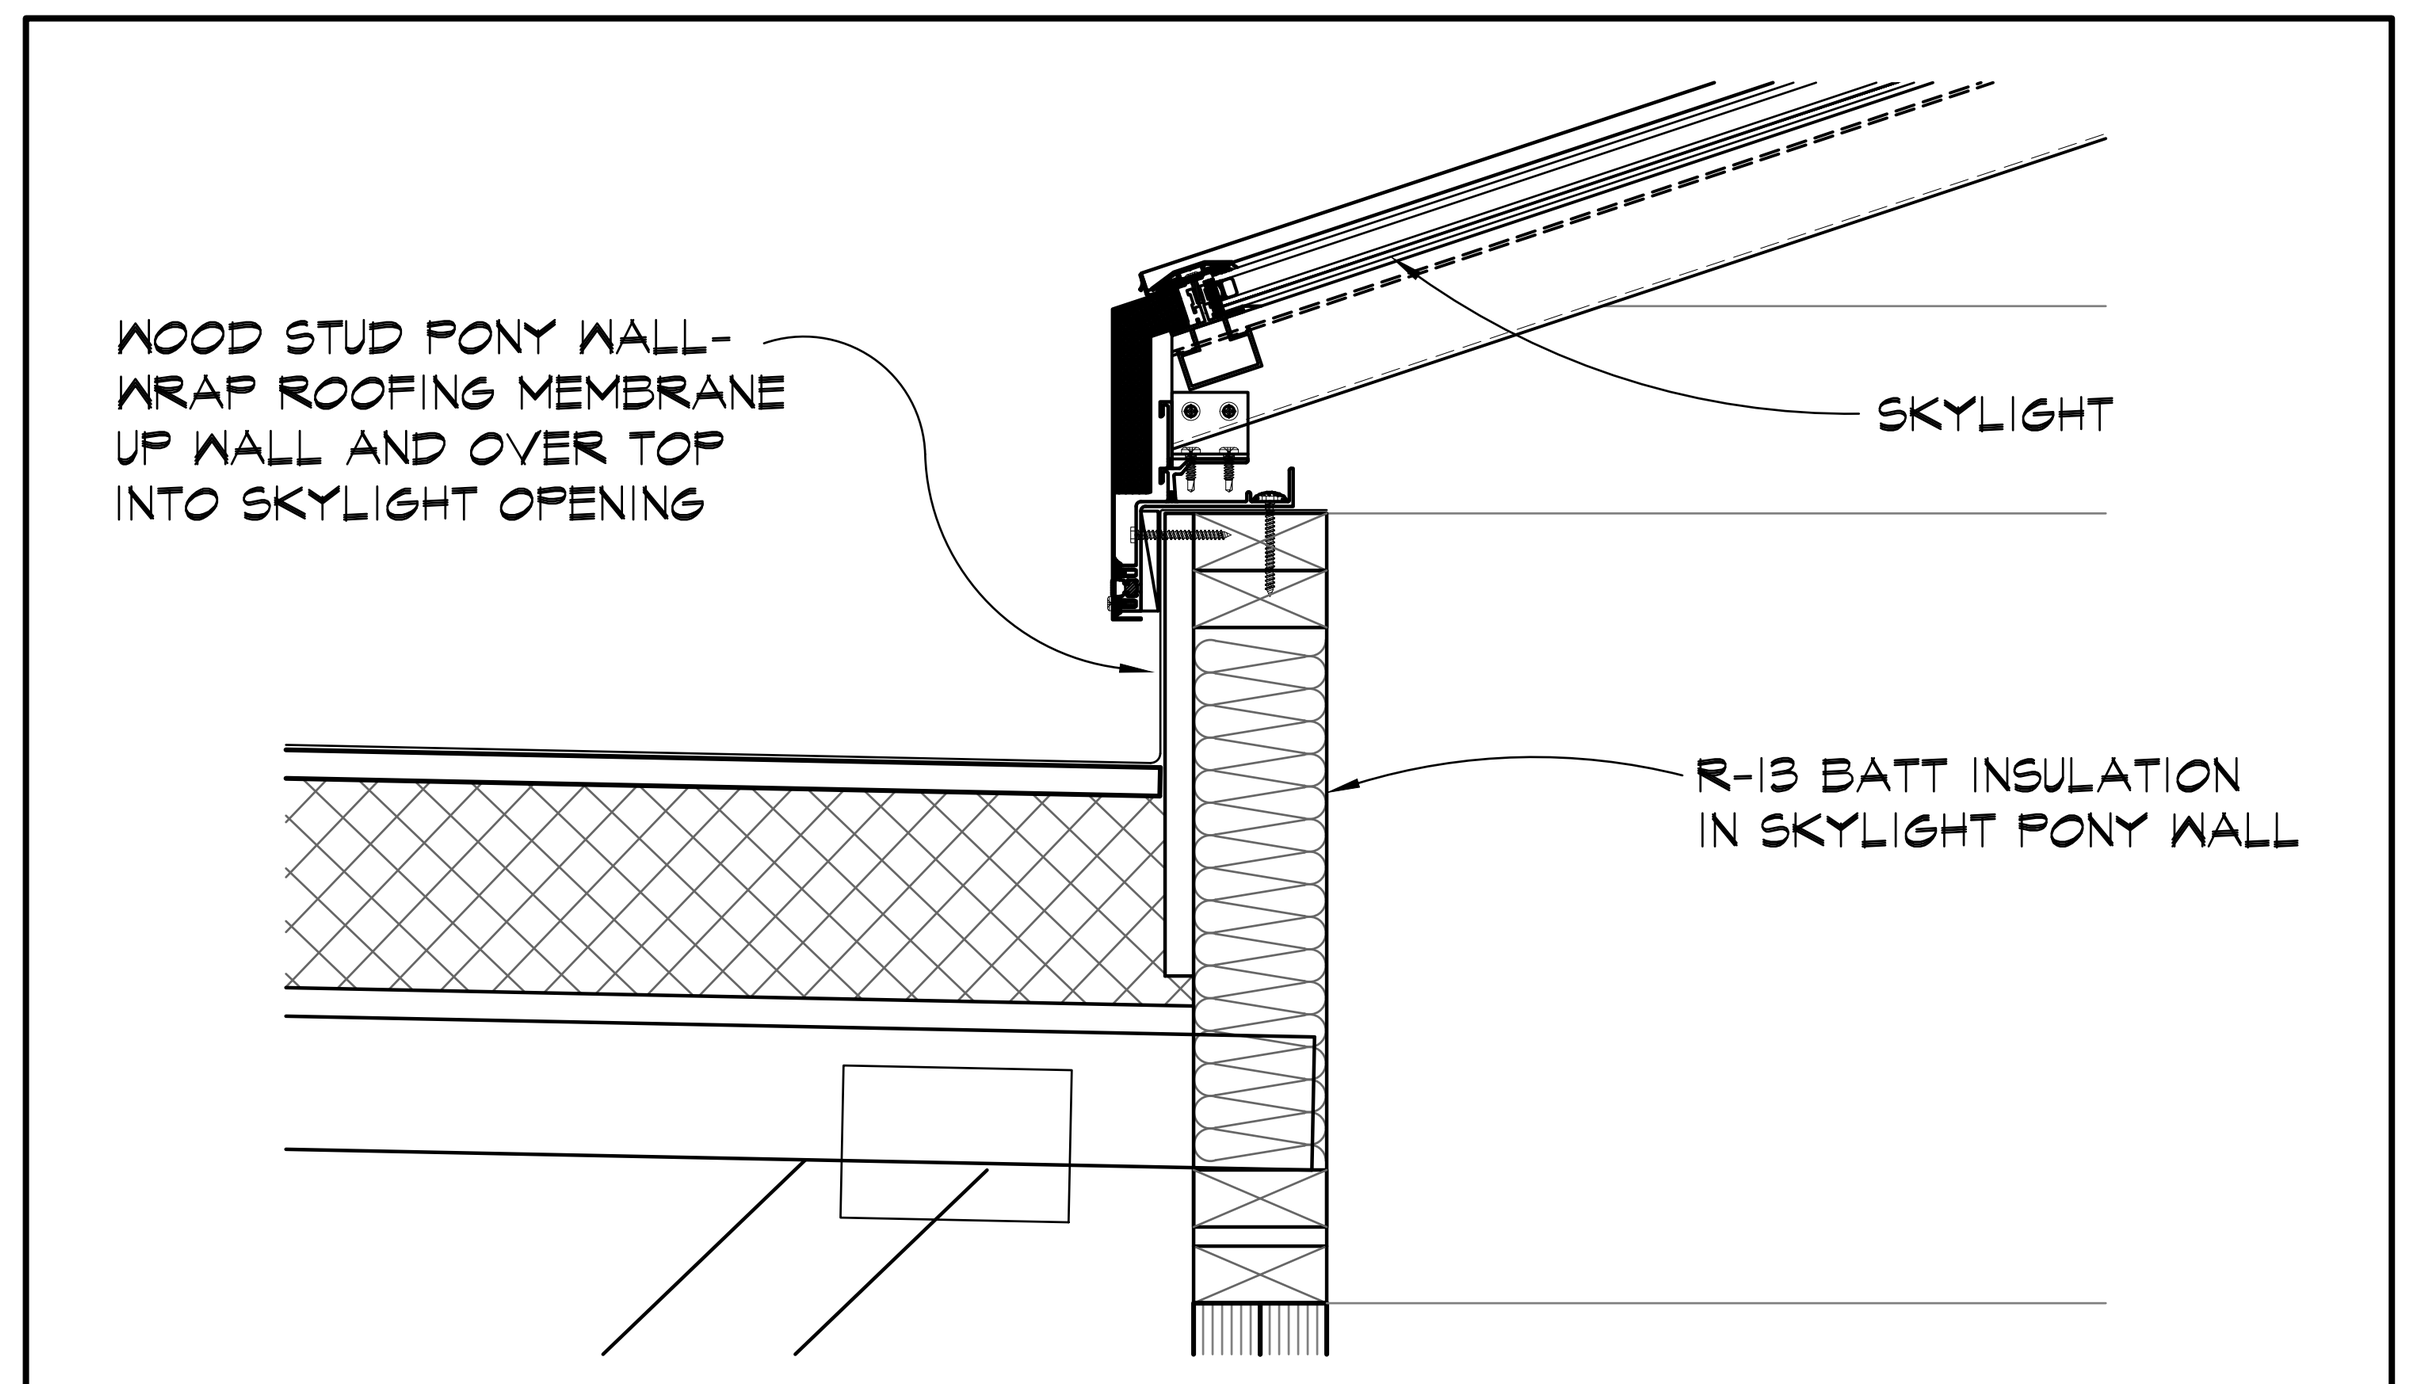

14 A5.1 **SECTION AT SKYLIGHT**
SCALE // 1 1/2" = 1'-0"

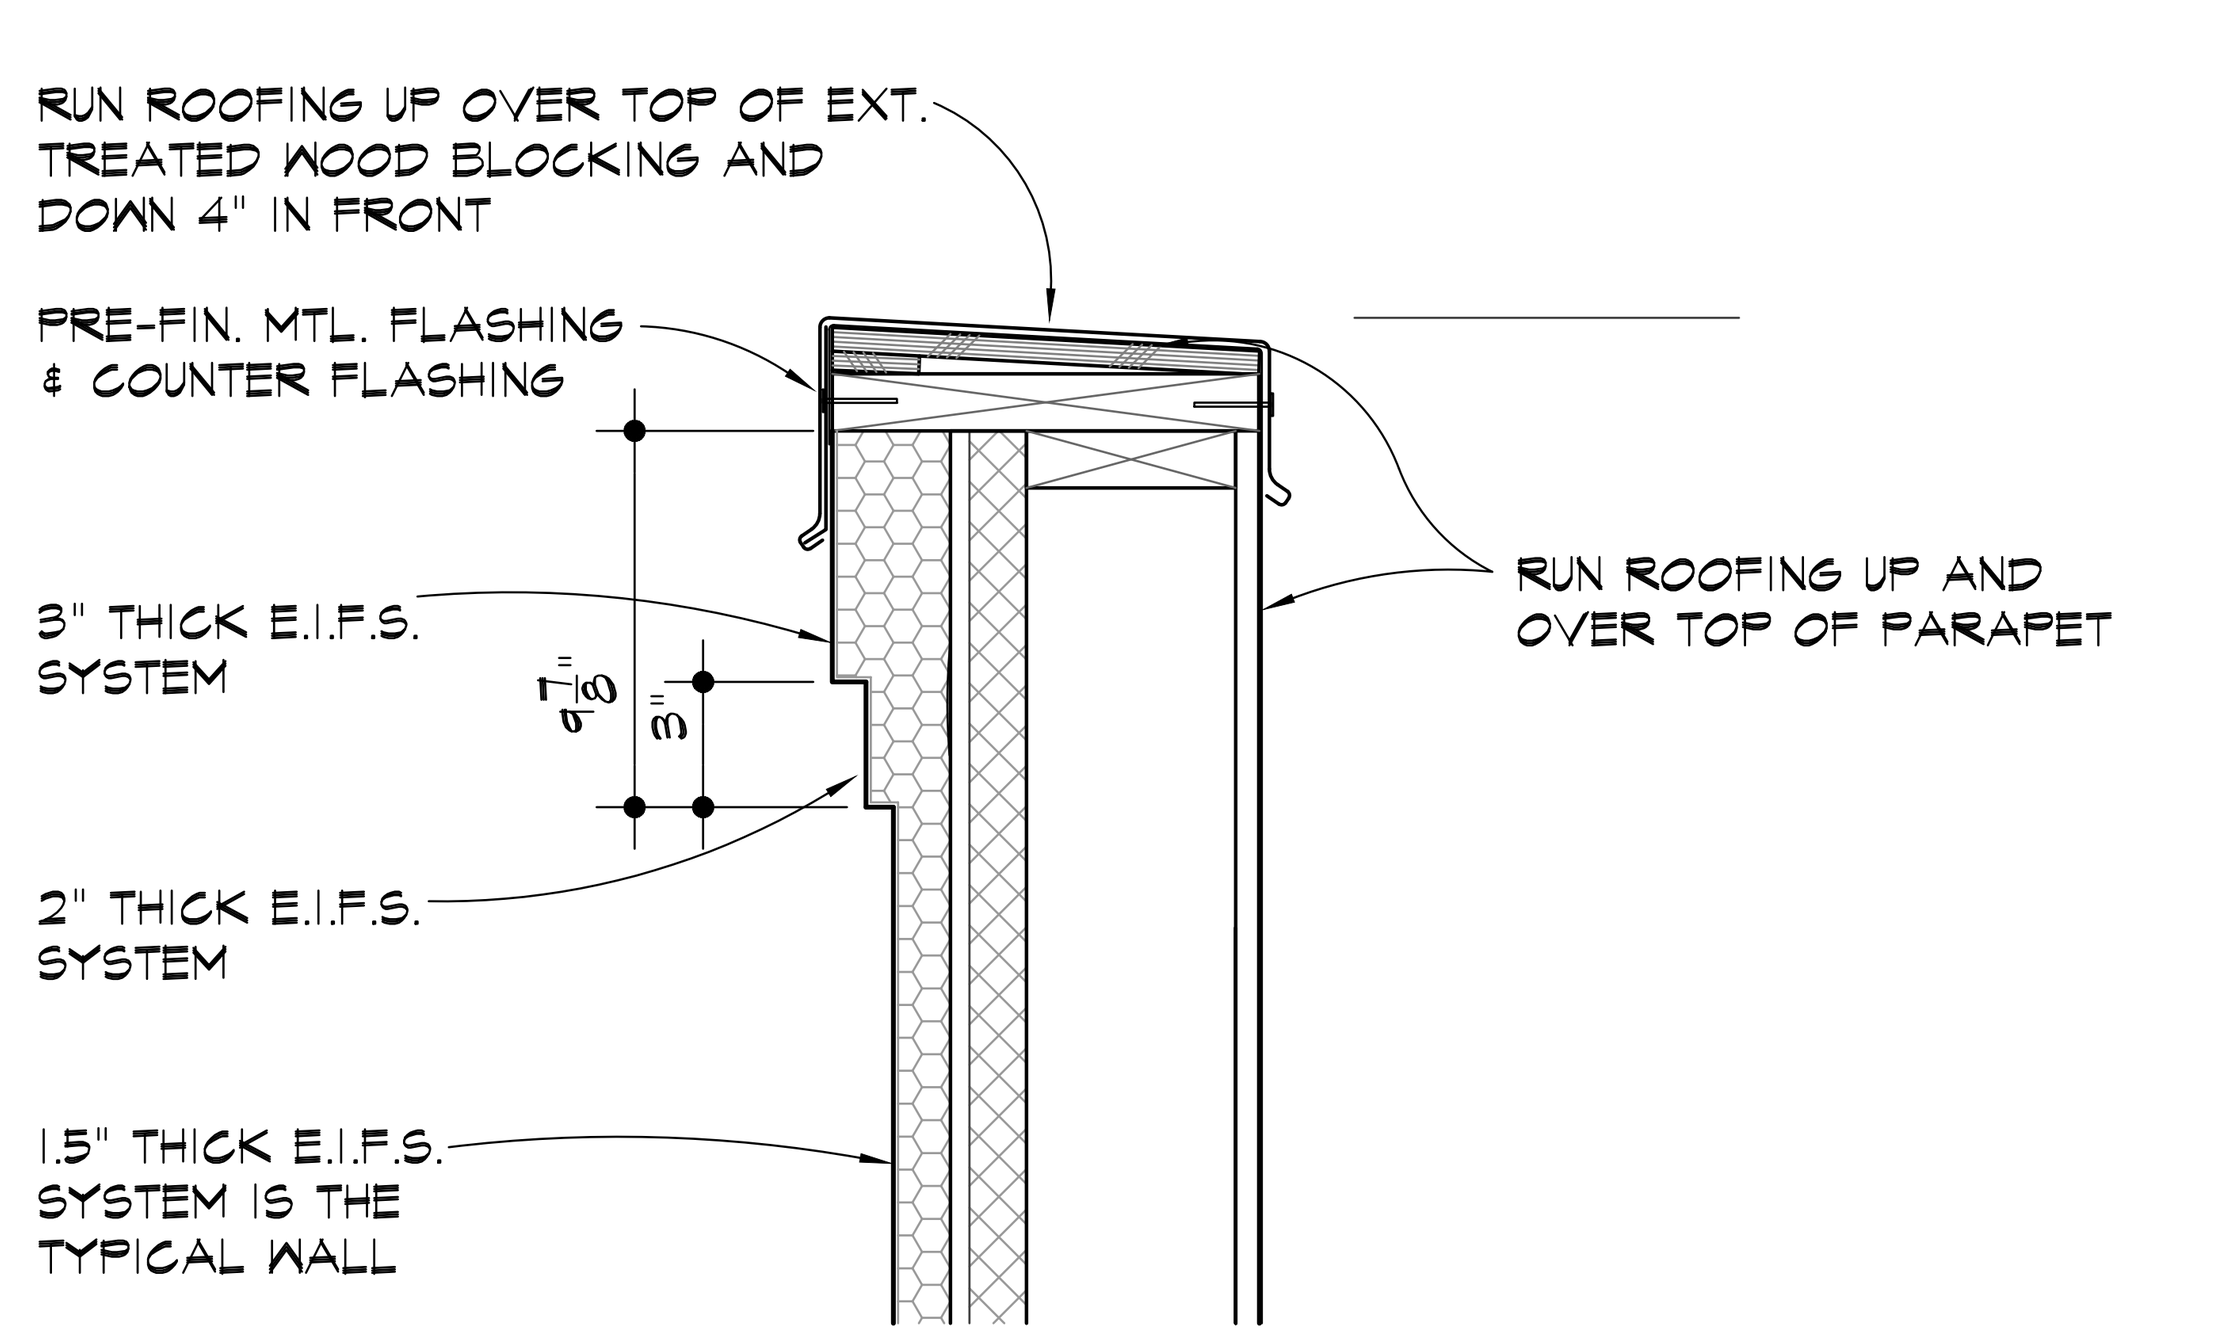

3 A5.1 **PARAPET DETAIL**
SCALE // 1 1/2" = 1'-0"

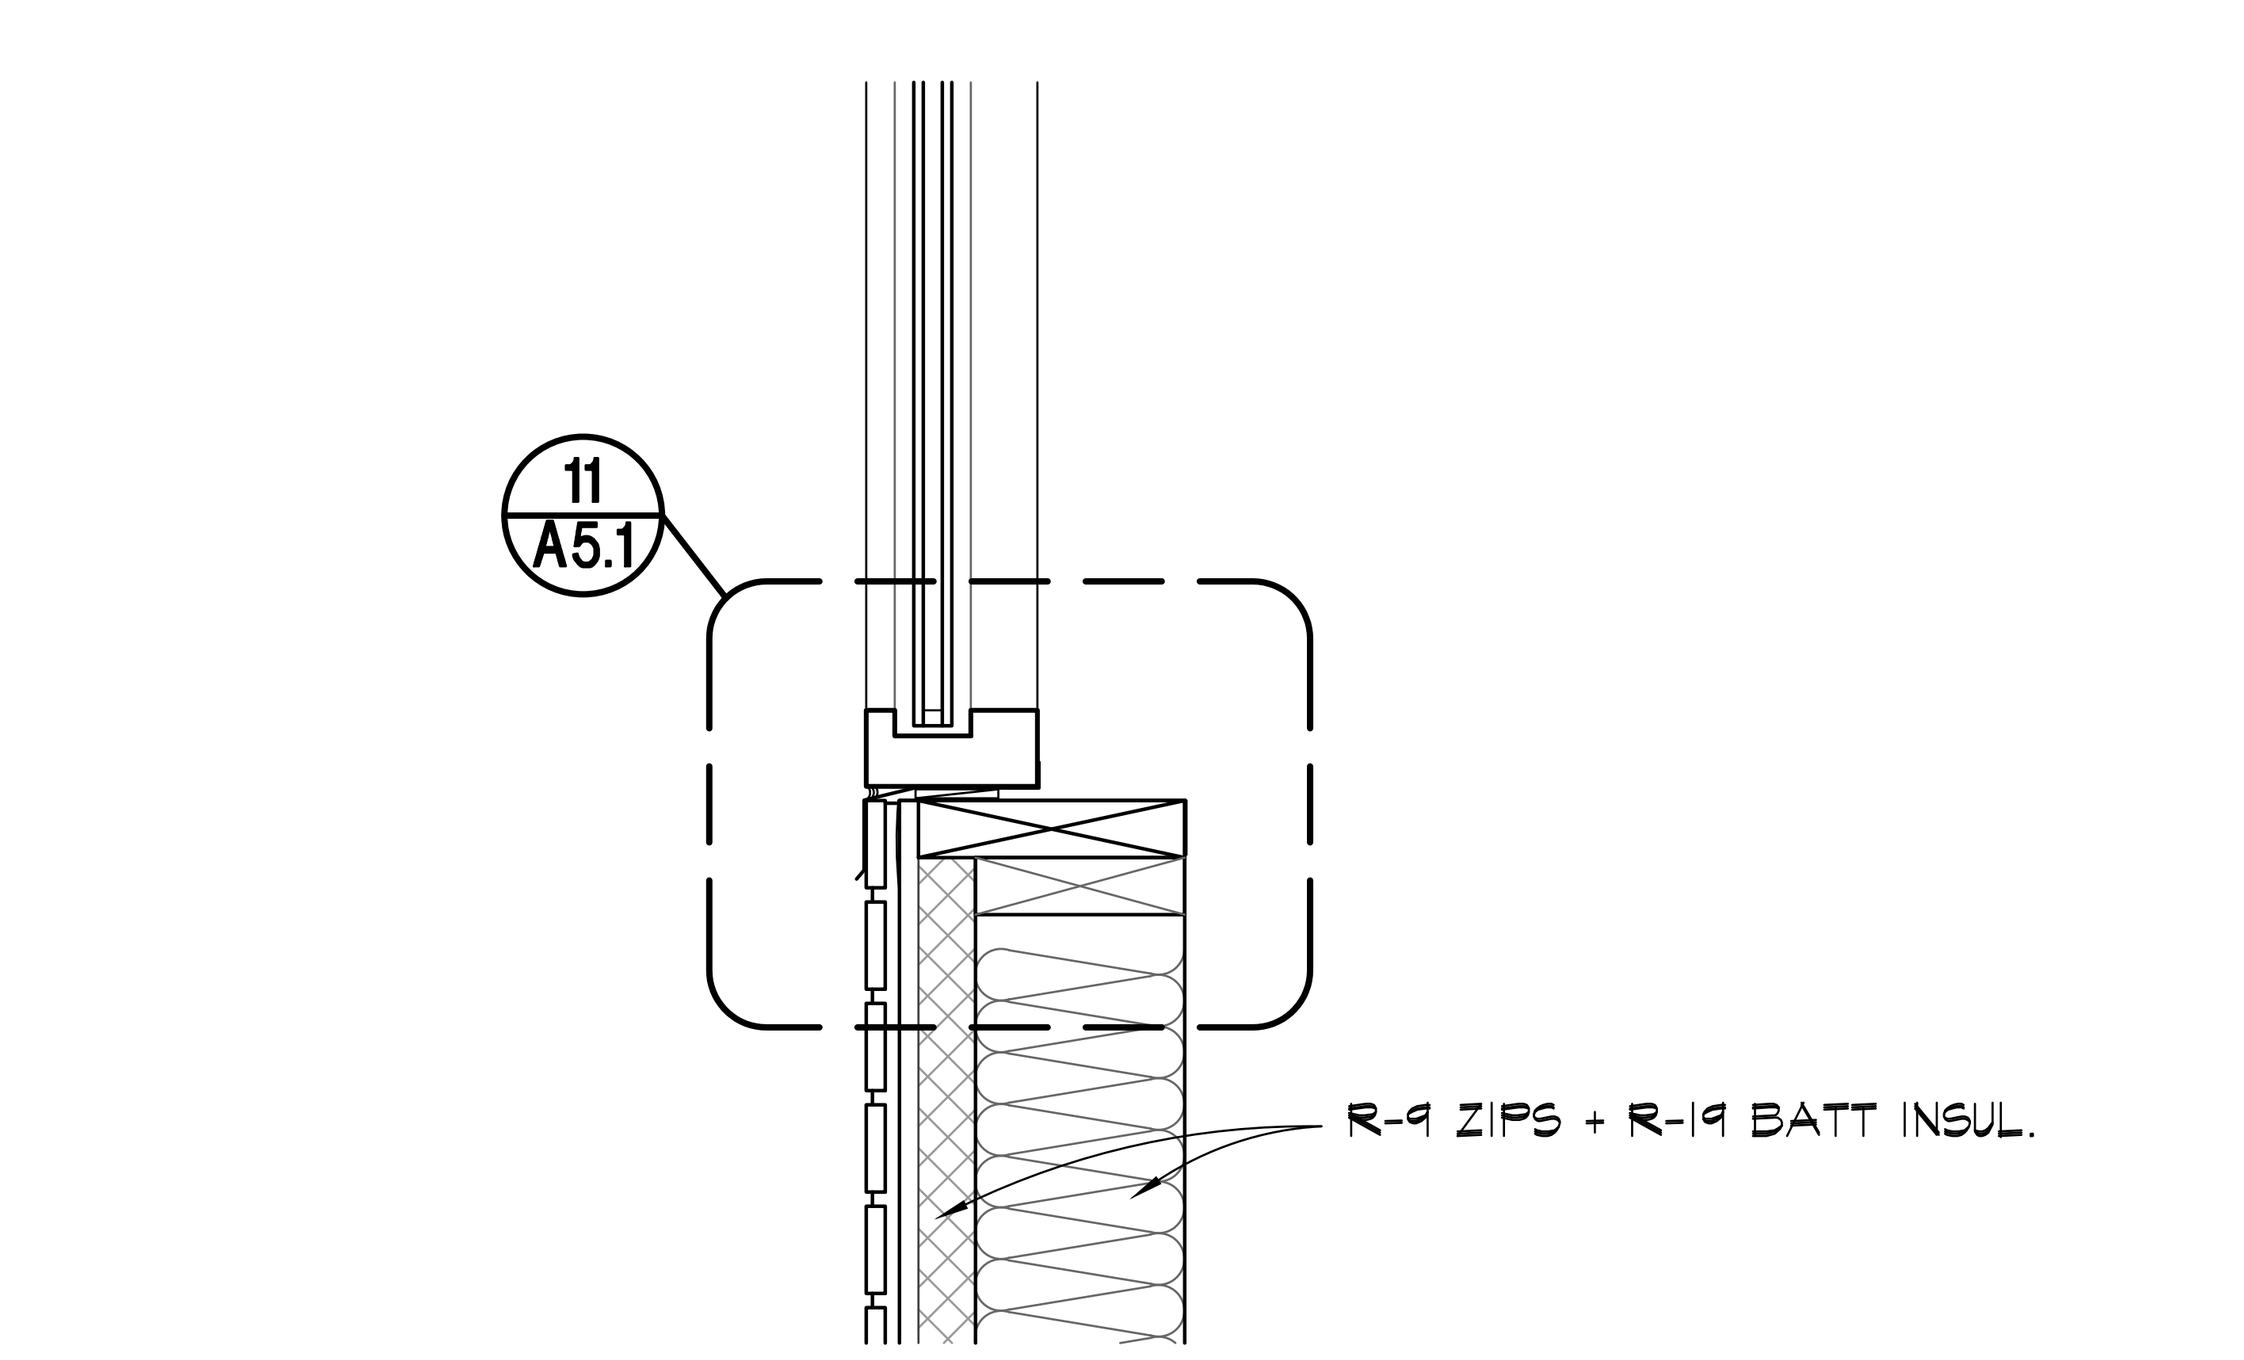

7 A5.1 **WINDOW SILL DETAIL**
SCALE // 1 1/2" = 1'-0"

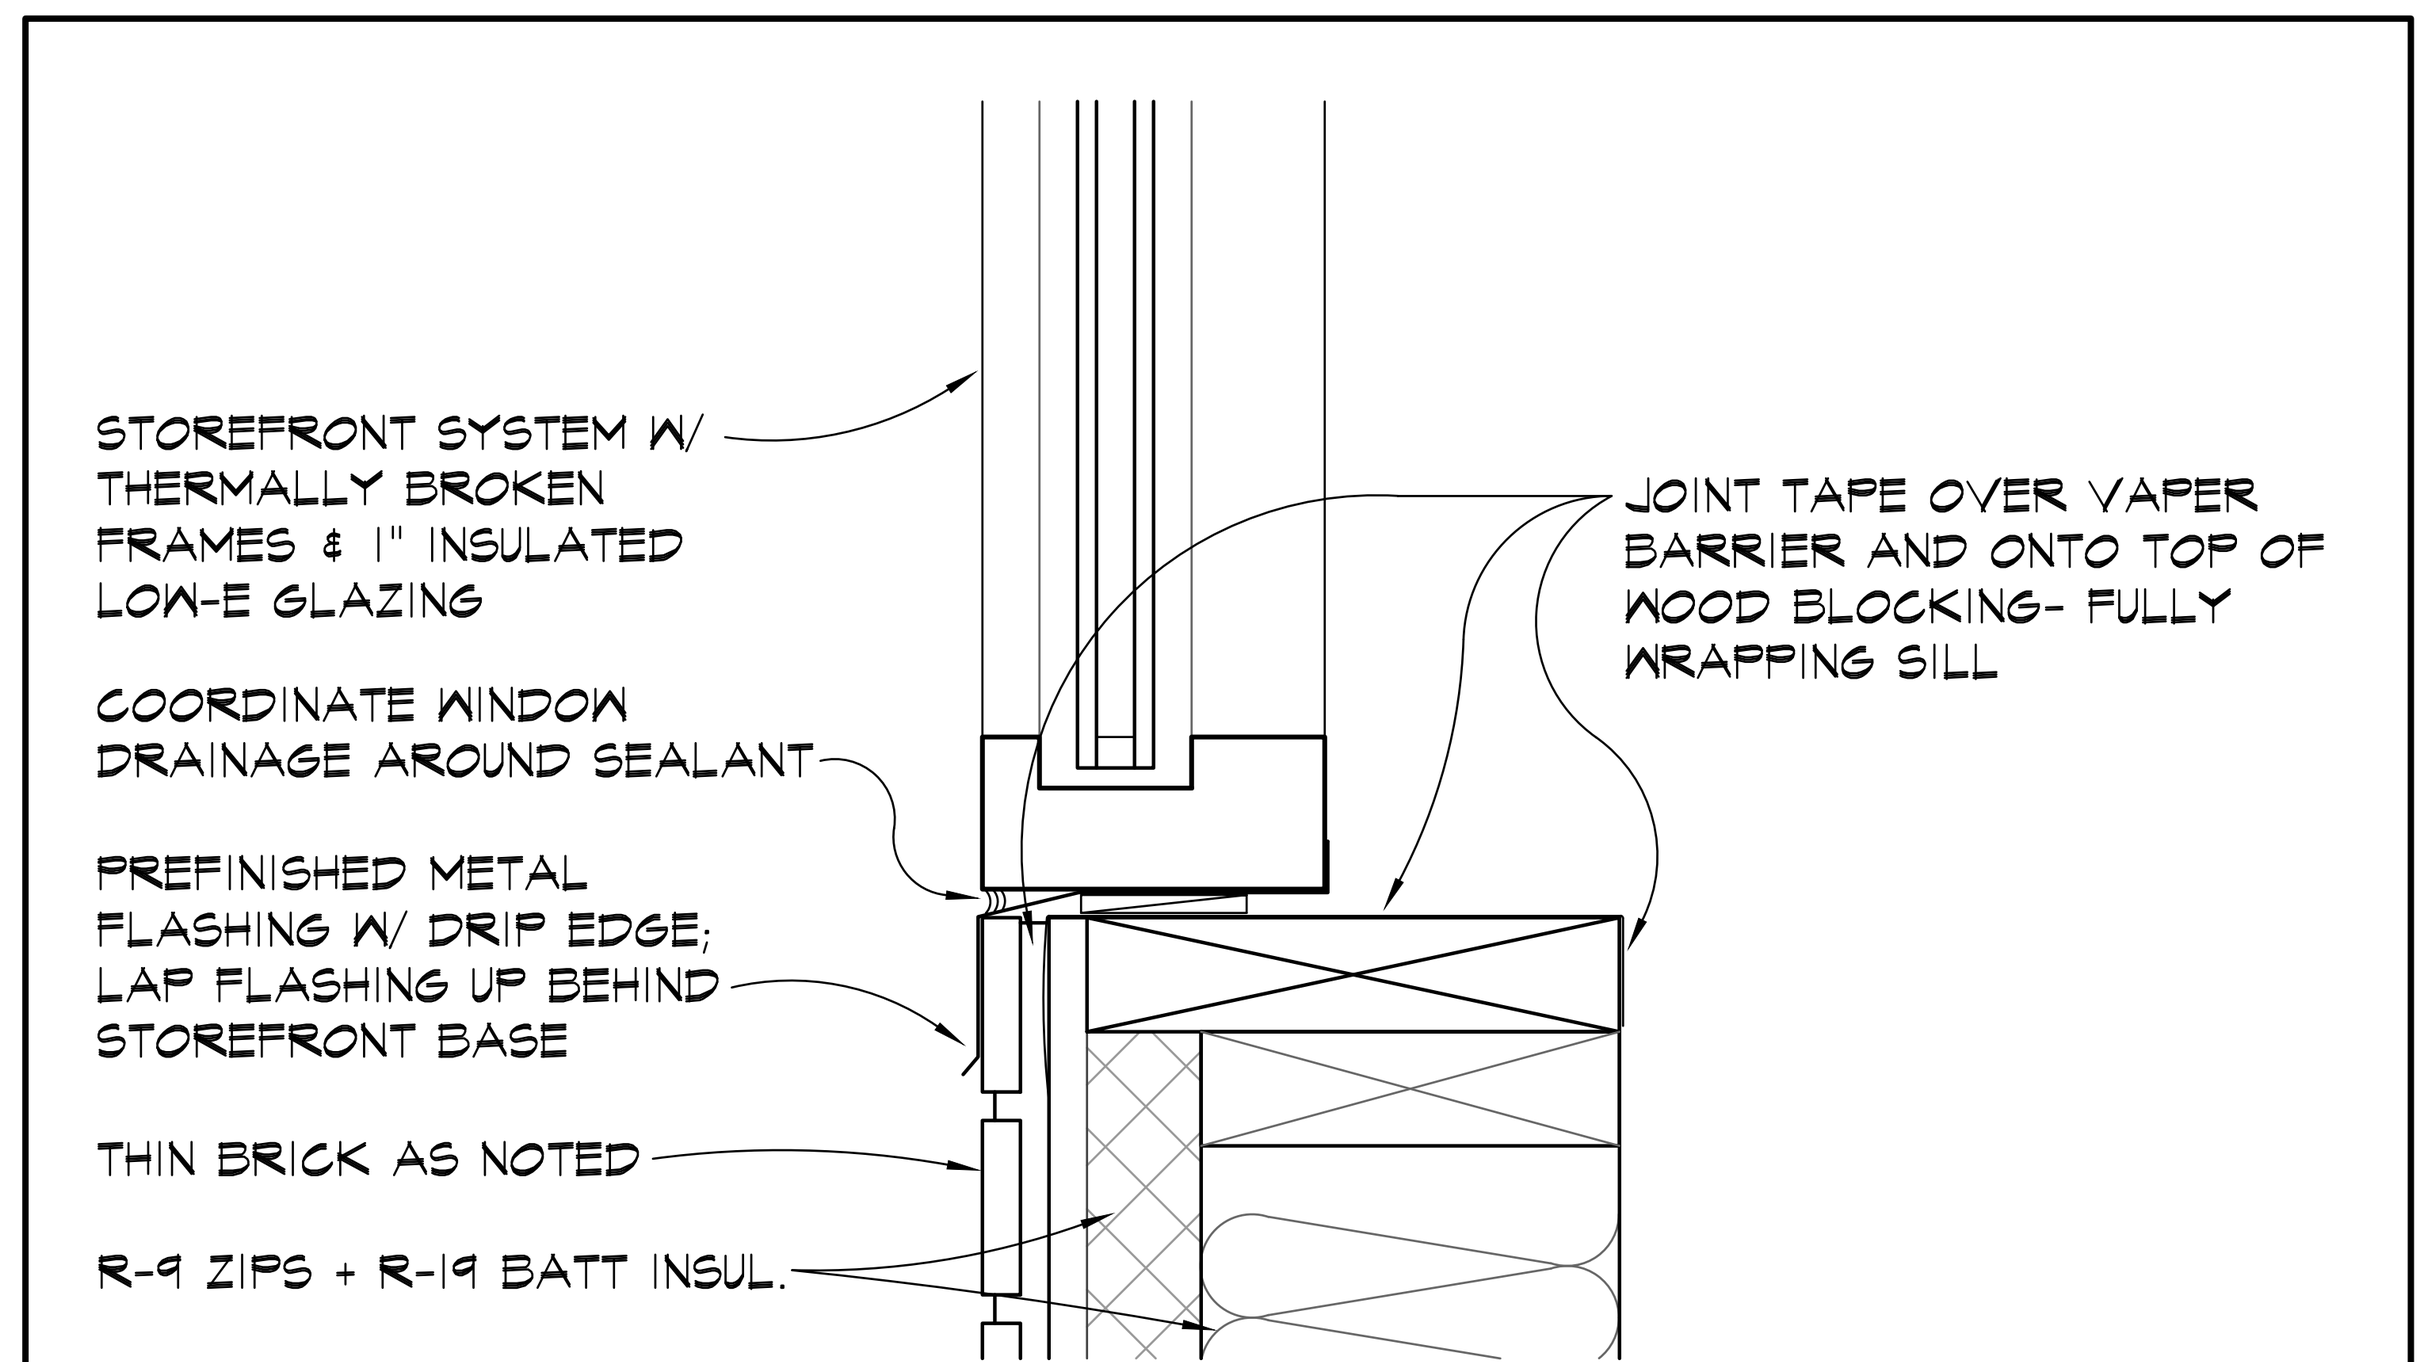

11 A5.1 **WINDOW SILL DETAIL**
SCALE // 3" = 1'-0"

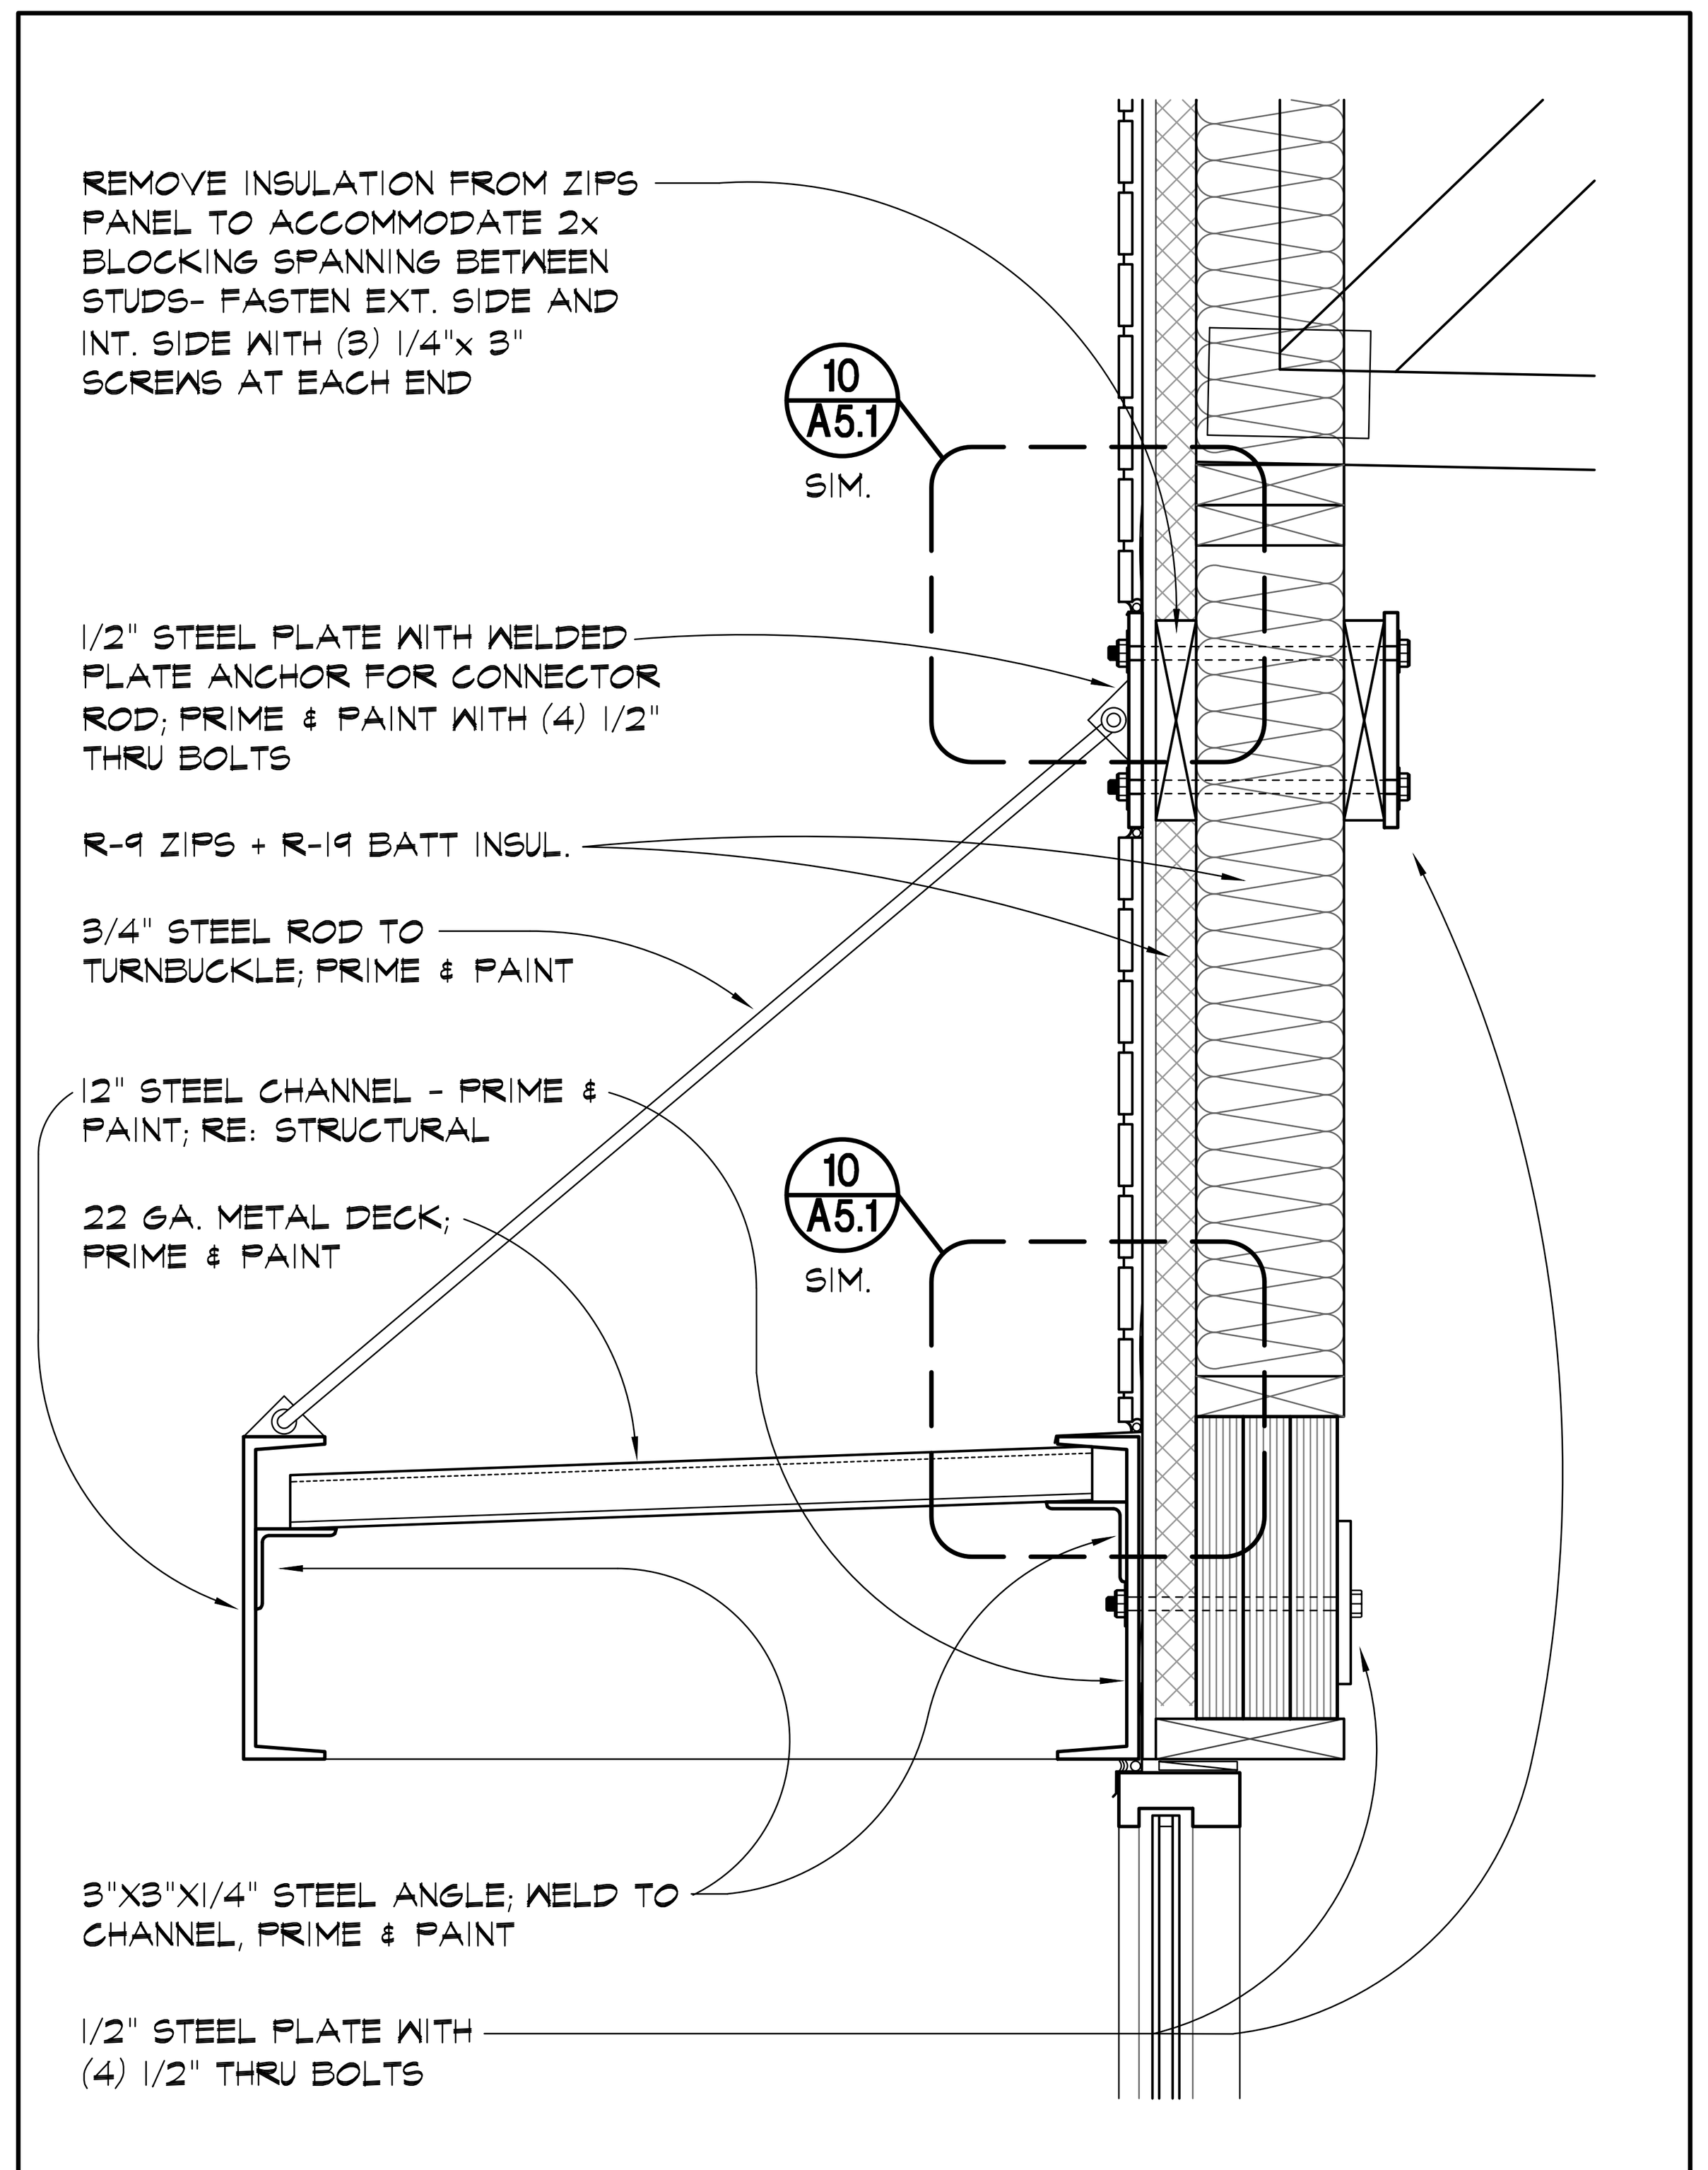

16 A5.1 **STEEL CANOPY DETAIL**
SCALE // 1 1/2" = 1'-0"

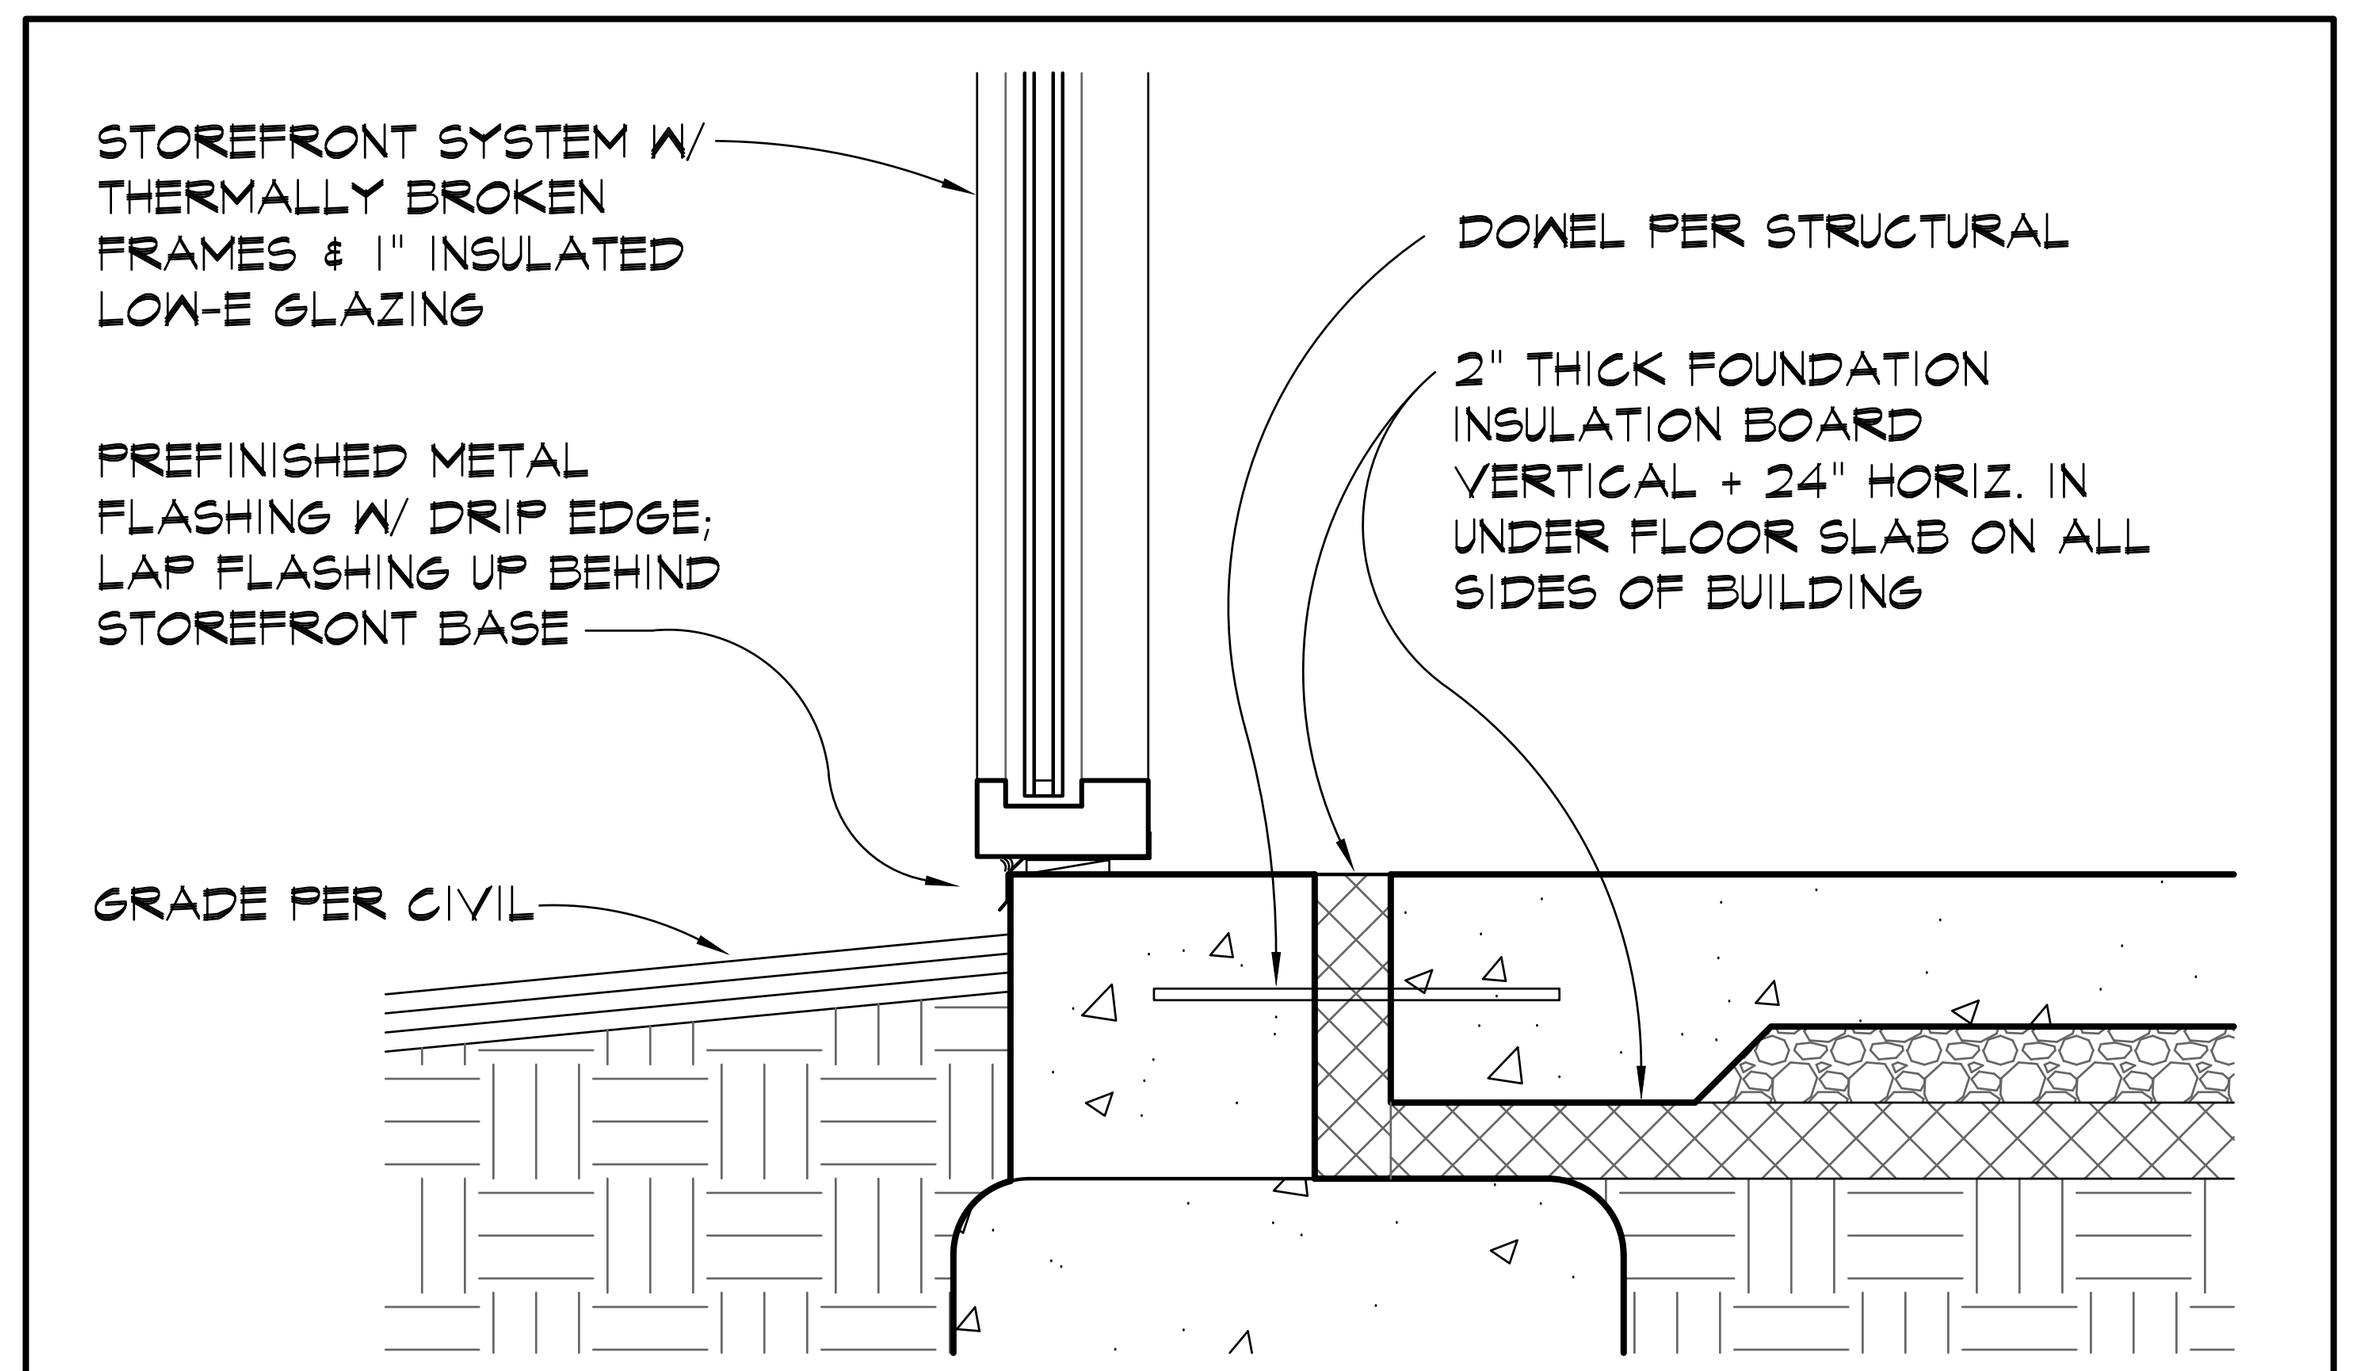

4 A5.1 **WINDOW BASE DETAIL**
SCALE // 1 1/2" = 1'-0"

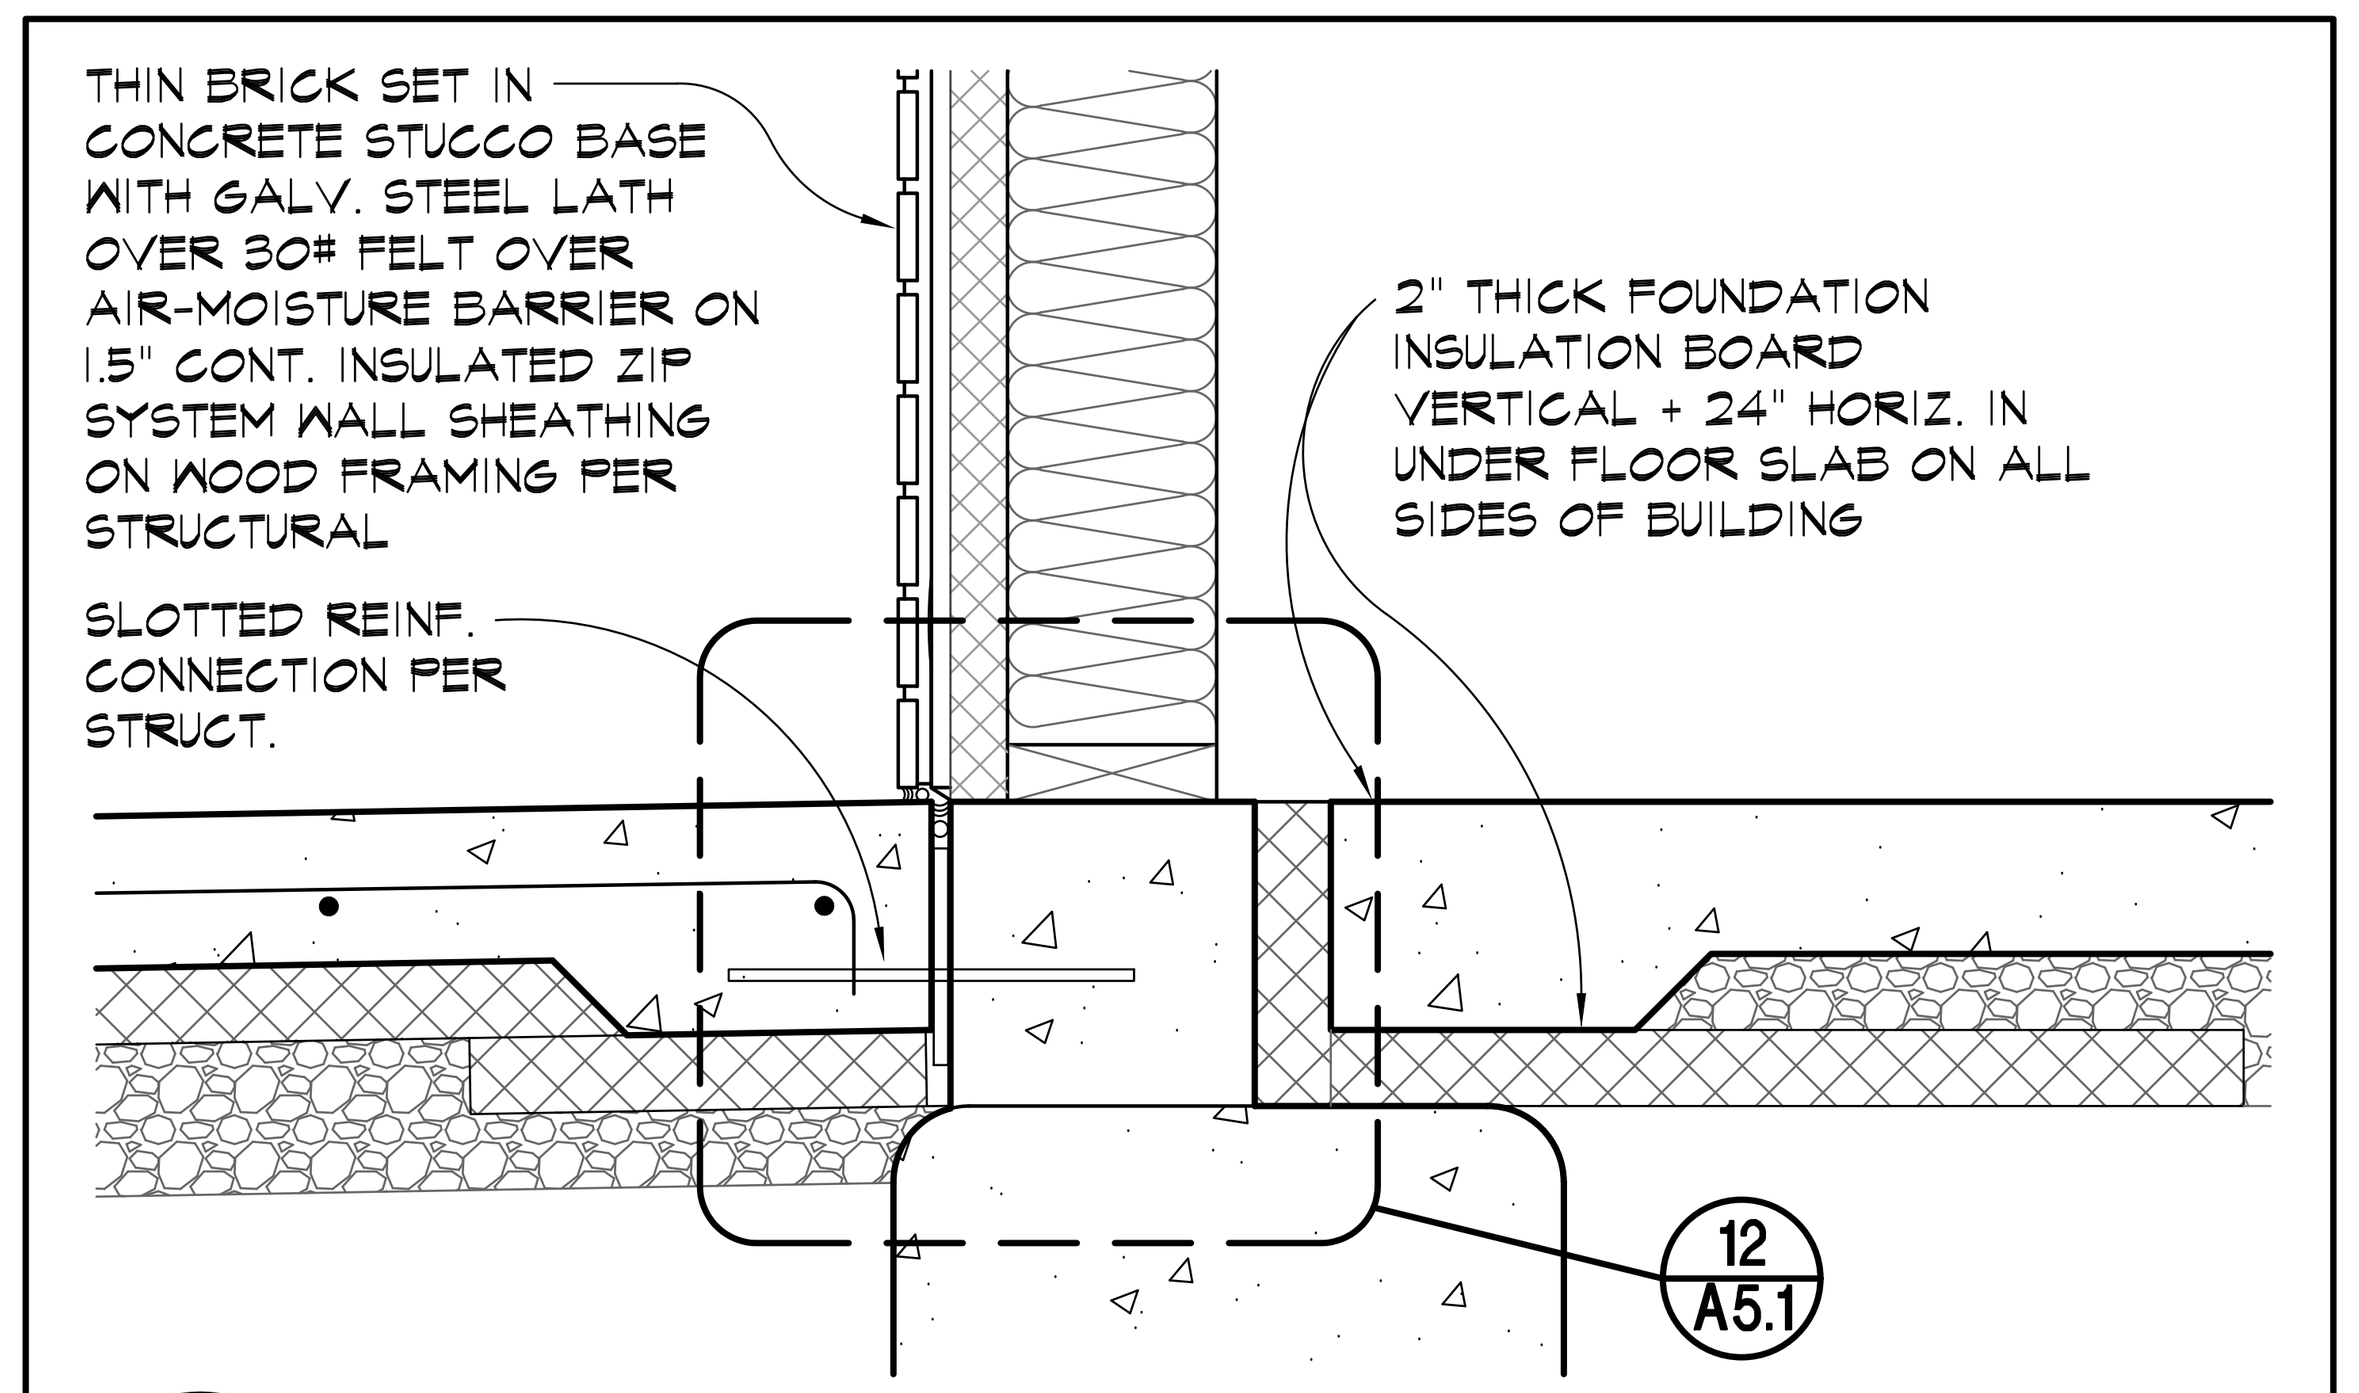

8 A5.1 **WALL BASE DETAIL**
SCALE // 1 1/2" = 1'-0"

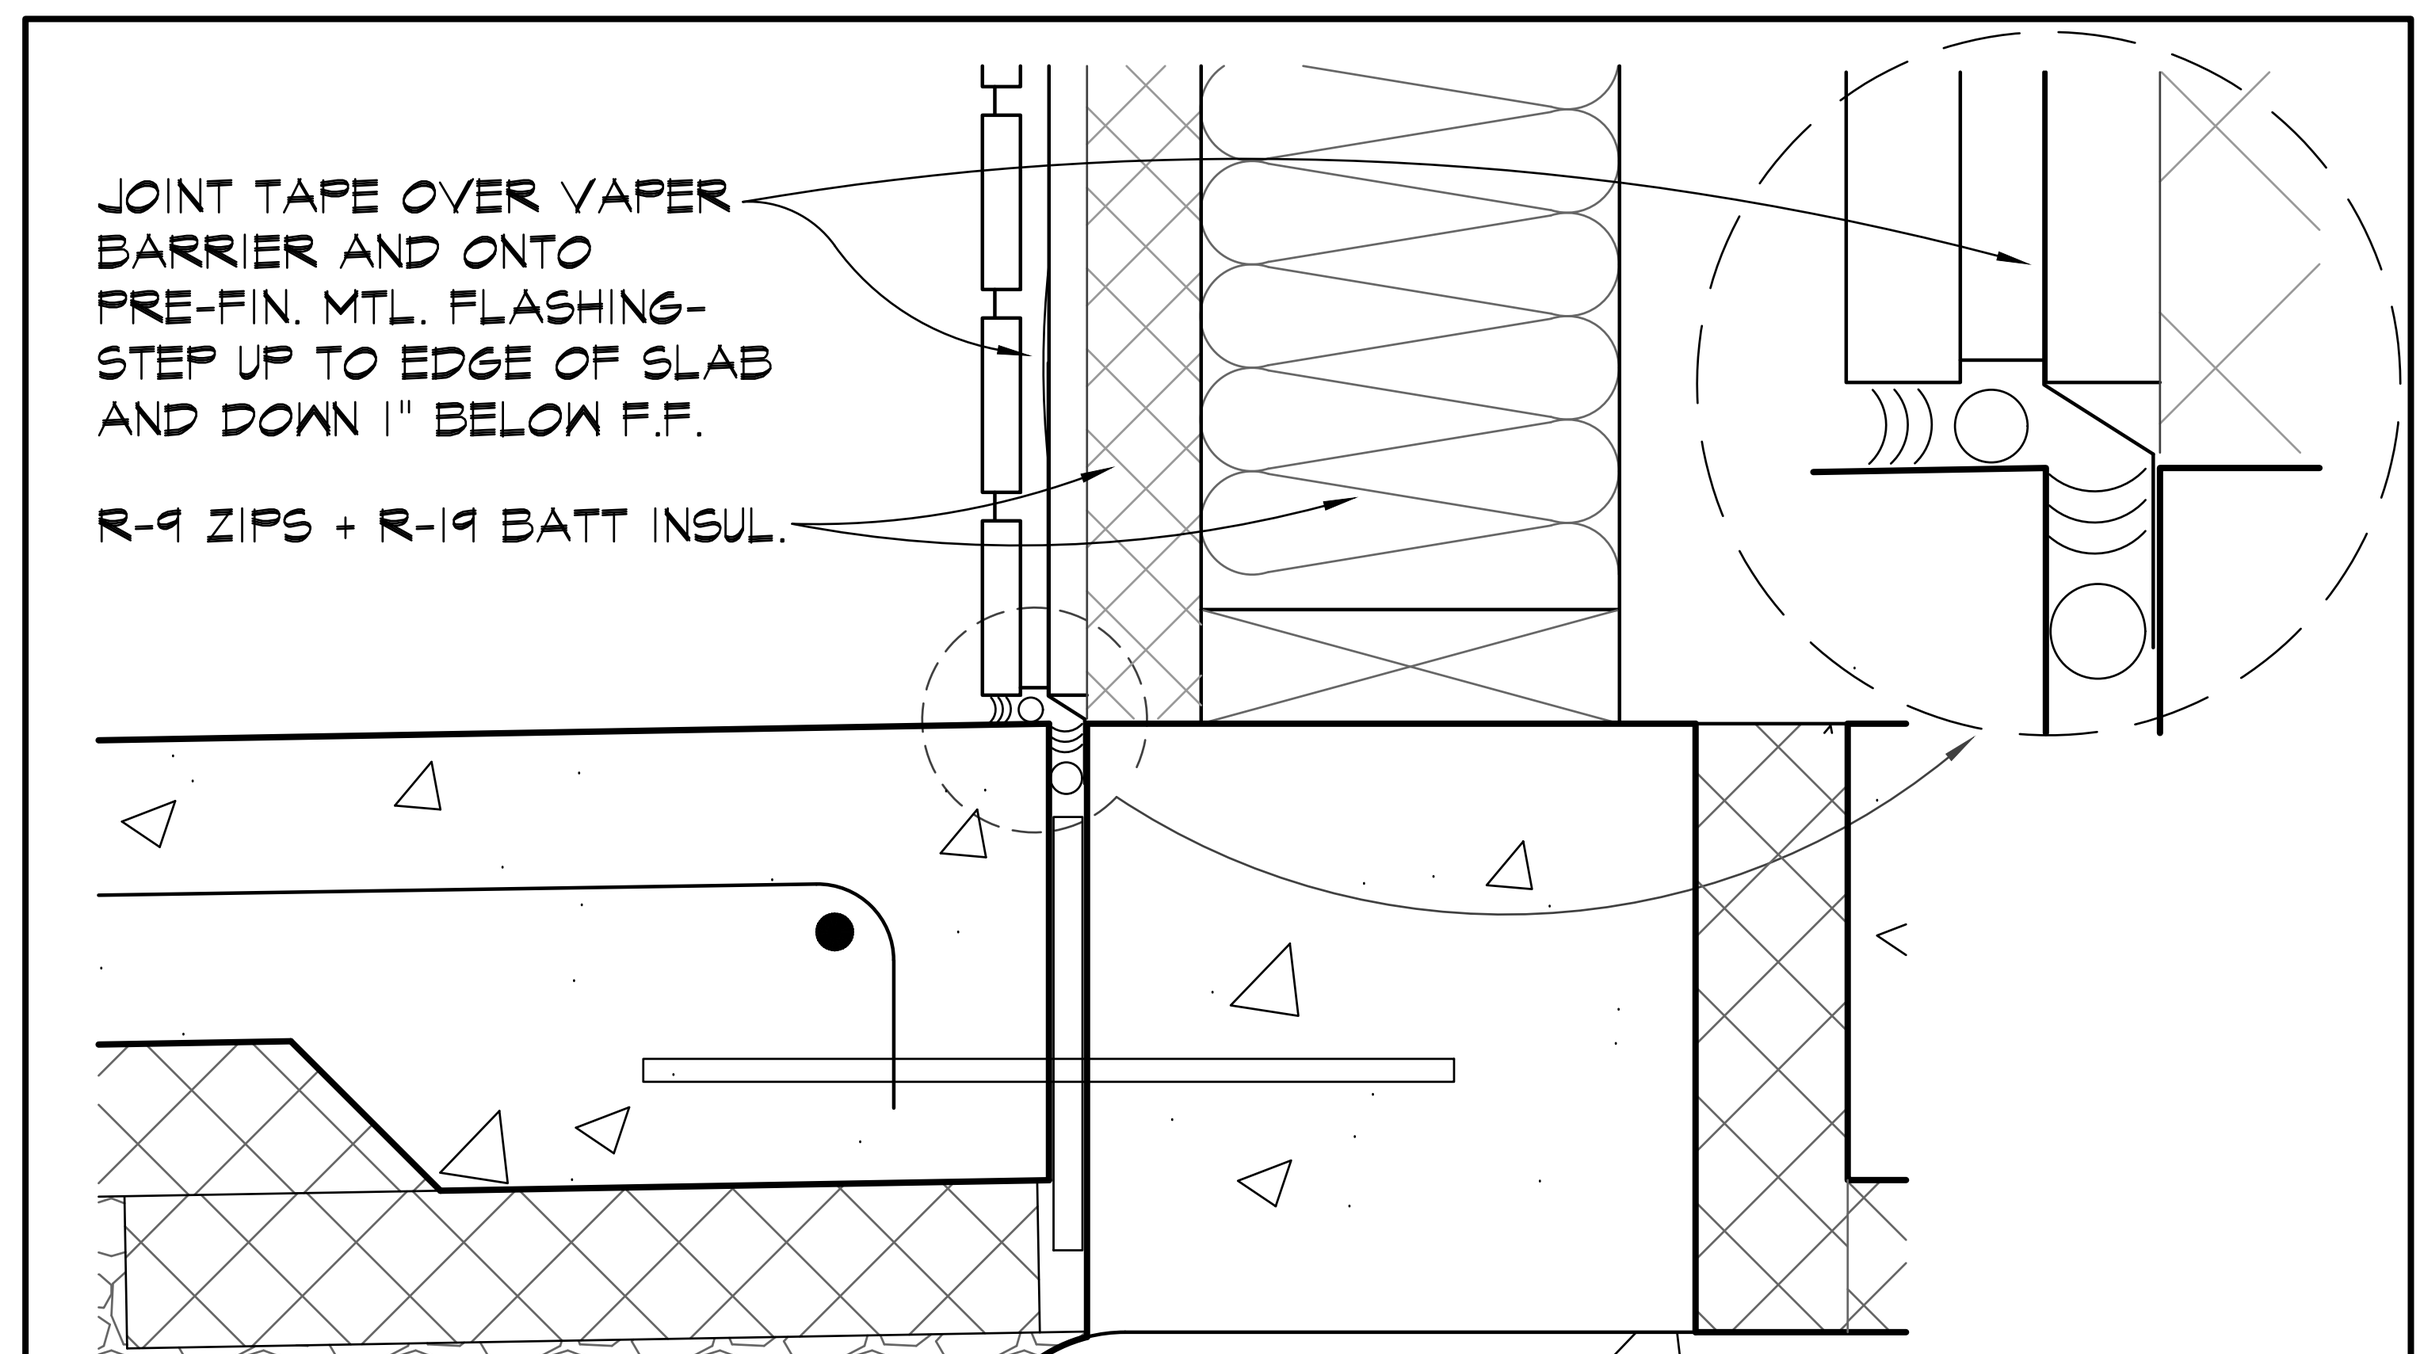

12 A5.1 **WALL BASE DETAIL**
SCALE // 3" = 1'-0"

DAVID A. KASTER LICENSED 3649 KANSAS PROFESSIONAL ARCHITECT
NOV. 24, 2025

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC
ARCHITECTURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center
Mr. D's DONUTS
14485 METCALF AVE.
OVERLAND PARK, KANSAS

DATE	NOV. 24, 2025
REVISED	
SHEET NUMBER	A5.1
OF SHEETS	

KAI JOB NO. 2506-C

03_Abbreviation Schedule	
Abbreviation	Abbreviation Name
+/-	PLUS OR MINUS
ADDNL	ADDITIONAL
ADJ	ADJACENT
AESS	ARCHITECTURALLY EXPOSED STRUCTURAL STEEL
AFF	ABOVE FINISHED FLOOR
ALT	ALTERNATE
AR	ANCHOR ROD
ARCH	ARCHITECT OR ARCHITECTURAL
B/	BOTTOM OF
B/W	BETWEEN
BLDG	BUILDING
BLKG	BLOCKING
BM	BEAM
BOT	BOTTOM
BRG	BEARING
BWP	BRACED WALL PANEL
CFS	COLD FORMED STEEL
CHKD	CHECKED
CIP	CAST IN PLACE
CJ	CONTROL JOINT
CJP	COMPLETE JOINT PENETRATION
CL	CENTERLINE
CLR	CLEAR
COL	COLUMN
CONC	CONCRETE
CONN	CONNECTION
CONT	CONTINUOUS
CTR	CENTER
db	DIA OF REINF BAR, DIA OF BOLT
DBA	DEFORMED BAR ANCHOR
DIA or Ø	DIAMETER
DIAG	DIAGONAL
DIR	DIRECTION
DWL	DOWEL
EA	EACH
EE	EXTENDED END
EJ	EXPANSION JOINT
ELEV	ELEVATION
EN	EDGE NAILING
ENGR	ENGINEER
EOD	EDGE OF DECK
EOS	EDGE OF SLAB
EQ	EQUAL
EW	EACH WAY
EXIST	EXISTING
EXT	EXTERIOR
FDN	FOUNDATION
FLG	FLANGE
FLR	FLOOR
FS	FAR SIDE
FTG	FOOTING
FV	FIELD VERIFY
GA	GAUGE
GALV	GALVANIZED
GB	GRADE BEAM
GC	GENERAL CONTRACTOR
HORIZ	HORIZONTAL
HSA	HEADED STUD ANCHOR
HSS	HOLLOW STRUCTURAL SECTION
IF	INSIDE FACE
INT	INTERIOR
JST	JOIST
K	KIPS (1000 LBS)
LCE	COMPRESSION EMBEDMENT LENGTH
LCS	COMPRESSION LAP SPLICE LENGTH
LLH	LONG LEG HORIZONTAL
LLV	LONG LEG VERTICAL
LSH	LONG SLOTTED HOLE
LTE	TENSION EMBEDMENT LENGTH
LTS	TENSION LAP SLICE LENGTH
LW	LIGHTWEIGHT
MFCR	MANUFACTURER
MTL	METAL
NIC	NOT IN CONTRACT
NS	NEAR SIDE
NTS	NOT TO SCALE
OC	ON CENTER
OF	OUTSIDE FACE
OPP	OPPOSITE
OVS	OVERSIZED
P/C	PRECAST
PAF	POWDER ACTUATED FASTENER
PAR	PARALLEL
PEMB	PRE-ENGINEERED METAL BUILDING
PEN	PENETRATION
PERP	PERPENDICULAR
PL	PLATE
PLF	POUNDS PER LINEAR FOOT
PREFAB	PREFABRICATED
PRELIM	PRELIMINARY
PSF	POUNDS PER SQUARE FOOT
PSI	POUNDS PER SQUARE INCH
RC	REINFORCED CONCRETE
RE:	REFER TO
REINF	REINFORCING
REQD	REQUIRED
RF	RIGID FRAME
SC	SLIP CRITICAL
SDS	SELF DRILLING SCREW
SIM	SIMILAR
SLV	SHORT LEG VERTICAL
SOG	SLAB ON GRADE
SQ	SQUARE
SS	STAINLESS STEEL
STD	STANDARD
STIR	STIRRUPS
STL	STEEL
SW	SHEAR WALL
SYM	SYMMETRIC
T&B	TOP AND BOTTOM
T/	TOP OF
TRANS	TRANSVERSE
TYP	TYPICAL
UNO	UNLESS NOTED OTHERWISE
VERT	VERTICAL
W/	WITH
W/O	WITHOUT
WF	WIDE FLANGE
WP	WORK POINT
WWR	WELDED WIRE REINFORCEMENT

STRUCTURAL DESIGN CRITERIA (2018 IBC AND ASCE 7-16):

1. BUILDING OCCUPANCY RISK CATEGORY II

2. LIVE LOADS [UNIFORM (PSF) / POINT LOADS (KIPS)]:
– ROOF:..20 PSF / 300#
– GROUND LEVEL SLAB ....100 PSF / 2.0 K

3. ROOF SNOW LOAD:
– GROUND SNOW LOAD (Pg):............................20 PSF
– FLAT ROOF SNOW LOAD (Pf): ....15.4 PSF + DRIFT PER PLAN
16.8 PSF + DRIFT (PATIO ROOF)
– MIN UNIFORM ROOF SNOW LOAD (Pm)...........20 PSF (NO DRIFT OR RAIN)
– RAIN ON SNOW SURCHARGE (Prs) ....5.0 PSF
– SNOW EXPOSURE FACTOR (Ce):.......................1.0, EXPOSURE C
– SNOW LOAD IMPORTANCE FACTOR (Is):..........1.0
– THERMAL FACTOR (Ct):.................................1.1 (just above freezing)
– SLOPE FACTOR (CS).......................................1.0 (for ¼ per foot roofs)

4. WIND DESIGN DATA:
– BASIC WIND SPEED (3 SEC GUST):..................115 MPH
– WIND EXPOSURE:..C
– GROUND ELEVATION ABOVE SEA LEVEL........1,000 FT
– DIRECTIONALITY FACTOR (Kd) 0.85
– INTERNAL PRESSURE COEFF:.........................0.18
– COMPONENTS AND CLADDING WIND (ULTIMATE 1.0"W) PRESSURES (BASED ON TRIB 10 S.F., EXP. C. MAY BE REDUCED FOR COMPONENTS WITH LARGER TRIB PER BLDG CODE):

ROOF COMP & CLADDING PRESSURES		
ZONE	PRES (+ve)(psf)	PRES (-ve)(psf)
INT	16	-45
EDGE	26	-60

EDGE ZONE = 10'-0" WIDE

WALL COMP & CLADDING PRESSURES		
ZONE	PRES (+ve)(psf)	PRES (-ve)(psf)
INT	26	-28
CORNER	26	-35
87 PSF (WINDWARD PARAPET)		
61 PSF (LEEWARD PARAPET)		

CORNER ZONE = 4'-3" WIDE

NOTE: COMPONENTS AND CLADDING WIND (ULTIMATE 1.0"W) PRESSURES (BASED ON TRIB 10 S.F., EXP. C. MAY BE REDUCED FOR COMPONENTS WITH LARGER TRIB PER BLDG CODE)

5. EARTHQUAKE DESIGN DATA:
– SEISMIC IMPORTANCE FACTOR (Ie):..............1.0
– MAPPED SPECTRAL RESP ACCEL (Ss / S1):.....0.097 / 0.069
– SITE CLASS:...C
– SPECTRAL RESPONSE COEFF (Sds / Sd1):.......0.084 / 0.07
– SEISMIC DESIGN CATEGORY:........................A

6. RAIN LOAD DATA:
– 15-MIN RAIN INTENSITY...................................7.56 IN/HR
– 60-MIN RAIN INTENSITY....................................3.63 IN/HR
DESIGN ASSUMES APPROPRIATE ROOF SLOPE AND DRAINAGE (INCLUDING OVERFLOWS) ARE PROVIDED. ROOF IS DESIGNED FOR LIVE LOAD INDICATED ABOVE

7. GUARD RAILS:...50 PLF, AND/OR 200# CONCENTRATED LOAD APPLIED IN ANY DIRECTION.

STRUCTURAL GENERAL NOTES:

1. DESIGN AND CONSTRUCTION SHALL CONFORM TO THE "INTERNATIONAL BUILDING CODE, 2018 EDITION" AS AMENDED BY THE CITY OF OVERLAND PARK, KS. REFER TO THE SPECIAL STRUCTURAL INSPECTION NOTES FOR ADDITIONAL REQUIREMENTS.

2. CONTRACTOR TO VERIFY ALL DIMENSIONS, ELEVATIONS AND EXISTING CONDITIONS AND REPORT ANY DISCREPANCIES TO THE ARCHITECT PRIOR TO COMMENCING WORK.

3. IF DISCREPANCIES EXIST BETWEEN STRUCTURAL PLANS, ARCHITECTURAL PLANS, OTHER PLANS, OR SPECIFICATIONS, THE CONTRACTOR OR SUBCONTRACTOR SHALL PROVIDE A WRITTEN REQUEST FOR CLARIFICATION FROM THE ARCHITECT AND/OR ENGINEER PRIOR TO PROCEEDING WITH THE WORK.

4. THE STRUCTURE IS DESIGNED TO BE SELF-SUPPORTING AND STABLE AFTER THE BUILDING IS FULLY COMPLETED. IT IS SOLELY THE CONTRACTOR'S RESPONSIBILITY TO EXECUTE AND DETERMINE FINAL ERECTION PROCEDURES, SEQUENCING AND TO ENSURE THE SAFETY OF THE BUILDING AND ITS COMPONENT PARTS DURING ERECTION. THIS INCLUDES WHATEVER SHORING, SHEETING, TEMPORARY BRACING, GUYING OR TIE DOWNS WHICH MIGHT BE NECESSARY.

5. THE STRUCTURE AND FOUNDATIONS ARE NOT DESIGNED FOR FUTURE EXPANSION.

6. FABRICATORS AND SUPPLIERS SHALL CLEARLY NOTE AND HIGHLIGHT CHANGES MADE IN SHOP DRAWINGS, WHICH DO NOT COMPLY WITH THE CONTRACT DOCUMENTS.

7. COLUMNS, BEAMS, JOISTS, OR TRUSSES SHALL NOT BE FIELD CUT OR TRIMMED FOR ANY REASON WITHOUT THE WRITTEN APPROVAL OF THE ARCHITECT/ENGINEER.

8. HOLES, PIPES, SLEEVES, ETC. NOT SHOWN ON THE DRAWINGS MUST BE REVIEWED BY THE ARCHITECT/ENGINEER BEFORE PLACEMENT THROUGH STRUCTURAL MEMBERS.

9. IF MECHANICAL AND ELECTRICAL EQUIPMENT SIZES, WEIGHTS, OR LOCATIONS DO NOT COINCIDE WITH EQUIPMENT SHOWN ON THE PLANS, COORDINATE ADJUSTMENTS WITH THE ARCHITECT.

10. NO AREA OF THE STRUCTURE SHALL BE LOADED WITH CONSTRUCTION MATERIALS OR EQUIPMENT THAT EXCEEDS FINAL DESIGN CRITERIA.

11. BEAMS, COLUMNS, WALLS AND FOOTING CENTERS SHALL BE CENTERED UNDER SUPPORTING MEMBERS (TYPICAL UNLESS NOTED OTHERWISE).

12. DELEGATED DESIGN - DEFERRED SUBMITTALS SHALL BE SIGNED/ SEALED PRIOR TO SUBMITTAL FOR REVIEW. THESE INCLUDE:
A. WOOD ROOF TRUSSES
B. PRE-ENGINEERED CANOPIES
C. STEEL CONNECTIONS
D. RAILINGS

SUBMIT THESE SHOP DRAWINGS AND CALCULATIONS SEALED BY A STRUCTURAL ENGINEER LICENSED TO PRACTICE IN THE JURISDICTION OF THE PROJECT SHALL BE FURNISHED TO THE ENGINEER OF RECORD FOR REVIEW. CONTRACTOR SHALL SUBMIT COPIES OF DEFERRED SUBMITTALS TO BUILDING DEPARTMENT AFTER ARCH/ENG REVIEW.

13. TYPICAL DETAILS ARE SHOWN ON SHEETS DESIGNATED "S0XX". THE INCLUDED TYPICAL DETAILS MAY OR MAY NOT BE CUT / REFERENCED ON PLANS OR SECTIONS, BUT ARE TO BE USED AS APPLICABLE.

SUBMITTALS:

1. GENERAL CONTRACTOR TO PROVIDE A SHOP DRAWING SUBMITTAL LOG AND SUBMITTAL SCHEDULE ITEMIZING ALL PROPOSED SUBMITTALS FOR APPROVAL BY STRUCTURAL ENGINEER OF RECORD.

2. ALL SHOP DRAWINGS SHALL BE CHECKED BY THE FABRICATOR AND APPROVED BY THE GENERAL CONTRACTOR PRIOR TO SUBMITTAL TO THE STRUCTURAL ENGINEER OF RECORD. SHOP DRAWING REVIEW BY ENGINEER IS LIMITED TO VERIFYING GENERAL CONFORMANCE TO THE CONTRACT DOCUMENTS. CONTRACTOR IS RESPONSIBLE FOR ANY CHANGES FROM THE CONTRACT DOCUMENTS, DIMENSIONAL ERRORS, COORDINATION ERRORS, OR OMISSIONS IN SHOP DRAWINGS. EOR IS NOT RESPONSIBLE FOR ANY DELAYS CAUSED BY THESE REQUIREMENTS NOT BEING MET.

3. SHOP DRAWINGS SHALL INCLUDE CONNECTIONS AS WELL AS SIZE, SPACING, AND GRADE OF ALL MEMBERS AND MATERIALS. PLANS AND ANY DETAILING NECESSARY FOR DETERMINING FIT AND PLACEMENT SHALL ALSO BE INCLUDED.

4. ANY CHANGES TO THE STRUCTURAL DRAWINGS SHALL BE SUBMITTED TO THE ARCHITECT AND ARE SUBJECT TO REVIEW AND APPROVAL OF THE STRUCTURAL ENGINEER OF RECORD PRIOR TO RELEASE FOR FABRICATION AND CONSTRUCTION.

5. DESIGN DRAWINGS, SHOP DRAWINGS, AND CALCULATIONS FOR THE DESIGN AND FABRICATION OF ITEMS THAT ARE DESIGNED BY THE CONTRACTOR SHALL BEAR THE SEAL AND SIGNATURE OF AN ENGINEER REGISTERED IN THE APPROPRIATE STATE AND SHALL BE SUBMITTED TO THE ARCHITECT / ENGINEER PRIOR TO FABRICATION AND CONSTRUCTION. CALCULATIONS SHALL BE INCLUDED FOR ALL CONNECTIONS TO THE STRUCTURE, CONSIDERING LOCALIZED EFFECTS ON STRUCTURAL ELEMENTS INDUCED BY THE CONNECTION LOADS. ITEMS THAT ARE DESIGNED BY THE CONTRACTOR SHALL BE DESIGNED TO RESIST THE LIVE LOADS INDICATED IN STRUCTURAL NOTES, DEAD LOAD, SELF WEIGHT, ANY ADDITIONAL LOADING INDICATED ON PLANS AND DETAILS, SNOW DRIFT, AND A NET WIND UPLIFT. THESE ITEMS DESIGNED BY THE CONTRACTOR SHALL INCLUDE ANY RELEVANT TECHNICAL LITERATURE FROM THE MANUFACTURER , SUCH AS ICC-ES REPORTS DEMONSTRATING CODE COMPLIANCE.

6. FIELD ENGINEERED DETAILS DEVELOPED BY THE CONTRACTOR THAT DIFFER FROM OR ADD TO THE STRUCTURAL DRAWINGS SHALL BE SUBMITTED TO THE ARCHITECT AND ARE SUBJECT TO REVIEW AND APPROVAL OF THE STRUCTURAL ENGINEER OF RECORD PRIOR TO RELEASE FOR FABRICATION AND CONSTRUCTION.

7. UNLESS DICTATED OTHERWISE BY THE CONTRACT DOCUMENTS, THE ENGINEER SHALL HAVE A MINIMUM OF 10 WORKING DAYS FROM RECEIPT OF SHOP DRAWINGS FOR REVIEW AND SHALL HAVE A MINIMUM OF 3 WORKING DAYS FOR RFI RESPONSES.

8. SEE MATERIAL SPECIFIC SECTIONS IN THE GENERAL NOTES FOR REQUIRED SHOP DRAWINGS AND CALCULATIONS TO BE SUBMITTED.

9. THE CONTRACTOR SHALL COORDINATE SEISMIC RESTRAINTS AND BRACING OF ARCHITECTURAL, MECHANICAL, PLUMBING, AND ELECTRICAL EQUIPMENT, MACHINERY, AND ASSOCIATED PIPING WITH THE STRUCTURE. ANY CONNECTIONS TO STRUCTURE SHALL CONFORM TO ASCE 7, CHAPTER 13 AND SHALL BE DESIGNED BY AN ENGINEER REGISTERED IN THE APPROPRIATE STATE AND SHALL BE SUBMITTED TO THE ARCHITECT PRIOR TO FABRICATION.

SPECIAL INSPECTIONS:

1. PROVIDE SPECIAL STRUCTURAL INSPECTIONS AND VERIFICATIONS BY A THIRD PARTY MEETING THE REQUIREMENTS OF CHAPTER 17 OF THE BUILDING CODE AND THE BUILDING OFFICIAL.

2. SPECIAL INSPECTORS SHALL BE QUALIFIED AND FURNISH THEIR REPORTS IN A TIMELY MANNER TO THE CONTRACTOR, BUILDING OFFICIALS, ARCHITECT, AND/OR ENGINEER.

3. SHOULD INSPECTOR IDENTIFY ANY DISCREPANCY, THEY SHALL NOTIFY CONTRACTOR FIRST, AND THEN ARCH/ENGINEER IMMEDIATELY THEREAFTER IF CORRECTIVE ACTION IS NEEDED.

4. SPECIAL INSPECTIONS AS REQUIRED BY CODE:
A. STEEL: SECTION 1705.2, AND AISC 360. PERIODIC OBSERVATIONS OF CONNECTIONS, WELDERS & FIELD WELDING
B. CONCRETE: SECTION 1705.3 AND TABLE 1705.3 CONCRETE MATERIAL SAMPLING AND TESTING, REBAR OBSERVATIONS. TAKE SET OF (3) CYLINDERS FOR EVERY 50 C.Y., BUT NOT LESS THAN ONE SET OF SAMPLES PER DAY'S WORK AND PER MIX
C. SOILS: SECTION 1705.6. FOUNDATION BEARING, EXCAVATION, FILL PLACEMENT
D. MASONRY: SECTION 1705.4, TMS 402 TABLE 3.1, TMS 602 TABLES 3 AND 4 FOR LEVEL 2 REQUIREMENTS
E. POST-INSTALLED ANCHORS: TABLE 1705.3

EARTHWORK AND FOUNDATIONS:

1. REFERENCE THE GEOTECHNICAL INVESTIGATION PREPARED BY ALPHA-OMEGA GEOTECH,INC. DATED SEPTEMBER 20, 2025 (JOB NO. AOG 250647 E). THE CONTRACTOR SHALL OBTAIN A COPY OF THIS REPORT AND FOLLOW ALL RECOMMENDATIONS WITHIN.

2. PERIMETER AND EXTERIOR FOOTINGS SHALL BEAR AT A MINIMUM OF 3'-0" BELOW ADJACENT GRADE.

3. ALL FOOTINGS SHALL BEAR ON FIRM NATIVE MATERIALS, COMPACTED OR ENGINEERED FILL CAPABLE OF SUPPORTING AN ALLOWABLE BEARING PRESSURE OF 3,000 PSF PER THE GEOTECHNICAL REPORT. DEEPEN FOOTINGS, AND REMOVE AND REPLACE UNACCEPTABLE SOILS WITH ENGINEERED FILL AS REQUIRED TO PROVIDE THIS MINIMUM DEPTH AND ALLOWABLE BEARING.

4. PROVIDE A MINIMUM DEPTH OF 24-INCHES OF LOW-VOLUME-CHANGE MATERIALS BELOW BOTTOM OF FLOOR SLAB ELEVATION PER THE GEOTECHNICAL REPORT.

5. IDENTIFICATION OF UNSUITABLE MATERIALS TO BE REMOVED, FILL PLACEMENT, COMPACTION, AND SOIL BEARING TESTS SHALL BE PERFORMED BY A GEOTECHNICAL ENGINEER PRIOR TO INSTALLING FOOTINGS AND SLABS TO ENSURE DESIGN ALLOWABLE BEARING VALUES AND SLAB SUBGRADE REQUIREMENTS ARE SATISFIED. IF ACTUAL SITE CONDITIONS DO NOT SATISFY THESE REQUIREMENTS, COORDINATE ADJUSTMENTS WITH ARCHITECT/ENGINEER/ GEOTECHNICAL ENGINEER.

6. SURFACE WATER SHALL NOT BE ALLOWED TO STAND ADJACENT TO OR DRAIN TOWARDS THE FOUNDATION AND SLAB SUBGRADES UNDER ANY CIRCUMSTANCES. PAVEMENTS OR GRADED SOILS AT THE PERIMETER OF THE BUILDING, EXCEPT AS REQUIRED AT EXITS OR AS NOTED, SHALL BE SLOPED AWAY AT 5% OR 6" MIN FOR THE FIRST TEN FEET AND AS REQUIRED TO PROVIDE POSITIVE DRAINAGE.

7. FOOTINGS MAY BE POURED TO NEAT LINES OF EXCAVATIONS PROVIDING VERTICAL LINES OF EXCAVATIONS CAN BE MAINTAINED DURING CONCRETE PLACEMENT.

8. FOUNDATION WALL BACKFILL SHALL NOT BE UNBALANCED BY MORE THAN TWO FEET ON EITHER SIDE AT ANY TIME. BASEMENT WALL AND RESTRAINED RETAINING WALL BACKFILL SHALL NOT BE PLACED, UNLESS THE WALL IS ADEQUATELY BRACED. RETAINING WALL AND BASEMENT WALL BACKFILL SHALL BE FREE DRAINING GRANULAR BACKFILL ACCEPTABLE TO THE GEOTECHNICAL ENGINEER.

9. DO NOT PLACE CONCRETE UNLESS FOOTING EXCAVATIONS ARE FREE OF ALL WATER, FROST, ICE OR LOOSE SOIL. CONCRETE SHALL BE PLACED AS SOON AS POSSIBLE AFTER EXCAVATION SO THAT EXCESSIVE DRYING OF BEARING MATERIALS DOES NOT OCCUR. BEARING MATERIAL SHALL BE INSPECTED BY A QUALIFIED INDEPENDENT TESTING LAB PRIOR TO PLACEMENT OF CONCRETE.

10. REFER TO THE ARCHITECTURAL DRAWINGS FOR PERIMETER INSULATION REQUIREMENTS.

CONCRETE AND MASONRY REINFORCING STEEL:

1. SUBMIT SHOP DRAWINGS FOR REBAR. ALL REINFORCING BARS SHALL MEET ASTM A615 GRADE 60.

2. ALL WELDED WIRE REINFORCEMENT (WWR) SHALL MEET ASTM A1064: LAP A MINIMUM OF 8" OR ONE FULL MESH, WHICHEVER IS GREATER.

3. GALVANIZED REINFORCING BARS SHALL MEET ASTM A767, CLASS II HOT-DIP GALVANIZED, AFTER FABRICATION AND BENDING.

4. REINFORCING BAR QUANTITIES SHOWN ARE FOR ESTIMATING PURPOSES ONLY.

5. PROVIDE AN ADDITIONAL ALLOWANCE OF 1% OF THE TOTAL REINFORCING SHOWN ON THE FINAL DRAWINGS TO BE PLACED DURING THE PROGRESS OF THE WORK AT THE DIRECTION OF THE STRUCTURAL ENGINEER. FOR THE ADDITIONAL REINFORCING ALLOWANCE, INCLUDE BOTH THE COST OF THE REINFORCING AND THE LABOR TO PLACE IT.

6. MAINTAIN MINIMUM CONCRETE PROTECTION OR COVER FOR REINFORCING AS INDICATED, UNLESS NOTED OTHERWISE:
A. 3" CLEAR WHERE CONCRETE IS CAST AGAINST AND PERMANENTLY IN CONTACT WITH GROUND
B. 2" CLEAR WHERE CONCRETE IS EXPOSED TO WEATHER OR IN CONTACT WITH GROUND BUT CAST AGAINST FORMS FOR BARS LARGER THAN #5
C. 1 ½" CLEAR WHERE CONCRETE IS EXPOSED TO WEATHER OR IN CONTACT WITH GROUND BUT CAST AGAINST FORMS FOR BARS #5 OR SMALLER
D. ¾" CLEAR FOR SLABS, JOISTS AND WALLS NOT EXPOSED TO WEATHER OR IN CONTACT WITH GROUND
E. 1 ½" CLEAR FOR BEAMS AND COLUMNS NOT EXPOSED TO WEATHER OR IN CONTACT WITH GROUND

7. CONTRACTOR SHALL VERIFY THAT ALL REINFORCEMENT, SLAB DOWELS, INSERTS, SLEEVES AND EMBEDDED ITEMS ARE PROPERLY LOCATED AND RIGIDLY SECURED PRIOR TO CONCRETE PLACEMENT. DO NOT "WET STICK" DOWELS. DO NOT LIFT, RAKE OR OTHERWISE ADJUST REINFORCEMENT DURING CONCRETE PLACEMENT TO OBTAIN COVER; SUPPORT BARS WITH APPROVED CHAIRS / SPACERS AND TIE IN THE FINAL POSITION BEFORE POURING.

8. REINFORCEMENT SHALL BE DETAILED IN ACCORDANCE WITH THE LATEST A.C.I. DETAILING MANUAL BY A QUALIFIED AND EXPERIENCED FIRM AND PERSON. PLACE AND SUPPORT REINFORCEMENT WITH ACCESSORIES: MAXIMUM SPACING - 48" CENTERS (PLASTIC-TIPPED LEGS FOR EXPOSED SURFACES). USE 3" SBP SUPPORTS AT ALL FOOTINGS.

9. ALL STRUCTURAL ADHESIVE FOR REINFORCING SHALL BE SIMPSON SET-3G OR HILTI HIT-HY 200-R OR EQUIVALENT. ALL STRUCTURAL ADHESIVE SHALL BE INSTALLED PER THE MANUFACTURER'S PRINTED INSTALLATION INSTRUCTIONS. SUBSTITUTIONS SHALL BE SUBMITTED FOR REVIEW AND APPROVAL WITH APPROPRIATE ICC-ES EVALUATION REPORTS.

CAST IN PLACE CONCRETE:

1. SUBMIT PROPOSED MIXED DESIGNS OF EACH TYPE FOR REVIEW. REQUIRED MINIMUM CONCRETE COMPRESSIVE STRENGTHS AT 28 DAYS:
A. FOOTING CONCRETE..4000 PSI
B. SLAB ON GRADE...4000 PSI
C. EXTERIOR SLAB ON GRADE..4500 PSI

2. ALL CONCRETE MIX DESIGNS SHALL HAVE WATER TO CEMENT RATIOS LESS THAN 0.52 (0.45 FOR MOISTURE SENSITIVE FLOORING), WITH A MAXIMUM 60/40 FINE TO COARSE AGGREGATE RATIO. CONCRETE MIX DESIGNS THAT DO NOT CONFORM TO THE ABOVE STANDARD AND/OR CONTAIN WATER REDUCING ADMIXTURES SHALL BE SUBMITTED WITH APPROPRIATE TEST DATA PER A.C.I.. ALL CONCRETE SHALL BE IN CONFORMANCE WITH THE A.C.I. 301 STANDARD THAT IS REFERENCED IN THE BUILDING CODE AT THE TIME OF PERMITTING THE PROJECT.

3. EXTERIOR CONCRETE (FLOOR SLABS, WALLS, ETC) SHALL HAVE 6.5% (PLUS/MINUS 1.5%) ENTRAINED AIR.

4. CHAMFER ALL EXPOSED CONCRETE EDGES 3/4" (VERIFY WITH ARCHITECT).

5. NO ALUMINUM SHALL BE EMBEDDED IN ANY CONCRETE.

6. NO CALCIUM CHLORIDE SHALL BE USED IN CONCRETE.

7. THE DESIGN, CONSTRUCTION, AND SAFETY OF ALL FORMWORK IS THE RESPONSIBILITY OF THE CONTRACTOR.

8. ALL CONCRETE IS REINFORCED UNLESS SPECIFICALLY NOTED AS UNREINFORCED. REINFORCE ALL CONCRETE NOT OTHERWISE SHOWN WITH THE SAME REINFORCING AS SIMILAR SECTIONS OR AREAS.

9. CONSTRUCTION JOINTS IN GRADE BEAMS, CONTINUOUS FOOTINGS, AND WALLS THAT DO NOT CHANGE DIRECTION SHALL BE SPACED NO GREATER THAN 60'-0". INTERMEDIATE CONTROL JOINTS SHALL BE SPACED AT 25'-0" MAX FOR WALLS. CONTROL JOINTS IN WALLS SHALL ALSO BE LOCATED 15'-0" FROM CORNERS AND AT CHANGES IN WALL THICKNESS.

10. WHERE FRESH CONCRETE IS DEPOSITED AGAINST HARDENED CONCRETE (GREATER THAN 8 HRS OLD), CLEAN EXISTING SURFACE OF LAITANCE AND FOREIGN MATERIAL AND DAMPEN THE EXISTING SURFACE. IF REQUIRED, ROUGHEN EXISTING CONCRETE TO ¼" AMPLITUDE.

11. SLABS ON GRADE SHALL BE 4" THICK MINIMUM ON 4" OF GRANULAR FILL. REFER TO THE GEOTECH FOR SPECIFIC REQUIREMENTS OF THE GRANULAR FILL. REINF SLAB WITH 6 X 6-W2.1xW2.1 WWR OR #3 BARS @ 18" OC EA WAY. PLACE REINF IN UPPER 1/3 OF SLAB THICKNESS. AT INTERIOR SLABS, A 10 MIL VAPOR BARRIER SHALL BE PLACED BETWEEN THE CONCRETE AND GRANULAR BASE AND CARE SHOULD BE TAKEN DURING CURING TO PREVENT SLAB CURLING. THIS NOTE SHALL BE TYPICAL UNLESS NOTED OTHERWISE.

12. SAW CUT JOINTS OR KEYED CONSTRUCTION JOINTS IN SLABS ON GRADE SHALL BE SPACED TO DIVIDE THE SLAB INTO PANELS NOT TO EXCEED 225 SQUARE FEET. THE LONGER DIMENSION OF EACH PANEL SHALL NOT EXCEED THE SHORTER DIMENSIONS BY MORE THAN 40%. JOINTS SHALL BE LOCATED AT COLUMN CENTERLINES WHERE POSSIBLE. SPACING BETWEEN JOINTS SHALL NOT EXCEED 15 FEET. CONTRACTOR SHALL SUBMIT JOINT LAYOUT TO ARCHITECT FOR APPROVAL. REFER TO TYPICAL DETAILS.

13. REINFORCEMENT SHALL BE CONTINUOUS AND LAPPED PER TYPICAL DETAIL (2'-6" MIN) EXCEPT AS NOTED AND PROVIDE CORNER BARS OF SAME SIZE AND SPACING.

14. MINIMUM CONCRETE WALL REINFORCING (WALL 10" OR GREATER) SHALL BE #5 AT 10" CENTERS EACH WAY, EACH FACE.

15. MINIMUM REINFORCING AROUND CONCRETE WALL OPENINGS 2'-0" OR GREATER (TYPICAL UNLESS NOTED): 2 - #5, EXTEND REINF 2'-0" PAST OPENINGS. PROVIDE 2-#5 x 4'-0" DIAGONAL BARS AT CORNERS.

16. CONTRACTOR SHALL COORDINATE ALL CURING COMPOUNDS WITH FLOOR FINISH REQUIREMENTS TO ENSURE COMPATIBILITY.

17. FOUNDATION CONTRACTOR TO ENSURE PROPER ANCHOR ROD PROJECTION AND THAT ANCHOR RODS ARE HELD SECURELY IN POSITION PRIOR TO CONCRETE PLACEMENT. INSTALL ANCHOR RODS TO THE STRICT DIMENSIONAL TOLERANCES PER AISC REQUIREMENTS. STRUCTURAL STEEL COLUMN ANCHOR RODS SHALL BE SET WITH A RIGID TEMPLATE.

18. AGGREGATES AND/OR CONCRETE MIXES SHALL BE CERTIFIED TO BE FREE OF AND ELIMINATE DAMAGE OF CONCRETE DUE TO ALKALI-SILICA REACTION OR ALKALI-AGGREGATE REACTIONS WHEN EXPOSED TO SOILS AND/OR AN EXTERIOR ENVIRONMENT.

19. ALL CONCRETE MIX DESIGNS EXPOSED TO AN EXTERIOR ENVIRONMENT SHALL MEET THE REQUIREMENTS OF THE KANSAS CITY METRO MATERIALS BOARD (KCMMB) OR THE JOHNSON COUNTY CONCRETE BOARD (JCCB).

STRUCTURAL STEEL:

1. STRUCTURAL STEEL SHAPES AND PLATE MATERIAL REQUIREMENTS (TYPICAL UNLESS NOTED OTHERWISE):
A. WIDE FLANGE SHAPES - ASTM A992 (FY = 50 KSI MIN.)
B. CHANNELS, ANGLES, AND PLATES: - ASTM A36 (FY = 36 KSI MIN)
C. ROUND HSS - ASTM A500, GR B (FY = 42 KSI)
D. RECTANGULAR HSS - ASTM A500, GR B (FY = 46 KSI)
E. PIPE - ASTM A53, GR B (FY = 35 KSI)
F. ANCHOR RODS - ASTM F1554 (FY = 36 KSI MIN.),
G. ADHESIVE ANCHORS - SIMPSON SET-3G, HILTI HIT-HY 200, OR EQUIVALENT

2. STRUCTURAL STEEL SHALL BE NEW AND MEET THE 15TH EDITION A.I.S.C. "SPECIFICATIONS FOR STRUCTURAL STEEL BUILDINGS AND BRIDGES", AND THE "CODE OF STANDARD PRACTICES FOR STEEL BUILDINGS AND BRIDGES", EXCLUDING SECTION 4.4.1.B. STRUCTURAL STEEL THROUGHOUT THE PROJECT HAS BEEN DESIGNED USING ASD DESIGN METHODOLOGY. SUBMIT SHOP DRAWINGS FOR STRUCTURAL STEEL PER THE SUBMITTAL REQUIREMENTS SECTION.

3. THE STRUCTURAL STEEL FABRICATOR SHALL BE AN AISC QUALITY CERTIFIED COMPANY FOR THE CATEGORY OF WORK IN THIS PROJECT OR PROVIDE A QUALITY ASSURANCE PLAN AND SPECIAL INSPECTIONS AS DEFINED IN THE CODE.

4. USE STANDARD AISC FRAMING CONNECTIONS WITH GROUP A-N/GROUP 120-N (E.G.,A325-N), F436 WASHERS, AND A563 HEAVY-HEX NUTS AS REQUIRED, UNLESS NOTED OTHERWISE.

5. BOLTS IN MOMENT AND BRACED FRAME CONNECTIONS SHALL BE PRE-TENSIONED. ALL GROUP B-N/GROUP 150-N (E.G., A490) BOLTS SHALL BE PRE-TENSIONED. OTHER BOLTED CONNECTIONS USING GROUP A-N/GROUP 120-N (E.G.,A325-N) MAY BE SNUG-TIGHTENED, UNLESS NOTED OTHERWISE.

6. STEEL BEAMS SHALL BE FABRICATED WITH MILL CAMBER UP.

7. WELDING SHALL CONFORM TO THE CURRENT AND APPLICABLE AWS STANDARDS AND BE COMPLETED BY AN AWS CERTIFIED WELDER. ALL WELDS SHALL UTILIZE E70xx ELECTRODES. SHOP DRAWINGS SHALL SHOW FIELD WELDS, AS APPROPRIATE.
A. AWS D1.1 - STRUCTURAL WELDING CODE - STEEL
B. AWS D1.3 - STRUCTURAL WELDING CODE - SHEET STEEL
C. AWS D1.6 - STRUCTURAL WELDING CODE - STAINLESS STEEL

8. WELD SIZES SHALL BE INCREASED TO MEET THE REQUIRED EFFECTIVE THROAT WIDTH IF GAPS EXIST AT THE FAYING SURFACE.

9. NO COLUMN OR BEAM SPLICES, UNLESS CLEARLY INDICATED ON THE STRUCTURAL DRAWINGS, WILL BE ALLOWED WITHOUT WRITTEN APPROVAL OF THE STRUCTURAL ENGINEER.

10. SEE ARCHITECTURAL PLANS FOR FIREPROOFING & FINISHING REQUIREMENTS, AND COORDINATE STEEL PRIMING & COATINGS ACCORDINGLY.

11. GROUT WHERE INDICATED ON PLANS AT BASE PLATES SHALL BE NON-METALLIC NON-SHRINK WITH A MINIMUM COMPRESSIVE STRENGTH OF 6000 PSI AT 28 DAYS CONFORMING TO ASTM C1107.

12. ALL POST-INSTALLED ANCHORS WHERE NOTED SHALL BE MANUFACTURED BY SIMPSON STRONG-TIE OR HILTI, INC. AND INSTALLED PER MANUFACTURER'S SPECIFICATIONS. SUBSTITUTIONS SHALL BE SUBMITTED FOR REVIEW AND APPROVAL WITH APPROPRIATE IC-ES EVALUATION REPORTS.

13. ALL STEEL AND ASSOCIATED FASTENERS NOT PROTECTED FROM WEATHER OR WHOLLY WITHIN A CONDITIONED SPACE (INCLUDING ALL MASONRY LINTELS) SHALL BE HOT DIPPED GALVANIZED PER ASTM A123.

14. CONNECTION REQUIREMENTS:
REACTIONS SHOWN ON THE DRAWINGS ARE BASED ON THE ALLOWABLE STRESS DESIGN METHOD, AND SHALL NOT BE REDUCED FURTHER THAN SHOWN. CONTRACTOR MAY OPT TO USE THE TYPICAL DETAILS SHOWN WHERE THE CAPACITIES ARE GREATER THAN THE REACTIONS INDICATED ON THE DRAWINGS.

CONNECTION DESIGN IS REQUIRED ELSEWHERE AS FOLLOWS:
A. AT MOMENT CONNECTIONS
B. AT ALL CONDITIONS NOT COVERED BY THE TYPICAL STANDARD SHEAR CONNECTION
C. AT ALTERNATIVE CONNECTION TYPES DESIRED BY FABRICATOR OR ERECTOR IF FIRST REQUESTED AND APPROVED BY THE EOR
D. RAILINGS

PROHIBITED CONNECTIONS AND NOTES:
A. SINGLE-ANGLE SHEAR CONNECTIONS ARE PROHIBITED
B. DOUBLE-ANGLE SHEAR CONNECTIONS ARE NOT PERMISSIBLE AT CONNECTIONS WITH AXIAL LOADS OR AT BRACED FRAMES

ADDITIONAL REQUIREMENTS:
A. USE STANDARD AISC FRAMING CONNECTIONS WITH GROUP A-N/GROUP 120-N (E.G.,A325-N) BOLTS, F436 WASHERS, AND A563 HEAVY-HEX NUTS AS REQUIRED, UNLESS NOTED OTHERWISE.
B. ALL CONNECTIONS REQUIRE A MINIMUM OF 2 BOLTS AND A MINIMUM CAPACITY OF 10 KIPS.
C. FOR STEEL BEAMS 10-FT OR LESS IN LENGTH, IF REACTION ON PLAN IS NOT SHOWN ASSUME 10 KIPS (ASD).
D. FOR BEAMS GREATER THAN 10-FT IN LENGTH, IF REACTION ON PLAN IS NOT SHOWN THE REACTION SHALL BE ASSUMED TO BE ONE HALF THE TOTAL ALLOWABLE UNIFORM CODE FOR THE BEAM SPAN FROM AISC STEEL CONSTRUCTION MANUAL UNLESS THE VALUE IS OBTAINED FROM THE ENGINEER OF RECORD.

SUBMIT SIGNED/SEALED SHOP DRAWINGS AND CALCULATIONS FOR THE DESIGN OF ALL STEEL CONNECTIONS, AND A LETTER SEALED BY AN ENGINEER REGISTERED IN THE STATE OF THE PROJECT STATING THAT THEY HAVE REVIEWED THE STEEL SHOP DRAWINGS FOR CONFORMANCE TO THE DESIGN REQUIREMENTS.

WOOD:

1. FRAMING MATERIAL: ALL WOOD FRAMING SHALL MEET OR EXCEED THE FOLLOWING:
A. NOMINAL STRUCTURAL LUMBER: DOUG. FIR -- NO.2 OR BETTER, KILN-DRIED, MIN Fb = 900 PSI, MIN E = 1400 KSI.
B. EXPOSED TO WEATHER: NOMINAL STRUCT LUMBER -- PRESS TREATED NO.2 OR BETTER, MIN Fb = 1000 PSI, MIN E = 1300 KSI
C. MICROLLAM LVL (LAMINATED VENEER LUMBER) BEAMS SHALL MEET TRUS JOIST SPECIFICATIONS: MINIMUM Fb = 2600 PSI AND MINIMUM E = 2000 KSI.
D. TIMBERSTRAND LSL (LAMINATED STRAND LUMBER) BEAMS SHALL MEET TRUS JOIST SPECIFICATIONS: MINIMUM Fb = 2600 PSI AND MINIMUM E = 1550 KSI.
E. PARALLAM PSL (PARALLEL STRAND LUMBER) POSTS SHALL MEET TRUS JOIST SPECIFICATIONS: MINIMUM Fc// = 2500 PSI AND MINIMUM E = 1800 KSI
F. GLULAM FRAMING: 24F-V4 DOUGLAS FIR, ARCHITECTURAL FINISH (COORDINATE WITH ARCH).

2. ALL LUMBER IN DIRECT CONTACT WITH CONCRETE OR MASONRY, SUCH AS SILL PLATES AND BEARING PLATES BELOW BEAMS POCKETED IN CMU, SHALL BE TREATED LUMBER.

3. WOOD SHEATHING:
A. ROOF SHEATHING SHALL BE 15/32" OR 1/2" WITH AN APA SPAN RATING OF 32/16, EXPOSURE 1, MINIMUM 2 SPAN, FASTEN WITH 10d COMMON NAILS AT 6" CENTERS AT ALL PANEL EDGES AND 12" CENTERS MAXIMUM AT INTERMEDIATE FRAMING MEMBERS (IN THE FIELD). USE PLYCLIPS AT MIDSPAN.
B. FLOOR SHEATHING SHALL BE TONGUE AND GROOVE SHEATHING, EXPOSURE 1, MINIMUM 2 SPAN, FASTEN WITH APA APPROVED ADHESIVE AND 10d RING SHANKED NAILS AT 6" ON CENTERS AT ALL PANEL EDGES AND AT 10" ON CENTERS MAXIMUM AT INTERMEDIATE FRAMING MEMBERS (IN THE FIELD).
a. WHEN CLEAR DISTANCE BETWEEN FLOOR JOISTS OR FLOOR TRUSSES IS 16" OR LESS USE 3/4" SHEATHING WITH AN APA SPAN RATING OF 48/24.
b. WHEN CLEAR DISTANCE BETWEEN FLOOR JOISTS OR FLOOR TRUSSES IS GREATER THAN 16" USE 7/8" SHEATHING WITH AN APA SPAN RATING OF 60/32.
C. WALL SHEATHING FOR EXTERIOR WALLS SHALL BE 7/16" WITH AN APA SPAN RATING OF 24/16, UNLESS NOTED OTHERWISE. ALL PANEL EDGES SHALL BE BACKED WITH 2 INCH NOMINAL OR WIDER FRAMING. FASTEN WITH 8d COMMON NAILS AT 6" OC MAXIMUM AT ALL TOP PLATES, BLOCKING, BOUNDARIES AND 12" OC MAXIMUM IN THE FIELD.

4. ALL WOOD SHEATHING TO BE STAGGERED 4'x8' SHEETS. ORIENTED PERPENDICULAR TO SUPPORTING MEMBERS. WHERE DIAPHRAGMS ARE DESIGNATED AS BLOCKED, ALL JOINTS IN SHEATHING SHALL OCCUR OVER AND BE FASTENED TO COMMON FRAMING MEMBERS AS INDICATED.

5. PROVIDE 1/8" GAP AT ALL SHEATHING PANEL EDGES AND END JOINTS UNLESS OTHERWISE SPECIFIED BY THE MANUFACTURER. DUE TO CONSTRUCTION CONDITIONS, TEMPORARY EXPANSION JOINTS MAY BE REQUIRED IN FLOOR/ROOF SHEATHING.

6. ALL HEADERS IN EXTERIOR OR INTERIOR BEARING WALLS SPANNING MORE THAN 3'-8" SHALL BE SUPPORTED ON DOUBLE STUDS UNLESS NOTED.

7. MINIMUM NAILING SHALL CONFORM TO IBC TABLE 2304.10.1. USE COMMON NAILS EXCEPT WHERE NOTED. ALL FASTENERS (BOLTS, SCREWS, NAILS, ETC) IN CONTACT WITH PRESSURE TREATED LUMBER SHALL BE HOT DIP GALVANIZED.

8. LIGHT GAUGE WOOD FRAMING CONNECTORS AS NOTED ON THE PLANS FOR WOOD JOISTS, COLUMNS, BEAMS AND TRUSSES SHALL BE "STRONG – TIE" CONNECTORS BY THE SIMPSON CO. OR REVIEWED EQUIVALENT. CONNECTORS IN DIRECT CONTACT WITH PRESSURE TREATED LUMBER SHALL HAVE "ZMAX" G185 HOT DIP GALVANIZED COATING OR REVIEWED EQUIVALENT.

9. CONNECTORS IN DIRECT CONTACT WITH PRESSURE TREATED LUMBER SHALL HAVE "ZMAX" G185 HOT DIP GALVANIZED COATING OR REVIEWED EQUIVALENT.

10. STAINLESS STEEL FASTENERS, ANCHOR BOLTS, LIGHT GAUGE CONNECTORS, ETC. MAY BE SUBSTITUTED FOR HOT DIP GALVANIZED MATERIALS AT THE CONTRACTORS OPTION.

11. PROVIDE UPLIFT CONNECTORS AT EACH ROOF TRUSS TO WALL CONNECTIONS PER IBC.

12. STUDS SHALL BE CONTINUOUS BETWEEN EACH DIAPHRAGM LEVEL. EXTERIOR WALL STUDS AT GROUND FLOOR SHALL BE BRACED BY KICKERS AND/OR STRUCTURAL CEILING FRAMING.

13. TYPICAL SILL ANCHOR RODS SHALL BE GALVANIZED 5/8" DIAMETER EMBEDDED 7" MIN INTO CONCRETE, SPACED NO FURTHER THAN 3'-0" OC, AND SHALL OCCUR WITHIN 12" OF THE ENDS OF A SILL PLATE. SPACE ANCHOR RODS MORE CLOSELY TOGETHER AT SHEAR WALLS AS SHOWN ON THE DRAWINGS. EACH SILL PLATE SHALL HAVE A MINIMUM OF 2 ANCHOR RODS. PROVIDE 2" SQUARE PLATE WASHERS AND NUTS.

14. SUBSTITUTIONS OF SPECIFIED WOOD MEMBERS SHALL NOT BE MADE WITHOUT REVIEW OF THE ARCHITECT/ENGINEER.

15. CUT ENDS OF EXTERIOR WOOD POSTS SHALL BE FIELD TREATED WITH AN APPROVED PRESERVATIVE (SUCH AS COPPER NAPHTHENATE). ATTACHMENT OF THE BEAM TO THE SIDE OF THE POST WITHOUT NOTCHING IS PROHIBITED. ALL 3-PLY BEAMS SHALL BE CONNECTED TO THE POST BY A POST CAP PLATE.

16. AT SHEAR WALLS WHERE PANELS ARE APPLIED ON BOTH FACES AND NAIL SPACING IS LESS THAN 6" ON CENTER ON EITHER SIDE, PANEL JOINTS SHALL BE OFFSET TO FALL ON DIFFERENT FRAMING MEMBERS.

17. ALL BOLTS BEARING ON LUMBER SHALL HAVE STANDARD CUT WASHERS UNDER THE BOLT HEAD AND NUT, UNLESS OTHERWISE NOTED.

18. LUMBER SHALL NOT BE CUT OR NOTCHED FOR PIPES, CONDUIT, ETC. EXCEPT AS SHOWN ON THESE PLANS.

PRE-FABRICATED WOOD TRUSS NOTES:

1. THE WOOD TRUSS MANUFACTURER SHALL SUBMIT SHOP DRAWINGS AND CALCULATIONS FOR ENGINEER'S REVIEW. THE SHOP DRAWINGS SHALL INCLUDE PLACING PLANS OF ALL TRUSSES CLEARLY LABELED, DETAILS OF TRUSS CONNECTIONS AND ANCHORAGES, DETAILS OF METAL CONNECTORS USED AT JOINTS, AND ENGINEERING DESIGN DATA. THE ENGINEERING DESIGN FOR EACH TYPE OF TRUSS SHALL INCLUDE: TRUSS LOCATION IDENTIFICATION, ALL LOADINGS AND REACTIONS, WOOD SPECIES AND STRESS GRADES, MEMBER STRESSES, JOINT CONNECTIONS, CONFIGURATION, TRUSS HANGERS, TRUSS TO TRUSS CONNECTIONS, BRACING FOR LATERAL STABILITY OF THE COMPLETED FRAMING SYSTEM AND OF THE TEMPORARY CONSTRUCTION CONDITION IN ACCORDANCE WITH THE TPI RECOMMENDATIONS, AND THE PROFESSIONAL ENGINEERS SEAL OF THE PERSON RESPONSIBLE FOR THE DESIGN OF THE TRUSSES/TRUSS SYSTEM.

2. PREFABRICATED WOOD TRUSS DESIGN SHALL CONFORM TO THE FOLLOWING REQUIREMENTS. ANSI/TPI "NATIONAL DESIGN STANDARD FOR METAL PLATE CONNECTED WOOD TRUSS CONSTRUCTION", " COMMENTARY AND RECOMMENDATIONS FOR HANDLING INSTALLING AND BRACING OF METAL PLATE CONNECTED TRUSSES", " RECOMMENDED DESIGN SPECIFICATION FOR TEMPORARY BRACING OF METAL PLATE CONNECTED WOOD TRUSSES". SHOP DRAWINGS SHALL INDICATE VERIFICATION OF PARTICIPATION IN THE TPI INSPECTION PROGRAM.

3. THE CONTRACTOR SHALL FURNISH A COPY OF THE APPROVED PRE-FABRICATED TRUSS SHOP DRAWINGS TO BUILDING OFFICIAL FOR THEIR RECORDS. REFER TO BCSI FOR TYPICAL DETAILS. PERMANENT BUILDING BRACING IS THE RESPONSIBILITY OF THE EOR AND SHALL BE INSTALLED IN ACCORDANCE WITH THESE CONSTRUCTION DOCUMENTS.

4. TRUSS DESIGNER SHALL DESIGN AND PROVIDE ALL TEMPORARY BRACING AND ALL PERMANENT BRACING IN ACCORDANCE WITH THE TPI RECOMMENDATIONS.

5. TRUSS MEMBERS AND COMPONENTS SHALL NOT BE FIELD CUT, NOTCHED, DRILLED, OR ALTERED IN ANY WAY WITHOUT THE WRITTEN APPROVAL OF THE ENGINEER RESPONSIBLE FOR THE TRUSS DESIGN.

6. INSTALL ROOF SHEATHING PRIOR TO ANY OVER FRAMING.

7. TRUSS TO TRUSS CONNECTIONS ARE THE RESPONSIBILITY OF THE TRUSS DESIGNER.

8. PRE-FABRICATED WOOD ROOF TRUSS DESIGN CRITERIA
– TOP CHORD DEAD LOAD...............................15 PSF
– TOP CHORD LIVE LOAD.................................20 PSF
– TOP CHORD SNOW LOAD........................ PER S101
– TOP CHORD WIND LOAD............................PER C&C WIND DESIGN CRITERIA
– BOT CHORD DEAD LOAD ....5 PSF
– LIVE LOAD DEFLECTION CRITERIA..............MIN OF L/360
– TOTAL LOAD DEFLECTION CRITERIA ....MIN OF L/240
MUST INCLUDE ALL LONG-TERM DEFLECTION EFFECTS
– MECHANICAL EQUIPMENT LOADS PER ROOF FRAMING PLAN

RTU CURBS AND SCREEN WALLS:

1. MECHANICAL ROOFTOP EQUIPMENT SUPPLIER SHALL SUPPLY A STRUCTURAL SUPPORT CURB (AND/OR ADAPTER) FOR THE PLENUM, OF THE SPECIFIED HEIGHT, AS SHOWN ON THE MECHANICAL DRAWINGS.
DESIGN OF THE CURB AND ADAPTER IS A DELEGATED DESIGN SUBMITTAL. EQUIPMENT SUPPLIER SHALL ENGAGE AN ENGINEER LICENSED IN THE STATE OF THE PROJECT TO DEVELOP A DESIGN FOR THE CURB AND ADAPTER. DESIGN SHALL CONSIDER ALL CODE REQUIRED GRAVITY AND WIND LOADS. THE DESIGN SHALL INCLUDE ALL FASTENERS AND CONNECTORS REQUIRED TO ANCHOR THE CURB TO THE ROOF STRUCTURE. SUBMIT SIGNED AND SEALED ANALYSIS CALCULATIONS, DESIGN AND SHOP DRAWINGS TO MECHANICAL AND STRUCTURAL ENGINEER FOR REVIEW.

2. CURB SHALL BE FABRICATED OF A MINIMUM OF 14 GA GALVANIZED STEEL.

3. CURBS SHALL BE INSULATED.

STAND STRUCTURAL ENGINEERING INC
8234 Robinson Street
Overland Park, KS 66204
913-214-2169
stand-sei.com

CODY ROBERT GIBBENS
LICENSED
PE28037
KANSAS
PROFESSIONAL ENGINEER
11/24/2025

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC
ARCHITECTURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center
Mr. D's DONUTS
14495 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 24, 2025
REVISED
SHEET NUMBER
S001
OF SHEETS
STAND JOB NO. 25281

STAND STRUCTURAL ENGINEERING INC
8234 Robinson Street
Overland Park, KS 66204
913-214-2169
stand-sei.com

CODY ROBERT GIBBENS
LICENSED
PE28037
KANSAS
PROFESSIONAL ENGINEER
11/24/2025

DAVID A. KASTER, RA,NCARB,LEED AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT
7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC

ARCHITECTURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center
Mr. D's DONUTS
14495 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 24, 2025
REVISED
SHEET NUMBER
S030
OF SHEETS
STAND JOB NO. 25281

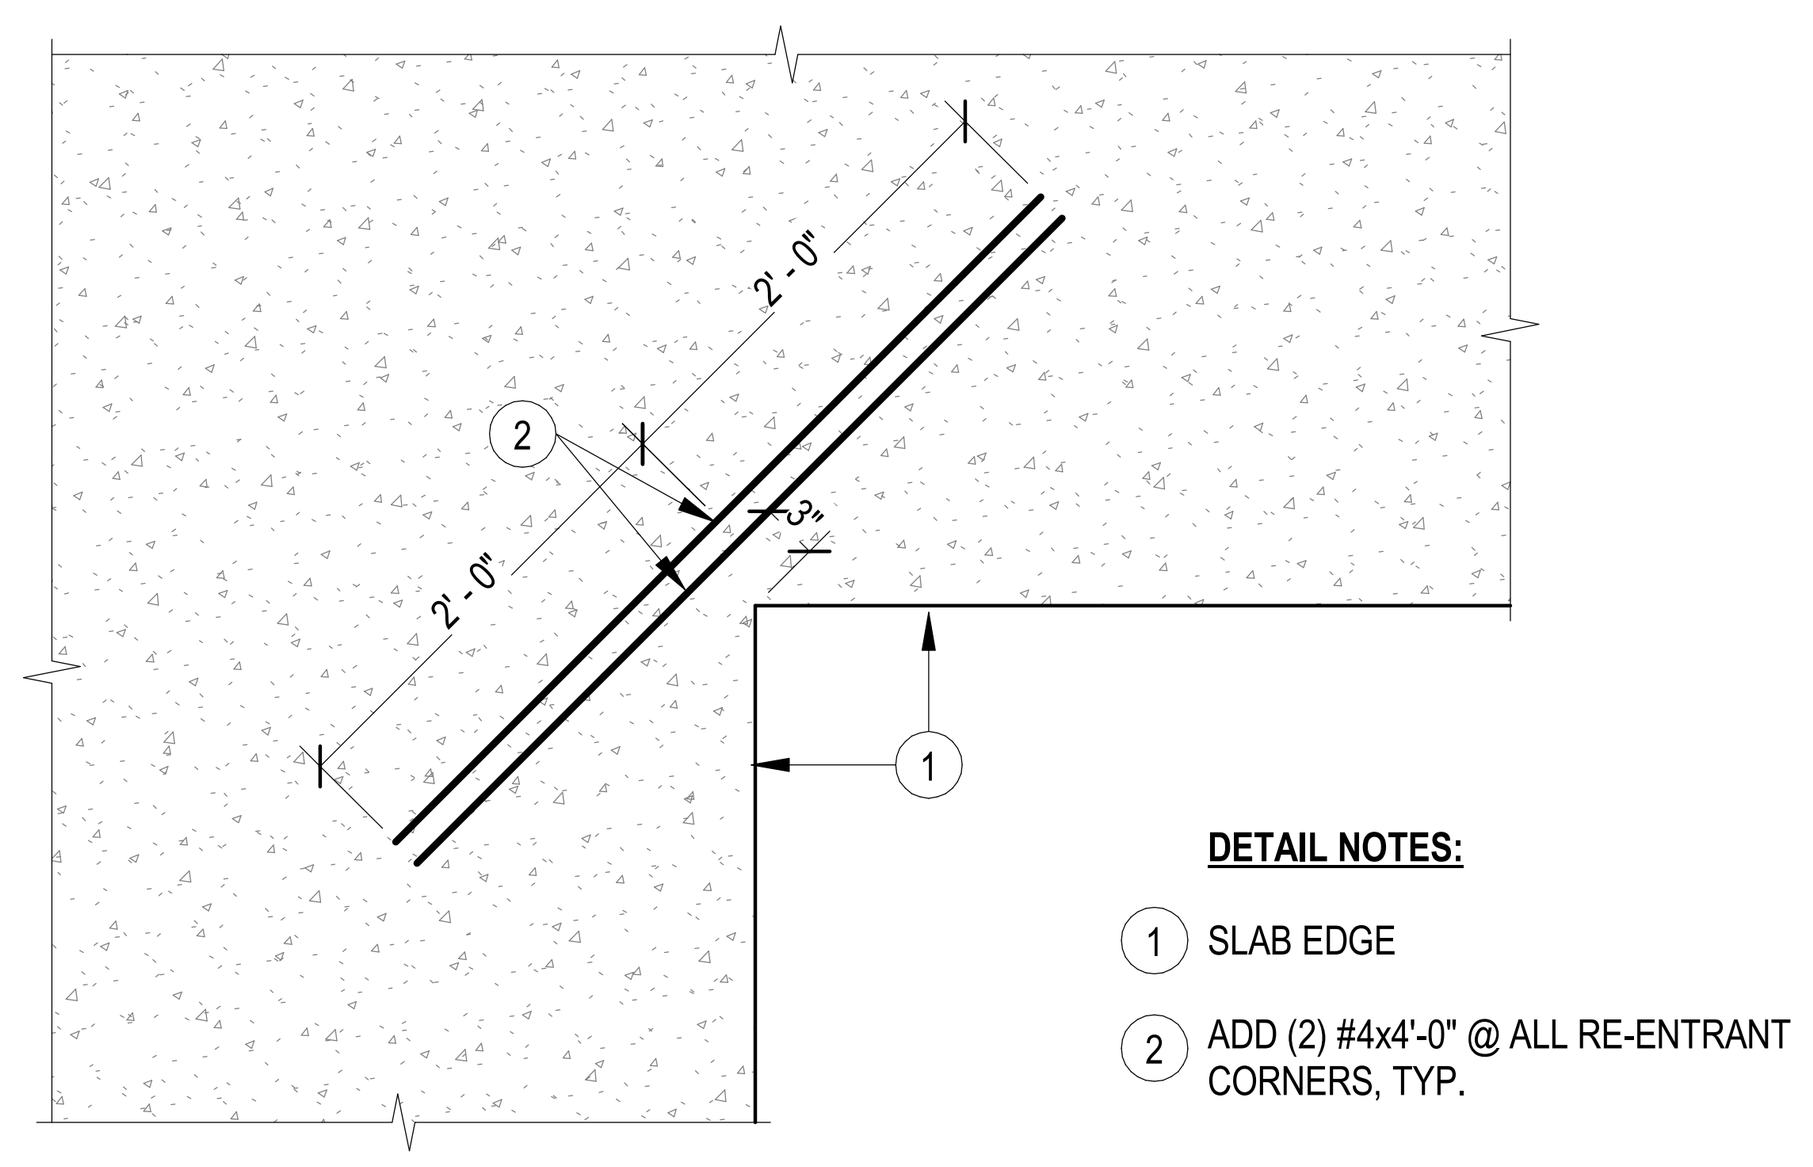

DETAIL NOTES:
1. SLAB EDGE
2. ADD (2) #4x4'-0" @ ALL RE-ENTRANT CORNERS, TYP.

9 SLAB REINFORCEMENT AT RE-ENTRANT CORNER

3/4" = 1'-0"

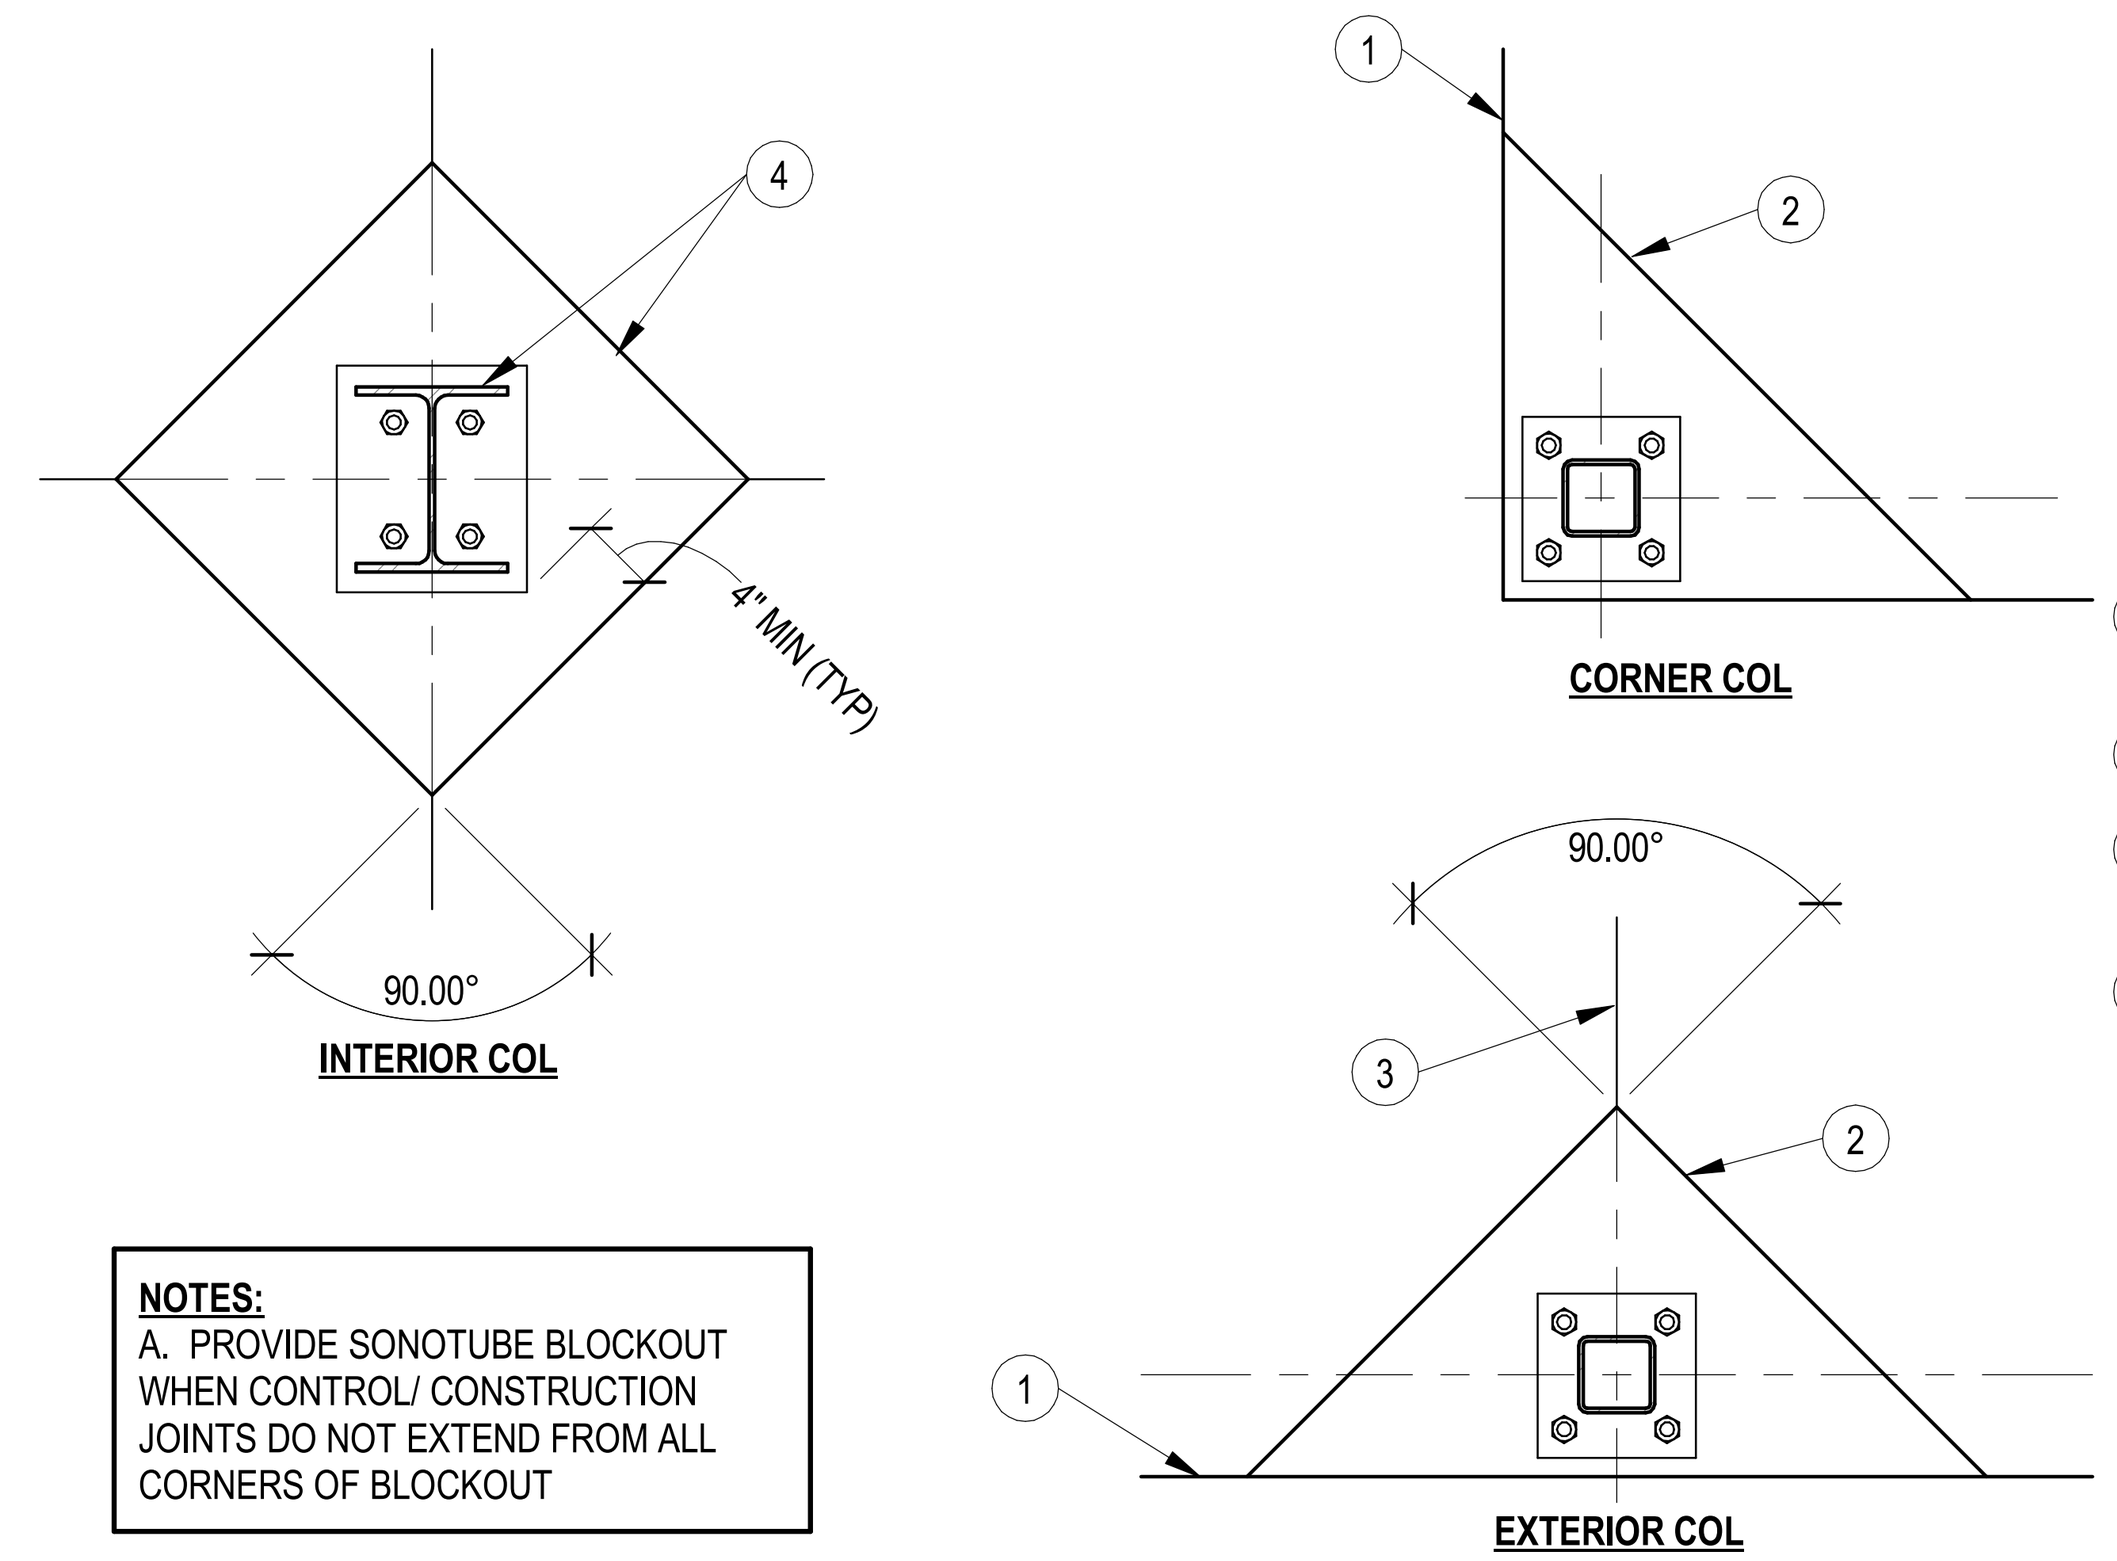

NOTES:
A. PROVIDE SONOTUBE BLOCKOUT WHEN CONTROL/ CONSTRUCTION JOINTS DO NOT EXTEND FROM ALL CORNERS OF BLOCKOUT

DETAIL NOTES:
1. EDGE OF SLAB OR FACE OF WALL
2. EDGE OF BLOCKOUT
3. CONTROL OR CONSTRUCTION JOINT
4. 1/4" PREFORMED JOINT FILLER AROUND COLUMN AND AT EDGE OF BLOCKOUT. FILL JOINT WITH SEALANT (TYP)

6 SLAB ON GRADE JOINTS @ COLUMNS

3/4" = 1'-0"

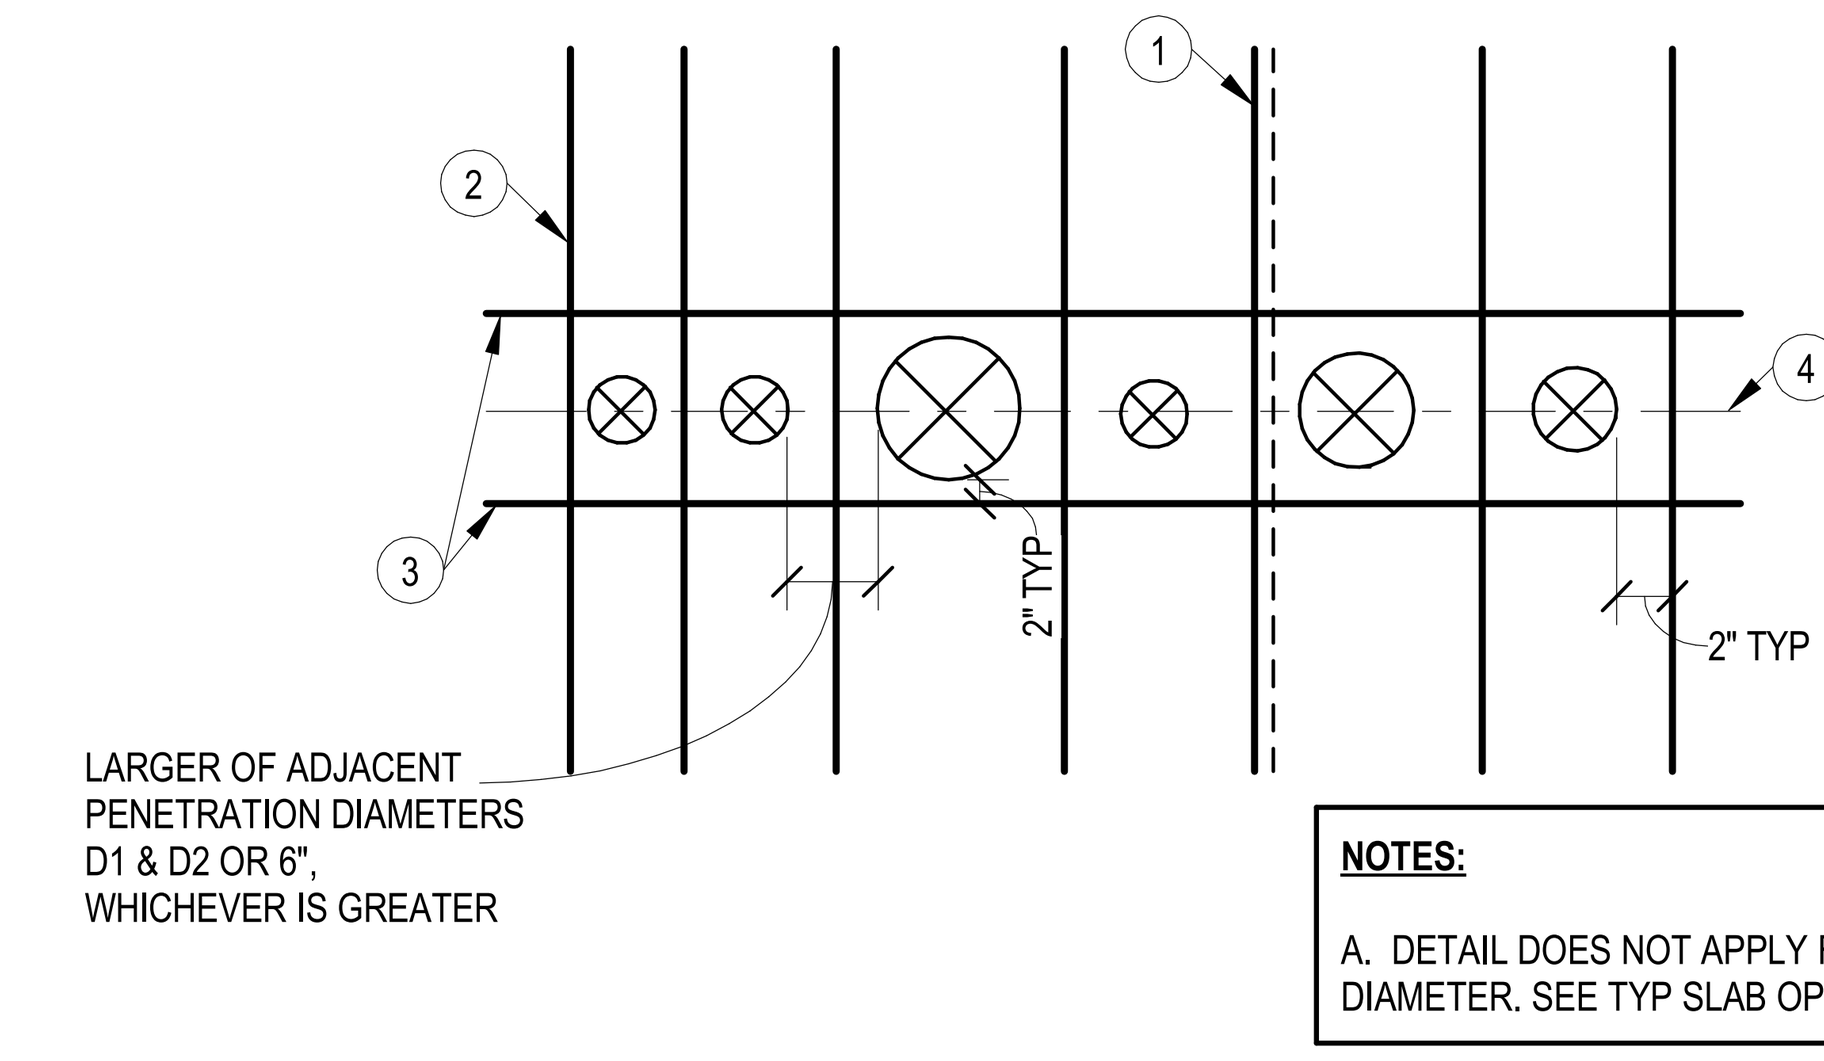

DETAIL NOTES:
1. ARRANGE PRIMARY SLAB BARS TO PASS BY PENETRATIONS, DO NOT TERMINATE SLAB BARS AT PENETRATIONS
2. (1) #5 x 5'-0" T&B @ ENDS & IN BTWN ALL PENETRATIONS
3. (1)#5 x 5'-0" T&B EA SIDE
4. ALIGN PENETRATIONS WHERE POSSIBLE

NOTES:
A. DETAIL DOES NOT APPLY FOR PENETRATIONS LARGER THAN 12" IN DIAMETER. SEE TYP SLAB OPENING DETAIL FOR SUCH PENETRATIONS

3 REINF @ SLAB PENETRATIONS

3/4" = 1'-0"

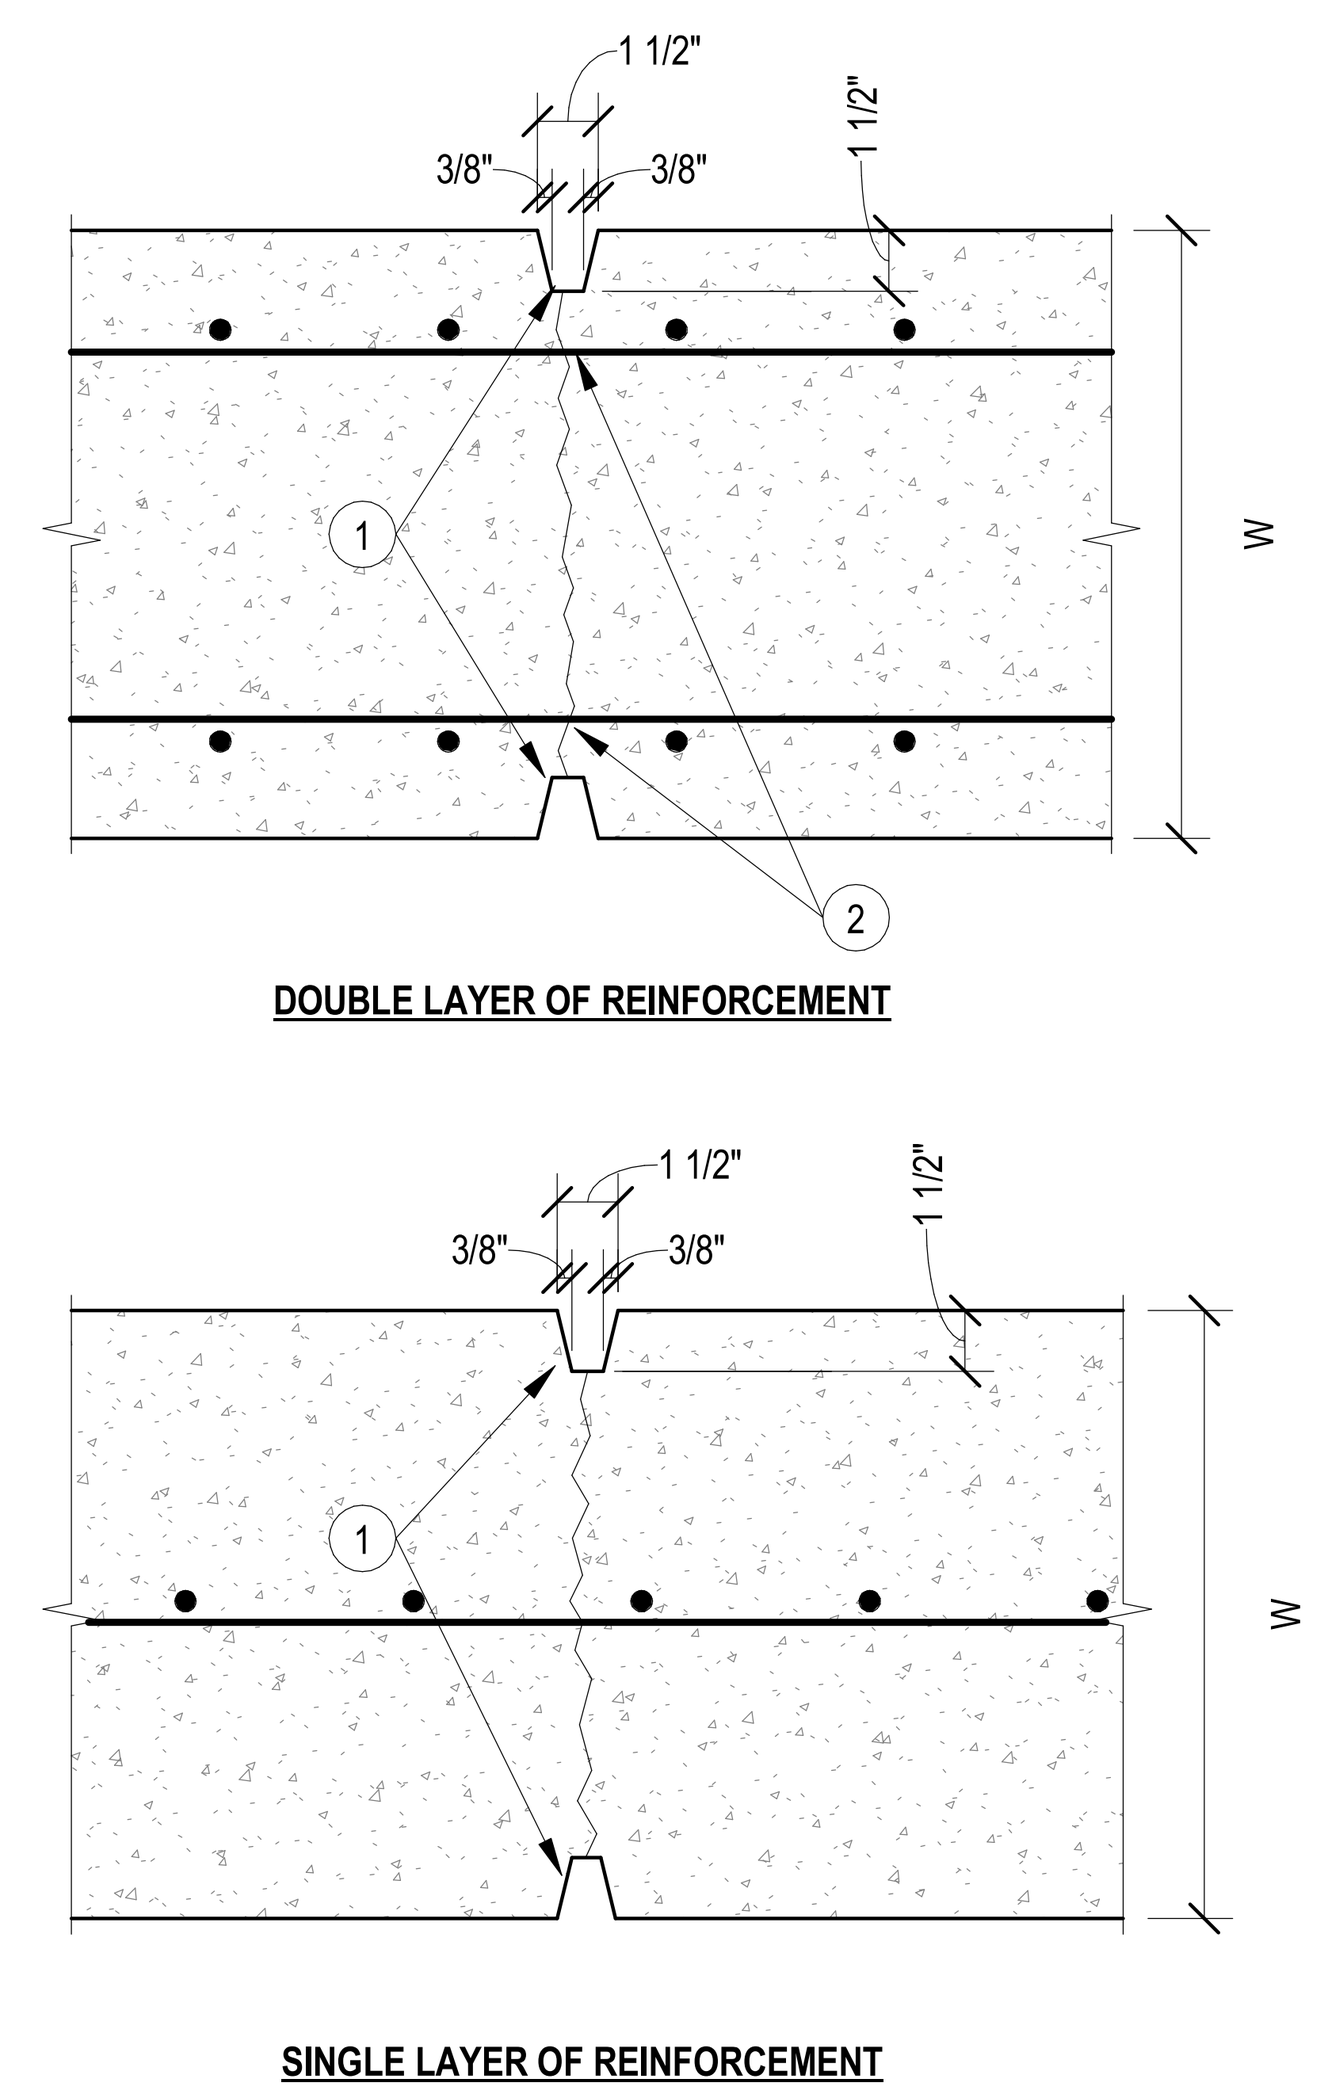

DETAIL NOTES:
1. PROVIDE CANT STRIPS EA FACE
2. FIELD CUT ALTERNATE HORIZ BARS EA FACE

5 CONC WALL CONTROL JOINTS

3/4" = 1'-0"

DEVELOPMENT AND LAP SPLICE SCHEDULE															
	F'c=3000 psi								F'c=4000 psi						
	EMBEDMENT			LAP SPLICE				EMBEDMENT			LAP SPLICE				
	COMPRESSION	TENSION (LTE)		COMPRESSION	TENSION (LTS)		HOOK	COMPRESSION	TENSION (LTE)		COMPRESSION	TENSION (LTS)		HOOK	
BAR	(LCE)	TOP	OTHER	(LCS)	TOP	OTHER	(LDH)	(LCE)	TOP	OTHER	(LCS)	TOP	OTHER	(LDH)	
#3	8	13	12	12	28	21	6	8	12	12	12	16	16	7	
#4	11	21	16	15	37	28	8	9	18	14	15	24	18	9	
#5	14	31	24	19	46	36	10	12	27	21	19	35	27	12	
#6	16	43	33	23	56	43	12	14	37	28	23	48	37	14	
#7	19	69	53	26	81	62	13	17	60	46	26	78	60	17	
#8	22	85	66	30	93	71	15	19	74	57	30	96	74	19	
#9	25	103	80	34	105	80	17	21	90	69	34	116	90	21	
#10	28	124	96	38	118	90	19	24	108	83	38	140	108	24	
#11	31	146	112	42	131	100	22	27	126	97	42	164	126	27	

NOTES (PERTAINING TO TABLE):
A. TOP BARS ARE HORIZONTAL BARS THAT HAVE MORE THAN 12" OF FRESH CONCRETE CAST BELOW THEM.
B. ALL BARS THAT ARE NOT "TOP BARS" ARE "OTHER" BARS
C. ABBREVIATIONS:
- LCE - COMPRESSION EMBEDMENT LENGTH
- LTE - TENSION EMBEDMENT LENGTH
- LCS - COMPRESSION LAP SPLICE LENGTH
- LTS - TENSION LAP SPLICE LENGTH
- LDH - HOOKED BAR TENSION EMBEDMENT LENGTH

NOTES (GENERAL):
A. STAGGER ALL SPLICES 12 db MIN, BUT NOT LESS THAN 12"
B. ALL DIMENSIONS INDICATED IN TABLE ARE IN INCHES
C. BARS GREATER THAN #11 SHALL BE MECHANICALLY SPLICED
D. ALL SPLICES SHALL BE WIRED IN CONTACT STACKED VERTICAL

MULTIPLIERS:
ALL EMBEDMENT AND LAP SPLICE LENGTHS SHALL BE INCREASED AS REQ'D BY THE MULIPLIERS BELOW. APPLY MULTIPLE MULTIPLIERS IF APPLICABLE
1.3 -- IF CONC CONTAINS LIGHT WEIGHT AGGREGATES
1.3 -- IF EPOXY COATED REBAR USED

2 SPLICE & DEVELOPMENT SCHEDULE

3/4" = 1'-0"

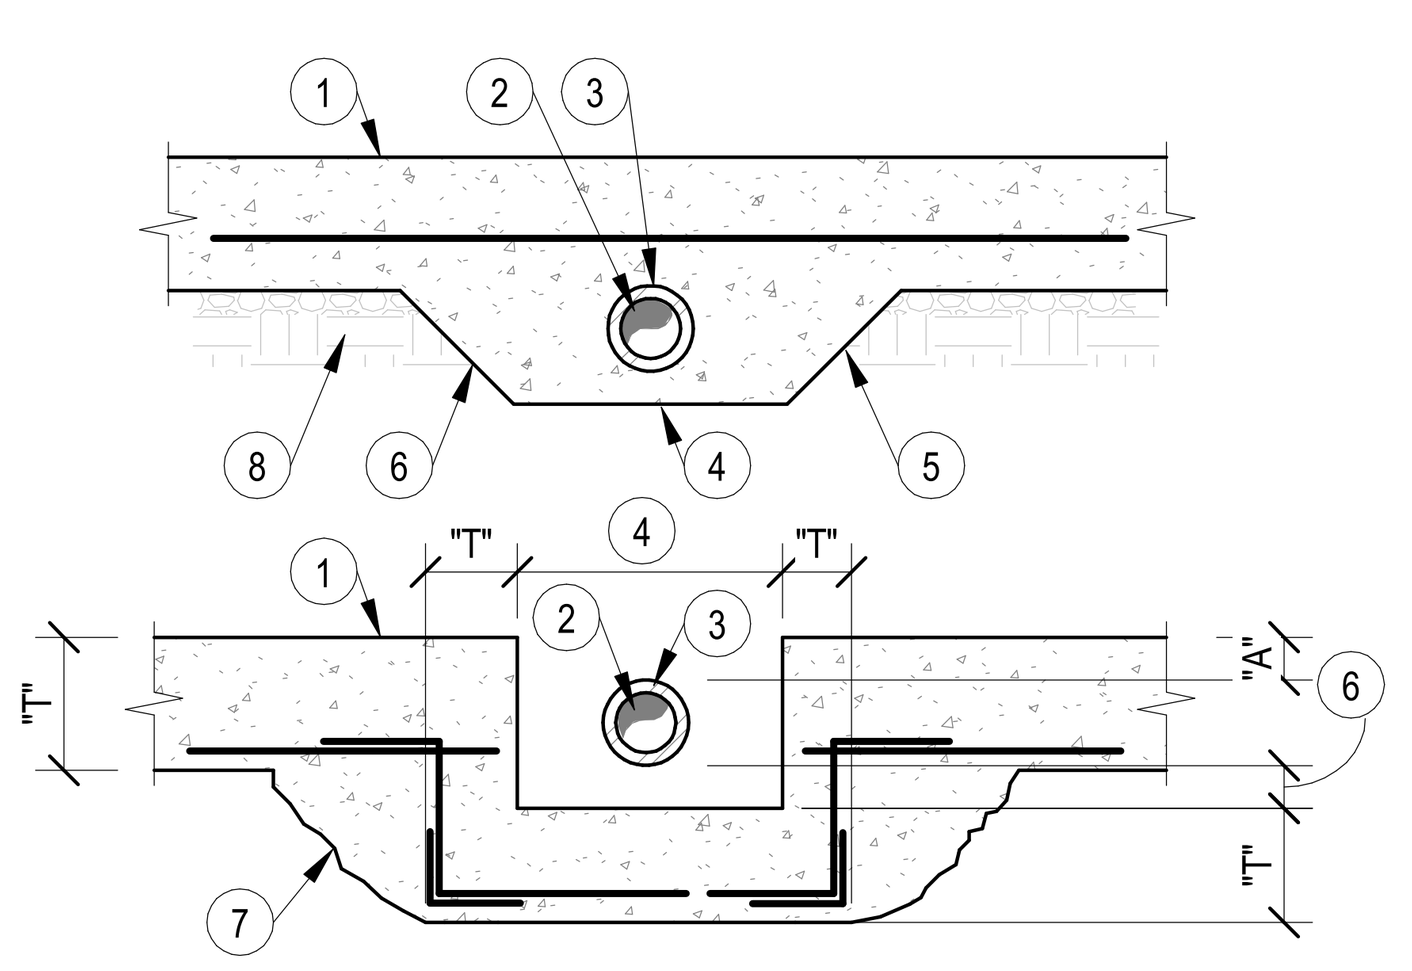

DETAIL NOTES:
1. T/ FOOTING ELEV, RE: PLAN
2. PIPE
3. SLEEVE, STEEL OR PVC PIPE
4. SLEEVE Ø PLUS 1'-0"
5. 6" MIN
6. THICKEN FOOTING AS SHOWN
7. STEP FOOTING DOWN AS SHOWN, RE: STEP FOOTING DETAIL
8. RE: GENERAL NOTES FOR UNDERSLAB REQUIREMENTS

8 FTG STEP FOR PIPE PENETRATION

3/4" = 1'-0"

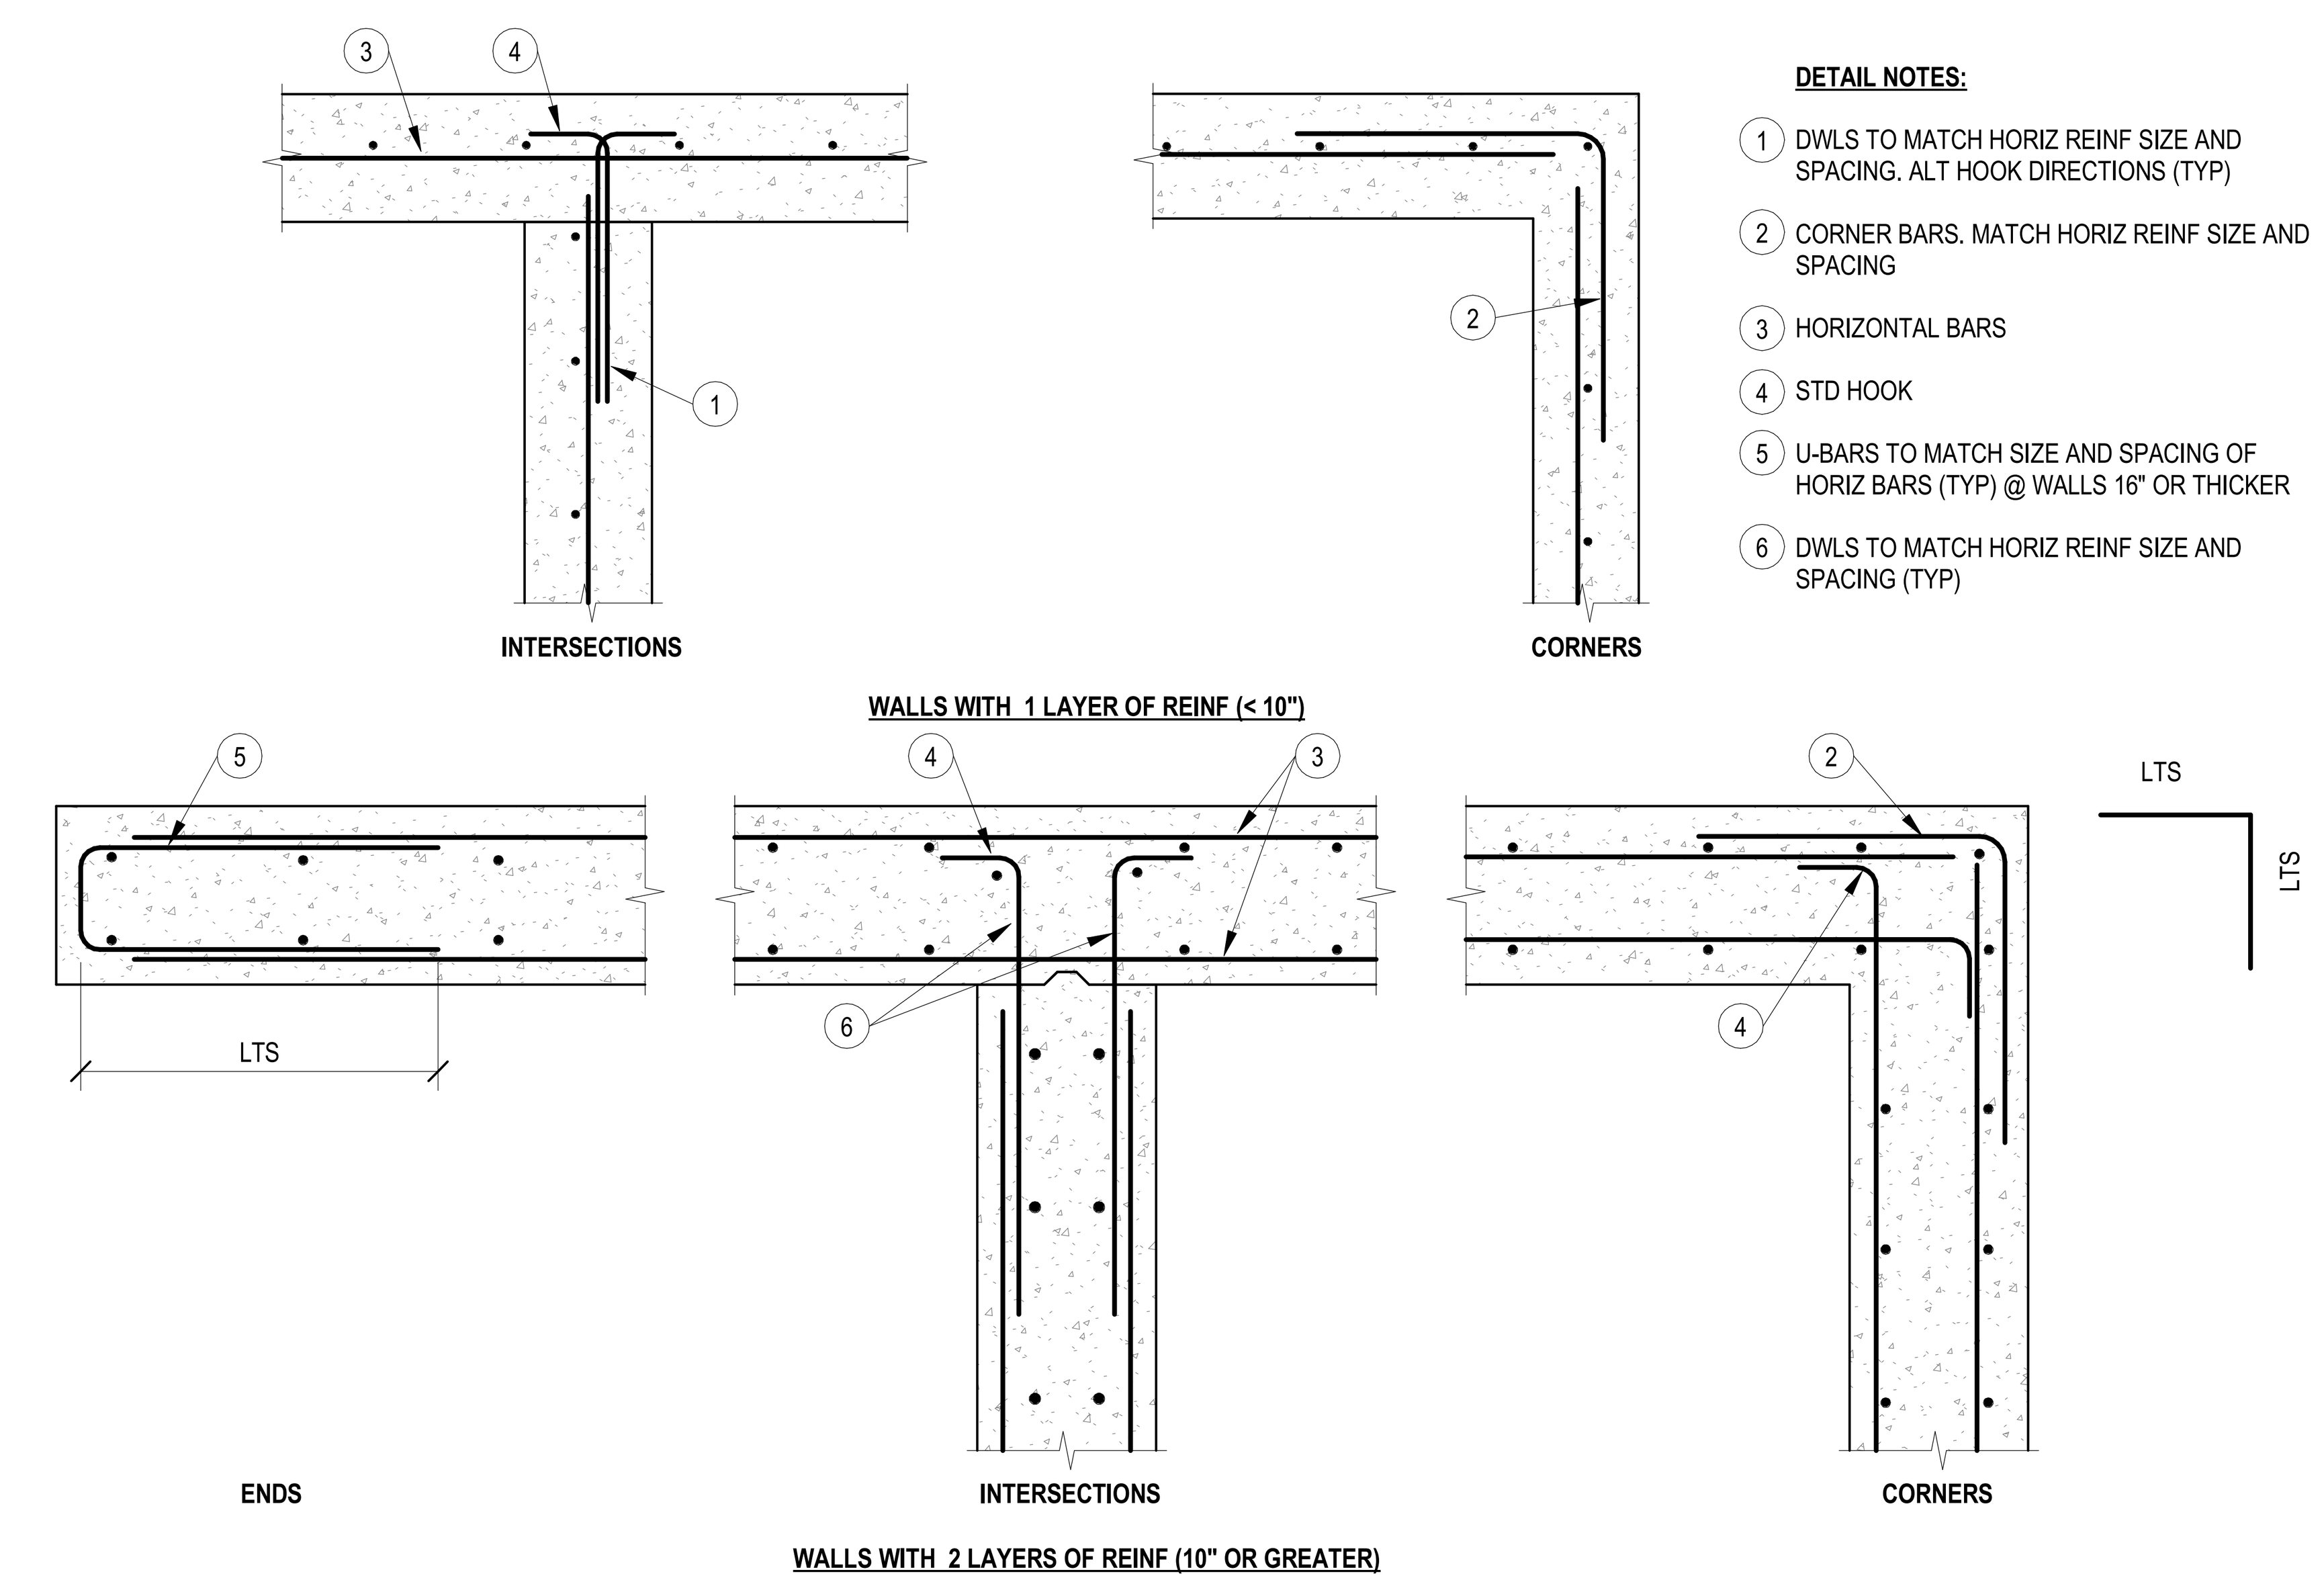

DETAIL NOTES:
1. DWLS TO MATCH HORIZ REINF SIZE AND SPACING. ALT HOOK DIRECTIONS (TYP)
2. CORNER BARS. MATCH HORIZ REINF SIZE AND SPACING
3. HORIZONTAL BARS
4. STD HOOK
5. U-BARS TO MATCH SIZE AND SPACING OF HORIZ BARS (TYP) @ WALLS 16" OR THICKER
6. DWLS TO MATCH HORIZ REINF SIZE AND SPACING (TYP)

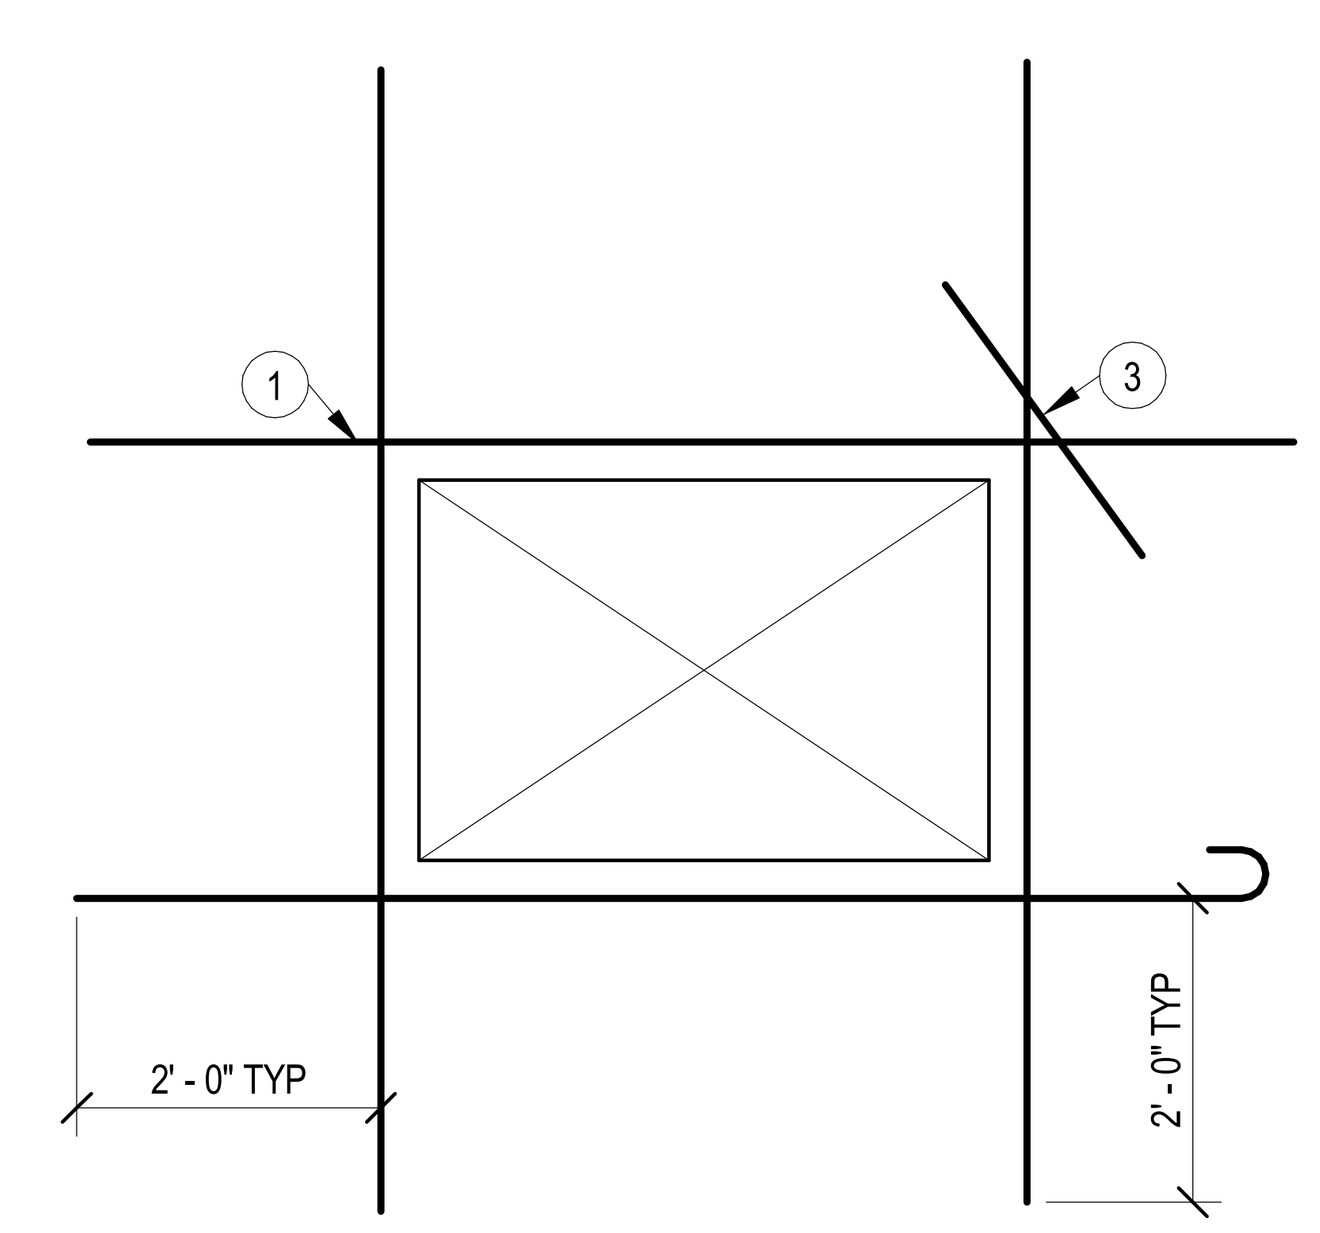

DETAIL NOTES:
1. (1) #4 BAR TYP
2. (2) #4 x 4'-0" EA CORNER

7 CONC WALL REINF @ OPENINGS

1/2" = 1'-0"

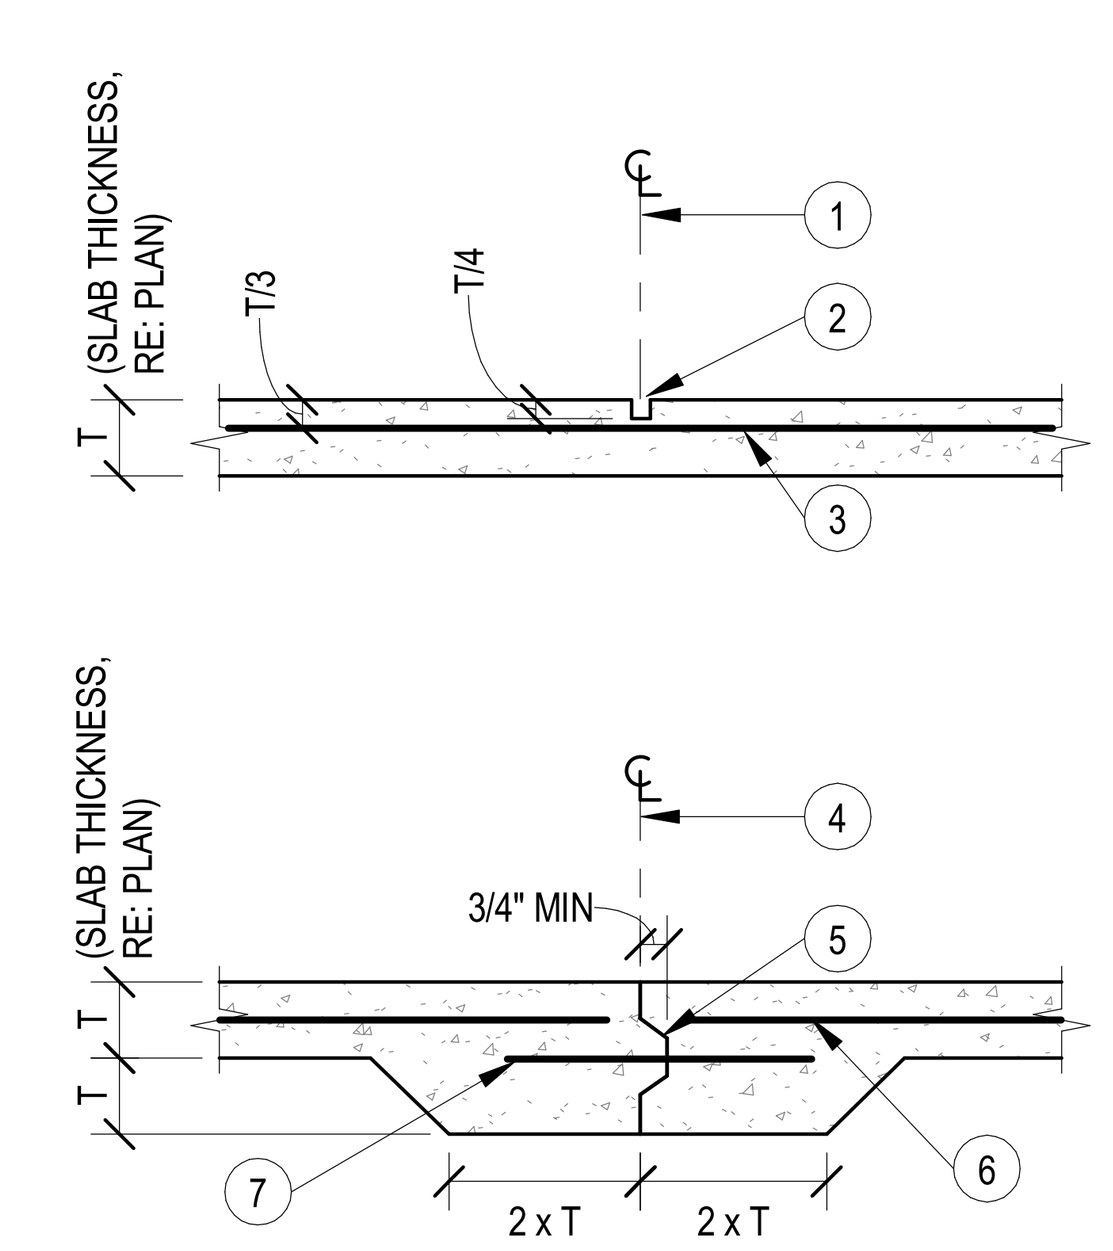

DETAIL NOTES:
1. SAW CUT JOINT
2. SAW CUT JOINT AS SOON AS EQUIPMENT CAN BE PLACED ON SLAB WITHOUT DAMAGE
3. MESH OR REBAR CONT
4. KEYED CONSTRUCTION JOINT USE BOND BREAKER
5. FORMED KEY (NO METAL KEY)
6. CUT MESH OR REBAR AT JOINT
7. 3/4" x 16" SMOOTH DWLS @ 12" OC

NOTES:
A. THIS DETAIL MAY BE USED IN LIEU OF SAW CUT JOINT

4 SLAB ON GRADE CONTROL JOINTS

3/4" = 1'-0"

1 CONC WALL CORNERS

3/4" = 1'-0"

STAND STRUCTURAL ENGINEERING INC
8234 Robinson Street
Overland Park, KS 66204
913-214-2169
stand-sei.com

CODY ROBERT GIBBENS
LICENSED
PE28037
KANSAS
PROFESSIONAL ENGINEER
11/24/2025

DAVID A. KASTER, RA,NCARB,LEED AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC
ARCHITECTURE - PLANNING - INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center
Mr. D's DONUTS
14495 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 24, 2025
REVISED
SHEET NUMBER
S050
OF SHEETS
STAND JOB NO. 25281

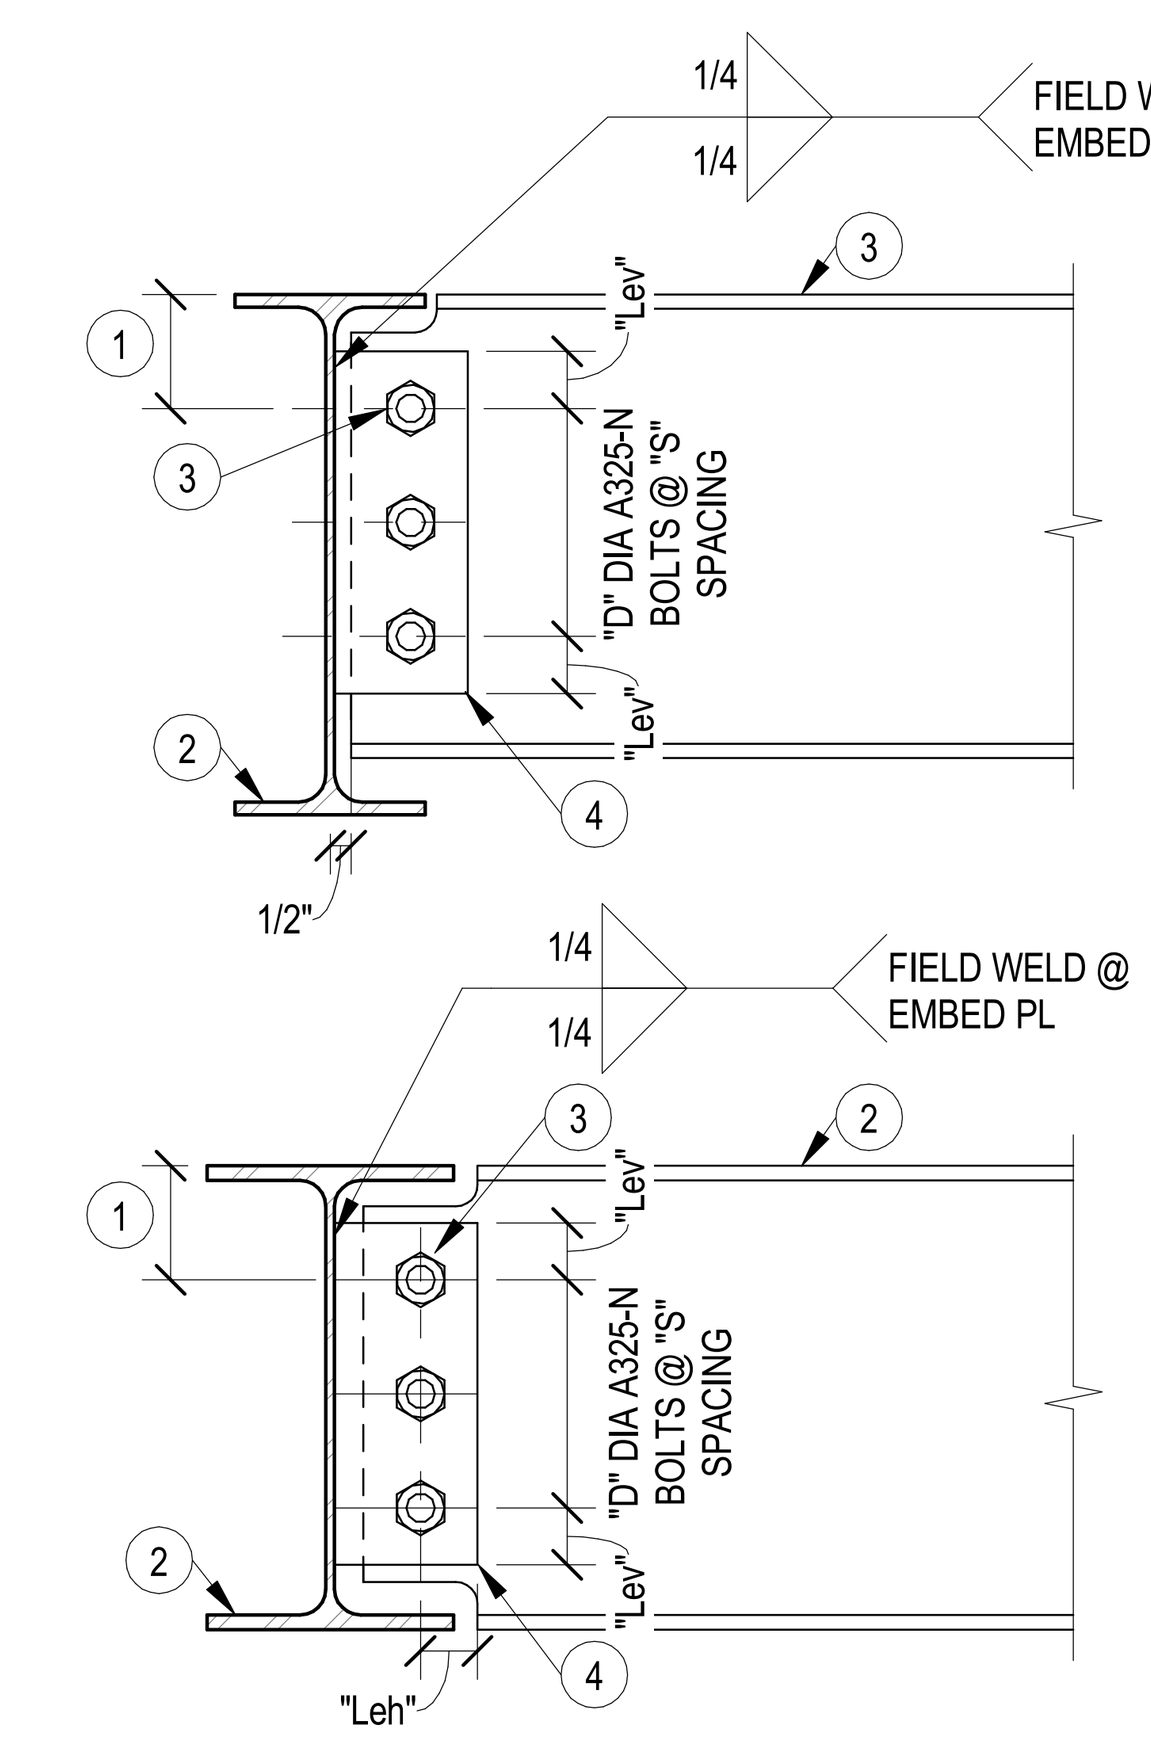

DETAIL NOTES:

1. 3" TYP EXCEPT AS RECOMMENDED BY AISC FOR W8 & SMALLER BEAMS OR FOR LARGER BEAMS
2. STEEL BEAM, RE: PLAN
3. HOLES MAY BE HORIZ SHORT SLOTS AS REQD
4. 3/8" TAB PL WIDTH = 2 x "Leh"+ 1/2". DEPTH AS REQD

BEAM	"N"	V-ALLOW (K)	VARIABLES
W8	2	9.0	"Lev" = 1 1/2" "Leh" = 1 1/2" "D" = 3/4" "N" = PER TABLE "S" = 3"
W10	2	14.0	
W12, W14	3	23.8	
W16	4	39.5	
W18	5	52.3	
W21, W24	6	64.9	
W24	7	77.2	
W27	8	89.5	
W30	9	101.5	

3 SHEAR TAB CONN - COPED

1 1/2" = 1'-0"

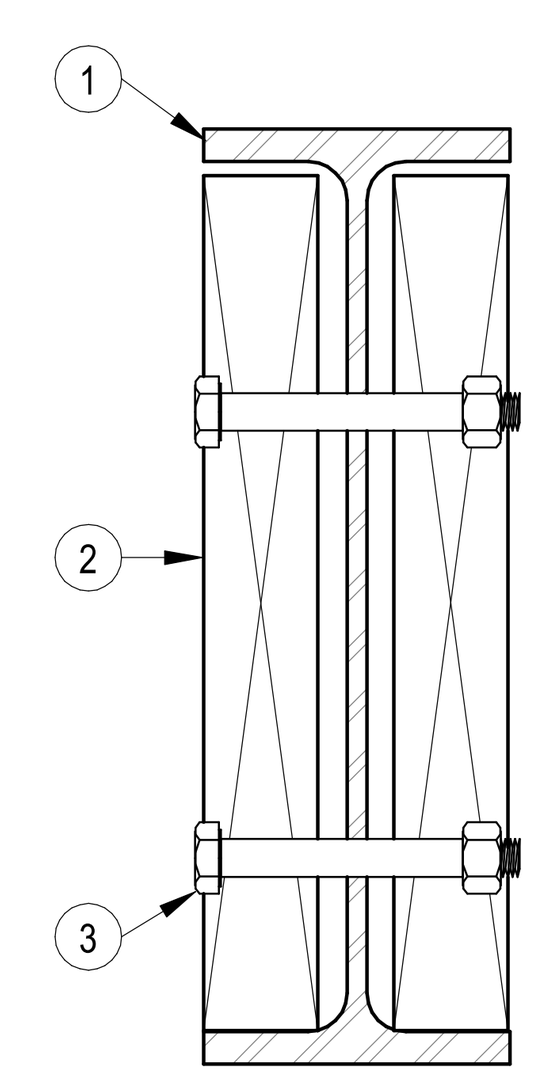

DETAIL NOTES:

1. STEEL BEAM, RE: PLAN
2. PACK OUT WEB WITH 2x LUMBER. CHAMFER @ FILLET AS REQD TO FIT INTO BEAM WEB
3. (2) 1/2" Ø THRU BOLTS @ 24" OC

5 PACK OUT STEEL BEAM WEB

3" = 1'-0"

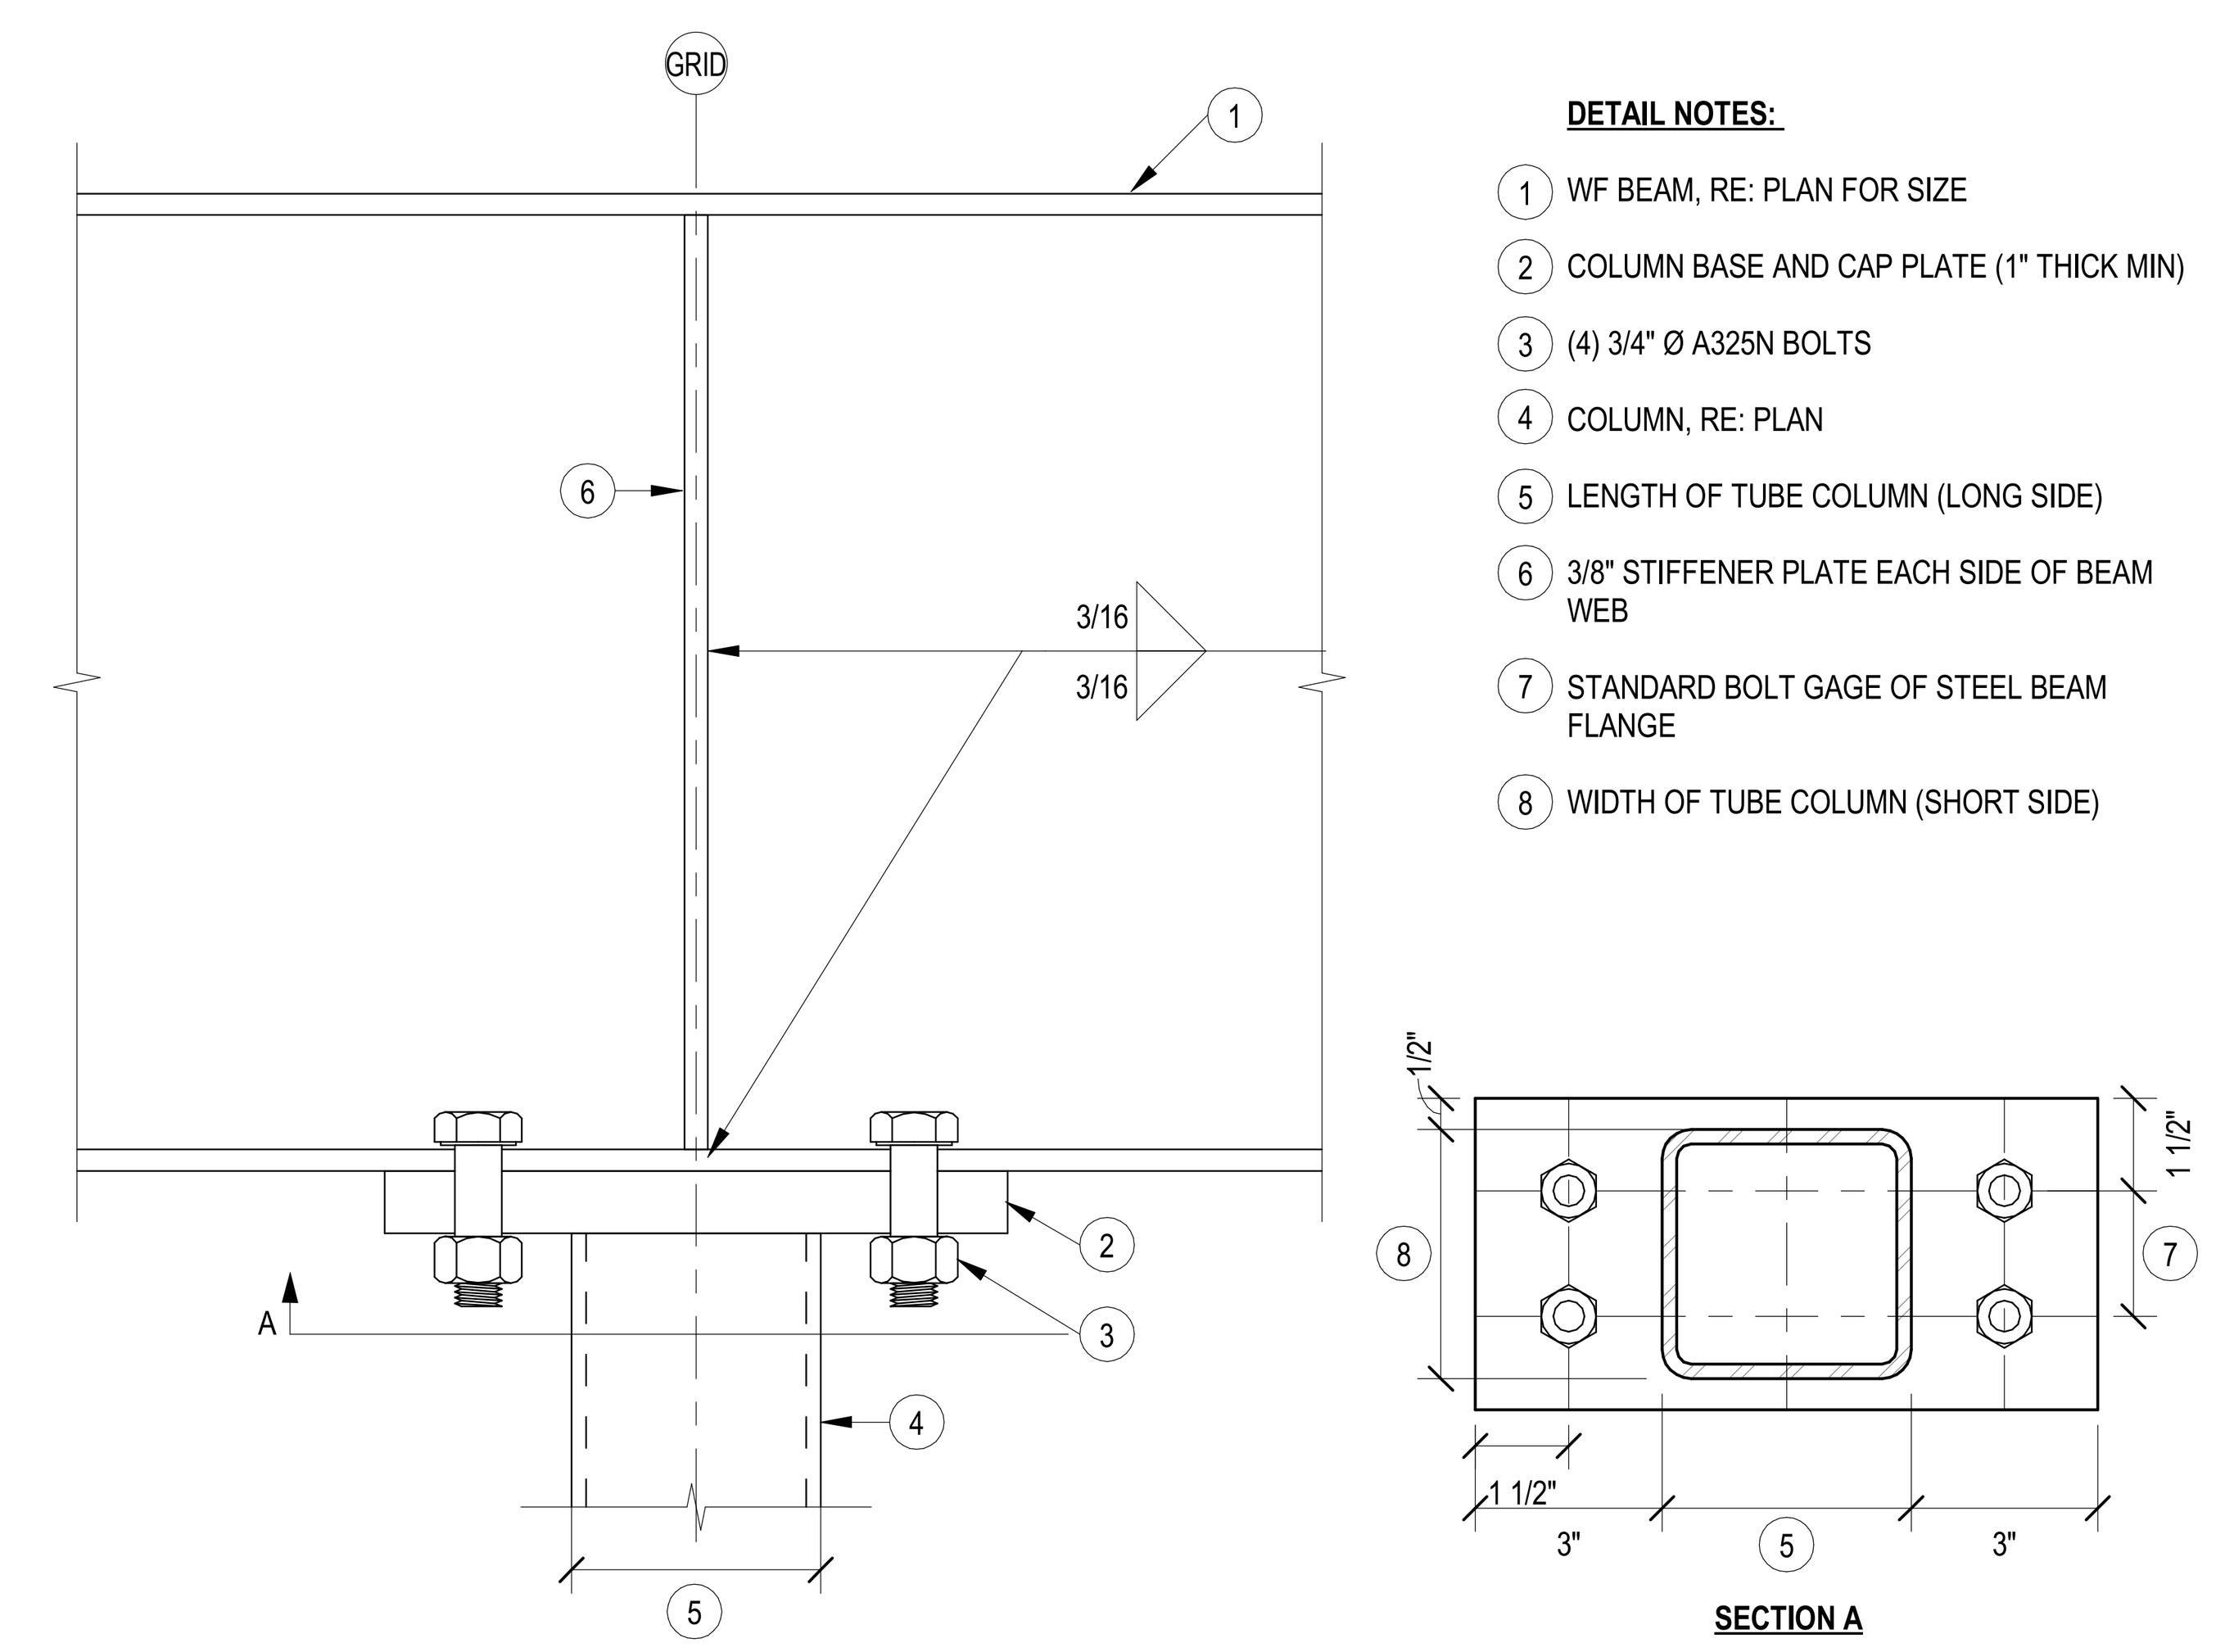

DETAIL NOTES:

1. WF BEAM, RE: PLAN FOR SIZE
2. COLUMN BASE AND CAP PLATE (1" THICK MIN)
3. (4) 3/4" Ø A325N BOLTS
4. COLUMN, RE: PLAN
5. LENGTH OF TUBE COLUMN (LONG SIDE)
6. 3/8" STIFFENER PLATE EACH SIDE OF BEAM WEB
7. STANDARD BOLT GAGE OF STEEL BEAM FLANGE
8. WIDTH OF TUBE COLUMN (SHORT SIDE)

2 HSS COLUMN SPLICE AT BEAM

NTS

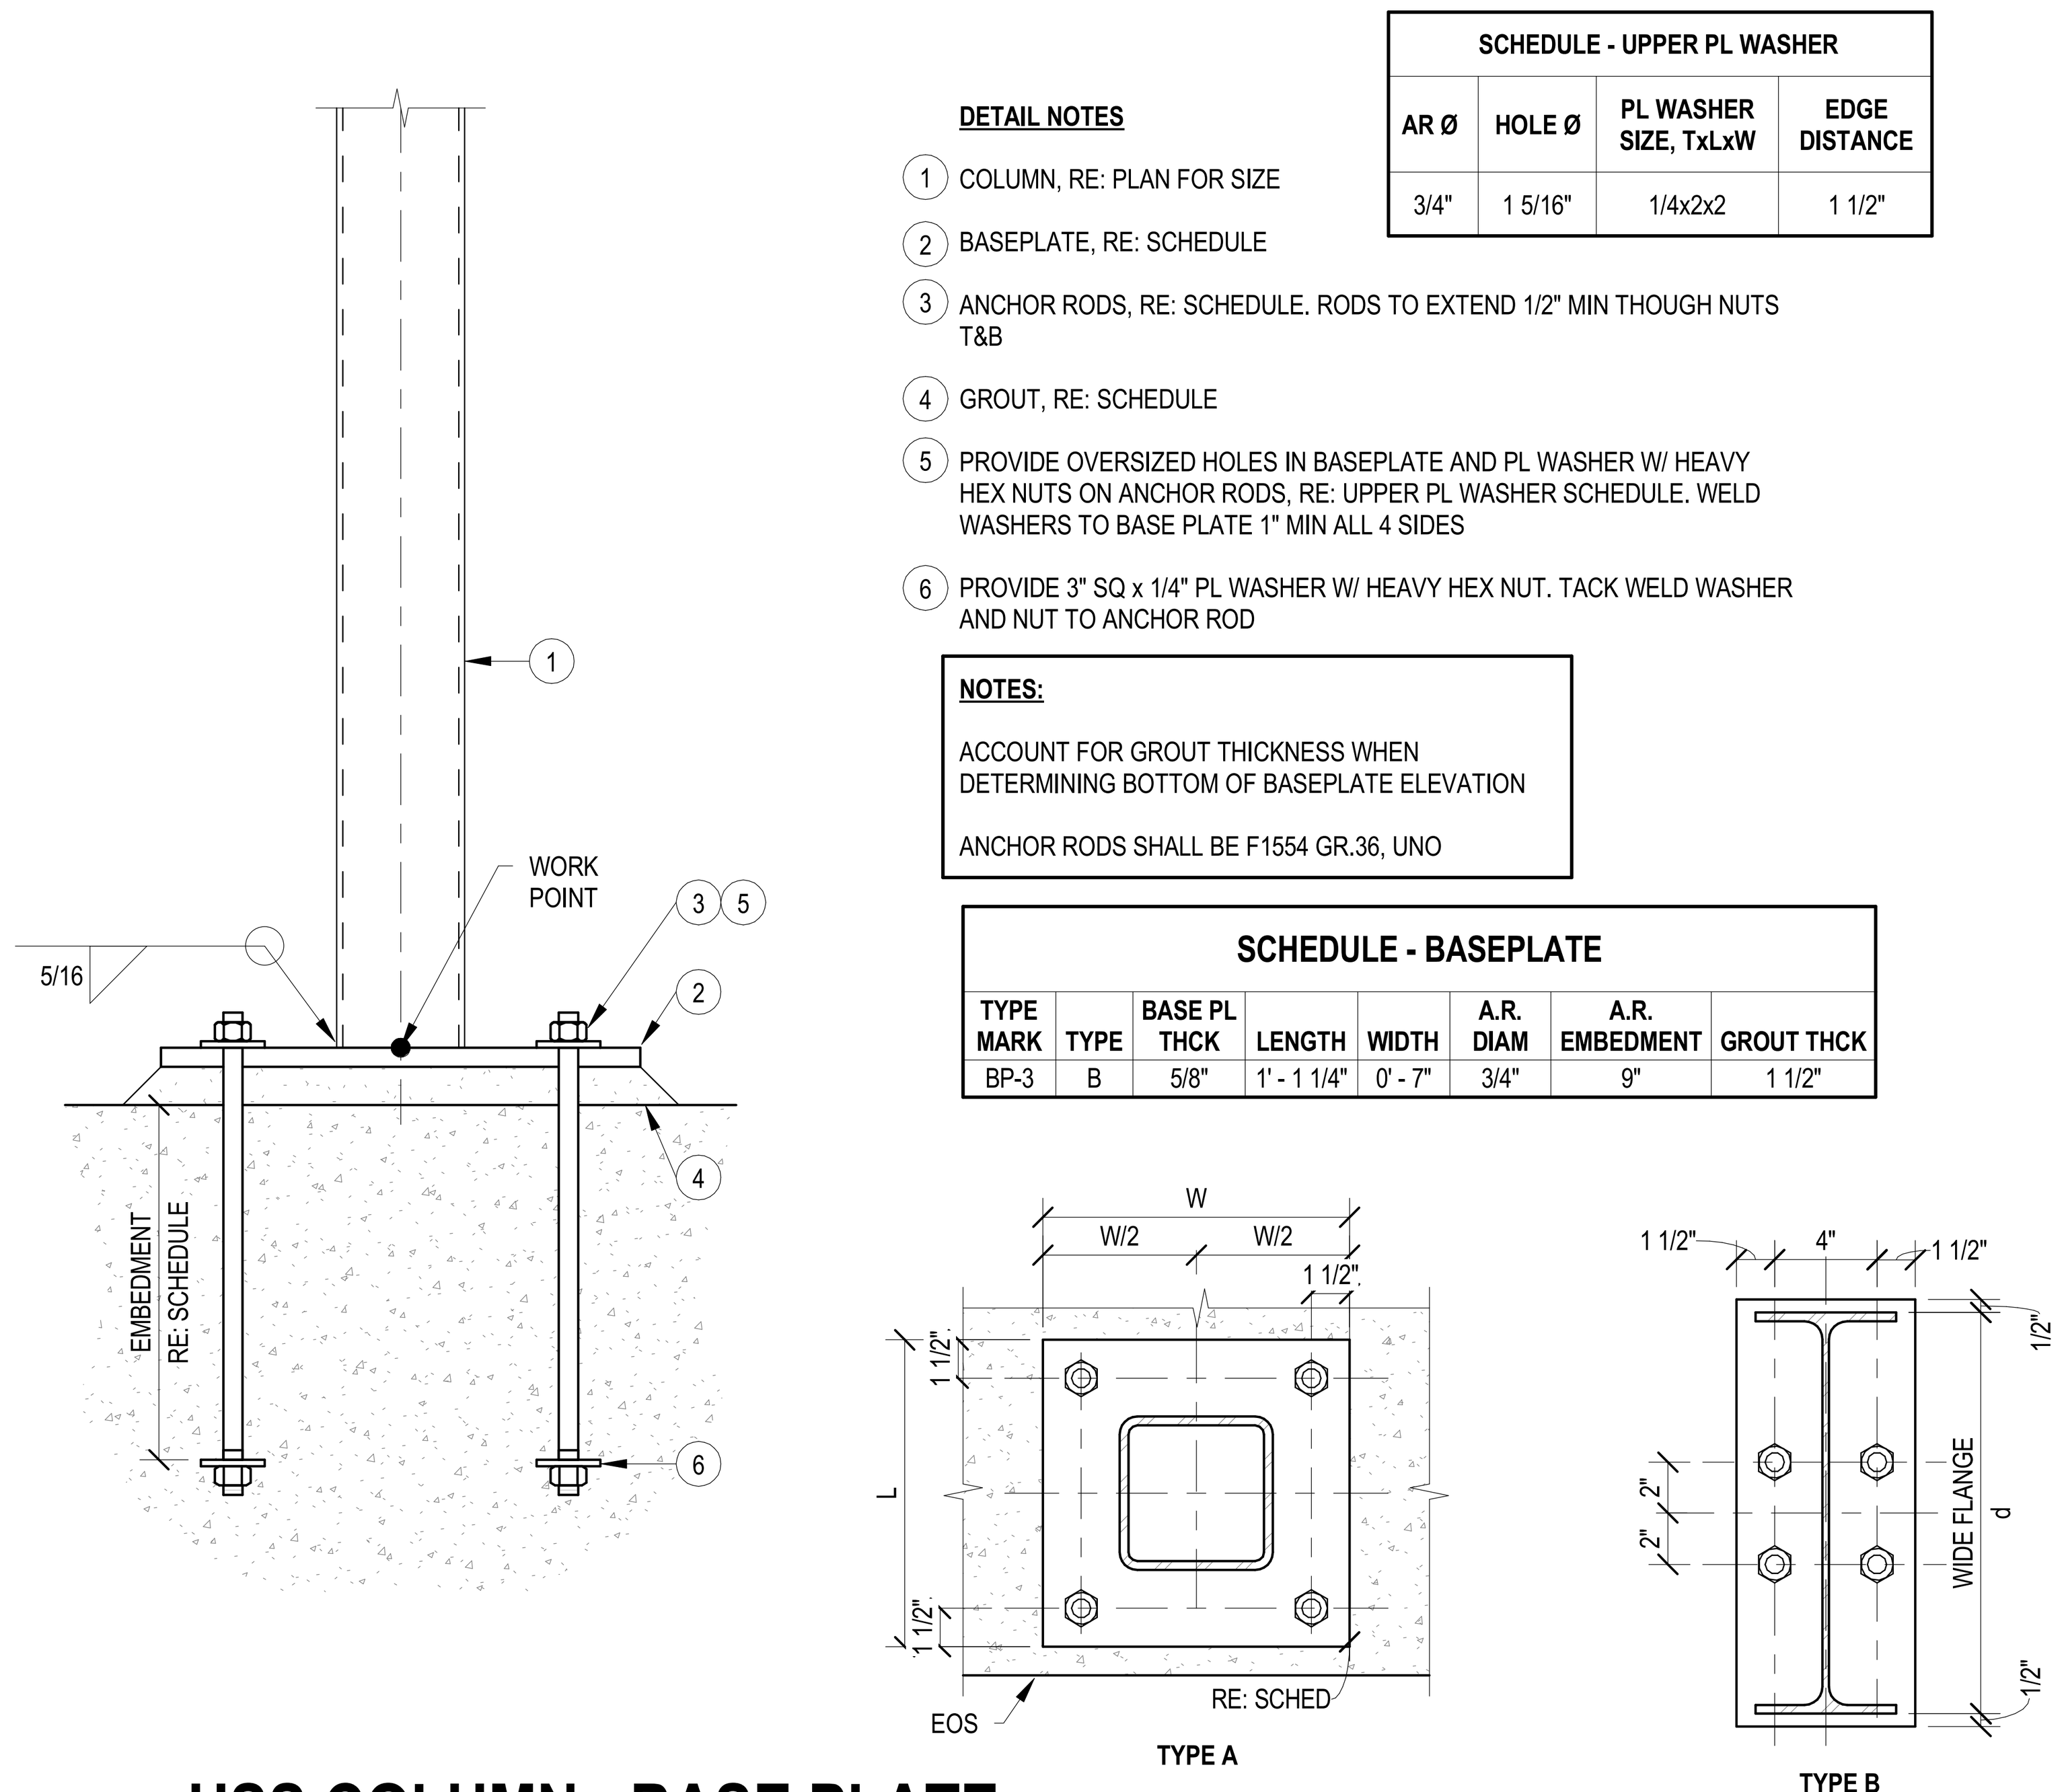

DETAIL NOTES

1. COLUMN, RE: PLAN FOR SIZE
2. BASEPLATE, RE: SCHEDULE
3. ANCHOR RODS, RE: SCHEDULE. RODS TO EXTEND 1/2" MIN THOUGH NUTS T&B
4. GROUT, RE: SCHEDULE
5. PROVIDE OVERSIZED HOLES IN BASEPLATE AND PL WASHER W/ HEAVY HEX NUTS ON ANCHOR RODS, RE: UPPER PL WASHER SCHEDULE. WELD WASHERS TO BASE PLATE 1" MIN ALL 4 SIDES
6. PROVIDE 3" SQ x 1/4" PL WASHER W/ HEAVY HEX NUT. TACK WELD WASHER AND NUT TO ANCHOR ROD

NOTES:

ACCOUNT FOR GROUT THICKNESS WHEN DETERMINING BOTTOM OF BASEPLATE ELEVATION

ANCHOR RODS SHALL BE F1554 GR.36, UNO

SCHEDULE - UPPER PL WASHER

AR Ø	HOLE Ø	PL WASHER SIZE, TxLxW	EDGE DISTANCE
3/4"	1 5/16"	1/4x2x2	1 1/2"

SCHEDULE - BASEPLATE

TYPE MARK	TYPE	BASE PL THCK	LENGTH	WIDTH	A.R. DIAM	A.R. EMBEDMENT	GROUT THCK
BP-3	B	5/8"	1' - 1 1/4"	0' - 7"	3/4"	9"	1 1/2"

4 HSS COLUMN - BASE PLATE

1 1/2" = 1'-0"

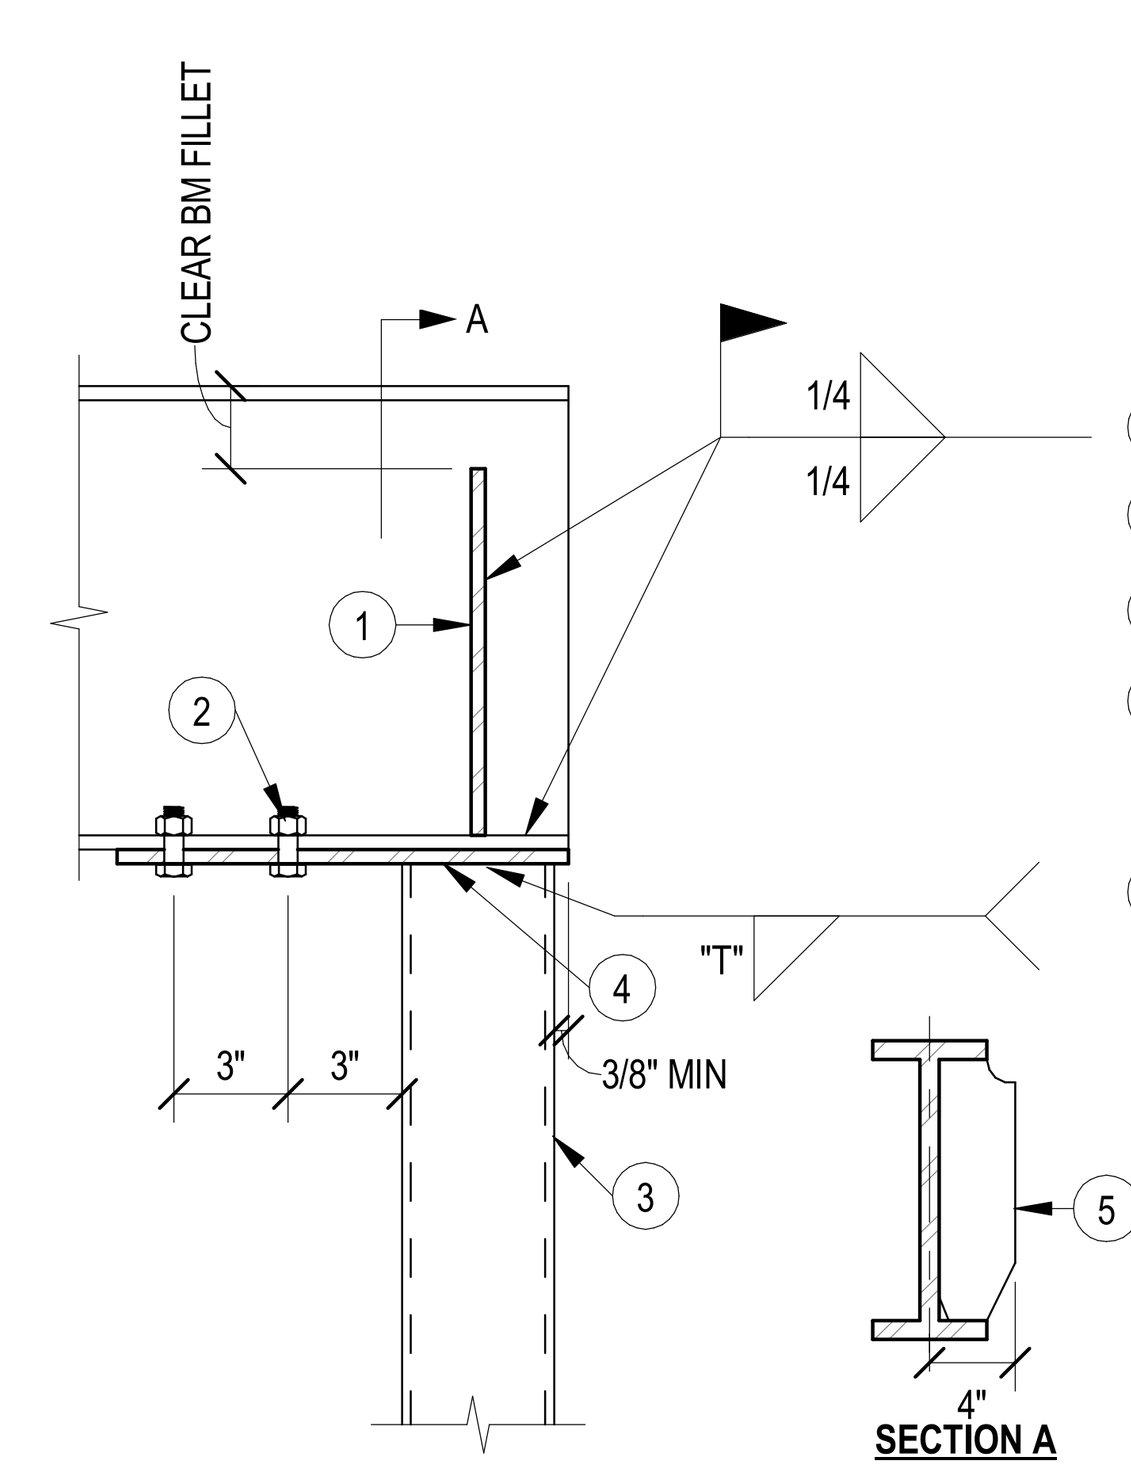

DETAIL NOTES

1. 3/8" STIFFENER PL EA SIDE
2. (4) 3/4" Ø A325 BOLTS UNO
3. HSS COL, RE: PLAN
4. CAP PL 3/4" x COL SIZE PLUS 1" OR BM FLANGE (WHICH EVER IS LARGER)
5. STIFFENER WHERE BM FRAMES IN @ COL CENTERLINE, RE: FRAMING CONN SINGLE SHEAR PL

NOTES:

"T" = THICKNESS OF TUBE, NEED NOT EXCEED 5/16"

1 PERIMETER COLUMN CAP PLATE

1 1/2" = 1'-0"

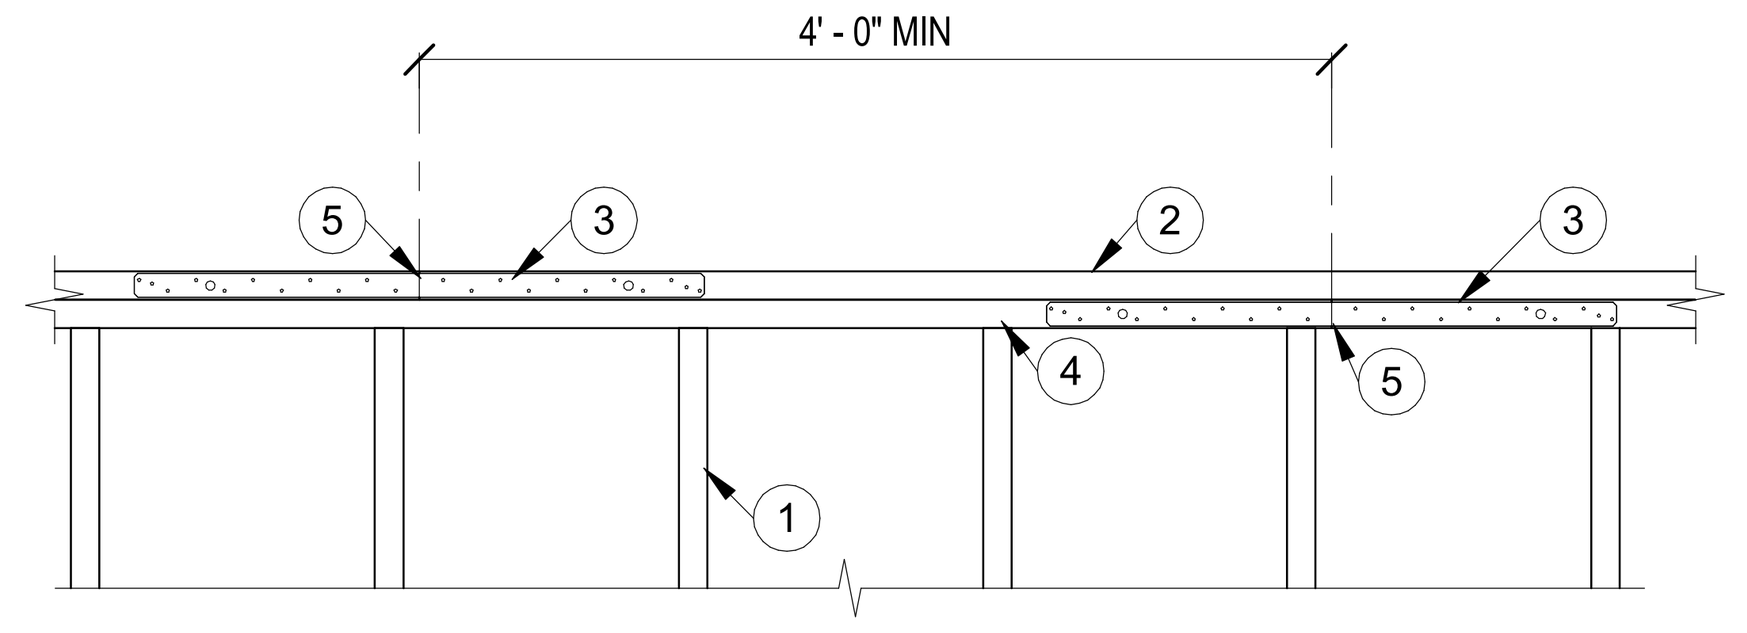

11 TOP PLATE SPLICE
3/4" = 1'-0"

DETAIL NOTES:

1. WALL STUDS
2. DOUBLE TOP PLATE
3. SIMPSON MSTA30 ON EACH FACE CENTERED AT SPLICE
4. JOINT IN LOWER PLATE MEMBERS SHALL OCCUR OVER A STUD
5. SPLICE

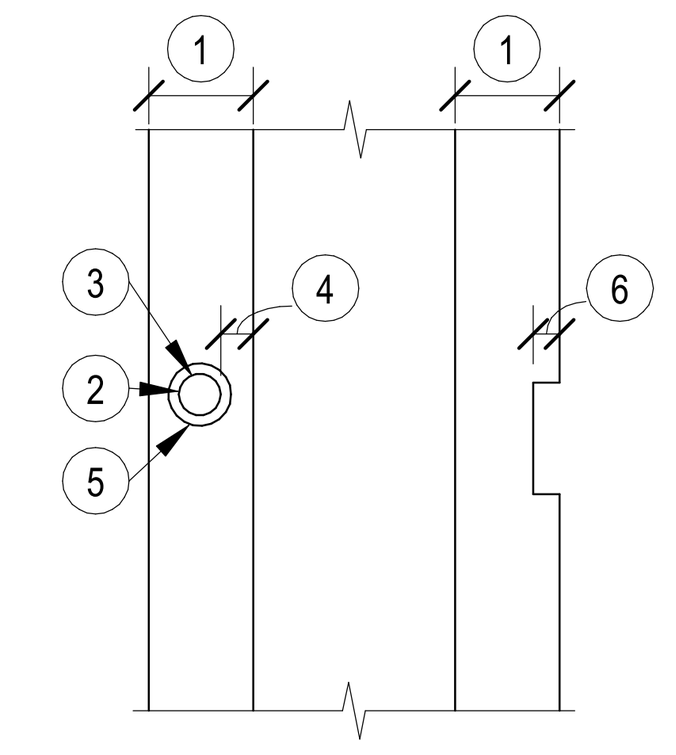

7 BORED HOLE & NOTCHES - VERT FRAMING
3/4" = 1'-0"

DETAIL NOTES:

1. STUD DEPTH
2. MAX DIAMETER OF BORED HOLE = STUD DEPTH / 2 1/2
3. IF BORED HOLE IS GREATER THAN STUD DEPTH / 21/2 & LESS THAN 3 * STUD DEPTH / 5, THEN STUD MUST BE DOUBLED & NO MORE THAN TWO SUCCESSIVE STUDS ARE DOUBLED & BORED
4. 5/8" MIN TO EDGE
5. BORED HOLES SHALL NOT BE LOCATED IN THE SAME CROSS SECTION OF CUT OR NOTCH IN STUD
6. MAX NOTCH = STUD DEPTH / 4

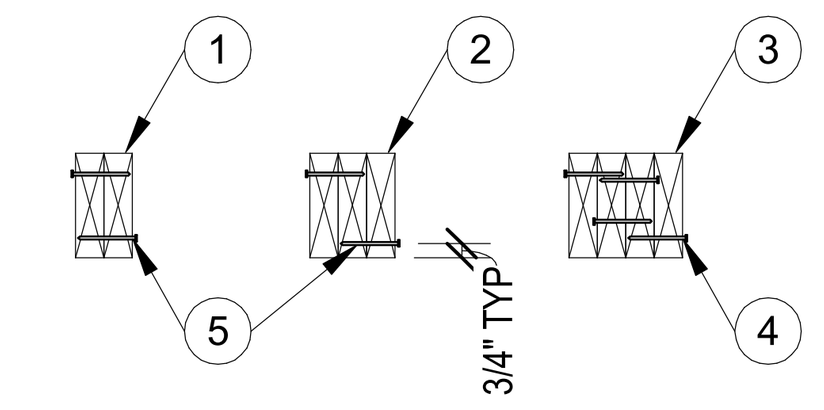

4 TYP BUILT UP COL DETAIL
3/4" = 1'-0"

DETAIL NOTES:

1. (2) 2x WALL FRAMING RE: PLAN
2. (3) 2x WALL FRAMING RE: PLAN
3. (4) 2x WALL FRAMING RE: PLAN
4. 10d NAILS @ 16" OC STAGGERED (FULL STUD HT)
5. 12d NAILS @ 16" OC STAGGERED (FULL STUD HT)

STAND STRUCTURAL ENGINEERING INC
8234 Robinson Street
Overland Park, KS 66204
913-214-2169
stand-sei.com

CODY ROBERT GIBBS
LICENSED
PE28037
KANSAS
PROFESSIONAL ENGINEER
11/24/2025

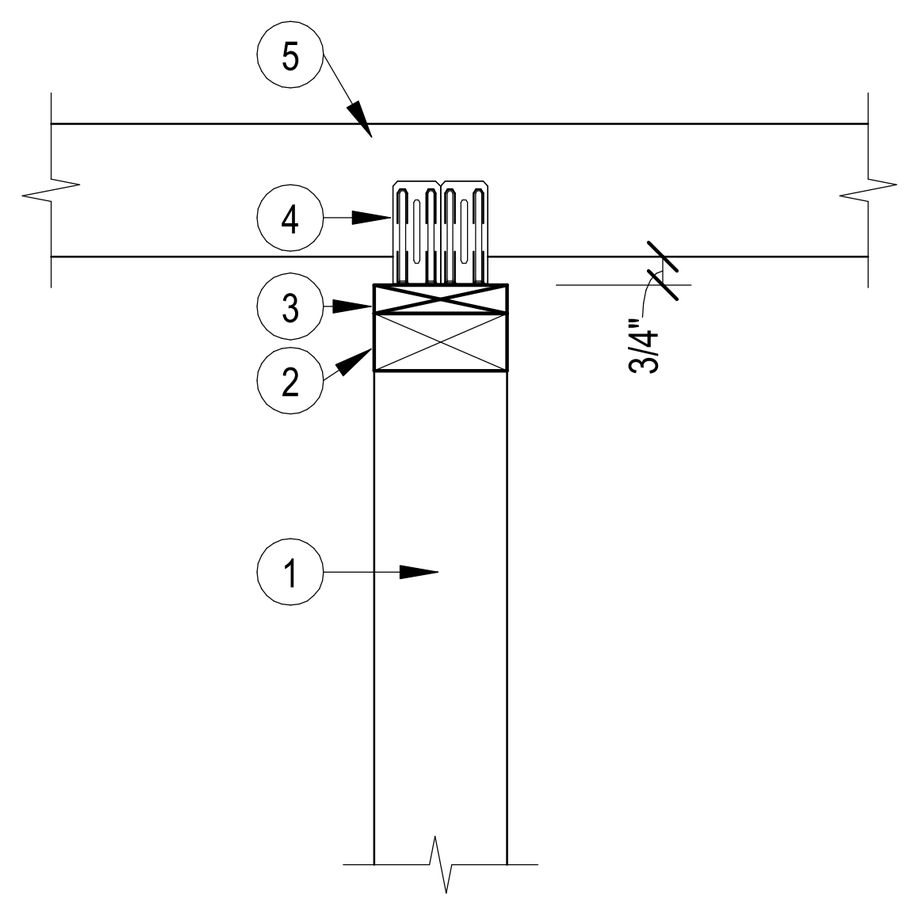

10 SECTION @ NON-LOAD BEARING WALL
1 1/2" = 1'-0"

DETAIL NOTES:

1. NON-LOAD BEARING WALL
2. CONT. 2x TOP PLATE
3. CONT 1x TOP PLATE
4. SIMPSON STC @ ALT TRUSSES @ 4'-0" MAX
5. PRE-FAB TRUSS OR 2x4 @ 48" OC BETWEEN TRUSSES

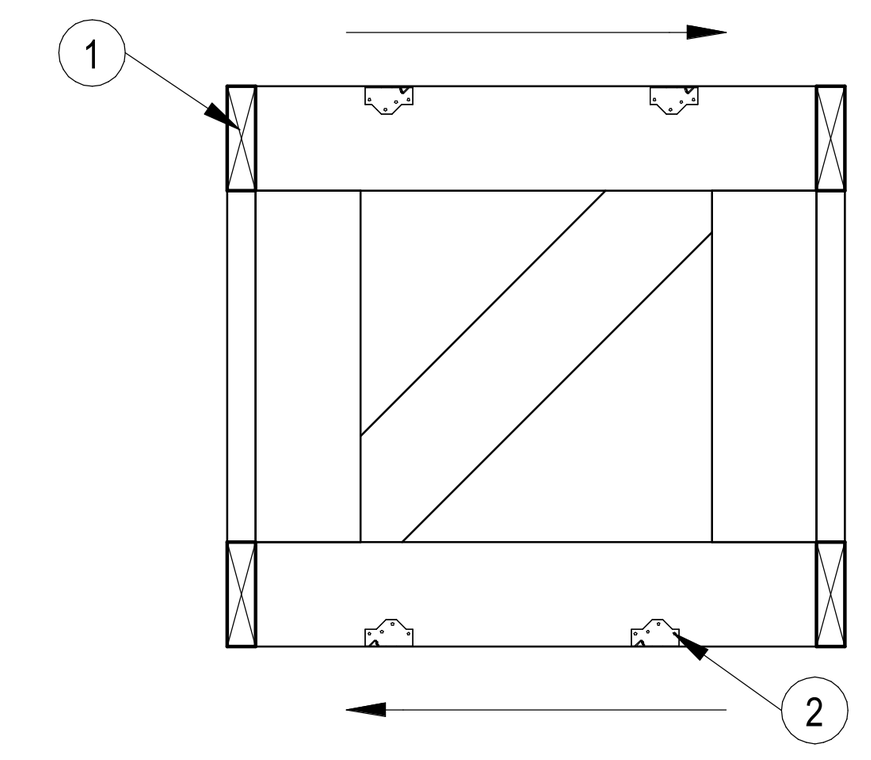

6 TRUSS BLOCKING ELEVATION
3/4" = 1'-0"

DETAIL NOTES:

1. PRE-ENGINEERED TRUSS BLOCKING BY TRUSS SUPPLIER.
2. FASTEN BOTTOM W/ (2) SIMPSON A34 CLIPS @ EACH TRUSS BLOCK T&B

NOTES:

BLOCKING BY TRUSS SUPPLIER, RE: SHEAR WALL SCHEDULE FOR DESIGN FORCES

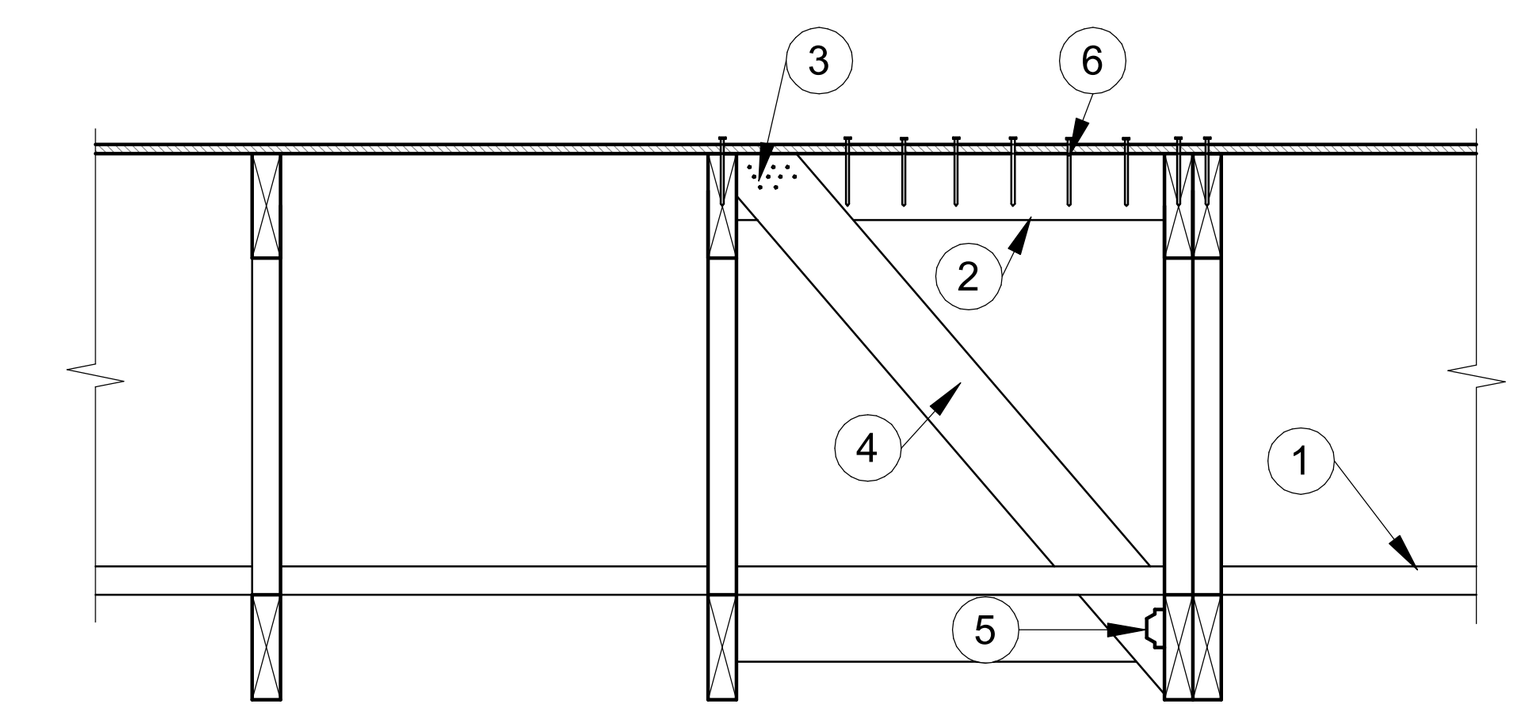

3 LATERAL BRACING DETAIL
3/4" = 1'-0"

DETAIL NOTES:

1. CONTINUOUS LATERAL BRACE, RE: TRUSS SUPPLIER
2. 2x4 BLOCKING.
3. FASTEN BRACE TO BLOCKING WITH (10) 10d NAILS
4. 2x4 BRACE EVERY 8 SPACES AND AT ENDS
5. (2) HGA10KT CLIPS @ EA BRACE
6. 10d NAILS @ 3" OC

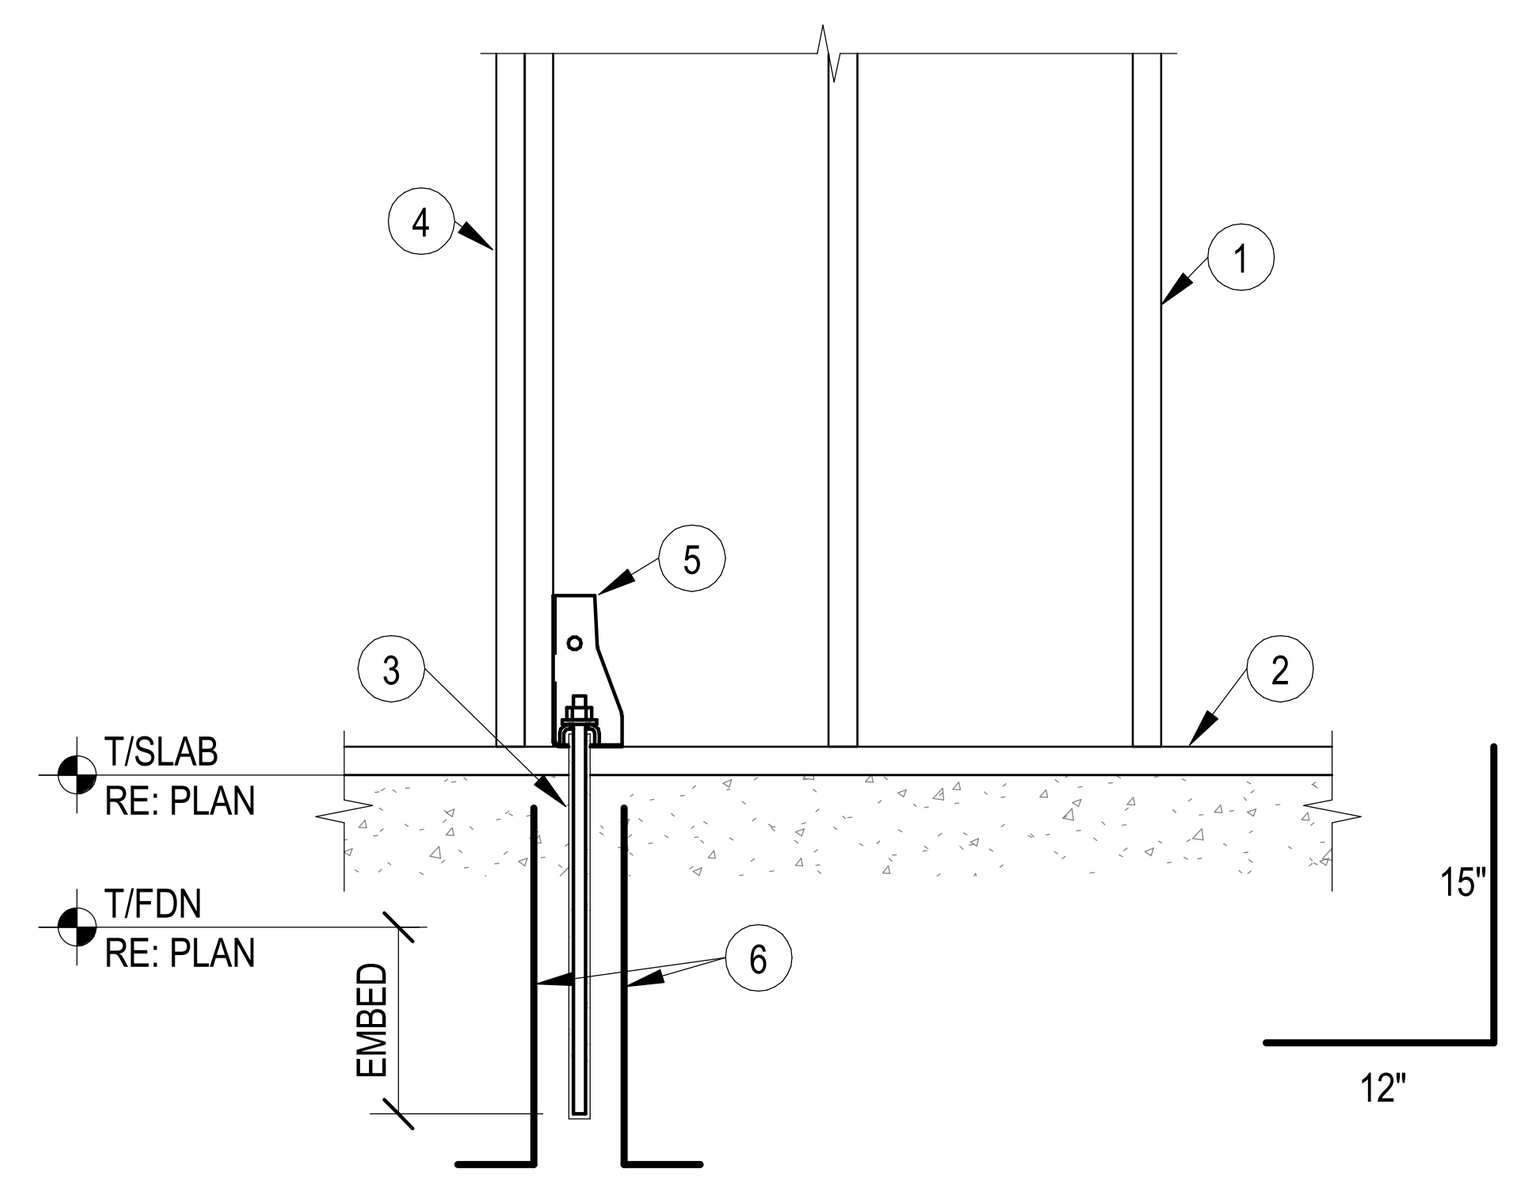

9 SHEAR WALL - BASE HOLDOWN
3/4" = 1'-0"

DETAIL NOTES

1. 2x STUD FRAMING OR CFS FRAMING, RE: SHEAR WALL SCHEDULE
2. AT WOOD WALLS, TREATED 2x SILL PLATE TO MATCH SIZE OF WALL. AT CFS WALLS, 800T125-54 SILL TRACK. ANCHORAGE RE: SHEAR WALL SCHEDULE
3. HOLDOWN ANCHOR, RE: SCHEDULE
4. BOUNDRY CONDITION STUDS @ SHEAR WALL ENDS. RE: SHEAR WALL SCHEDULE FOR NUMBER OF PLYS. RE: GENERAL NOTES FOR BUILT UP 2x FRAMING FASTENER SCHEDULE
5. SIMPSON HOLDOWN ATTACH TO BOUNDARY CONDITION STUDS PER SIMPSONS SPECS. RE: SHEARWALL SCHEDULE FOR SIZE. RE: PLAN FOR LOCATION
6. PROVIDE (2) #5 HOOKED DOWELS @ SHEAR WALL HOLDOWNS RE: PLAN, CENTER IN STEMWALL EA SIDE OF HOLDOWN.

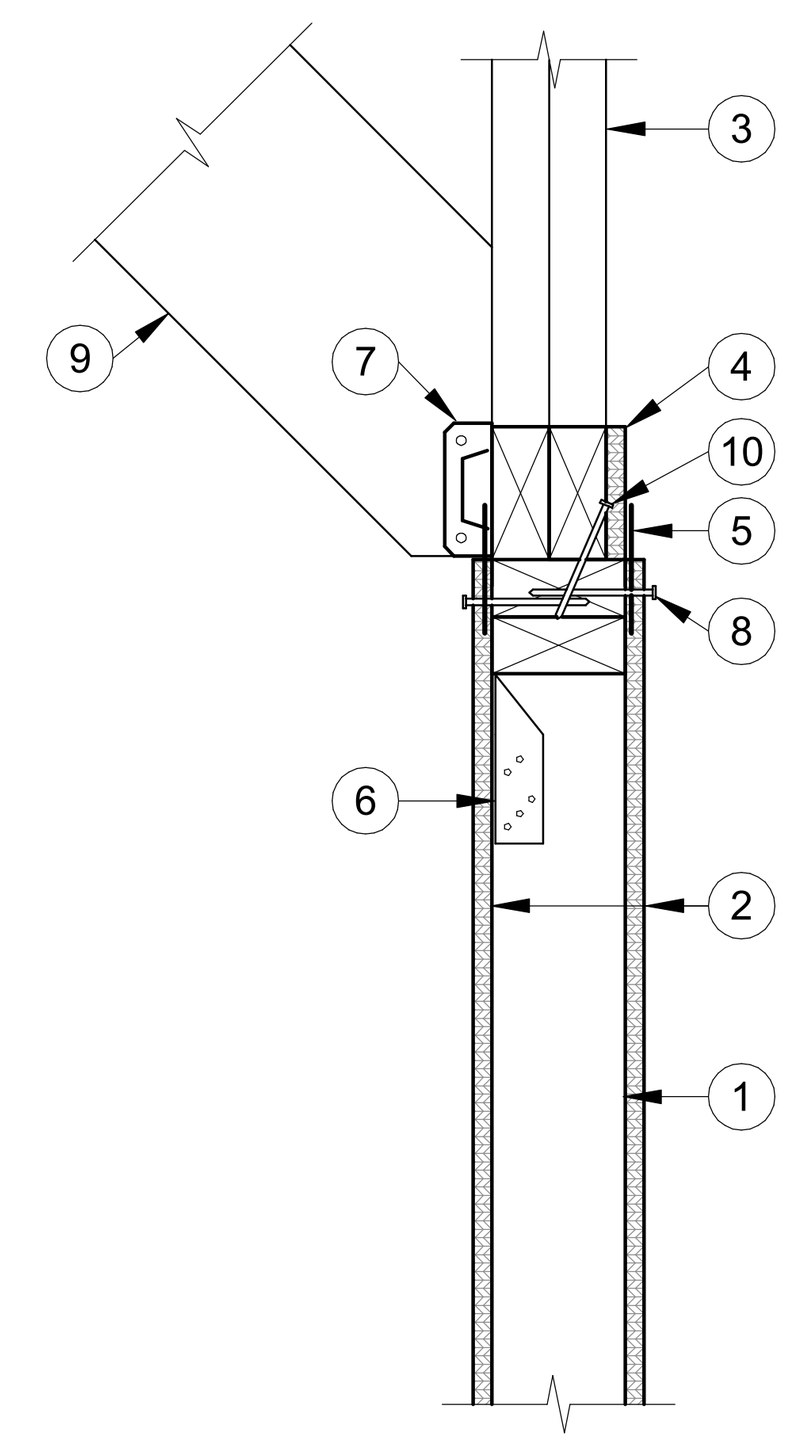

5 ALT. INTERIOR SHEAR WALL
1 1/2" = 1'-0"

DETAIL NOTES:

1. 2x4 STUDS @ SHEAR WALL
2. SHEATHING PER SHEARWALL SCHEDULE
3. PRE-ENGINEERED WOOD ROOF TRUSS BY TRUSS SUPPLIER, RE: PLAN. DESIGN TO TRANSFER LOAD TO SHEAR WALL PER SHEAR WALL SCHEDULE. MAX STRUT LOAD, RE: PLAN
4. SHIM FACE OF TRUSS TO BE FLUSH WITH FACE OF STUD
5. SIMPSON LTP4 CLIP @ 8" OC EACH FACE
6. SIMPSON TSP @ EA STUD
7. SIMPSON GA2 @ EACH BRACE
8. SHEAR WALL EDGE NAIL EA FACE
9. BRACE, RE: 12/S060
10. TOENAIL TRUSS TO TOP PLATE WITH MIN 8d NAILS @ 8" OC

NOTES:

RE: 7/S060 FOR INFORMATION NOT SHOWN

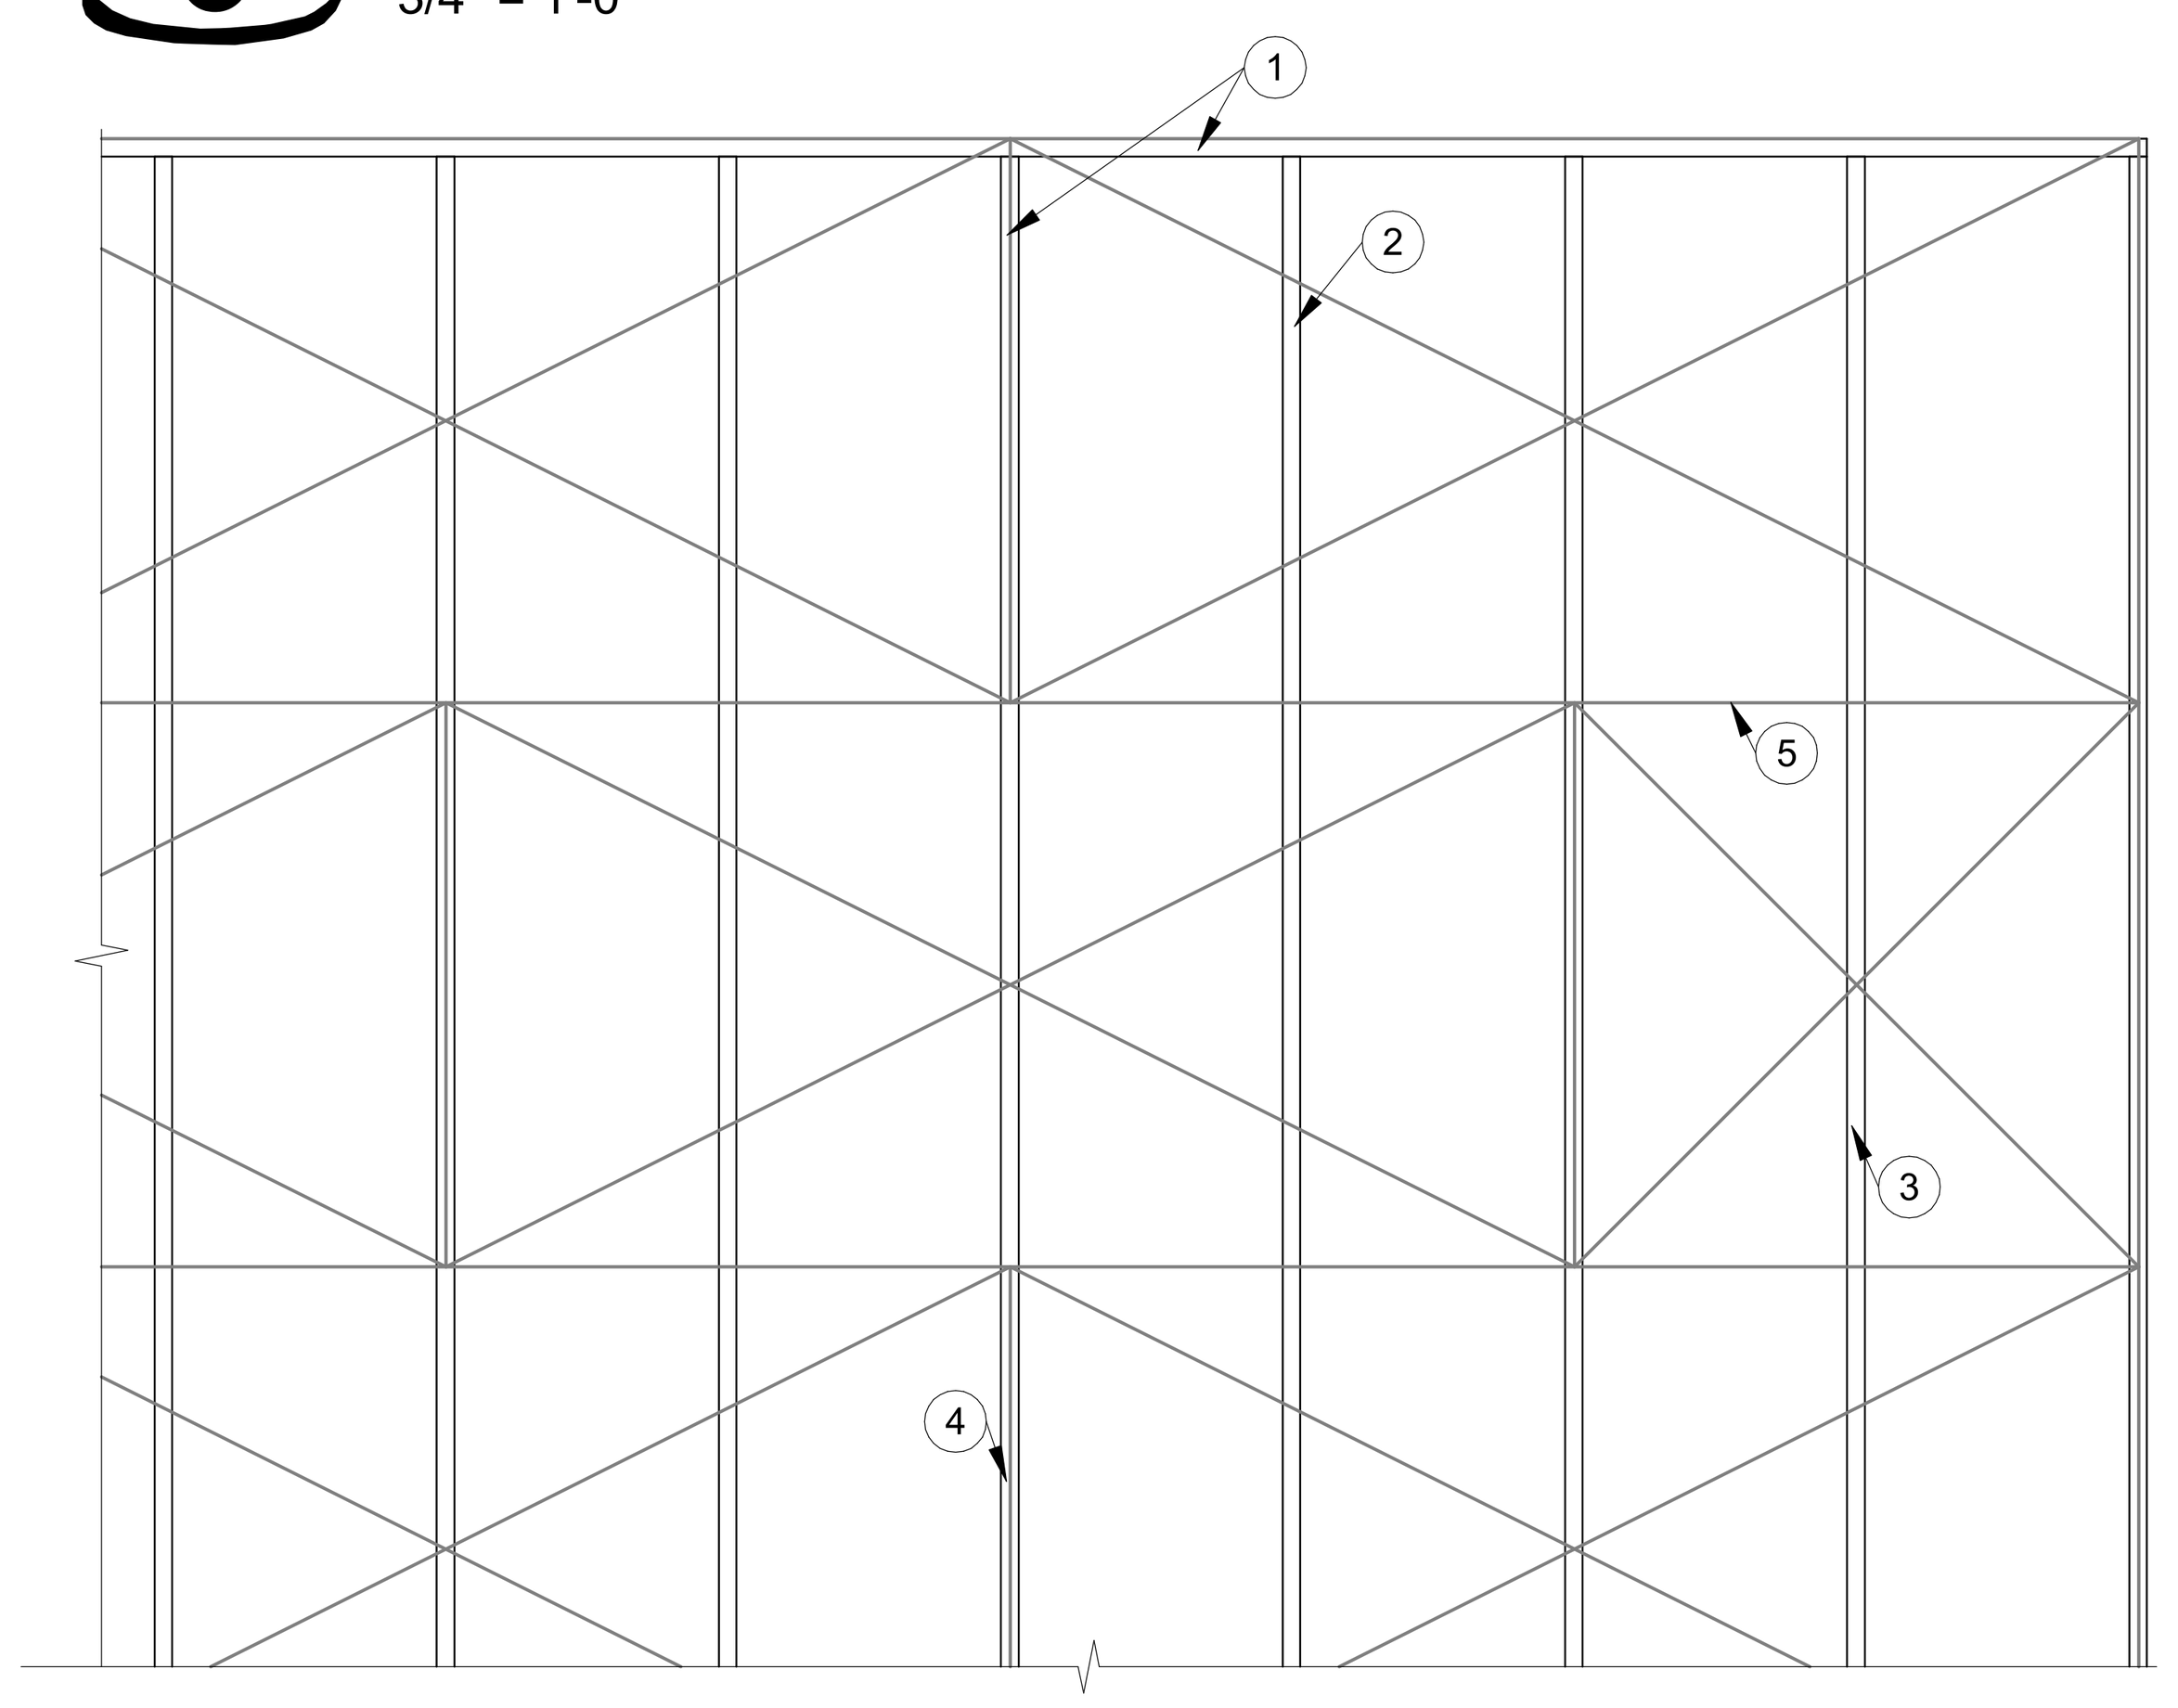

2 ROOF DIAPHRAM NAILING PATTERN
1/2" = 1'-0"

DETAIL NOTES:

1. 10d @ 6" OC ON BOUNDRY TYP
2. 10d @ 12" OC IN FIELD
3. BLOCK ALL EDGES OF PLYWOOD W/ 2x4 BLOCKING BTWN TRUSSES
4. ROOF PREFAB TRUSS
5. JOINT

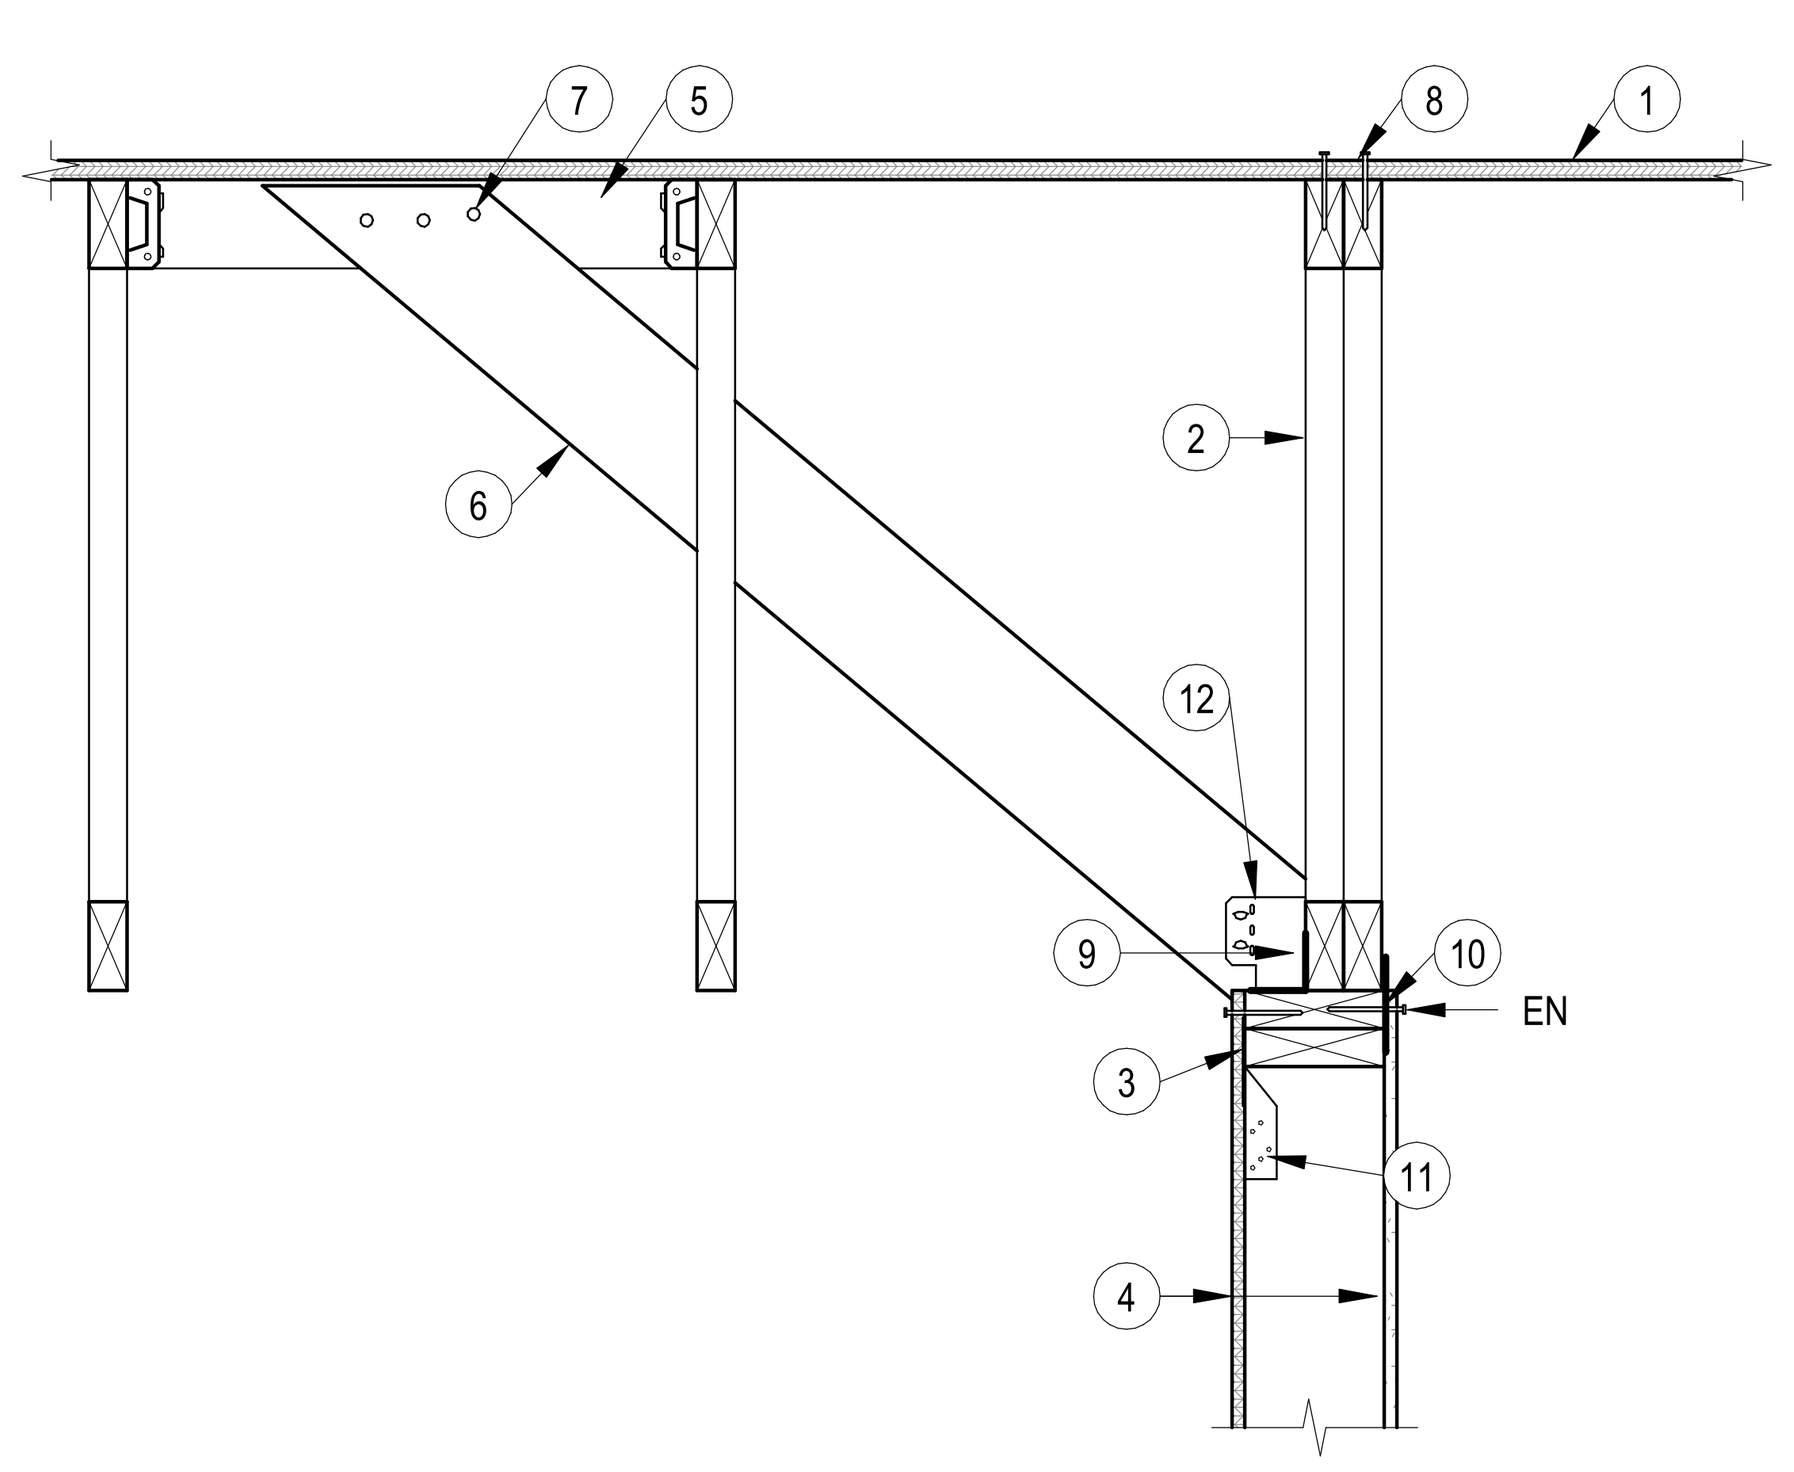

8 SECTION @ INTERIOR SHEAR WALL
1" = 1'-0"

DETAIL NOTES:

1. ROOF SHEATHING, RE: PLAN & GEN NOTES
2. PRE-ENGINEERED WOOD ROOF TRUSS BY TRUSS SUPPLIER, RE: PLAN. DESIGN TO TRANSER LOAD TO SHEAR WALL PER SHEAR WALL SCHEDULE. MAX STRUT LOAD, RE: PLAN
3. DOUBLE TOP PLATE
4. SHEATHING PER SHEAR WALL SCHEDULE
5. 2x4 BRACE @ 8'-0" OC (MAX) W/ SIMPSON A34 EACH END
6. 2x6 BRACE @ 8'-0" OC (MAX) AND AT END OF SHEAR WALL
7. FASTEN BRACE TO BLOCKING WITH (3) 16D COMMON NAILS
8. 10d NAILS @ 6" OC MIN
9. SIMPSON A35 CLIP @ 12" OC
10. SIMPSON LTP4 @ 12" OC
11. SIMPSON TSP @ EA STUD
12. SIMPSON GBC @ EACH BRACE

NOTES:

RE: 5/S060 FOR 2x4 SHEAR WALL CONDITION

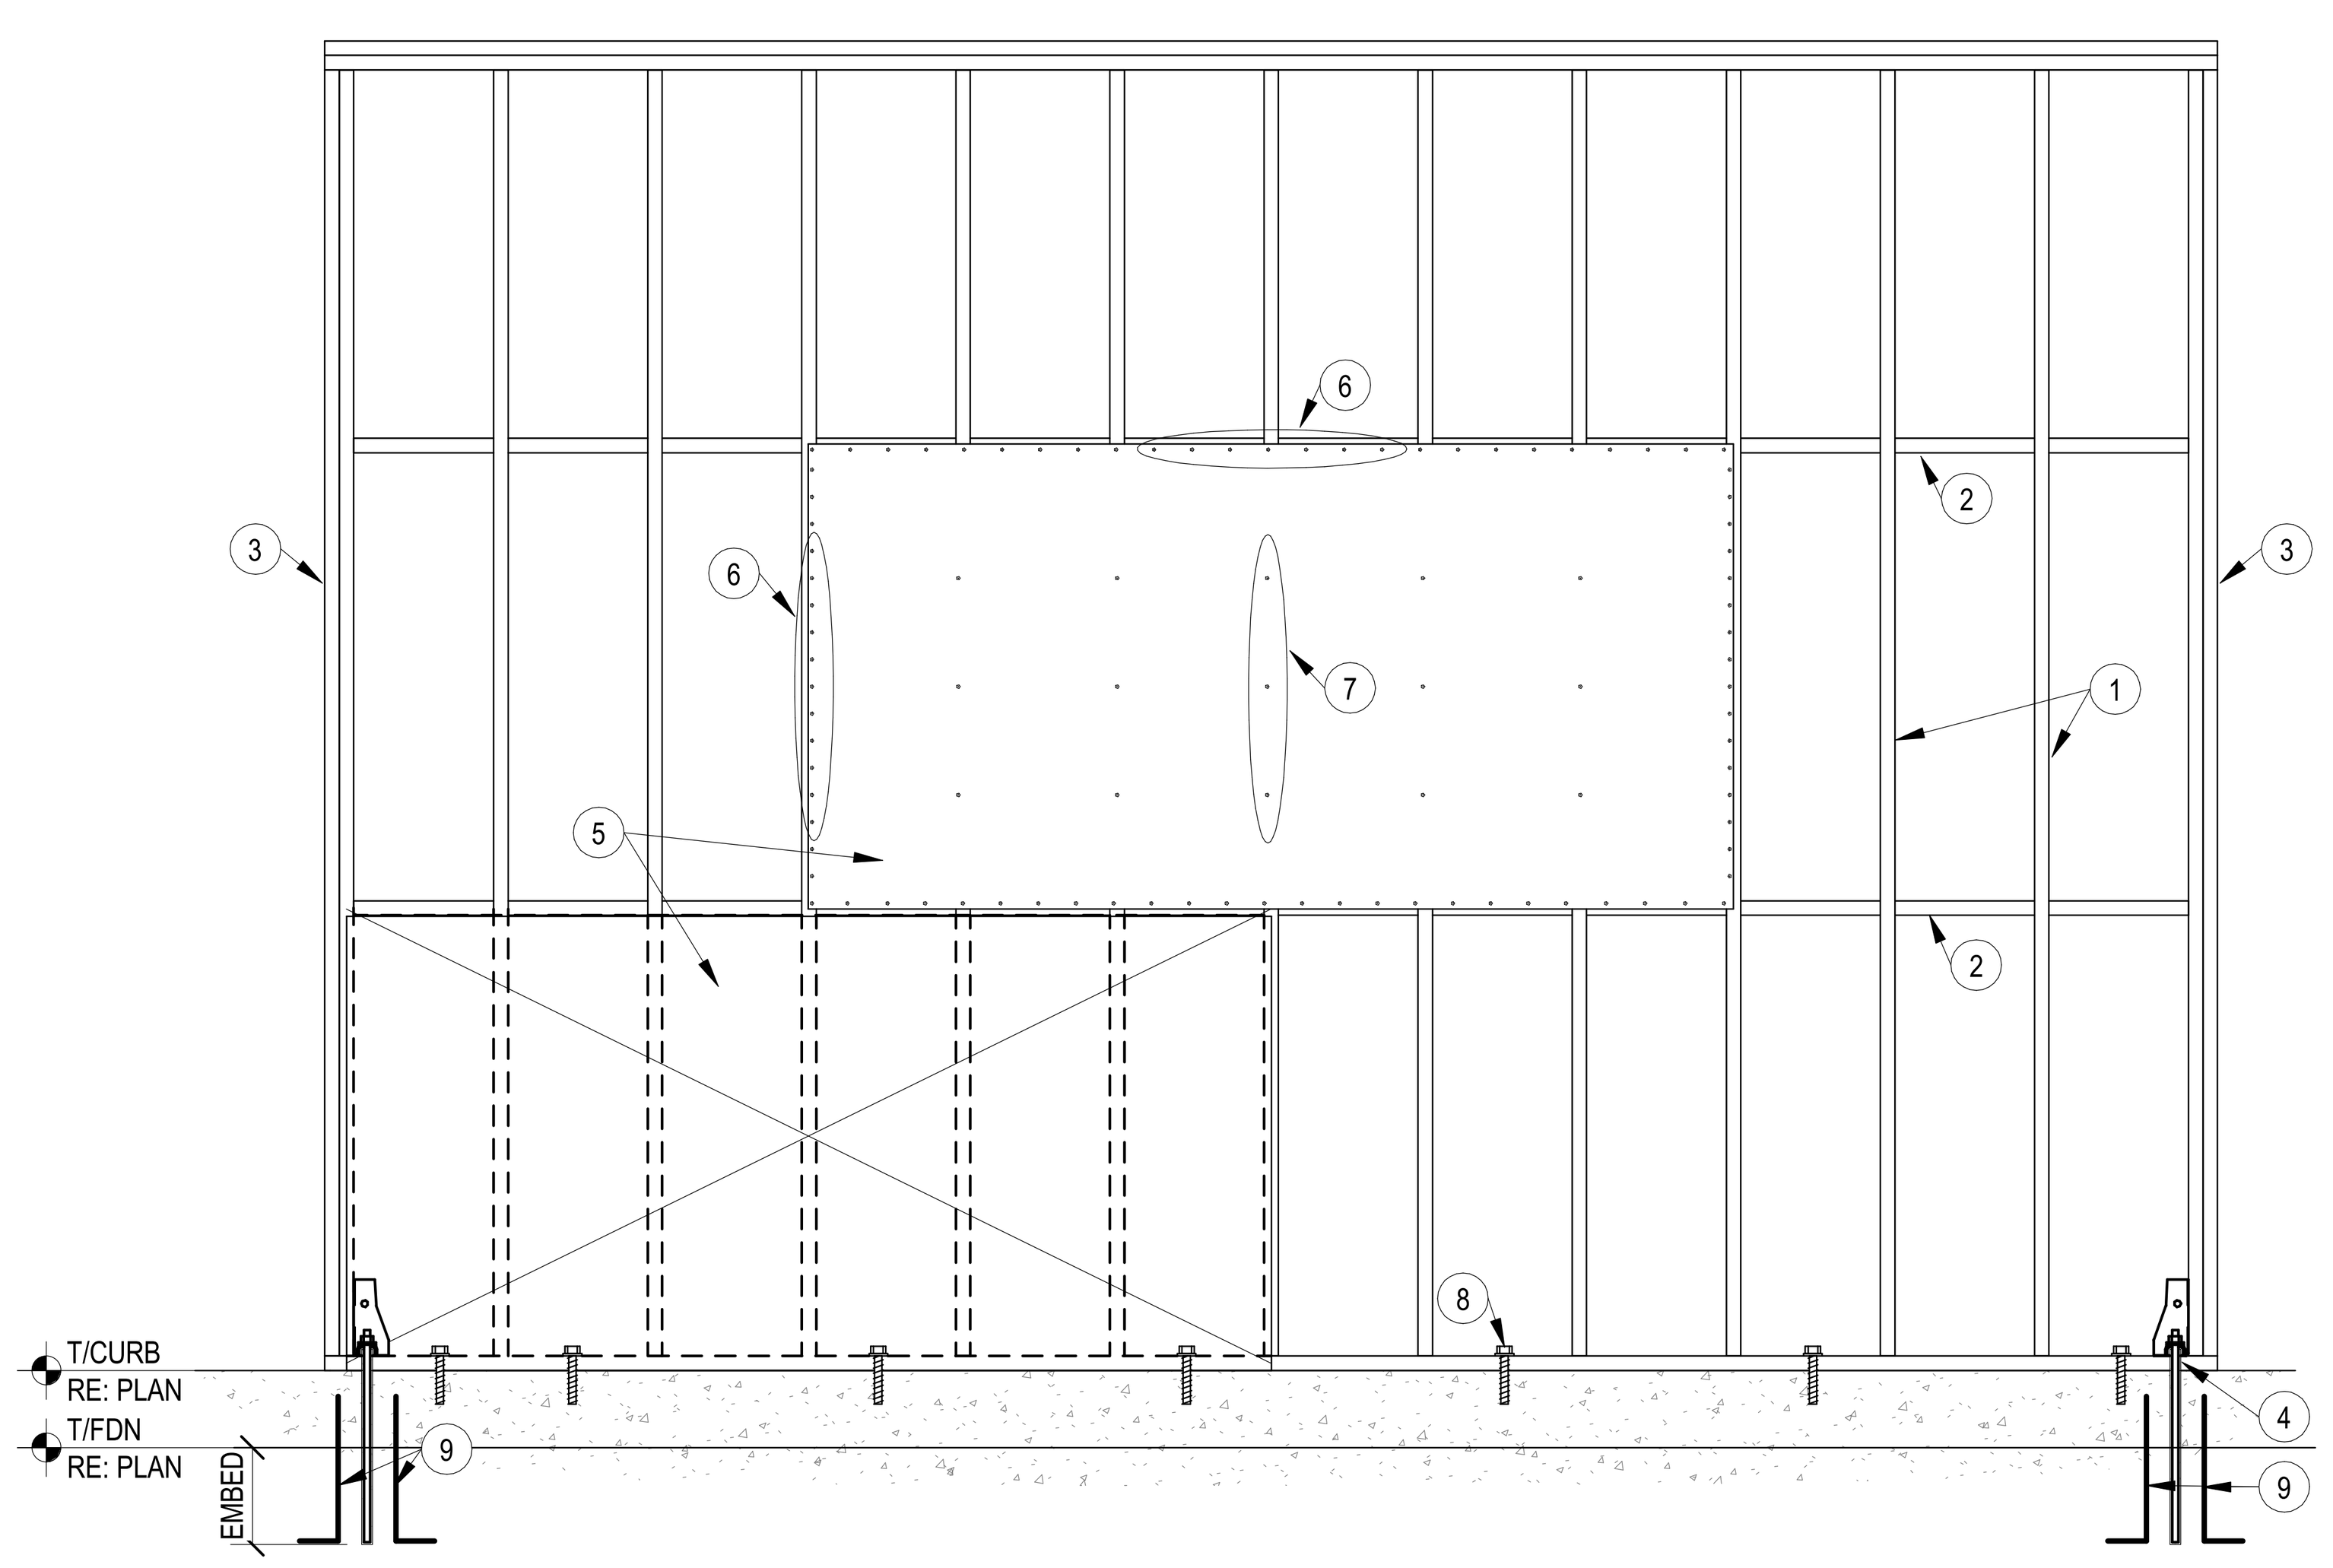

1 SHEAR WALL - ELEVATION
1/2" = 1'-0"

DETAIL NOTES:

1. 2x STUD FRAMING OR CFS FRAMING, RE: SHEAR WALL SCHEDULE
2. PANEL BLOCKING AS REQD, RE: SHEAR WALL SCHEDULE
3. BOUDARY CONDITION @ SHEAR WALL ENDS, RE: SHEAR WALL SCHEDULE FOR NUMBER OF PLYS
4. HOLDOWNS, RE: SHEAR WALL SCHEDULE AND HOLDOWN TYP DETAIL
5. WOOD STRUCTURAL PANEL SHEATHING, RE: SHEAR WALL SCHEDULE
6. PANEL EDGE FASTENERS NO LESS THAN 3/8" FROM PANEL EDGES, RE: SHEAR WALL SCHEDULE FOR PATTERN
7. INTERMEDIATE FIELD FASTENERS @ 12" OC, TYP UNO
8. AT WOOD WALLS, TREATED 2x SILL PLATE W/ SILL ANCHORS PER SHEAR WALL SCHED EMBEDED INTO CONC MIN OF 6". AT CFS WALLS, SILL TRACK AND ANCHORS PER SHEARWALL SCHEDULE.
9. PROVIDE (2) HOOKED DOWELS @ SHEAR WALL HOLDOWNS. RE: 9/S060

NOTES:

AT SILL ANCHORS, PROVIDE SIMPSON BPS 1/2-6 BEARING PLATES. LOCATE EDGE OF BEARING PLATE WITHIN 5/8" OF EDGE OF SILL PLATE ON SHEATHED SIDE. PROVIDE STANDARD CUT WASHER BETWEEN ANCHOR HEAD AND BEARING PLATE.

SCHEDULE - SHEAR WALL

SW MARK	SHEATHING	FASTENER (EDGE/INTERIOR)	BOUNDARY STUD	SILL ANCHORS	HOLDOWN	ANCHOR ROD	EMBEDMENT
SW-A	ZIP R-6	16d (BOX) @ 3"/12" [BLOCKED]	(3) 2x6	36" OC	DUE3-SDS3	5/8" Ø	8"
SW-B	7/16" OSB [2-SIDED]	8d (COMMON) @ 3"/12" [BLOCKED]	(5) 2x6	16" OC	HDUE17-SDS4.5	1" Ø	24"

NOTES:

1. PROVIDE HOLD DOWN ANCHOR. CLEAN HOLE PRIOR TO INSTALLATION PER MFCR SPECIFICATIONS.
2. BLOCKING TO EXTEND FROM SILL PLATE TO TOP OF TRUSS
3. WOOD SHEATHING PANELS SHALL BE APPLIED WITH THE LONG DIMENSION ACROSS STUDS.
4. LOADS ARE LISTED IN LRFD (1.0 W)
5. APA PLYWOOD SHEATHING (MIN 3-PLY) MAY BE SUBSTITUTED FOR APA RATED OSB SHEATHING OF THE SAME THICKNESS
6. SILL ANCHORS PER GENERAL NOTES. TIGHTEN SPACING AS REQUIRED PER THIS SCHEDULE

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC
ARCHITECTURE · PLANNING · INTERIOR DESIGN

L0T 11: Lionsgate Shopping Center
Mr. D's DONUTS
14495 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV 24, 2025
REVISED
SHEET NUMBER
S060
OF SHEETS

STAND JOB NO. 25281

STAND STRUCTURAL ENGINEERING INC
8234 Robinson Street
Overland Park, KS 66204
913-214-2169
stand-sei.com

CODY ROBERT GIBBENS
LICENSED
PE28037
KANSAS
PROFESSIONAL ENGINEER
11/24/2025

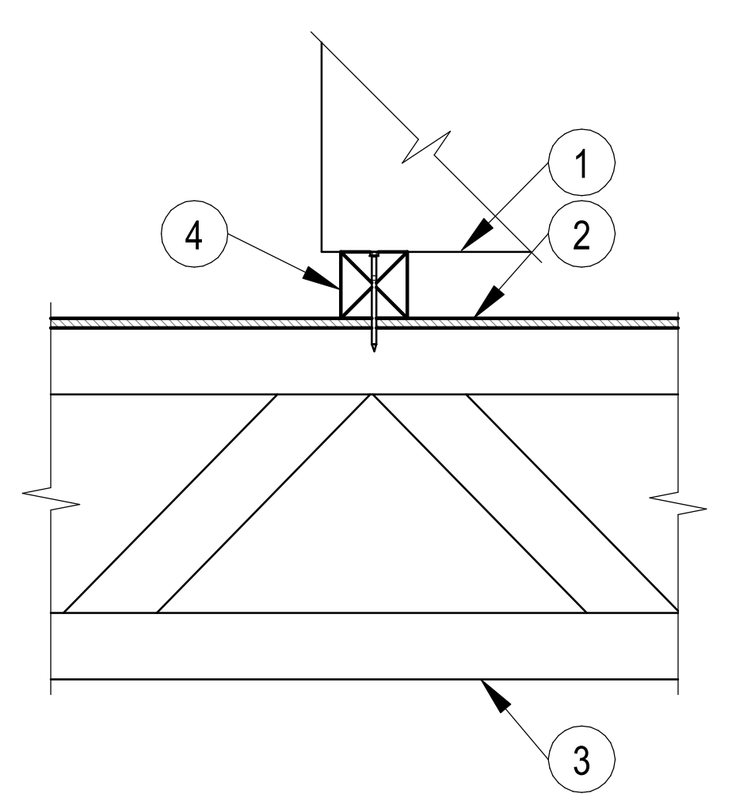

DETAIL NOTES:

1. MECHANICAL UNIT, RE: MEP
2. ROOF SHEATHING, RE: GENERAL NOTES
3. PRE-ENGINEERED WOOD TRUSSES, RE: TRUSS MANUFACTURER
4. CONT TREATED 4x4, EXTEND 4" PAST ADJACENT TRUSS, FASTEN TO EA TRUSS W/ 1/4" Øx5" SIMPSON SDS SCREW

8 EQUIPMENT WITHOUT CURB
3/4" = 1'-0"

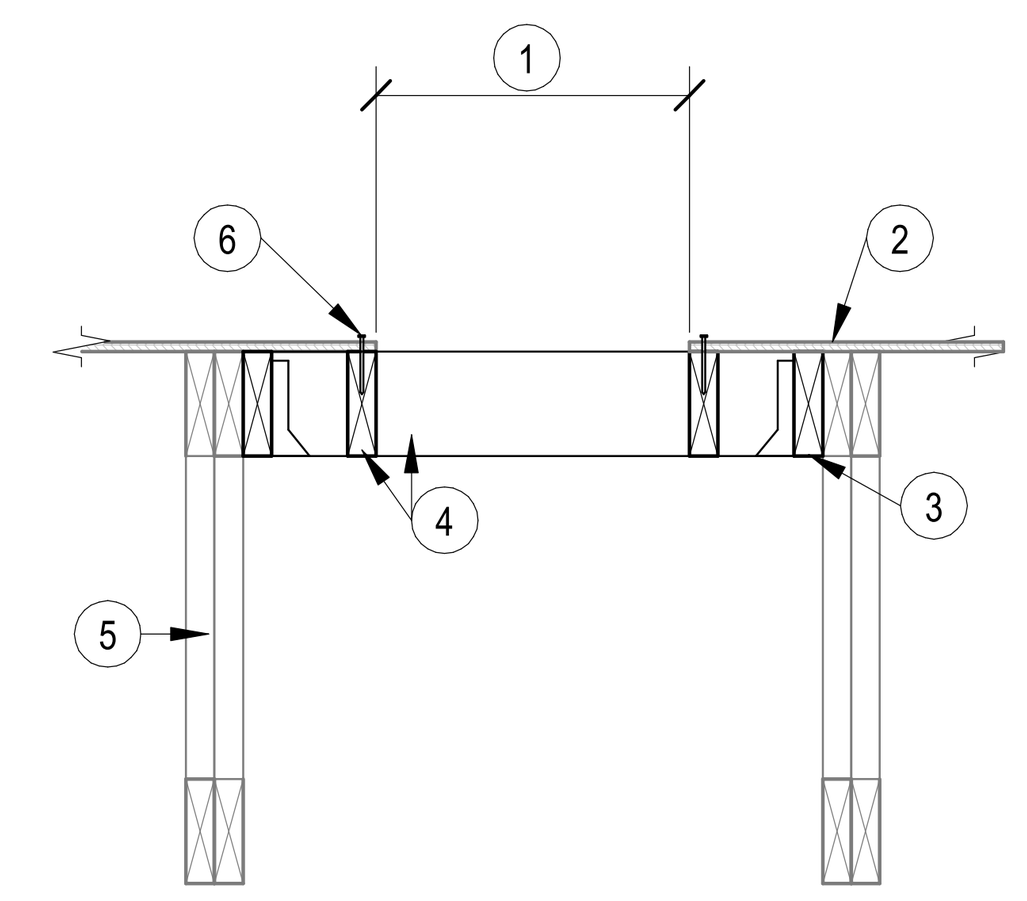

DETAIL NOTES:

1. RE: MECH CONTRACTOR FOR SIZE AND LOCATION
2. ROOF SHEATHING, RE: GENERAL NOTES
3. 2x6 LEDGER x 24", LEDGER W/ (12) 8d NAILS UNIFORMLY DISTRIBUTED
4. 2x6 BLOCKING AROUND OPENING W/ SIMPSON LUS26 EA END TYP
5. PRE-ENGINEERED ROOF TRUSS, RE: PLAN
6. DIAPHRAGM FASTENERS, RE: GENERAL NOTES

7 ROOF SECTION @ OPENING
3/4" = 1'-0"

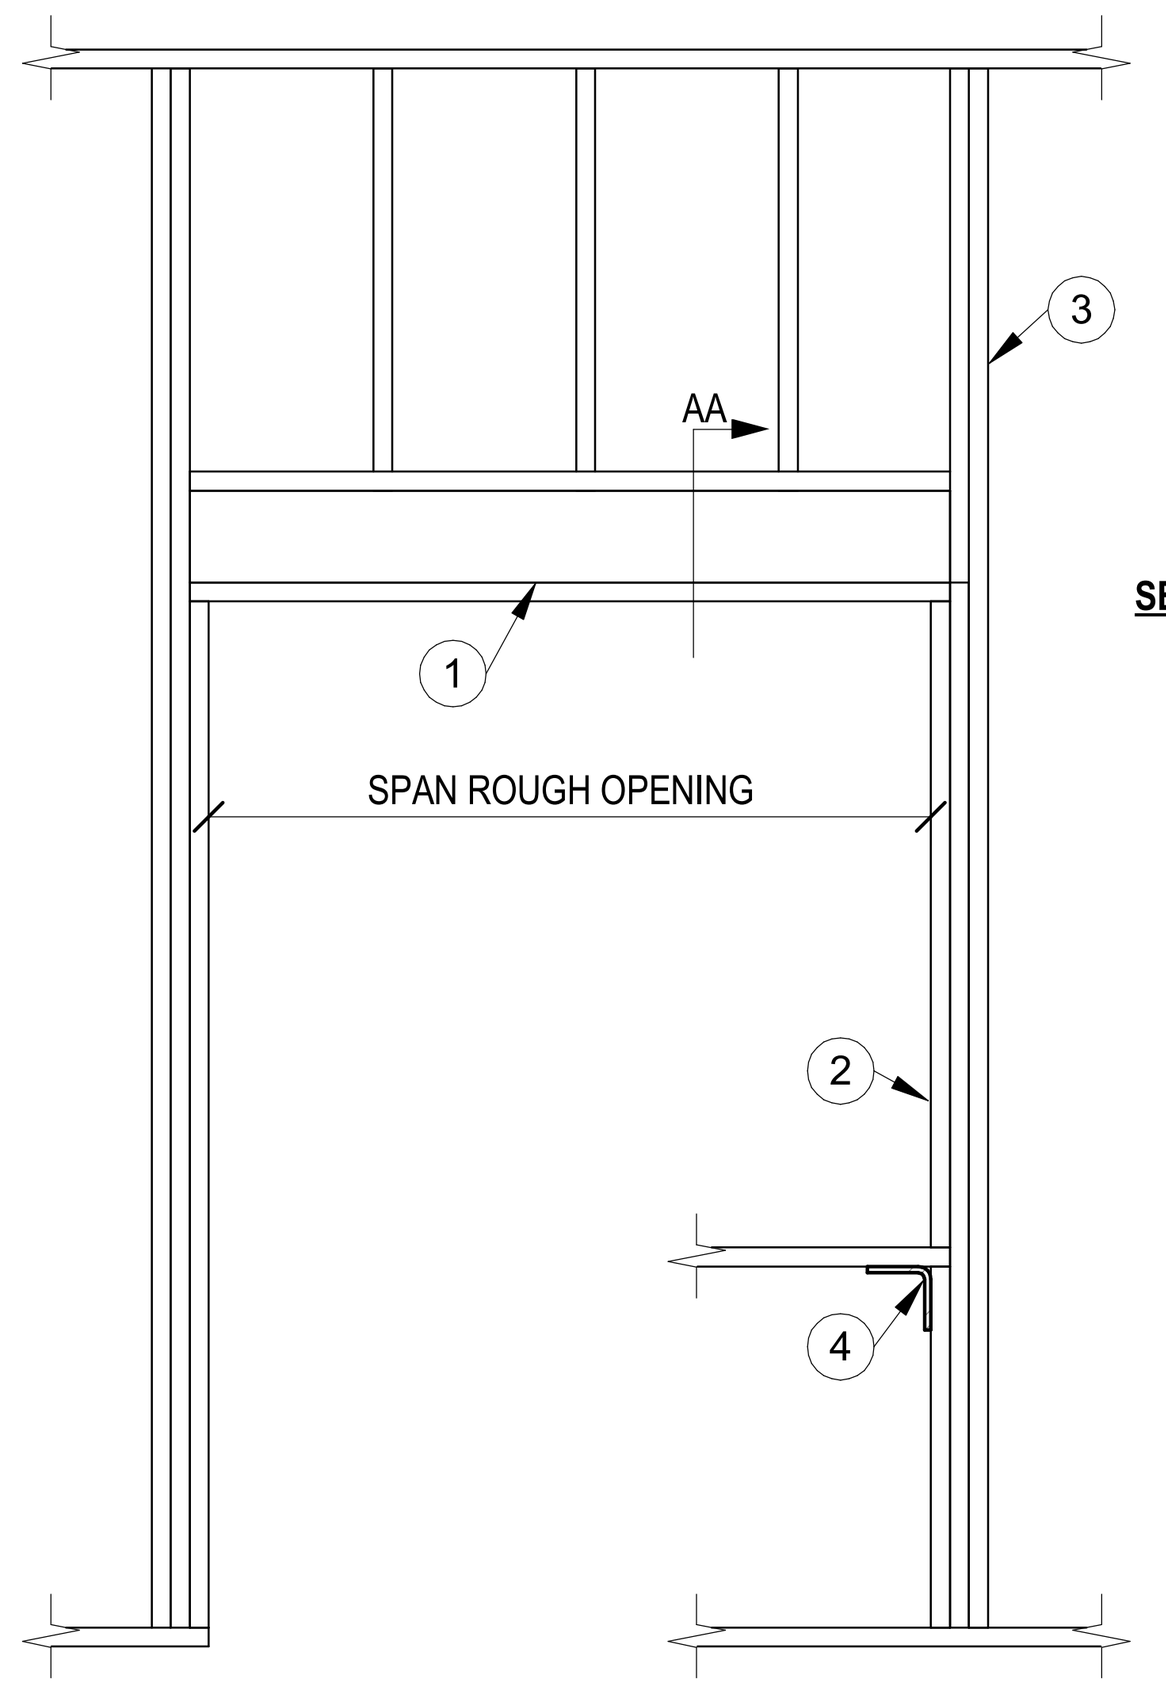



WOOD HEADER SCHEDULE				
MARK	MEMBERS	MAX SPAN	JAMB MEMBERS	NOTES
HD206	(2) 2x6	6'-0"	1 KING, 1 TRIMMER*	NON-STRUCT HDR
HDN08	(N) 2x8	SEE PLAN	1 KING, 2 TRIMMER*	
HDN10	(N) 2x10	SEE PLAN	2 KING, 2 TRIMMER	
HDN12	(N) 2x12	SEE PLAN	2 KING, 2 TRIMMER	
HDLVL	(3) 1 3/4"x9 1/4" LVL	SEE PLAN	3 KING, 2 TRIMMER	

*PROVIDE MIN (2) KING STUDS FOR ALL EXTERIOR WALL OPENINGS

LEGEND

HD 2 08
HEADER
"N" PLIES
DEPTH / DESIGNATION

DETAIL NOTES:

1. WOOD HEADER, RE: SCHEDULE. ALL HEADERS SHALL BE NAILED TOGETHER AT 16" OC MAX. PROVIDE PLYWOOD FILLER AS REQD TO MATCH STUD THICKNESS
2. TRIMMER STUDS, RE: SCHEDULE
3. KING STUDS, RE: SCHEDULE
4. PROVIDE STUD UNDER SILL END OR SIMPSON A35 CLIP ANGLE

6 HEADER SCHEDULE
1/2" = 1'-0"

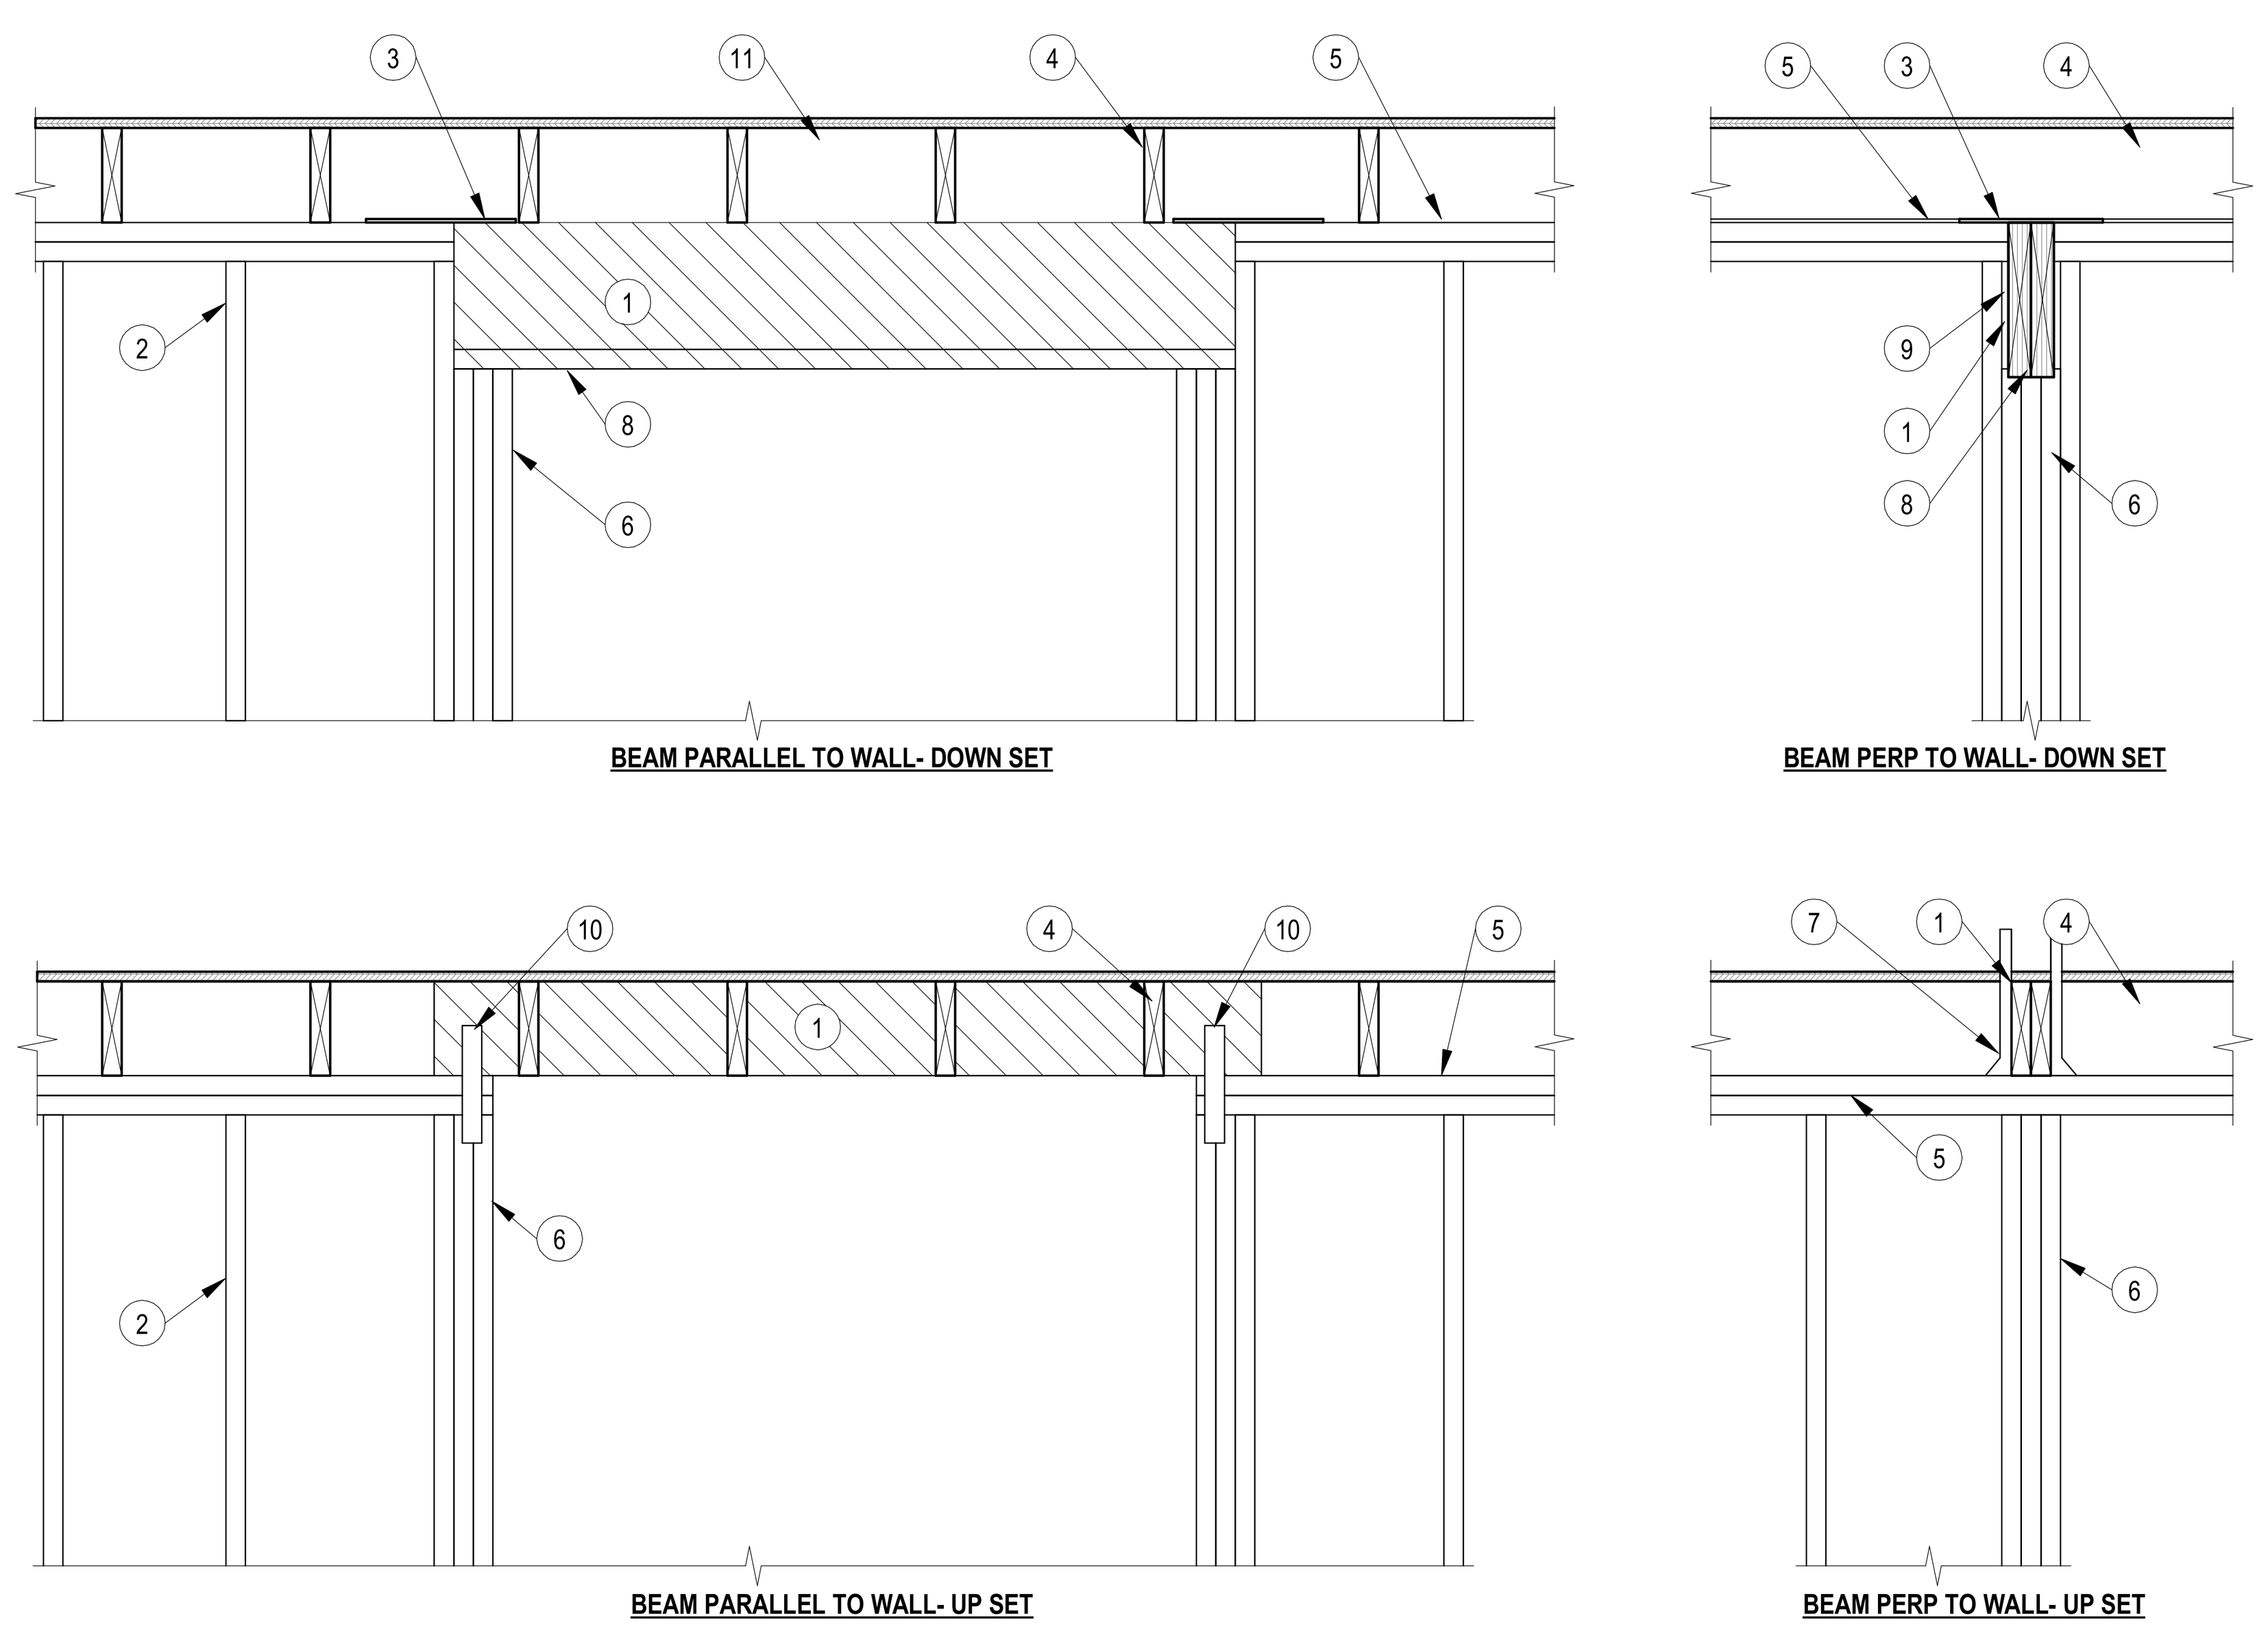

DETAIL NOTES:

1. WOOD BEAM, RE: PLAN
2. WALL STUDS
3. IF TOP PLATE IS INTERRUPTED USE SIMPSON LSTA9 STRAP OR EQUIVALENT
4. WOOD JOISTS, RE: PLAN
5. DOUBLE 2x TOP PLATE
6. MIN 3 STUDS TO SUPPORT BEAM UNO ON PLAN
7. FACE MOUNT JOIST HANGER
8. COORD BOT OF BEAM ELEV W/ ARCH REQUIREMENTS
9. 1/2" OSB SPACERS AS REQD
10. SIMPSON LSTA9 STRAP EA SIDE
11. WHEN BEAM IS DOWNSET PROVIDE 2x FULL HT BLOCKING BTWN FLOOR JOISTS

5 BEAM BEARING CONDITIONS
3/4" = 1'-0"

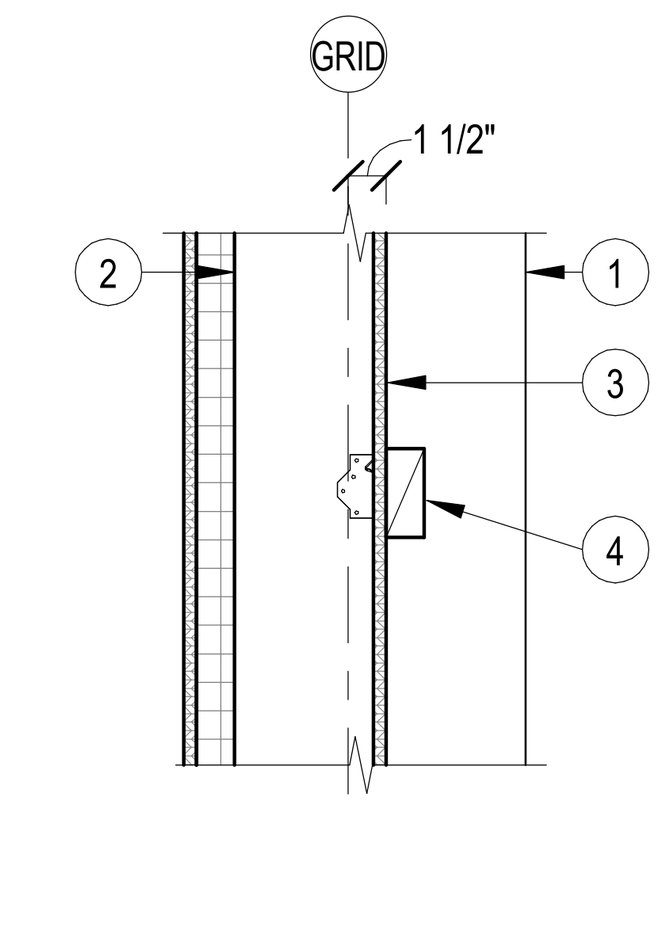

DETAIL NOTES:

1. LOAD BEARING STUD WALL, RE: PLAN
2. 2x EXTERIOR FURRING @ 16" OC, RE: ARCH
3. SHEAR WALL SHEATHING, RE: PLAN AND SHEARWALL SCHEDULE
4. 2x4 BLOCKING AND SIMPSON A34 CLIP @ 8'-0" OC

NOTES:

WHERE SHEAR WALL SHEATHING TRANSITIONS BETWEEN 7/16" SHEATHING AND ZIP-R SHEATHING, PROVIDE DOUBLE STUD AND EDGE NAILING. 7/16" SHEATHING IS TO BE USED IN LIEU OF ZIP-R WHERE WALLS ARE FURRED.

4 FURR OUT WALL
1" = 1'-0"

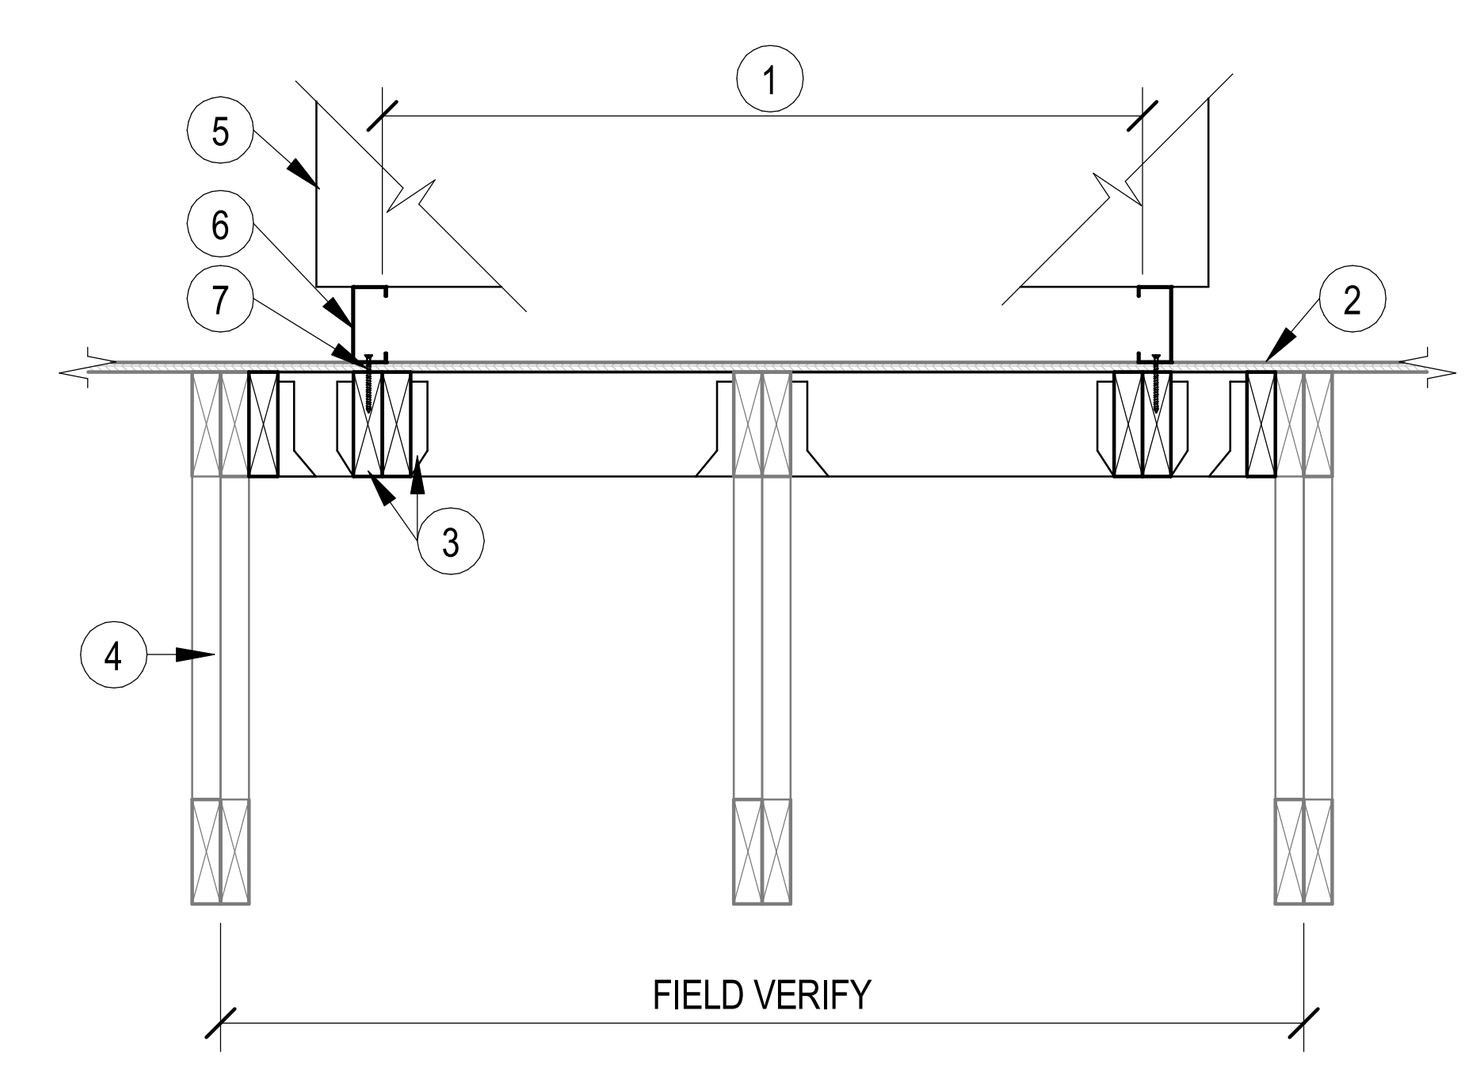

DETAIL NOTES:

1. IF DECK OPENINGS ARE REQUIRED FOR UNIT, COORDINATE. PER DETAIL 7/S061
2. ROOF SHEATHING, RE: GENERAL NOTES
3. (2) 2x6 BLOCKING AROUND OPENING W/ SIMPSON LUS26-2 EA END TYP
4. PRE-ENGINEERED ROOF TRUSS, RE: PLAN
5. MECHANICAL UNIT, RE: MEP
6. CURB PER EQUIPMENT MFCR
7. #8x3" WOOD SCREW @ 12" OC

3 ROOF SECTION @ CURB
3/4" = 1'-0"

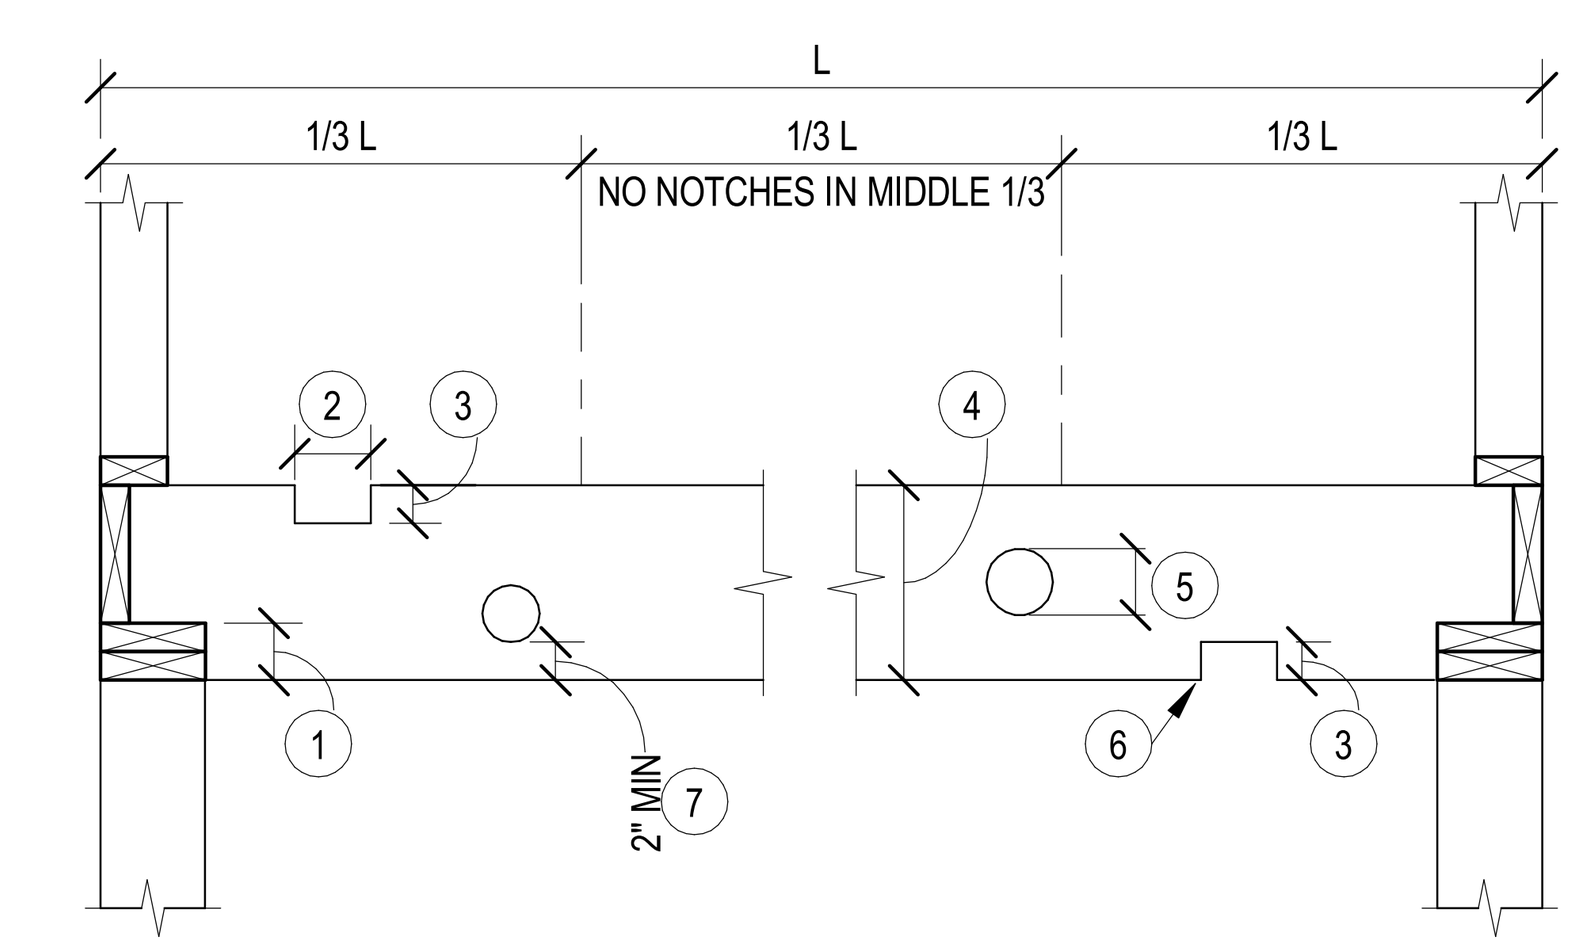

DETAIL NOTES:

1. MAX DIMENSION = JOIST DEPTH / 4
2. MAX DIMENSION = JOIST DEPTH / 3
3. MAX DIMENSION = JOIST DEPTH / 6
4. JOIST DEPTH
5. MAX DIMENSION = JOIST DEPTH / 3
6. SQUARE HOLES AND NOTCHES NOT RECOMMENDED
7. HOLES MAY BE ANYWHERE ALONG THE LENGTH OF THE SPAN MINUS 1'-0" ON EA END. HOLE EDGES SHALL BE 2" FROM TOP OF JOIST OR BOTTOM OF JOIST. THEY SHALL ALSO BE 2" FROM ANY OTHER HOLE OR NOTCH

NOTES:

DETAIL IS FOR DIMENSIONAL LUMBER ONLY. FOR I-JOISTS AND LVL'S FOLLOW MFCR REQUIREMENTS

2 BORED HOLE & NOTCHES - HORIZ FRAMING
3/4" = 1'-0"

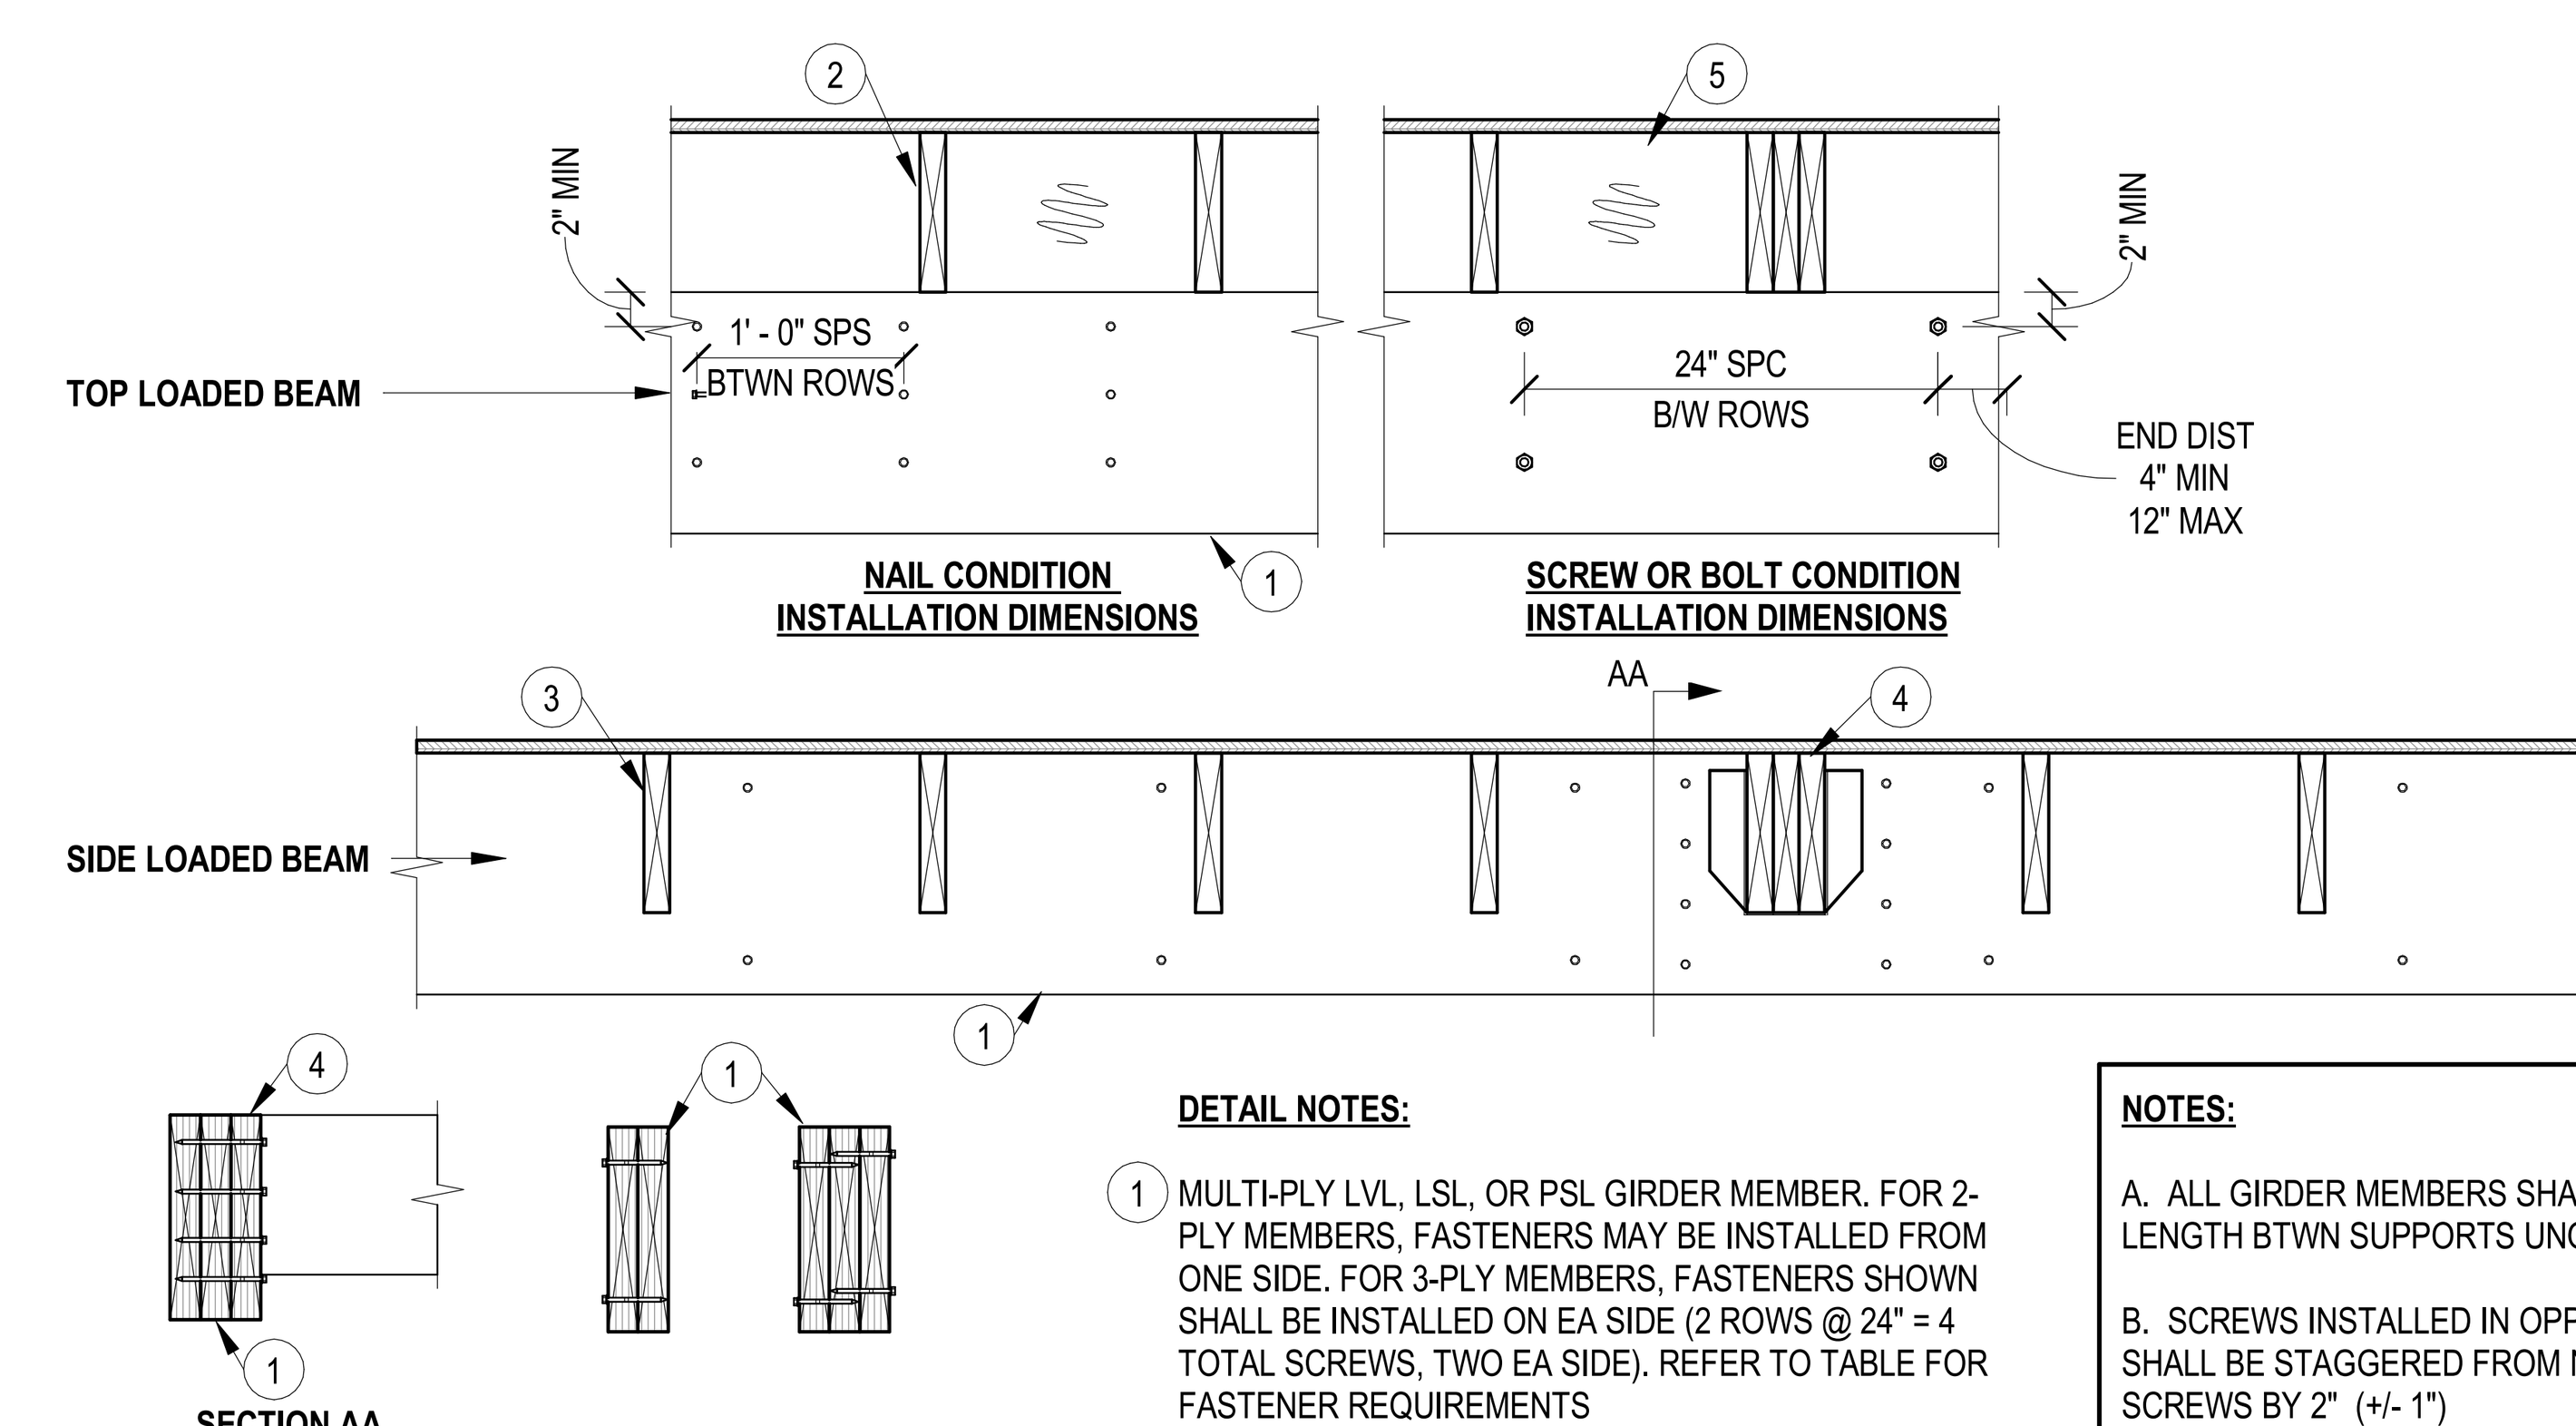

FASTENER OPTIONS				
FASTENER	BM DEPTH	2-PLY	3-PLY	4-PLY
10d (0.128"x3") NAILS	7.25" TO 14"	3 @ 12" OC	3 @ 12" OC EA SIDE	NOT ALLOWED
10d (0.128"x3") NAILS	14" OR GREATER	4 @ 12" OC	4 @ 12" OC EA SIDE	NOT ALLOWED
1/2" DIA THRU BOLTS	7.25" OR GREATER	2 @ 24" OC	2 @ 24" OC	2 @ 16" OC
STRUCTURAL SCREW	7.25" OR GREATER	2 @ 24" OC	2 @ 24" OC EA SIDE	2 @ 16" OC EA SIDE

DETAIL NOTES:

1. MULTI-PLY LVL, LSL, OR PSL GIRDER MEMBER. FOR 2-PLY MEMBERS, FASTENERS MAY BE INSTALLED FROM ONE SIDE. FOR 3-PLY MEMBERS, FASTENERS SHOWN SHALL BE INSTALLED ON EA SIDE (2 ROWS @ 24" = 4 TOTAL SCREWS, TWO EA SIDE). REFER TO TABLE FOR FASTENER REQUIREMENTS
2. FLOOR JOISTS, RE: PLAN. TOP LOADED CONDITION
3. FLOOR JOISTS, RE: PLAN. SIDE LOADED CONDITION. PROVIDE FACE MOUNTED OR TOP FLANGE MOUNTED HANGERS ATTACHED TO GIRDER PER MFCR REQUIREMENTS
4. AT HEAVY LOADED BEAM HANGER LOCATIONS, PROVIDE (4) STRUCTURAL SCREWS EA SIDE OF HANGER. SCREWS SHALL PENETRATE ALL PLYS (3.25" MIN FOR 2 PLY, 5" MIN FOR 3 PLY). THIS SHALL BE TYP UNO
5. WHEN BEAM IS DOWNSET PROVIDE 2x FULL HEIGHT BLOCKING BTWN FLOOR JOISTS

NOTES:

A. ALL GIRDER MEMBERS SHALL BE FULL LENGTH BTWN SUPPORTS UNO

B. SCREWS INSTALLED IN OPPOSITE FACE SHALL BE STAGGERED FROM NEAR FACE SCREWS BY 2" (+/- 1")

C. EXCESSIVELY WARPED OR CURVED LVL SHOULD NEVER BE FORCED INTO ALIGNMENT BY USE OF CLAMPS, SCREWS OR BOLTS AS SPLITTING MAY OCCUR

D. IF COUNTERSINKING SCREWS OR BOLTS IS REQUIRED, USE A SPADE BIT TO CREATE THE COUNTERSINK PRIOR TO INSTALLING THE FASTENER

E. BOLTS SHALL MEET OR EXCEED ASTM A307

F. STRUCTURAL SCREWS MAY BE ONE OF THE FOLLOWING PRODUCTS: 1/4" Ø SIMPSON STRONG TIE SDS, WS SCREWS BY USP, OR TRUSSLOK SCREWS BY FASTENMASTER

1 BUILT-UP ENGR LUMBER BEAM
3/4" = 1'-0"

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC
ARCHITECTURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center
Mr. D's DONUTS
14495 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 24, 2025
REVISED
SHEET NUMBER
S061
OF SHEETS

STAND JOB NO. 25281

STAND STRUCTURAL ENGINEERING INC
8234 Robinson Street
Overland Park, KS 66204
913-214-2169
stand-sei.com

FRAMING LEGEND

- FOUNDATION
- LOAD BEARING WALL
- SHEAR WALL
- HEADER
- BEAM
- SPAN DIRECTION
- JOIST / TRUSS
- EXTENTS OF JOIST TYPE
- HOLDOWN
- MOMENT CONN.

SHEET NOTES:

A. REFERENCE SHEET S001 FOR STRUCTURAL GENERAL NOTES. REVIEW NOTES & DETAILS FOR APPLICABILITY.

B. SEE ARCHITECTURAL DRAWING FOR DETAILS & DIMENSIONS NOT SHOWN.

C. REFER TO S030-S061 FOR TYPICAL DETAILS.

D. T/SLAB ELEVATION = 100'-0" UNO.

E. T/TRENCH FOOTING AND SPREAD FOOTINGS ELEVATION = 99'-4" UNO. THE BOTTOM OF ALL EXTERIOR FOOTINGS SHALL BE 3'-0" MIN BELOW GRADE, DEEPEN FOOTINGS AS REQUIRED. GRADE IS GENERALLY 6" BELOW FINISH FLOOR ELEVATION (COORDINATE WITH CIVIL).

F. SPREAD FOOTINGS DENOTED ON PLAN BY "Fx.x". REFER TO SCHEDULE ON THIS SHEET FOR SIZE AND REINFORCING.

G. PROVIDE BLOCKOUTS IN SLAB FOR COLUMNS PER TYPICAL DETAIL .

H. STEEL COLUMNS ARE DENOTED ON PLAN AS "Cx.x". REFER TO SCHEDULE ON THIS SHEET FOR COLUMN SIZE, BASEPLATE TYPE, AND BASEPLATE DIMENSIONS.

J. PROVIDE MIN (1) 2x6 STUD PER TRUSS PLY @ GIRDER TRUSS BEARING POINTS AND A MIN OF (3) 2x6 STUDS TOTAL.

K. REFER TO ARCH/PLUMBING PLANS FOR ALL LOCATIONS OF FLOOR DRAINS, PLUMBING PENETRATIONS THROUGH SLAB, SLOPES AND EQUIPMENT PADS.

L. COORDINATE LOCATIONS OF PLUMBING LINES PRIOR TO PLACING FOOTINGS AND SLAB ON GRADE.

M. GC TO COORDINATE ACTUAL BUILDING ORIENTATION ON SITE W/ CIVIL.

N. ALL STRUCTURAL WALLS SHALL BE 2x6 WOOD AT 16" OC UNO. ALL EXTERIOR WALLS ARE LOAD BEARING.

P. SW-X DENOTES WOOD SHEAR WALLS, RE: S060 FOR SHEAR WALL SCHEDULE.

PLAN NOTES:

1. 4" CONCRETE SLAB ON GRADE, RE: GENERAL NOTES FOR REINFORCING, GRANULAR FILL, VAPOR BARRIER AND JOINTING REQUIREMENTS
2. 16" WIDE x MIN 12" THICKENED SLAB BELOW SHEAR WALL. REINF W/ (3) # 4 CONT BOT BARS & #3 TRANSV @ 18" OC
3. 18" WIDE x MIN 30" DEEP CONT FTG @ EXTERIOR WALL . REINF W/ (2) #5 BARS CONT T&B AND #4 CLOSED TIES @ 24" OC
4. PROVIDE (2) #4 x 4'-0" @ RE-ENTRANT CORNER RE: 9/S030
5. EXTERIOR 4" CONCRETE SLAB ON GRADE, RE: GENERAL NOTES FOR REINFORCING, GRANULAR FILL, VAPOR BARRIER AND JOINTING REQUIREMENTS
6. CONCRETE PEDESTAL PER SECTION
7. PROVIDE 12"x12" THICKENED SLAB AT EDGE. REINF W/ (2) #4 CONT. PROVIDE #4 DOWELS (2'-0" LONG W/ STD HOOK) AT PERIMETER AT 18" OC

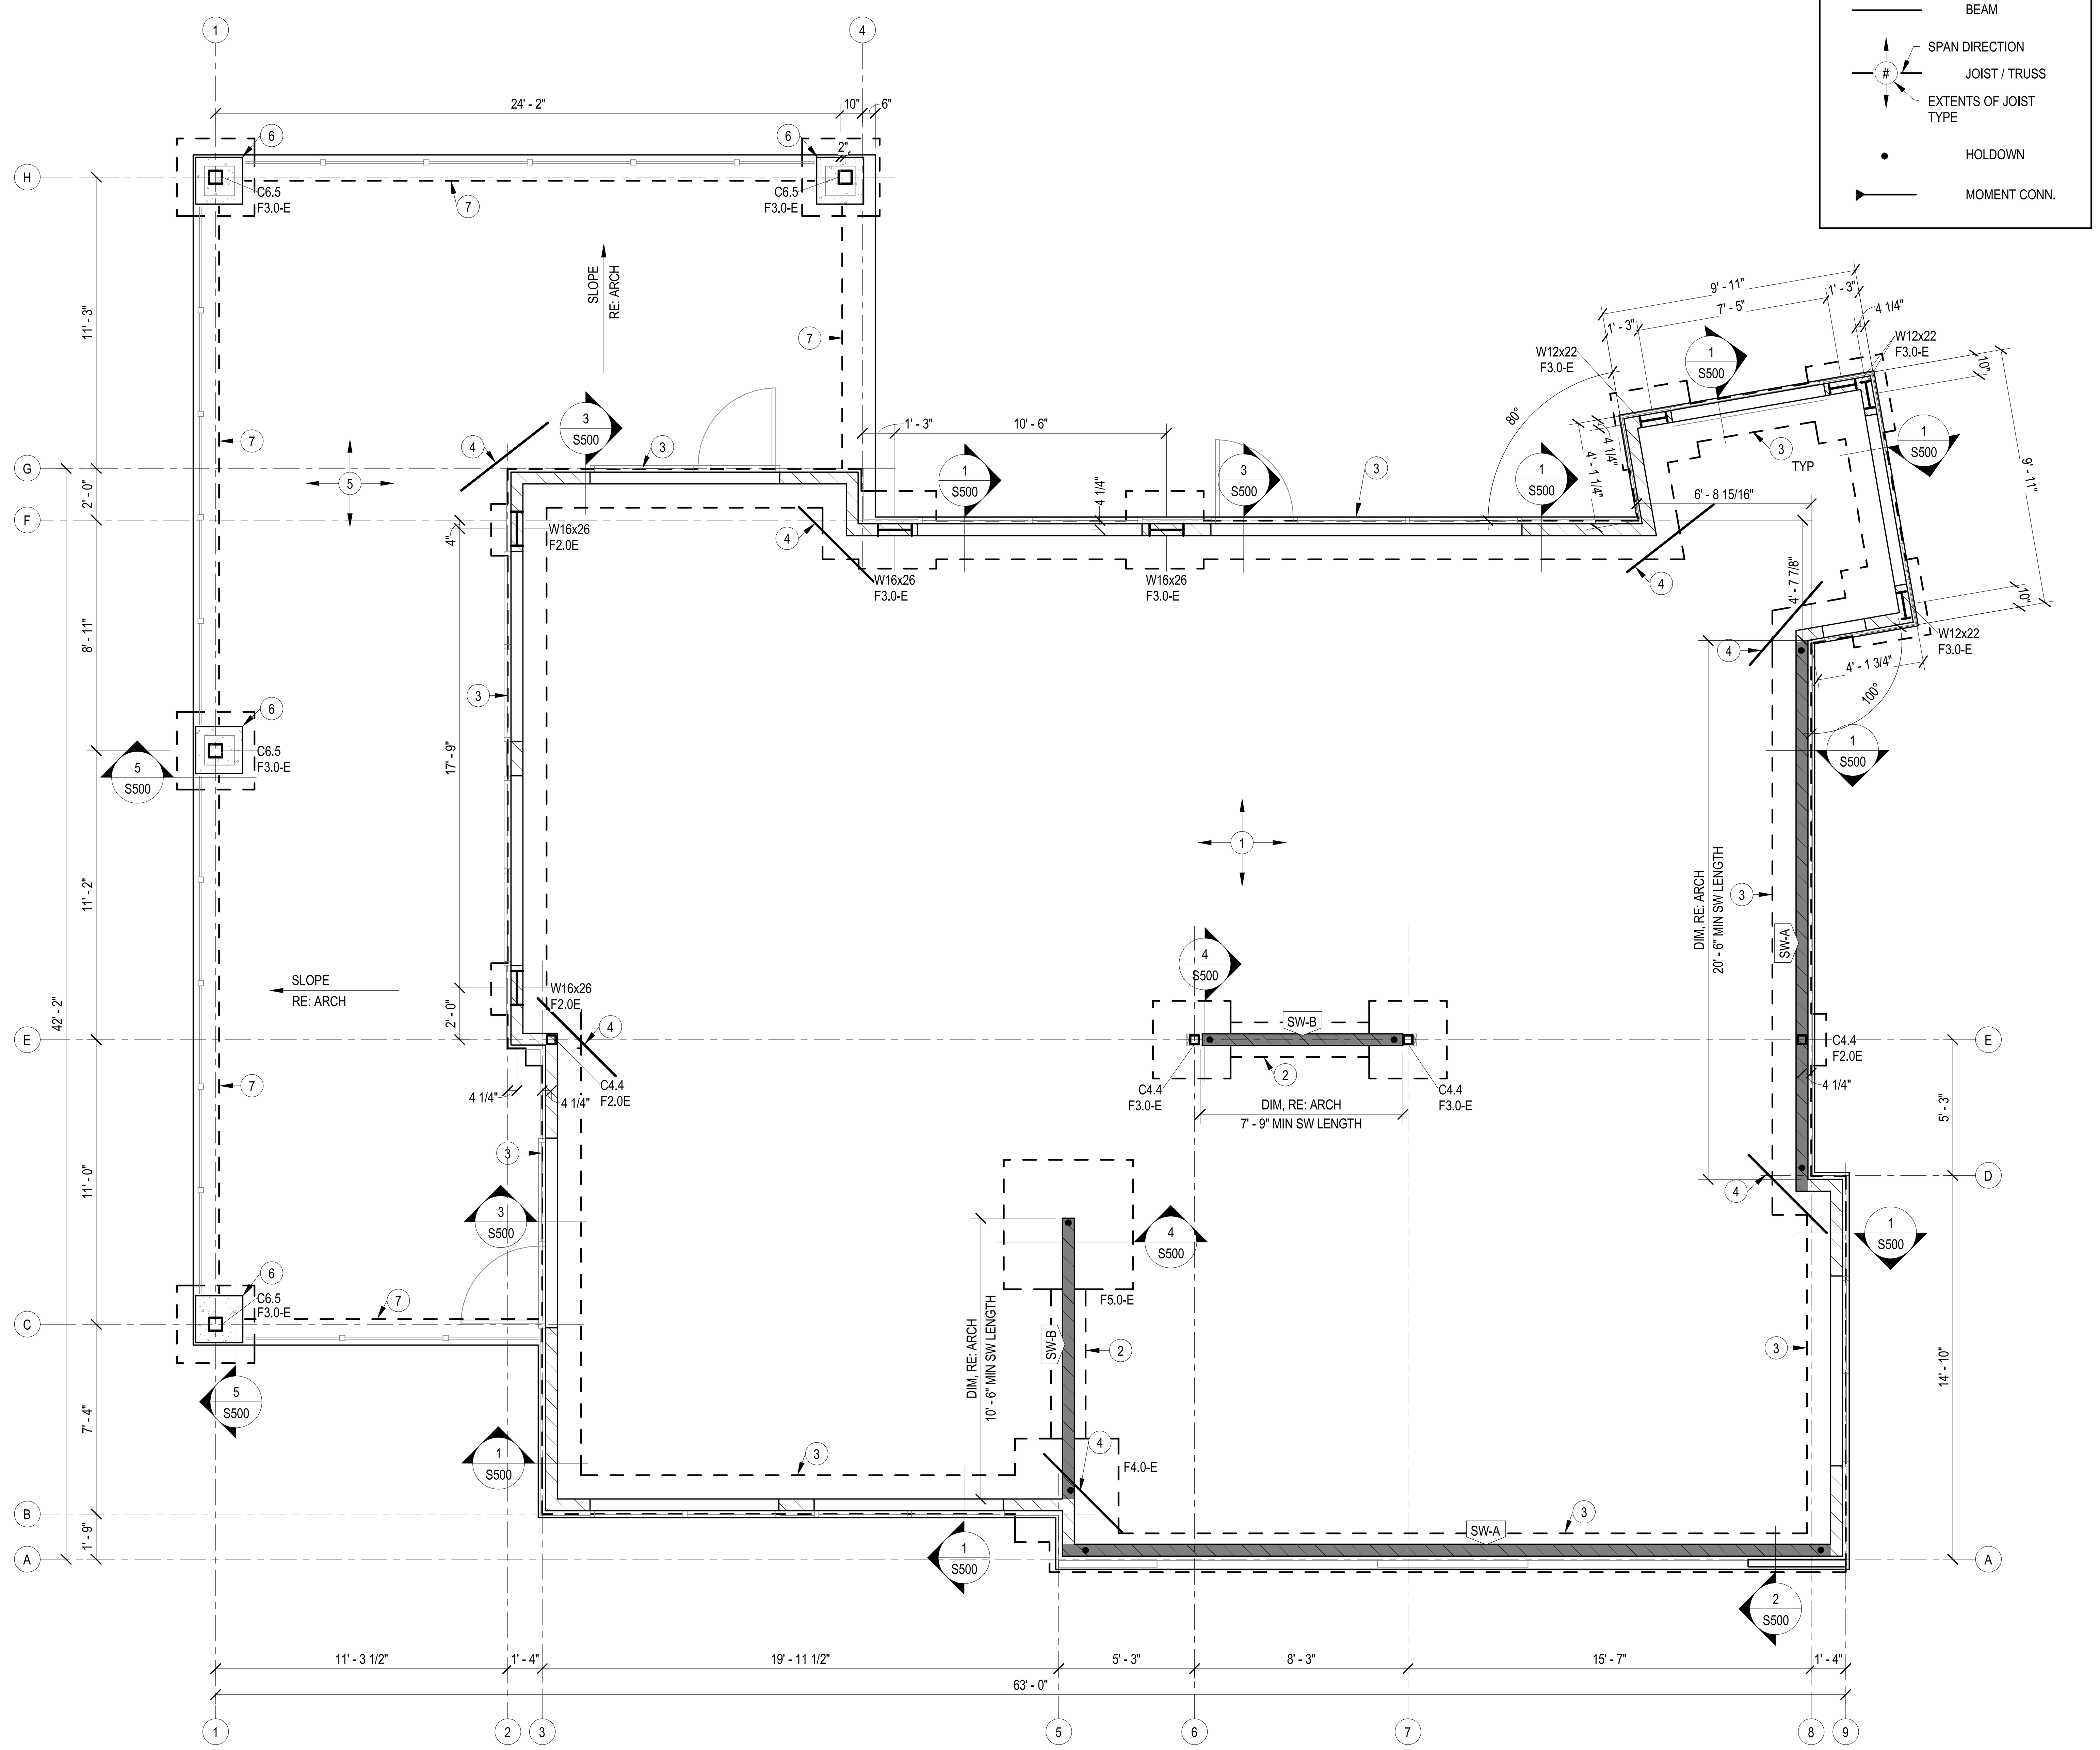

NORTH

1 FOUNDATION PLAN
1/4" = 1'-0"

SCHEDULE - COLUMN

TYPE MARK	TYPE	BASE PLATE
C4.4	HSS4x4x1/4	BP-1
C6.5	HSS6x6x5/16	BP-1
W12x22	W12x22	BP-3
W16x26	W16x26	BP-2

SCHEDULE - SPREAD FOOTING

TYPE MARK	LENGTH	WIDTH	THICKNESS	REINF
F2.0E	2' - 0"	2' - 0"	3' - 0"	(3) #5 EA WAY T&B
F3.0-E	3' - 0"	3' - 0"	3' - 0"	(4) #5 EA WAY T&B
F4.0-E	4' - 0"	4' - 0"	3' - 0"	(7) #5 EA WAY T&B
F5.0-E	5' - 0"	5' - 0"	3' - 0"	(7) #5 EA WAY T&B

CODY ROBERT GIBBENS
LICENSED
PE28037
KANSAS
PROFESSIONAL ENGINEER
11/24/2025

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC
ARCHITECTURE · PLANNING · INTERIOR DESIGN

L0T 11: Lionsgate Shopping Center
Mr. D's DONUTS
14495 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 24, 2025
REVISED
SHEET NUMBER
S100
OF SHEETS
STAND JOB NO. 25281

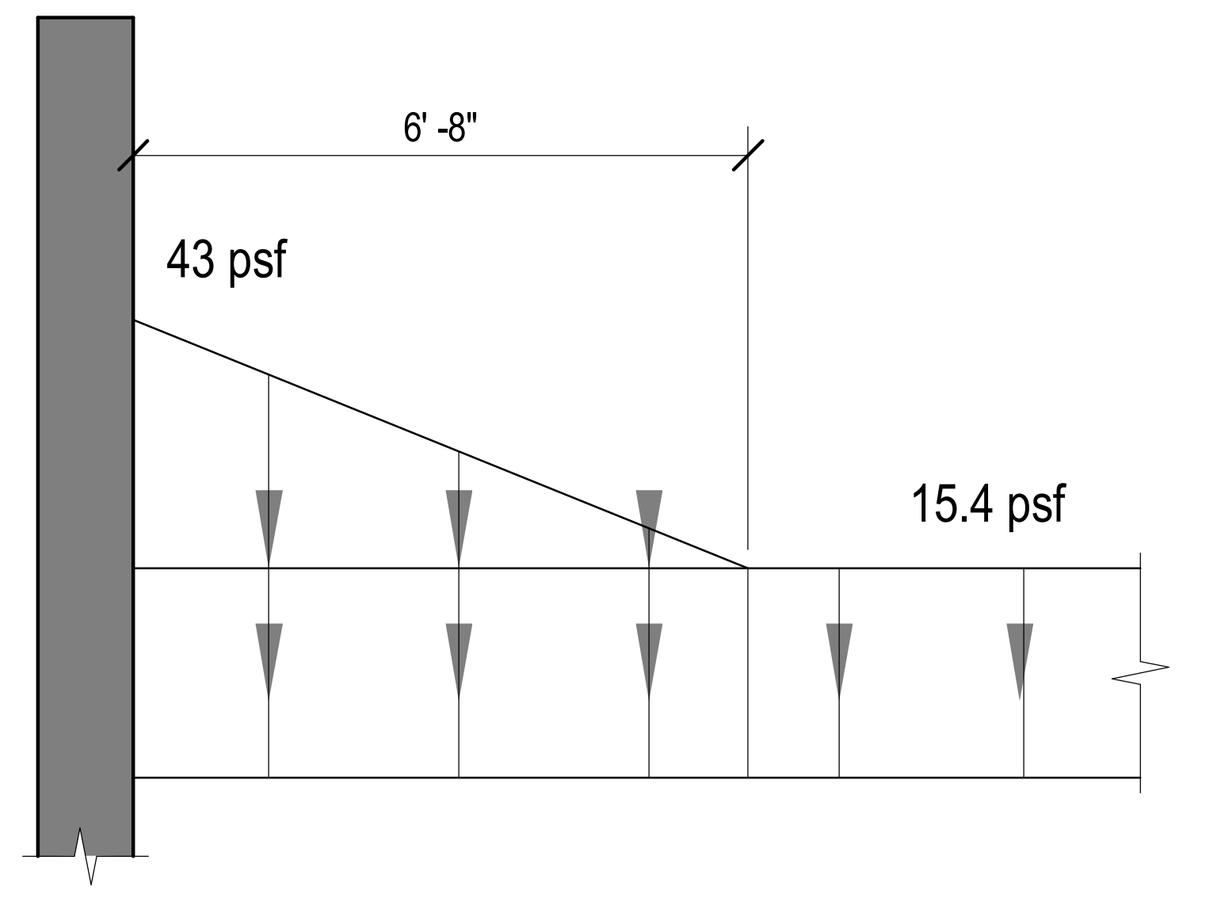

2 ROOF SNOW DRIFT LOADING
3/4" = 1'-0"

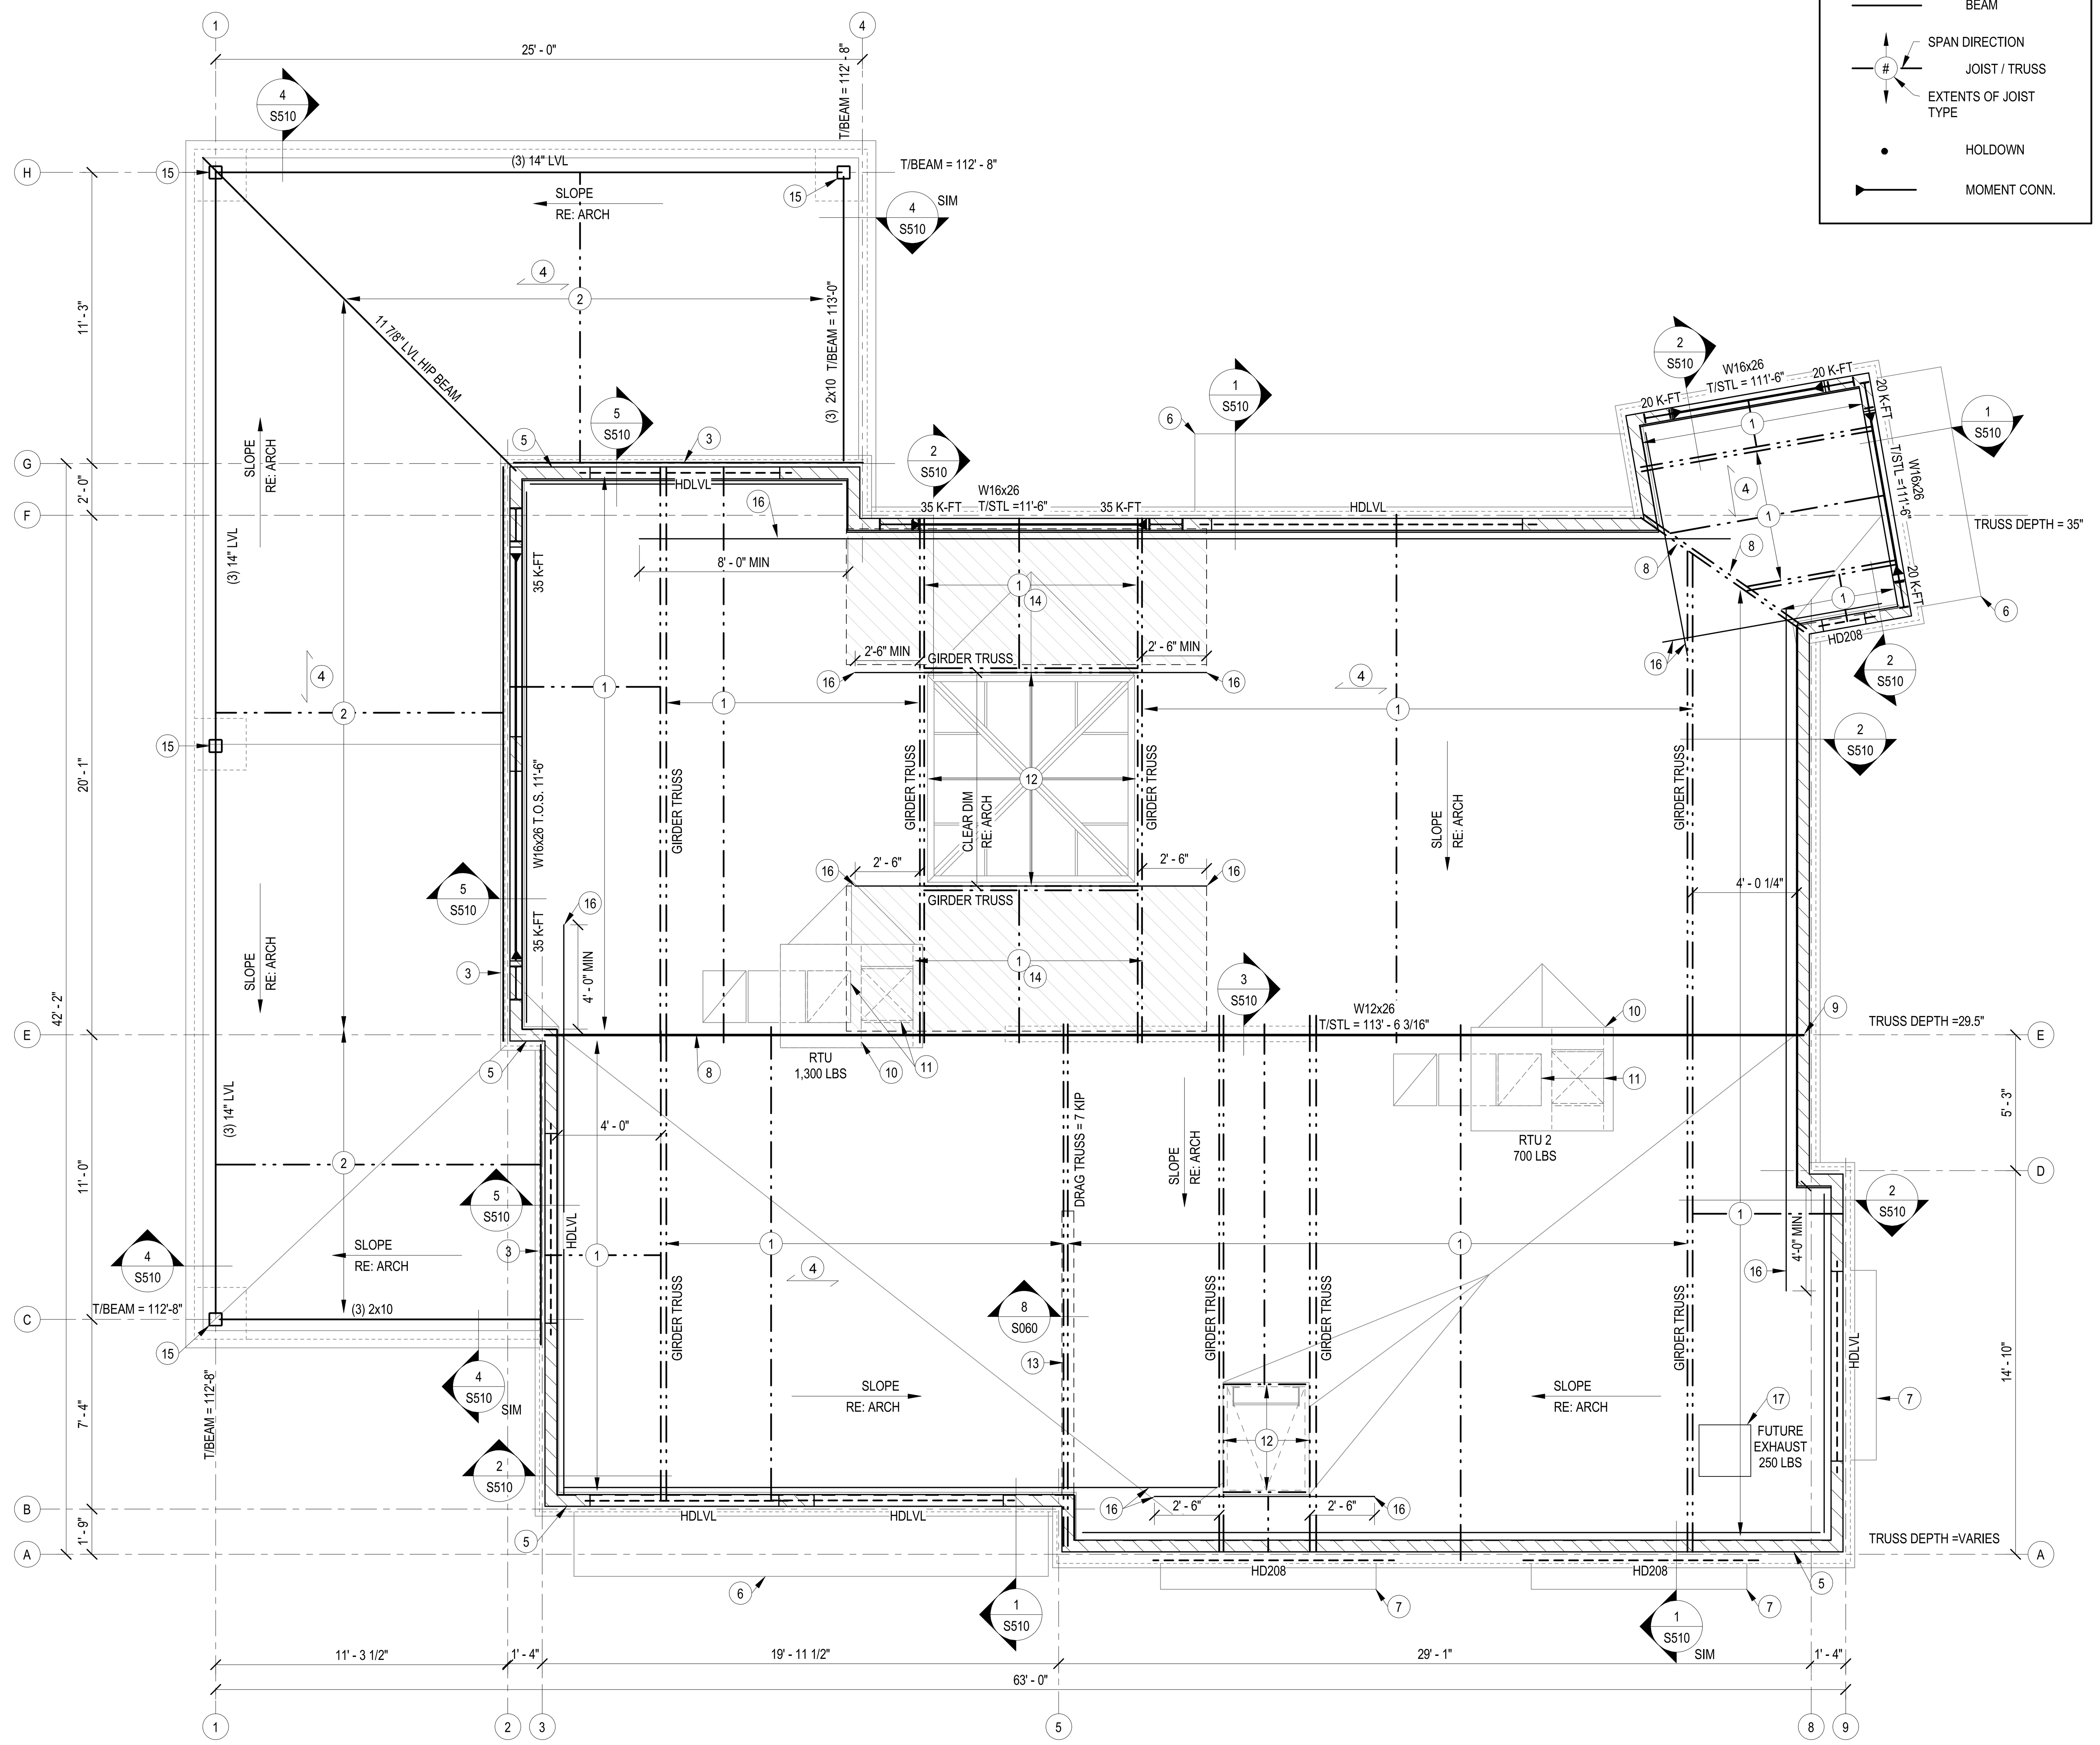

1 ROOF FRAMING PLAN
1/4" = 1'-0"

NORTH

FRAMING LEGEND

- FOUNDATION
- LOAD BEARING WALL
- SHEAR WALL
- HEADER
- BEAM
- SPAN DIRECTION / JOIST / TRUSS / EXTENTS OF JOIST TYPE
- HOLDOWN
- MOMENT CONN.

SHEET NOTES:

A. REFERENCE SHEET S001 FOR STRUCTURAL GENERAL NOTES. REVIEW NOTES FOR APPLICABILITY.

B. SEE ARCHITECTURAL DRAWING FOR DETAILS & DIMENSIONS NOT SHOWN.

C. REFER TO S030-S061 FOR TYPICAL FRAMING DETAILS.

D. PROVIDE TRUSS BRIDGING PER TRUSS MANUFACTURER REQUIREMENTS.

E. REFER TO ARCHITECTURAL DRAWINGS FOR ROOF SLOPES AND DRAINAGE.

F. TRUSS DESIGNER SHALL VERIFY FINAL MEP WEIGHTS AND DIMENSIONS WITH MEP DRAWINGS.

G. TRUSS BEARING ELEVATION = 112' - 6" TYP UNO.

H. PROVIDE MIN (3) STUD PACK BELOW EACH GIRDER TRUSS.

J. TRUSS BRACING DETAIL & LOCATIONS PER TRUSS SUPPLIER.

K. ROOFS SHALL HAVE PRIMARY AND SECONDARY DRAINAGE, RE: ARCH.

L. ALL MULTI-PLY ENGINEERED LUMBER BEAMS ARE DESIGNATED BY NUMBER OF PLIES AND DEPTH (EX: (3) 14" LVL). THE PLIES SHALL BE 1.75" WIDTH UNO AND STRENGTH SHALL BE PER THE GENERAL NOTES. BEAMS SHALL BE FASTENED TOGETHER PER THE TYPICAL DETAILS.

M. HEADERS IN STRUCTURAL WALLS ARE CALLED OUT ON PLANS AS "HDxxx", RE: TYPICAL DETAILS. HEADERS IN NON-STRUCTURAL WALLS ARE (2) 2x6. ALL HEADERS ARE TO BE DOWNSET, UNO.

PLAN NOTES:

1. PRE-ENGINEERED ROOF TRUSS MIN 21.5" DEEP @ 2'-0" OC MAX BY TRUSS SUPPLIER. FLAT BOT CHORD, MONOSLOPE TOP CHORD TO MATCH ROOF SLOPE, RE: ARCH, RE: PLAN FOR TRUSS DEPTH @ LOW SIDE
2. TREATED 2x10 ROOF JOISTS @ 16" OC. PROVIDE SIMPSON LUS210 HANGER EACH END. SLOPE OF JOISTS VARY TO MATCH DRAINAGE PLAN, RE: ARCH
3. 2x10 TREATED LEDGER. FASTEN TO STUDS W/ (2) 10d NAILS AT EA STUD. IN ADDITION, PROVIDE (1) FASTENMASTER HEADLOK SCREW x 2 7/8" LONG @ EVERY STUD. PROVIDE BLOCKING BEHIND LEDGER
4. ROOF SHEATHING, RE: GENERAL NOTES
5. LOCATE (1) TRUSS @ INSIDE FACE OF STUDS. FASTEN TO EA STUD W/ (2) LEDGERLOK SCREWS
6. METAL CANOPY WITH TIE BACKS, RE: ARCH
7. AWNING. DESIGN & ATTACHMENT BY OTHERS
8. CHANGE IN SLOPE, RE: ARCH. PROVIDE BLOCKING ALONG CHANGE IN SLOPE FOR SHEATHING ATTACHMENT AS REQUIRED.
9. STRAP EACH TOP PLATE ACROSS STEEL COLUMN WITH SIMPSON STRONG-TIE CTS218 EACH SIDE PER MFCR
10. TRUSS DESIGN TO ACCOUNT FOR UNIT WT PER PLAN. TRUSS SUPPLIER TO COORD HEADER/CURB SUPPORT, RE: TYP DETAILS ON S061
11. COORD LOCATION & OPENINGS W/ ARCH & MEP. ALL DUCT DROPS SHALL PASS BTWN STRUCT FRAMING WHERE POSSIBLE & PROVIDE BLOCK OUT PER TYP DETAILS BTWN TRUSSES. ANY DUCT DROPS INTERFERING W/ TRUSSES SHALL BE COORD W/ THE TRUSS DESIGNER TO ADD GIRDER TRUSSES
12. COORDINATE OPENING WITH ARCH
13. FACE OF TRUSS TO BE ALIGNED OVER WALL WITH FACE OF SHEAR WALL STUD. TRUSS TO BE DESIGNED FOR DRAG FORCES PER PLAN
14. PROVIDE DIAPHRAGM BLOCKING IN SHADED AREA
15. PROVIDE 3/8" STEEL SADDLE AT TOP OF HSS COLUMN TO CARRY EAVE BEAMS. MITER LVL BEAMS AT CORNER LOCATIONS. PROVIDE (2) 1/2" THRU BOLTS AT END OF EACH LVL
16. CONTINUE CS14 STRAPPING PAST CORNER PER DIMENSIONS ON PLAN. PROVIDE 2x6 BLOCKING BELOW STRAPPING
17. COORDINATE WITH TENANT FINISH

STAND STRUCTURAL ENGINEERING INC
8234 Robinson Street
Overland Park, KS 66204
913-214-2169
stand-sei.com

CODY ROBERT GIBBENS
LICENSED
PE28037
KANSAS
PROFESSIONAL ENGINEER
11/24/2025

DAVID A. KASTER, RA, NCARB, LEED AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT
7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC

ARCHITECTURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center
Mr. D's DONUTS
14495 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 24, 2025
REVISED
SHEET NUMBER
S101
OF SHEETS

STAND JOB NO. 25281

STAND STRUCTURAL ENGINEERING INC
8234 Robinson Street
Overland Park, KS 66204
913-214-2169
stand-sei.com

CODY ROBERT GIBBENS
LICENSED
PE28037
KANSAS
PROFESSIONAL ENGINEER
11/24/2025

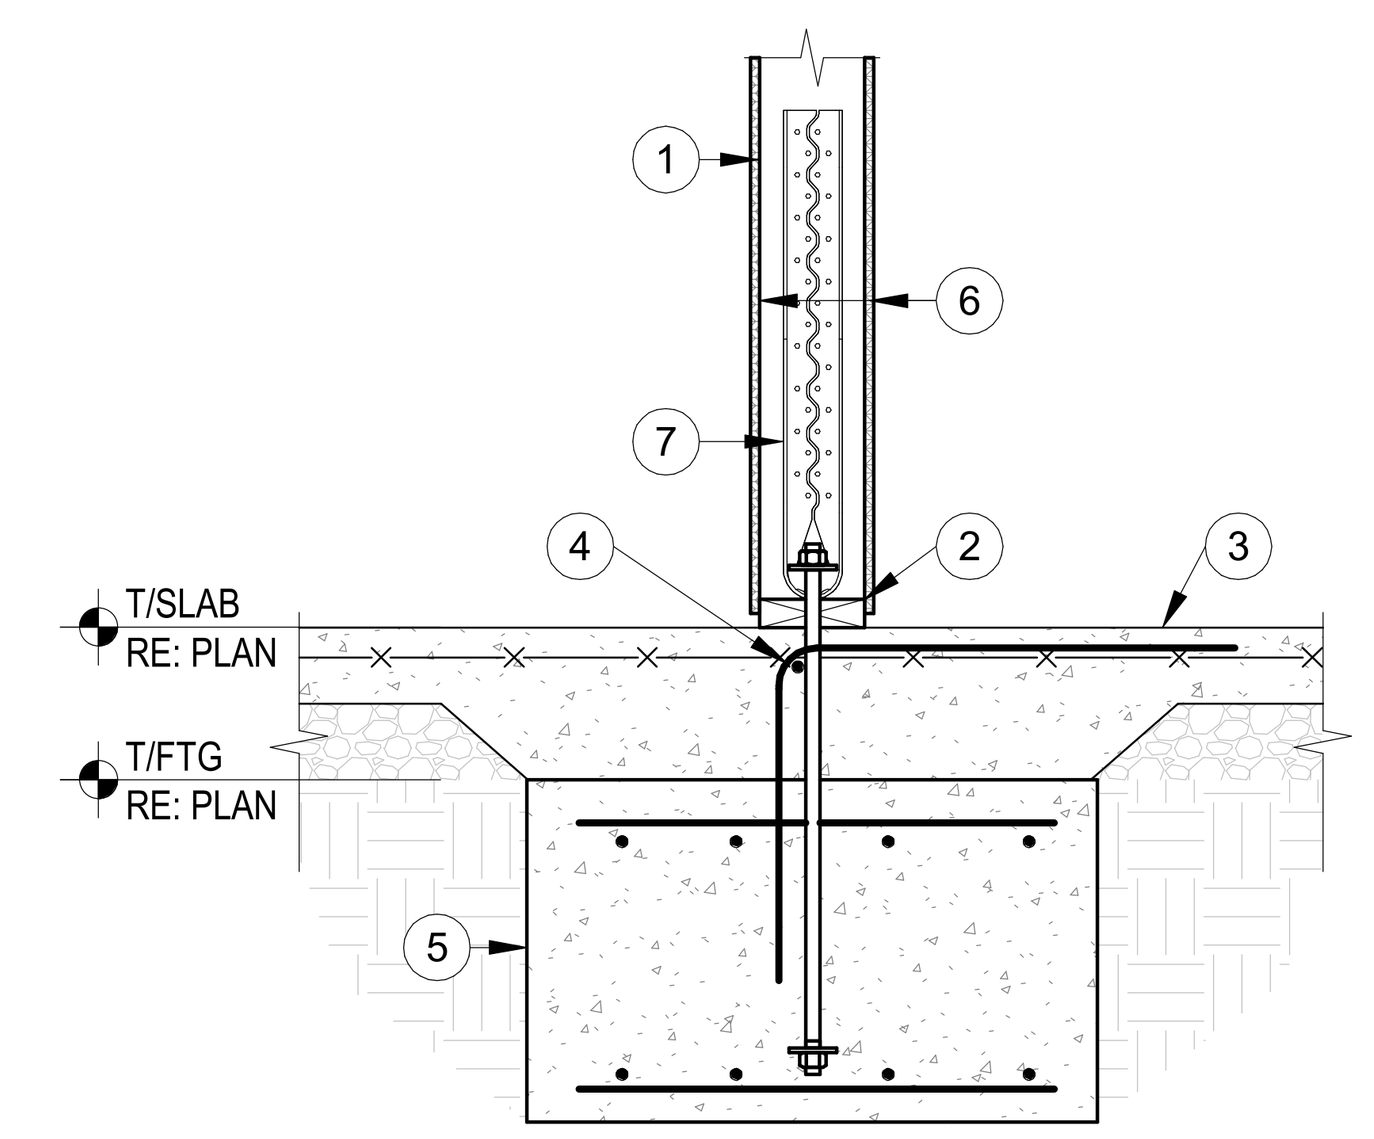

DETAIL NOTES:

1. SHEAR WALL, RE: PLAN
2. PRESSURE TREATED 2x SILL PLATE TO MATCH STUD WALL SIZE, RE: SHEAR WALL SCHEDULE AND S001 FOR SILL ANCHORAGE
3. SLAB ON GRADE, RE: PLAN
4. #4 DWL (2'-0" x 2'-0") @ 24" OC & CONT @ PERIMETER
5. SPREAD FOOTING, RE: PLAN FOR SIZE & REINF
6. SHEATHING PER SHEAR WALL SCHEDULE AND S001
7. HOLD DOWN AND ANCHORAGE, RE: SHEAR WALL SCHEDULE

4 FOUNDATION SECTION

3/4" = 1'-0"

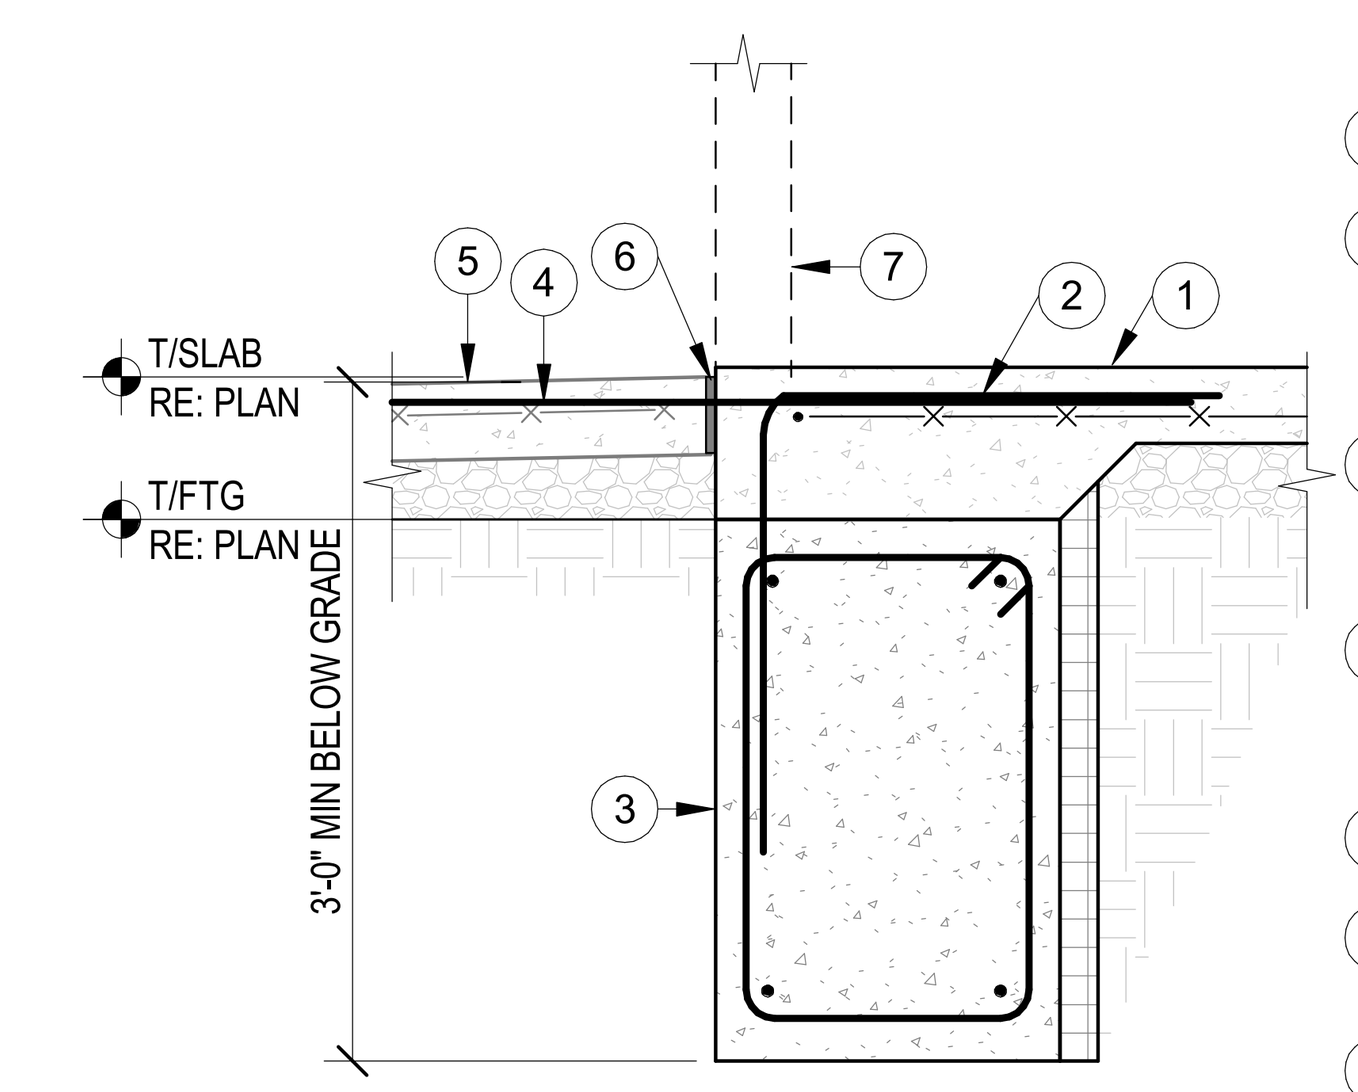

DETAIL NOTES:

1. SLAB ON GRADE, RE: PLAN
2. PROVIDE #4 (2'-0"x2'-0") DWL'S @ 24" OC AND #4 CONT @ PERIMETER. AT DOOR OPENINGS TIGHTEN DWL SPACING TO 12" OC
3. TRENCH FOOTING, RE: PLAN FOR SIZE AND REINF, RE: ARCH FOR INSULATION REQUIREMENTS.
4. AT DOORS PROVIDE #4 x 4'-0" LONG DWL @ 18" OC MAX @ BETWEEN INTERIOR AND EXTERIOR SLAB ON GRADE
5. EXT PAVING, RE: CIVIL
6. 1/2" EXP JT W/ REMOVABLE CAP & SEALANT
7. OPENING, RE: ARCH

3 FOUNDATION SECTION

3/4" = 1'-0"

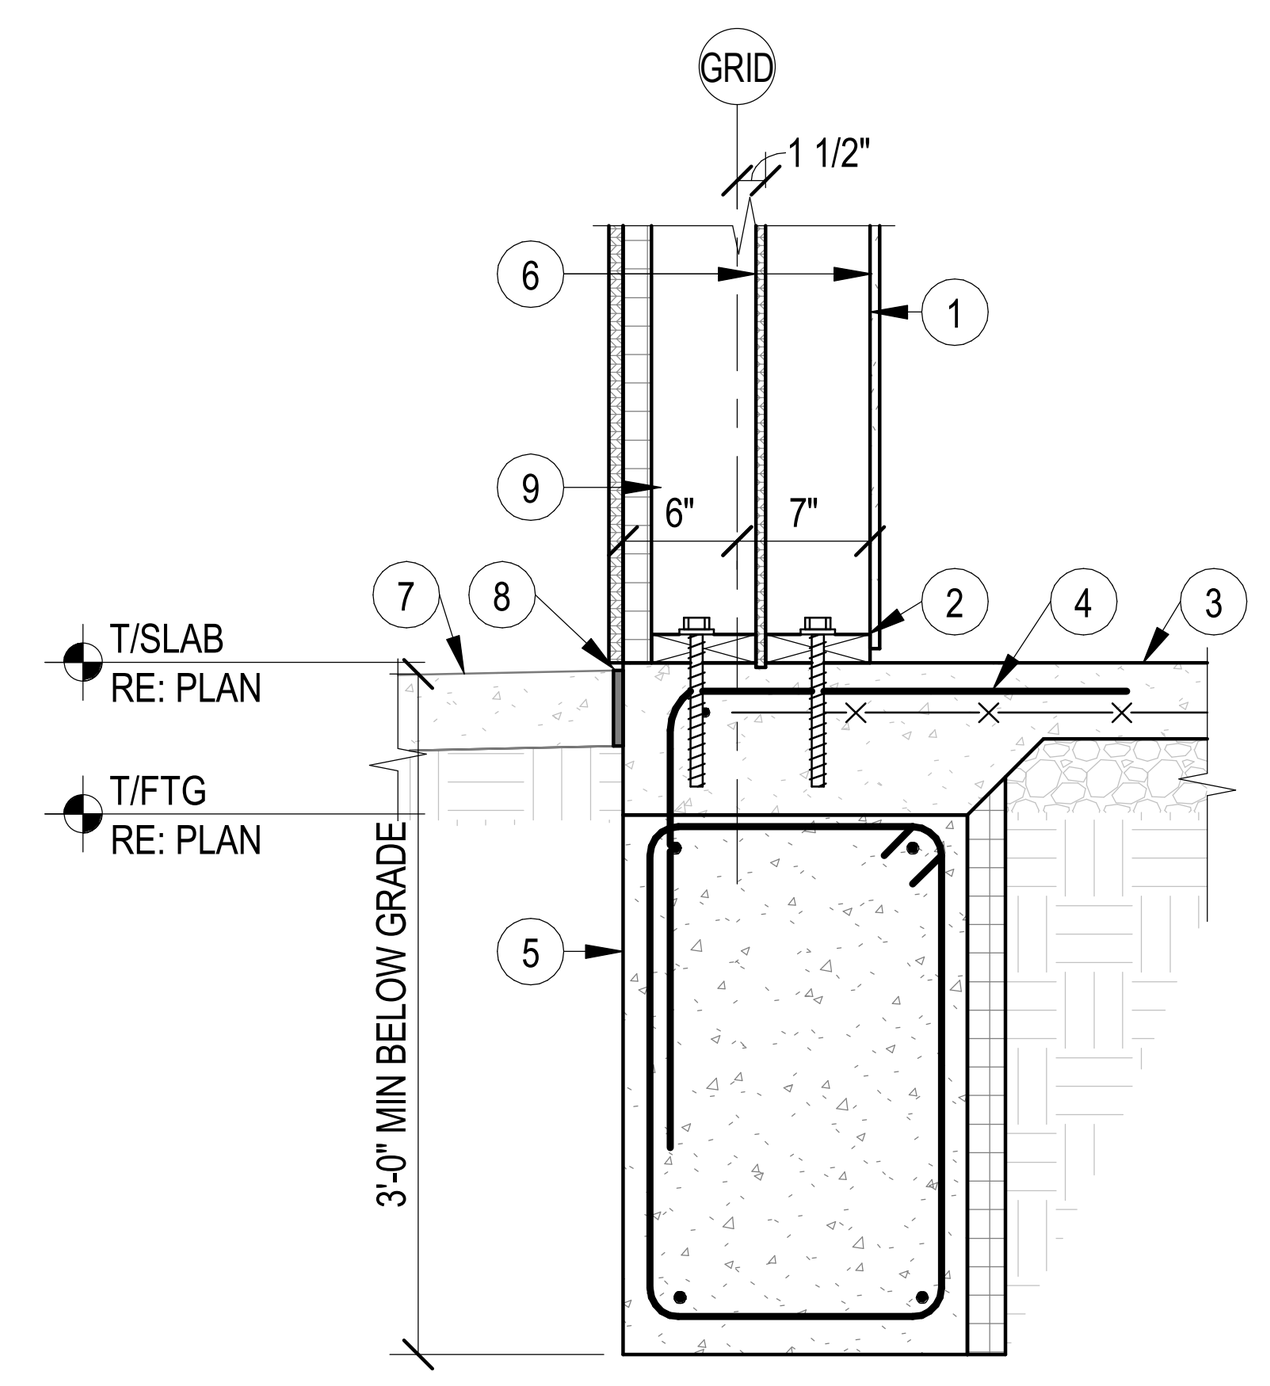

DETAIL NOTES:

1. LOAD BEARING STUD WALL, RE: PLAN
2. PRESSURE TREATED 2x SILL PLATE TO MATCH STUD WALL SIZE, RE: SHEAR WALL SCHEDULE AND S001 FOR SILL ANCHORAGE
3. SLAB ON GRADE, RE: PLAN
4. #4 DWL (2'-0" x 2'-0") @ 24" OC & CONT @ PERIMETER
5. TRENCH FOOTING, RE: PLAN FOR SIZE AND REINF. RE: ARCH FOR INSULATION REQUIREMENTS
6. WALL SHEATHING, RE: SHEAR WALL SCHEDULE AND GENERAL NOTES
7. EXT PAVING OR GRADE, RE: CIVIL
8. 1/2" EXP JT W/ REMOVABLE CAP & SEALANT AS REQUIRED WHERE EXTERIOR PAVEMENT IS PRESENT
9. FUR OUT WITH 2x STUD WALL, RE: ARCH. FASTEN PER TYPICAL DETAIL ON S061

2 FOUNDATION SECTION

3/4" = 1'-0"

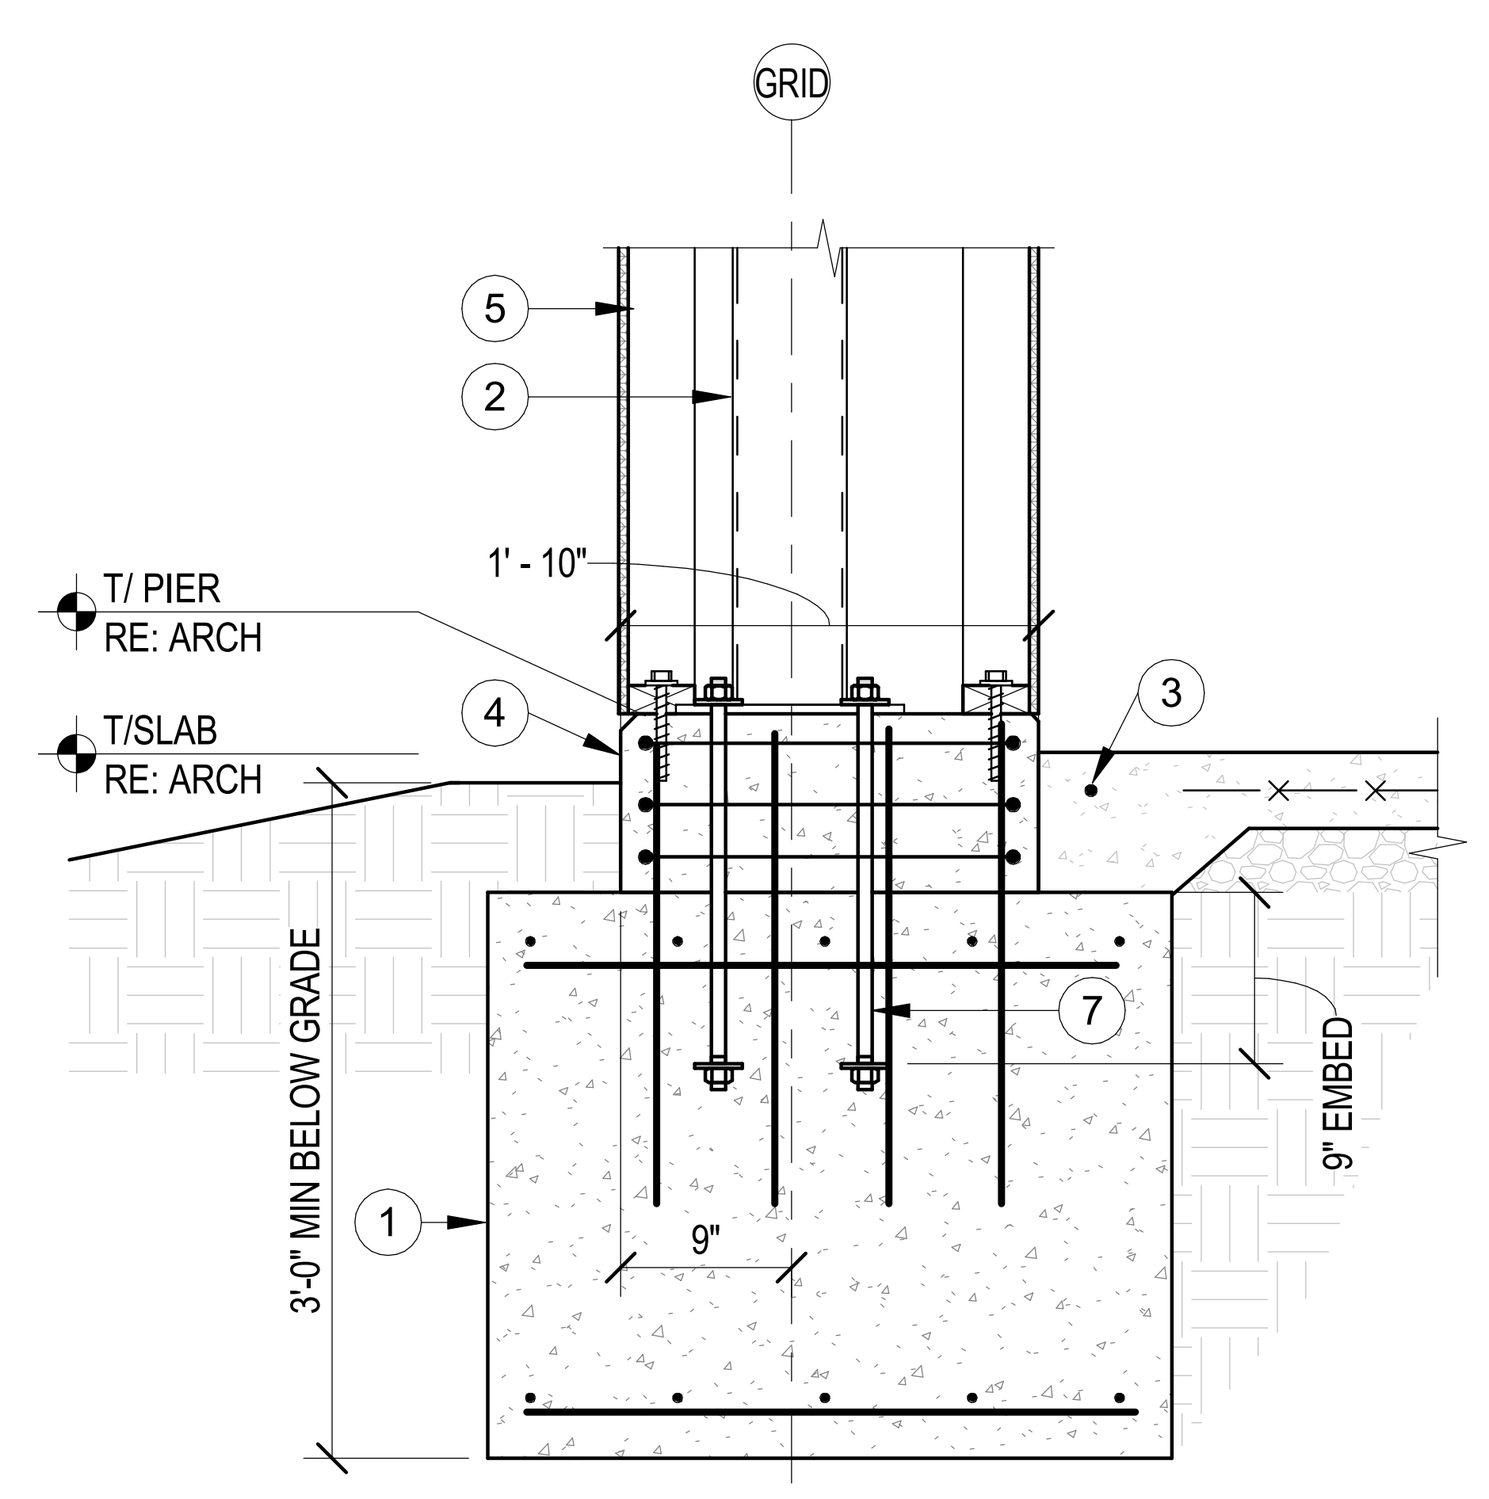

DETAIL NOTES:

1. FOOTING RE: PLAN FOR SIZE & REINF
2. HSS POST, RE: PLAN
3. SLAB ON GRADE RE: PLAN. PROVIDE #4 CONT @ PERIMETER. EXTEND MIN 2' PAST CORNER. PROVIDE DIAGONAL REINFORCING AT RE-ENTRANT CORNERS PER TYPICAL DETAILS
4. CONCRETE PIER W/ (12) #4 VERTS & (3) #3 TIES. CHAMFER CORNERS 3/4"
5. STUD WALL, RE: ARCH. 2x CONTINUOUS TREATED SILL PLATE, ANCHOR TO CONCRETE PER GENERAL NOTES
6. 1/2" BASE PLATE
7. (4) 3/4" Ø CAST IN PLACE ANCHOR RODS

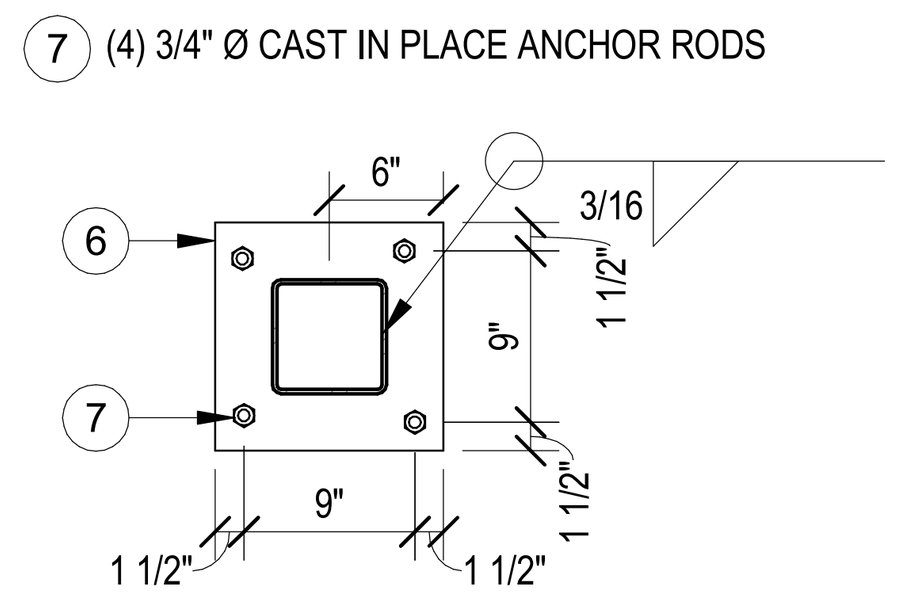

BASE PLATE DIAGRAM

5 SECTION AT PATIO HSS POST

3/4" = 1'-0"

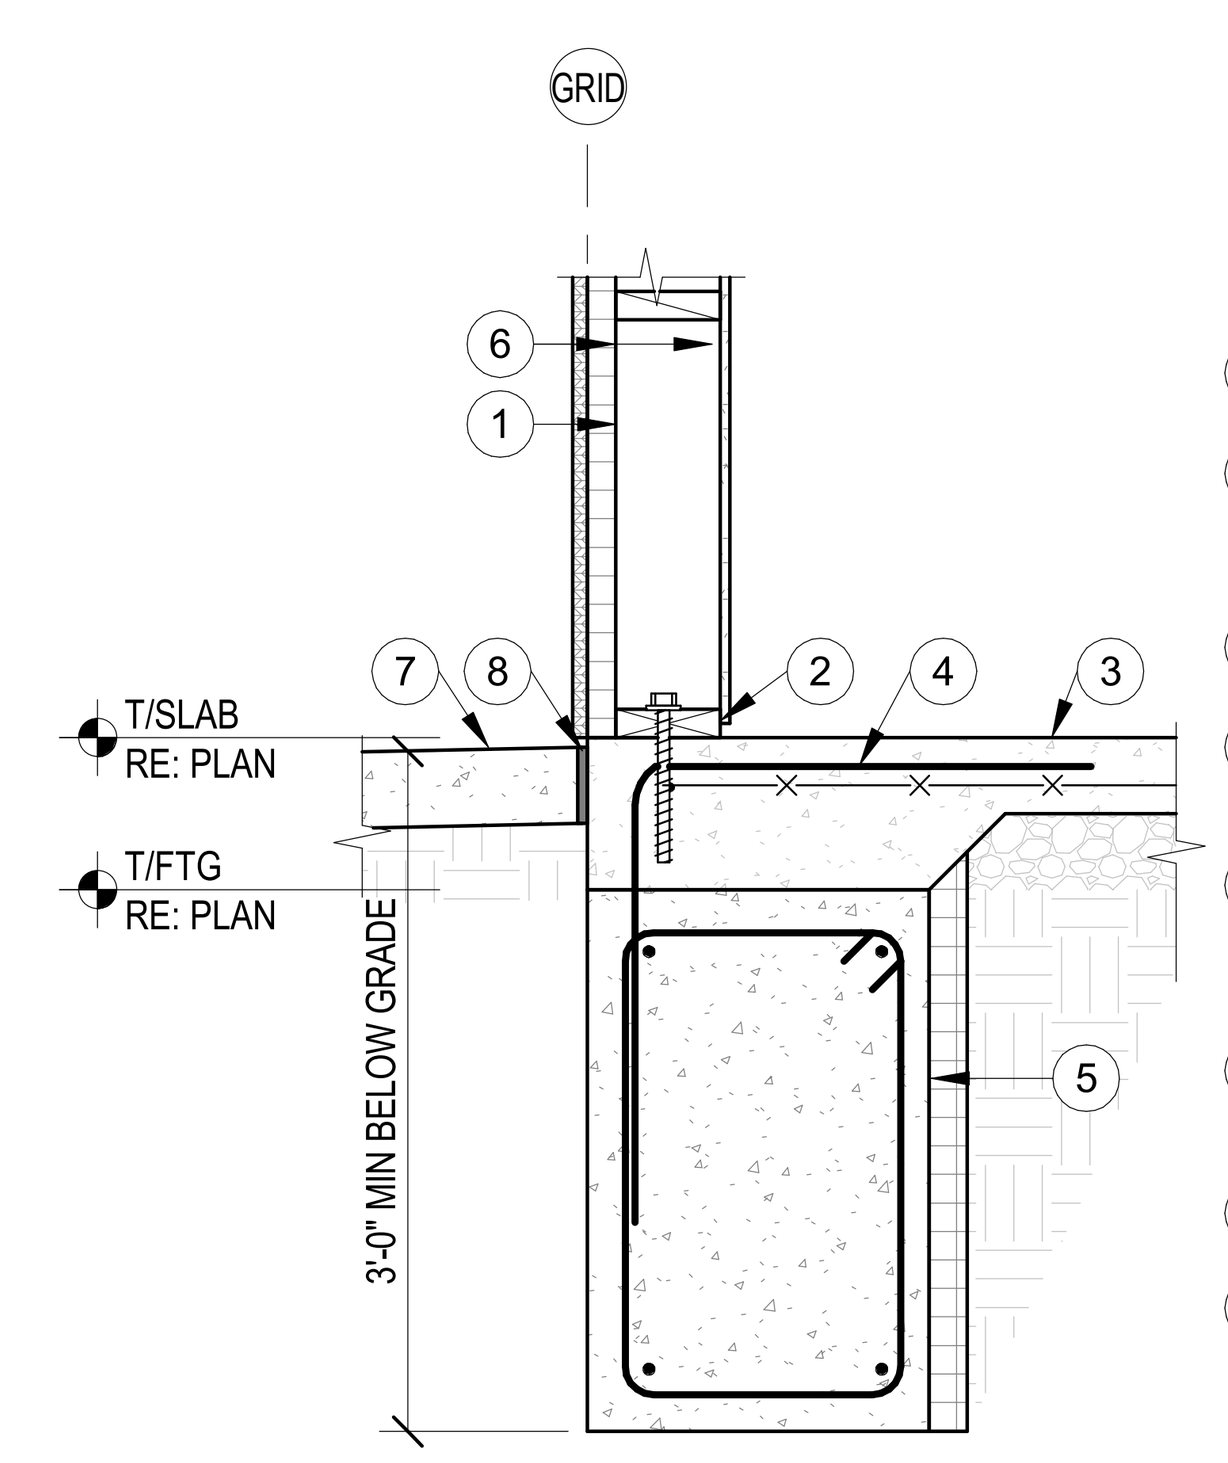

DETAIL NOTES:

1. LOAD BEARING STUD WALL, RE: PLAN
2. PRESSURE TREATED 2x SILL PLATE TO MATCH STUD WALL SIZE, RE: SHEAR WALL SCHEDULE AND S001 FOR SILL ANCHORAGE
3. SLAB ON GRADE, RE: PLAN
4. #4 DWL (2'-0" x 2'-0") @ 24" OC & CONT @ PERIMETER
5. TRENCH FOOTING, RE: PLAN FOR SIZE AND REINF. RE: ARCH FOR INSULATION REQUIREMENTS.
6. WALL SHEATHING, RE: SHEAR WALL SCHEDULE AND GENERAL NOTES
7. EXT PAVING OR GRADE, RE: CIVIL
8. 1/2" EXP JT W/ REMOVABLE CAP & SEALANT AS REQUIRED WHERE EXTERIOR PAVEMENT IS PRESENT

1 FOUNDATION SECTION

3/4" = 1'-0"

DAVID A. KASTER, RA,NCARB,LEED AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC

ARCHITECTURE · PLANNING · INTERIOR DESIGN

L0T 11: Lionsgate Shopping Center
Mr. D's DONUTS
14495 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 24, 2025
REVISED
SHEET NUMBER
S500
OF SHEETS

STAND JOB NO. 25281

STAND STRUCTURAL ENGINEERING INC
8234 Robinson Street
Overland Park, KS 66204
913-214-2169
stand-sei.com

CODY ROBERT GIBBENS
LICENSED
PE28037
KANSAS
PROFESSIONAL ENGINEER
11/24/2025

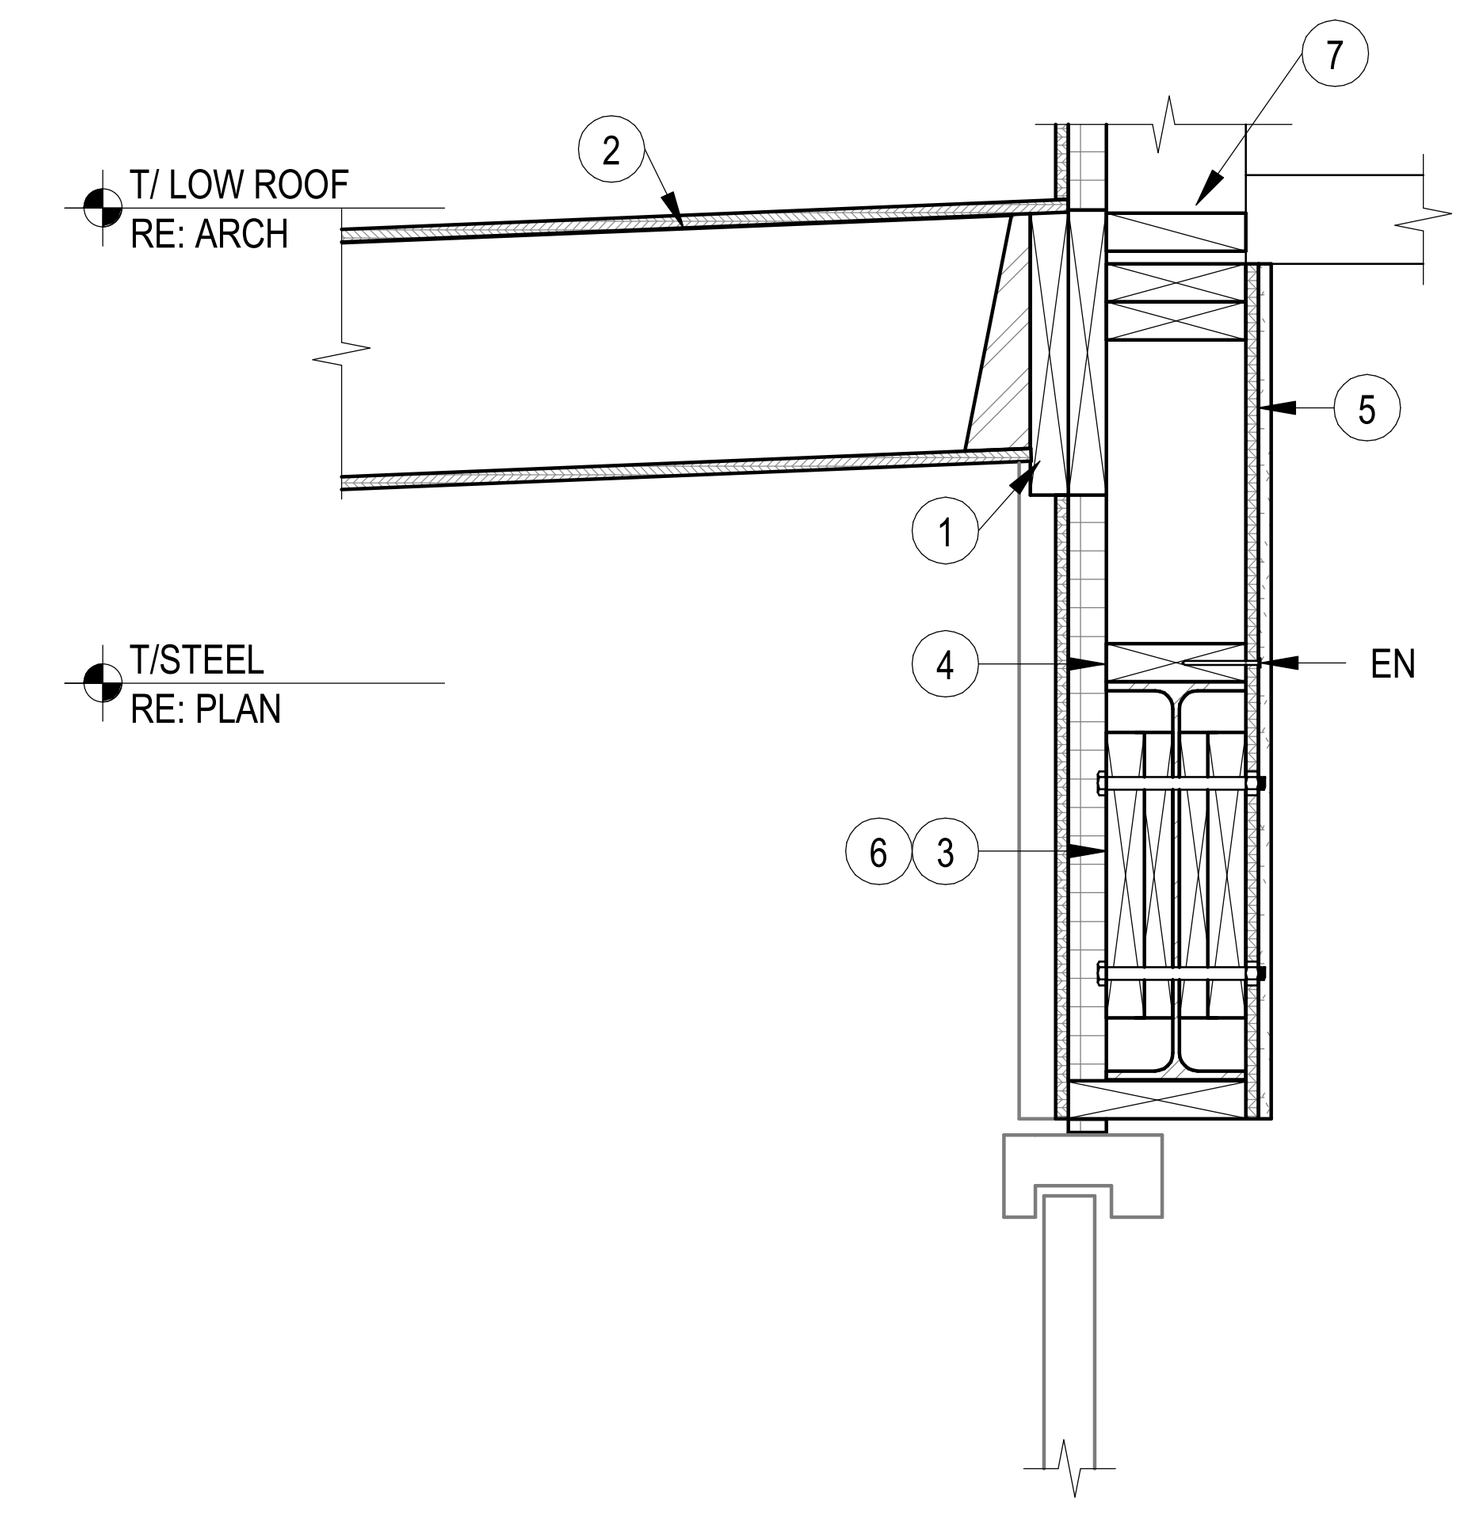

DETAIL NOTES:

1. LEDGER, RE: PLAN
2. PATIO ROOF JOISTS AND HANGERS
3. WOOD HEADER OR STEEL PORTAL BEAM, RE: PLAN
4. FASTEN 2x WOOD PLATE W/ PAF (2) 0.45" Ø x 2" LONG PAF @ 16" OC. TIP OF PAF SHALL FULLY PENETRATE STEEL FLANGE
5. PROVIDE SHEATHING PER SHEAR WALL SCHEDULE SW-A ON INSIDE FACE OF WALL
6. PACK OUT STEEL BEAM PER TYPICAL DETAIL
7. CONTINUOUS BLOCKING BETWEEN TRUSSES AT LEDGER SUPPORT

NOTES:

REFER TO DETAILS 1/S510 AND 2/S510 FOR UPPER ROOF FRAMING CONDITIONS

5 ROOF FRAMING SECTION
1" = 1'-0"

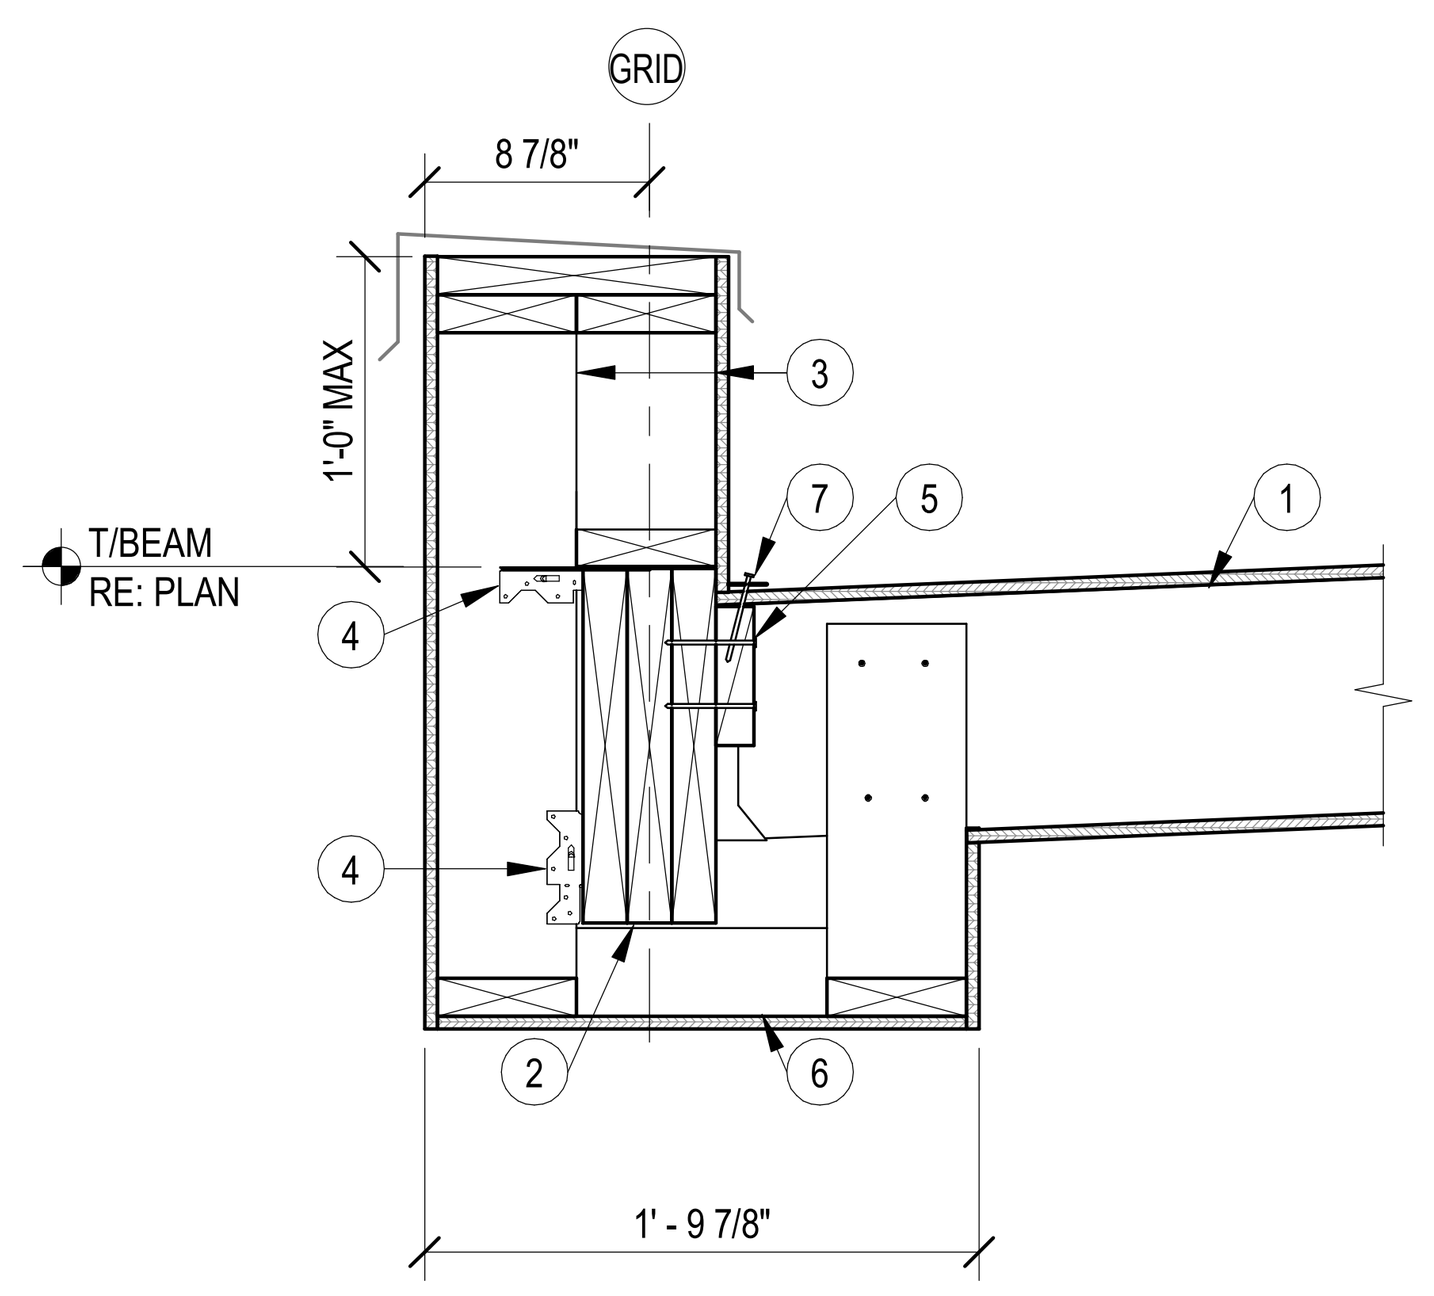

DETAIL NOTES:

1. ROOF JOISTS, RE: PLAN. SLOPE RE: ARCH
2. EAVE BEAM, RE: PLAN
3. 2x6 PARAPET STUD @ 16" OC
4. SIMPSON A35 CLIP @ EACH STUD TO BOT OF LVL BEAM. AT TOP PROVIDE A35 CONFIGURATION 2 @ EACH STUD
5. 2x6 CONTINUOUS BLOCKING BETWEEN EACH TRUSS. FASTEN TO LVL WITH (4)1/4" x 3.5" SCREWS
6. SOFFIT FRAMING, RE:ARCH
7. (1) SIMPSON CS14 CONT COIL STRAP FULL LENGTH OF ROOF DIAPHRAGM. PROVIDE 8d EDGE NAILING ALONG LENGTH PER GENERAL NOTES (DO NOT SPLICE). ANCHOR ENDS PER MFCR

NOTES:

AT SIM ROOF JOISTS RUN PARALLEL TO BEAM. PROVIDE BLOCKING @ 24" OC IN FIRST TWO JOIST SPACES

4 PATIO EAVE SECTION
1" = 1'-0"

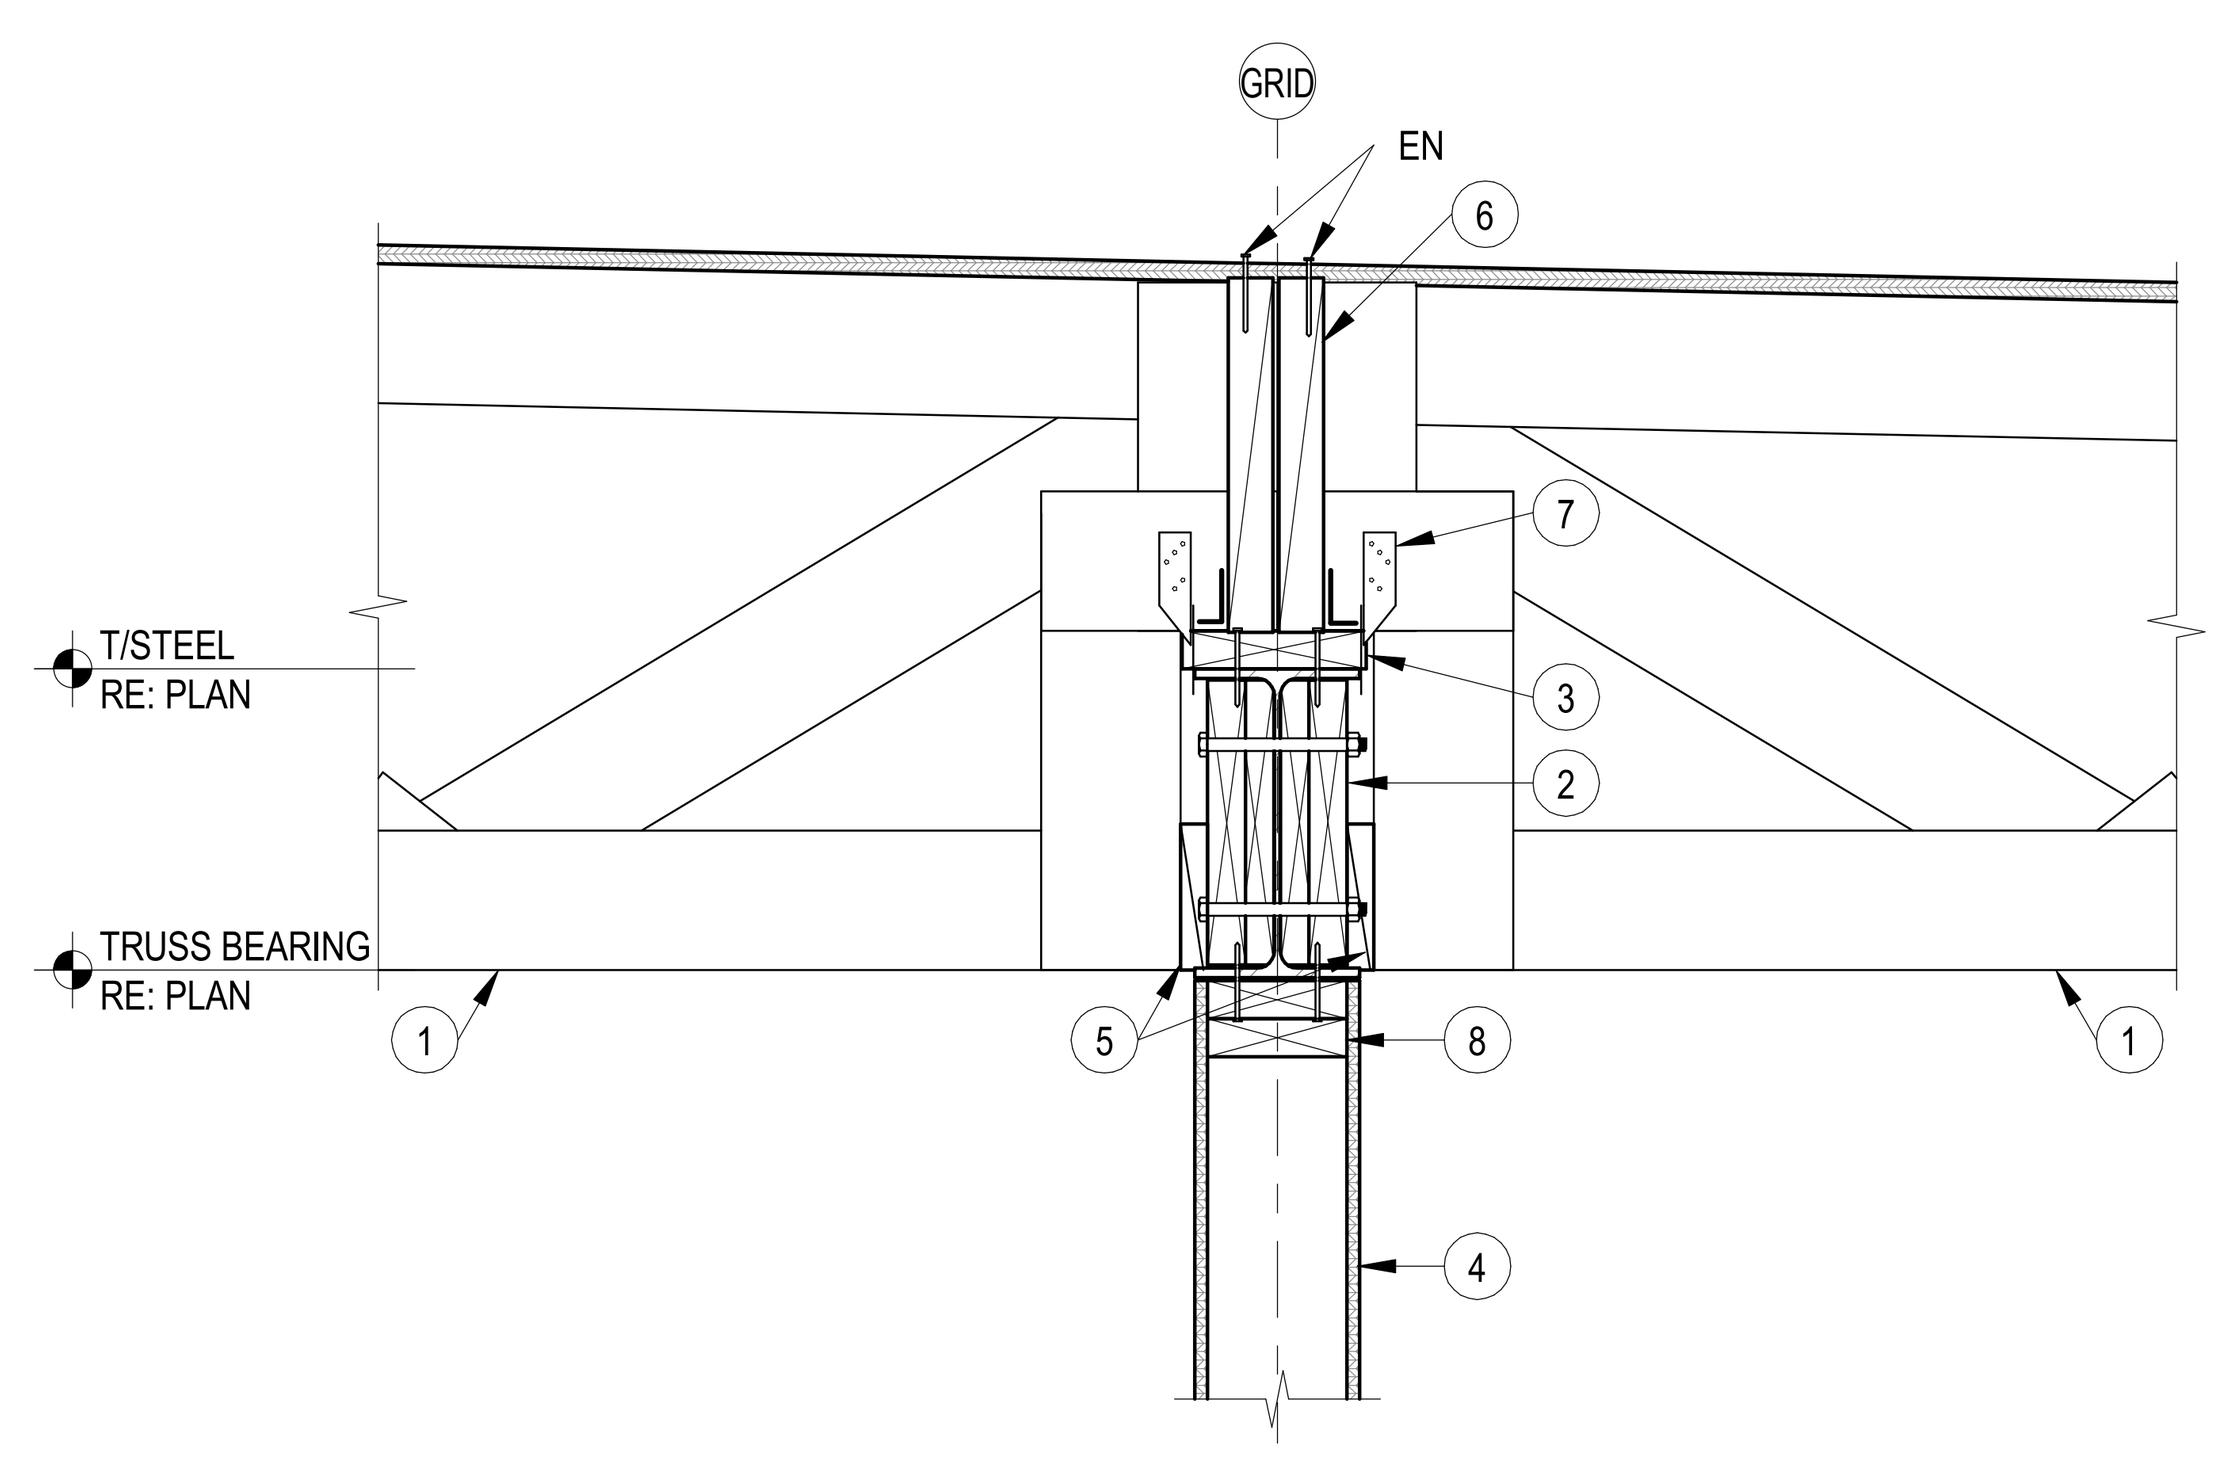

DETAIL NOTES:

1. PRE-ENGINEERED ROOF TRUSSES, RE: PLAN. DAP ENDS AS SHOWN
2. STEEL BEAM, RE: PLAN. PACK OUT PER TYPICAL DETAILS
3. PROVIDE CONT 2x NAILER TO MATCH FLANGE WIDTH. FASTEN W/ PAF (2) 0.45" Ø x 2" LONG PAF @ 16" OC. TIP OF PAF SHALL FULLY PENETRATE STEEL FLANGE
4. SHEAR WALL, RE: PLAN AND SHEAR WALL SCHEDULE
5. AT GRID 5 AND GRID 7 AND AT TWO TRUSS TO EITHER SIDE OF EACH GRIDLINE: SHIM TIGHT BETWEEN THE STEEL BEAM AND THE TRUSS. FASTEN SHIMS WITH MIN (4) 10d NAILS TO STEEL BEAM PACKING
6. PROVIDE BLOCKING BETWEEN TRUSSES. PROVIDE A35 CLIPS @ 12" OC BETWEEN BLOCKING AND NAILER
7. H6 HURRICANE TIE AT EACH TRUSS. FASTEN TO PACKED OUT STEEL BEAM. (NOTE: AT GIRDER TRUSSES, CONNECTION SHALL BE BY TRUSS SUPPLIER)
8. DOUBLE TOP PLATE. FASTEN TOP PLY TO STEEL BEAM W/ PAF (2) 0.45" Ø x 2" LONG PAF @ 16" OC. TIP OF PAF SHALL FULLY PENETRATE STEEL FLANGE

NOTES:

CONNECTION OF TRUSS AND TRUSS STABILITY PER TRUSS SUPPLIER.

3 SECTION AT STEEL BEAM
1" = 1'-0"

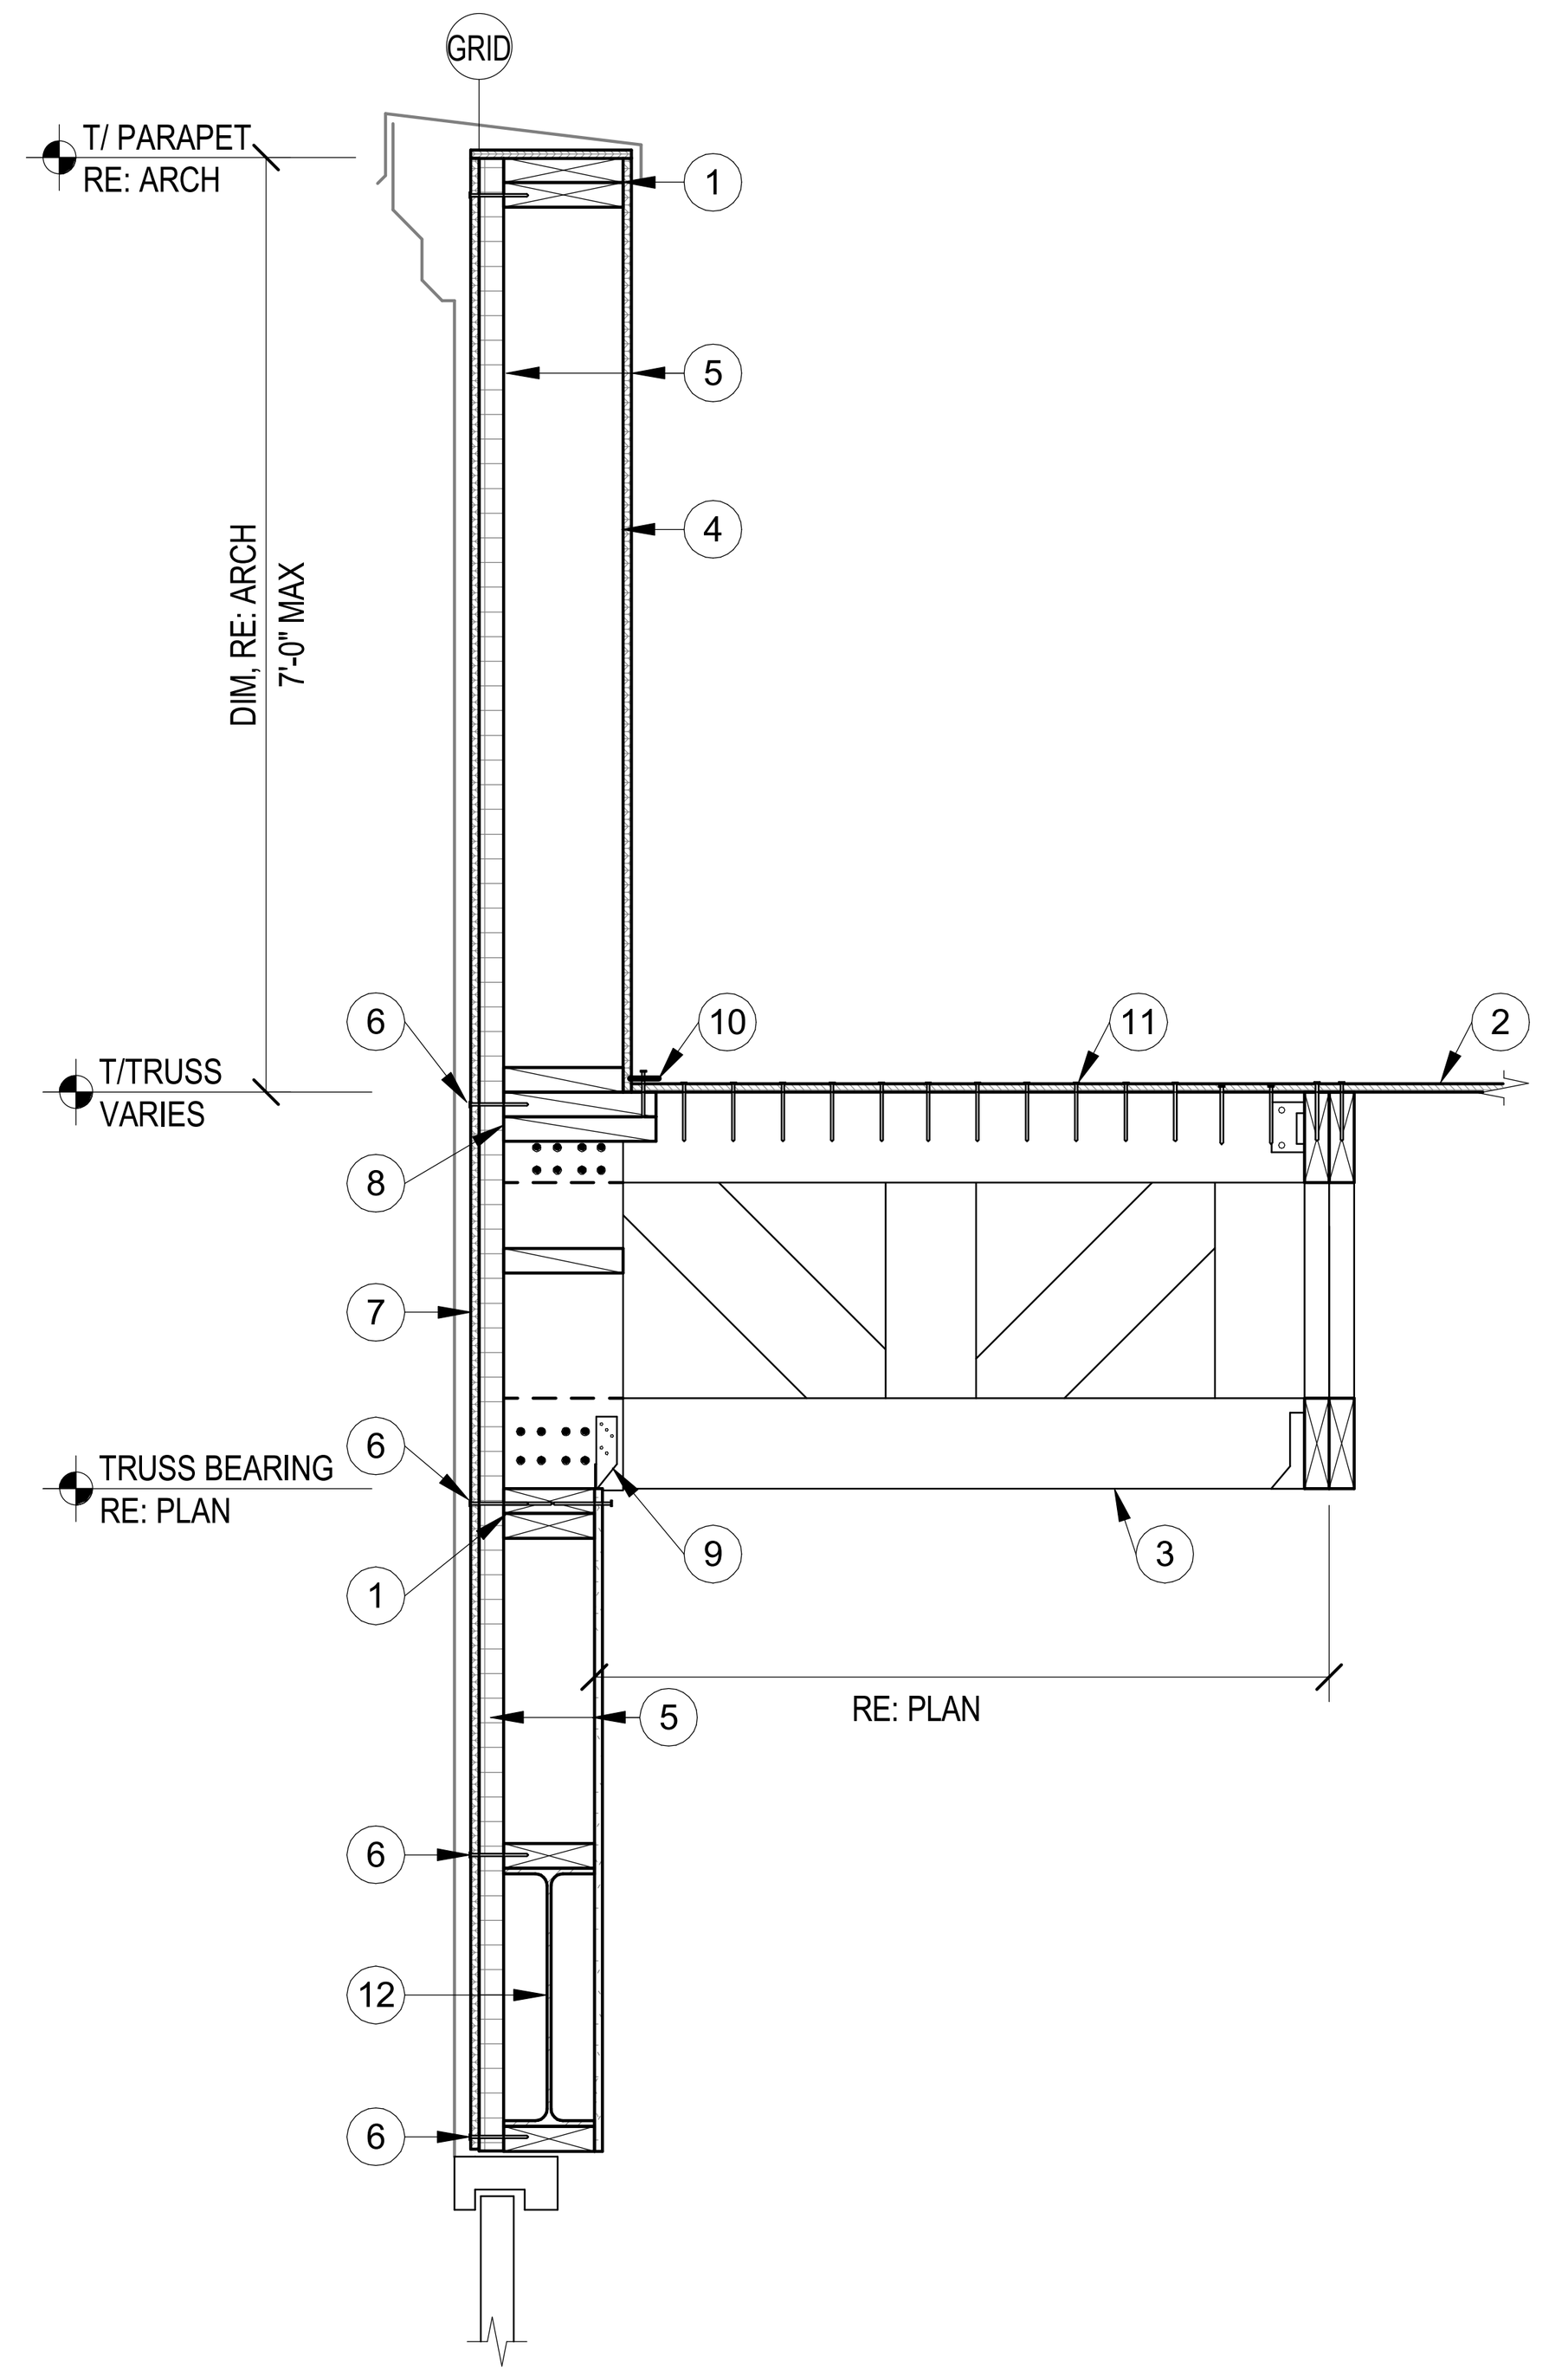

DETAIL NOTES:

1. DOUBLE 2x TOP PL
2. ROOF SHEATHING, RE: PLAN & GEN NOTES
3. PRE-ENGINEERED WOOD ROOF TRUSS BY TRUSS SUPPLIER, RE: PLAN
4. (2) 2x8 PARAPET STUD, SANDWICH LAP W/ WOOD TRUSS. FASTEN EACH PLY TO TRUSS WITH (8) 10d NAILS TO TOP CHORD (16 TOTAL), AND (8) 10d NAILS TO BOT CHORD (16 TOTAL)
5. WALL SHEATHING, RE: GENERAL NOTES AND SHEAR WALL SCHEDULE
6. EDGE NAILING PER GENERAL NOTES AND SHEAR WALL SCHEDULE
7. SHEATHING TO BE CONTINUOUS UP TO ROOF. PROVIDE BLOCKING AS REQUIRED PER SHEAR WALL SCHEDULE
8. (2) 2x10 CONTINUOUS BLOCKING
9. PROVIDE SIMPSON HTS16 TWIST STRAP @ EACH END OF TRUSS
10. (1) SIMPSON CS14 CONT COIL STRAP FULL LENGTH OF ROOF DIAPHRAGM. PROVIDE 8d EDGE NAILING ALONG LENGTH PER GENERAL NOTES (DO NOT SPLICE). ANCHOR ENDS PER MFCR
11. FASTEN SHEATHING WITH 10d NAILS AT 3" OC TO TOP OF TRUSS
12. HEADER, RE: PLAN . AT STEEL HDR FASTEN 2x WOOD PLATE TOP AND BOT W/ PAF (2) 0.45" Ø x 2" LONG PAF @ 16" OC. TIP OF PAF SHALL FULLY PENETRATE STEEL FLANGE

NOTES:

TRUSS SUPPLIER TO INCLUDE OVERTURNING REACTION ON GIRDER TRUSS FROM PARAPET LOADING

2 ROOF FRAMING SECTION
3/4" = 1'-0"

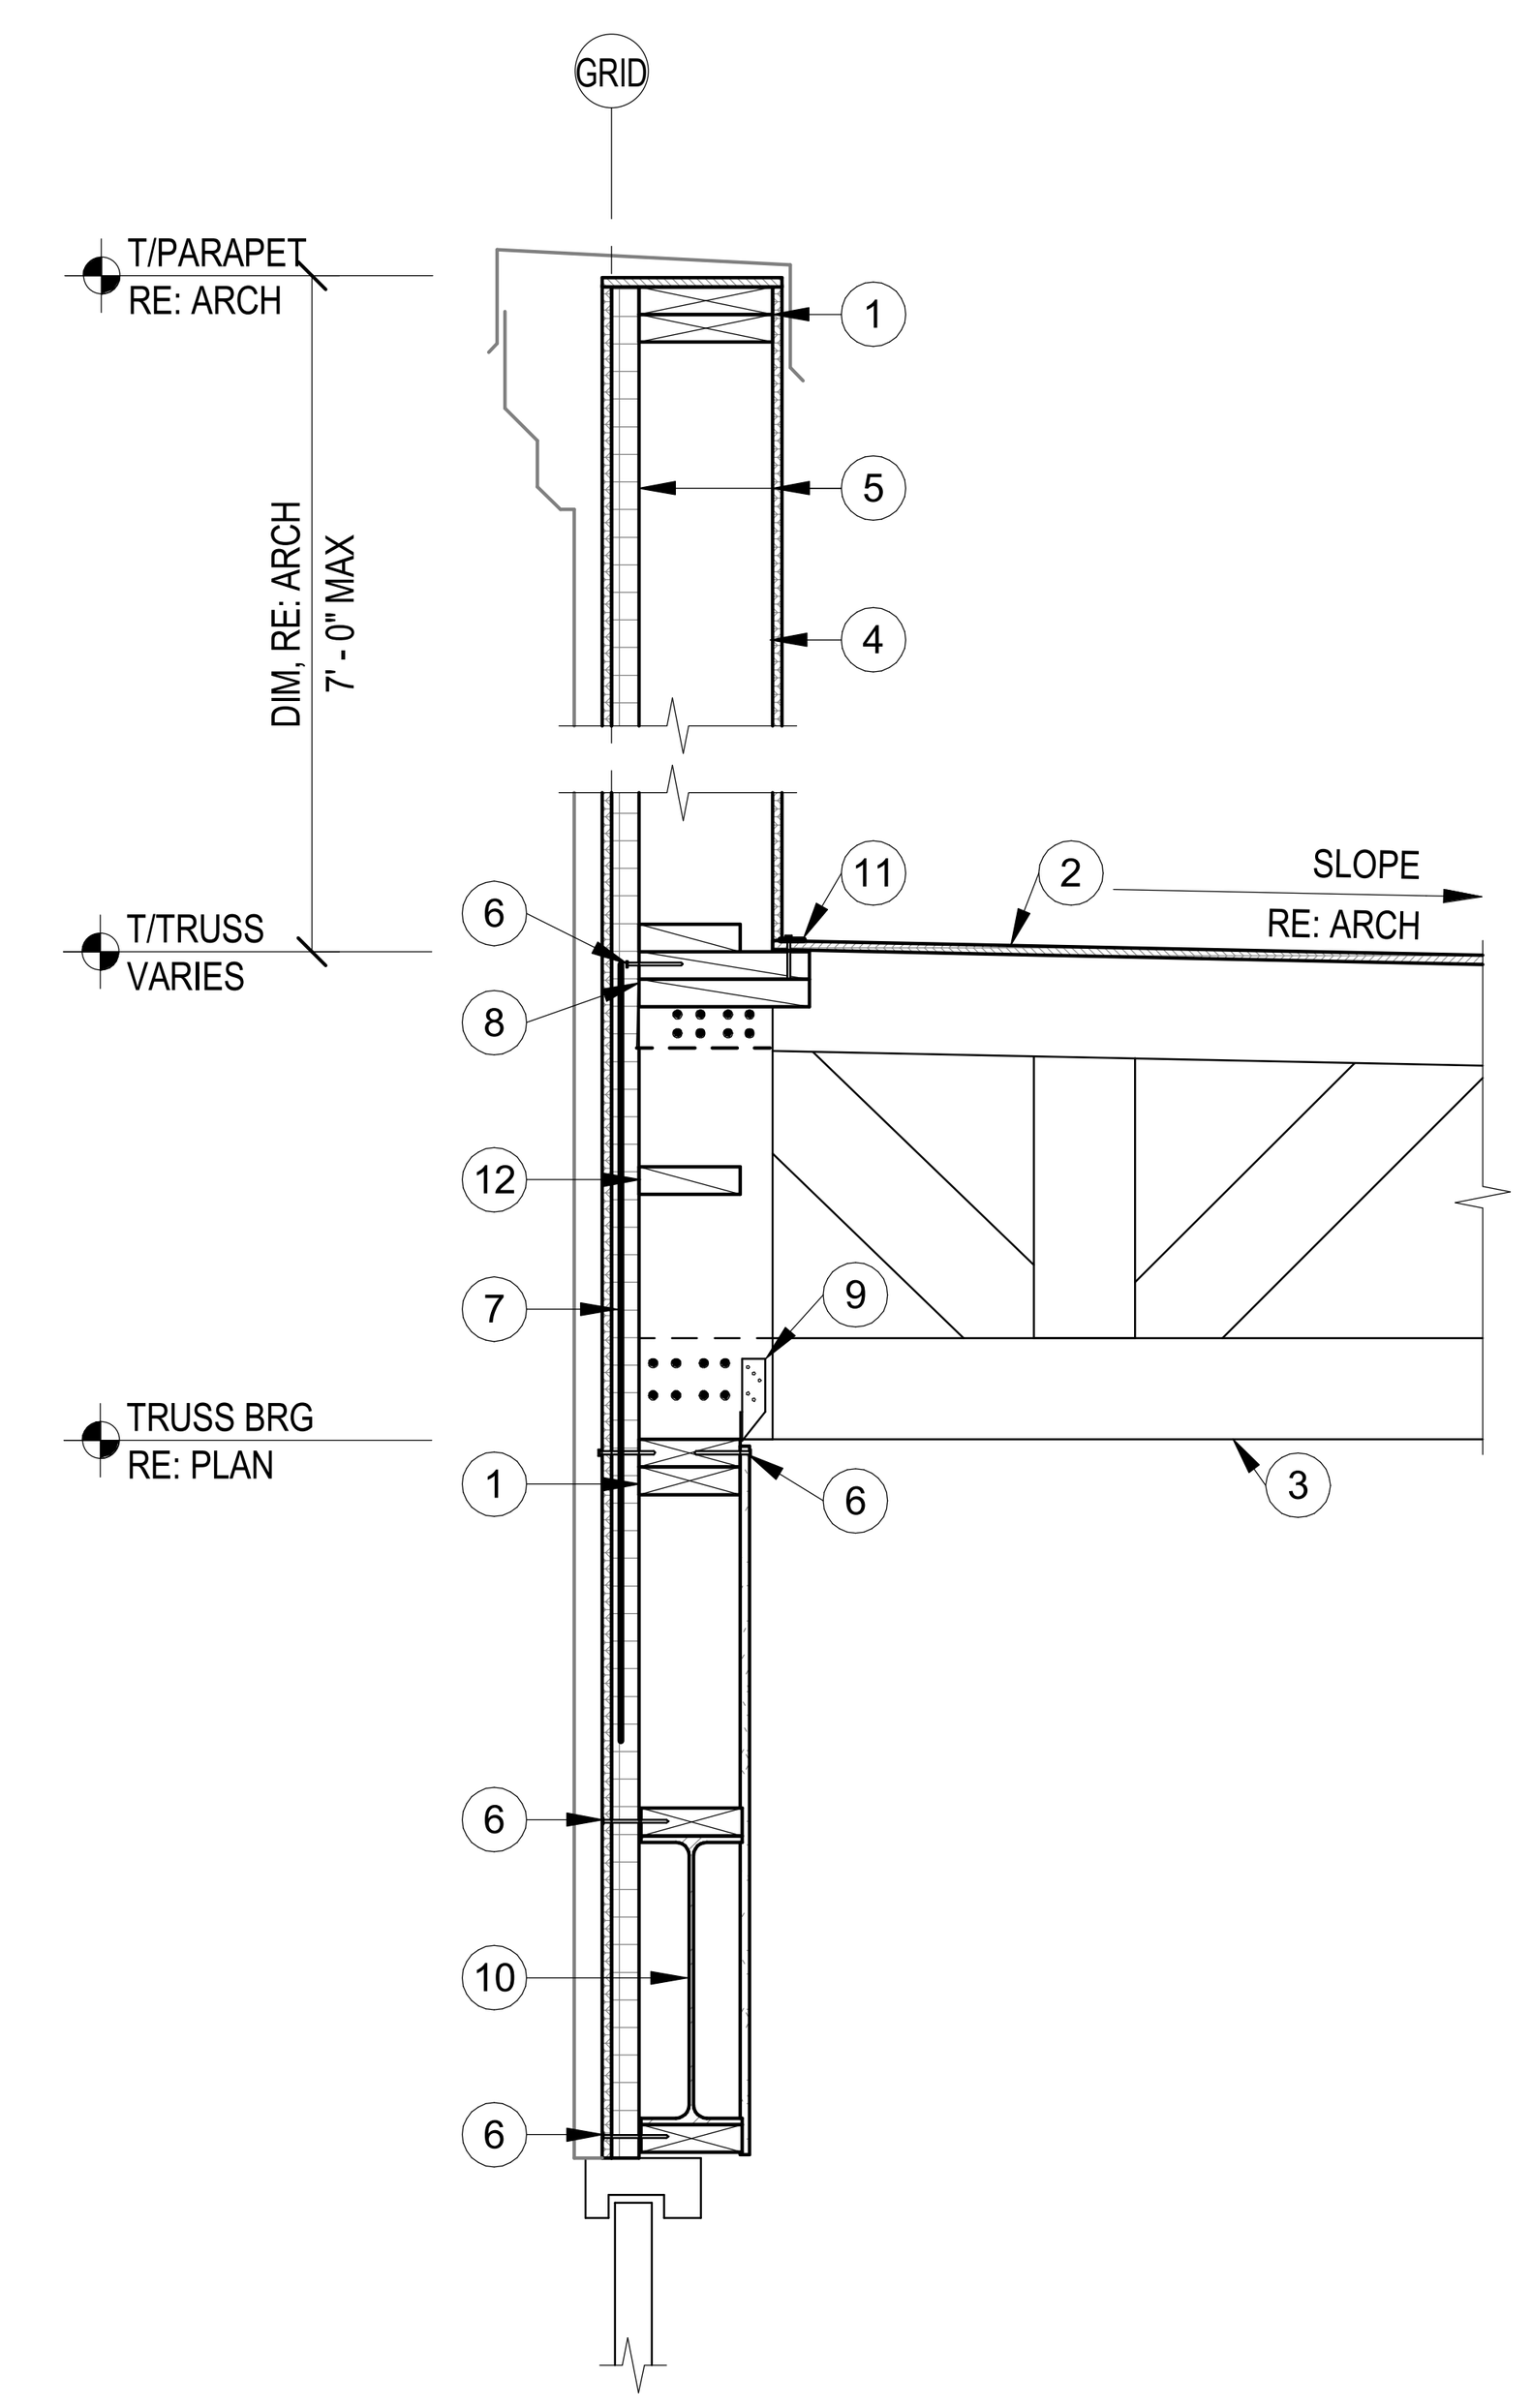

DETAIL NOTES:

1. DOUBLE 2x TOP PL
2. ROOF SHEATHING, RE: PLAN & GEN NOTES
3. PRE-ENGINEERED WOOD ROOF TRUSS BY TRUSS SUPPLIER, RE: PLAN
4. (2) 2x8 PARAPET STUD, SANDWICH LAP W/ WOOD TRUSS. FASTEN EACH PLY TO TRUSS WITH (8) 10d NAILS TO TOP CHORD (16 TOTAL), AND (8) 10d NAILS TO BOT CHORD (16 TOTAL)
5. WALL SHEATHING, RE: GENERAL NOTES AND SHEAR WALL SCHEDULE
6. EDGE NAILING PER GENERAL NOTES AND SHEAR WALL SCHEDULE
7. AT GIRDER TRUSS FASTEN (1) MSTA30 STRAP TO EACH PLY AND TO STUD BELOW PER MANUFACTURER REQUIREMENTS
8. (2) 2x10 BLKG @ ROOF PANEL EDGES
9. PROVIDE SIMPSON H2.5T TIE EACH END OF TRUSS
10. WOOD OR STEEL HEADER, RE: PLAN . AT STEEL HDR FASTEN 2x WOOD PLATE TOP AND BOT W/ PAF (2) 0.45" Ø x 2" LONG PAF @ 16" OC. TIP OF PAF SHALL FULLY PENETRATE STEEL FLANGE.
11. (1) SIMPSON CS14 CONT COIL STRAP FULL LENGTH OF ROOF DIAPHRAGM. PROVIDE 8d EDGE NAILING ALONG LENGTH PER GENERAL NOTES (DO NOT SPLICE). ANCHOR ENDS PER MFCR
12. SHEAR WALL SHEATHING TO CONTINUE UP TO ROOF. PROVIDE BLOCKING AS REQUIRED

NOTES:

AT SIM EXTERIOR OR WALL IS FURRED OUT, SEE TYPICAL DETAILS FOR FURRING FASTENERS

1 ROOF FRAMING SECTION
3/4" = 1'-0"

DAVID A. KASTER, RA,NCARB,LEED AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC
ARCHITECTURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center
Mr. D's DONUTS
14495 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 24, 2025
REVISED
SHEET NUMBER
S510
OF SHEETS

STAND JOB NO. 25281

PLUMBING GENERAL NOTES:
1. DRAWINGS ARE SCHEMATIC IN NATURE AND BASED ON PRELIMINARY SITE OBSERVATION AND ORIGINAL DESIGN DRAWINGS (WHEN AVAILABLE). PRIOR TO BID, CONTRACTOR SHALL INVESTIGATE THE PROJECT SITE AND BECOME FULLY AWARE OF ALL FIELD CONDITIONS, CURRENT SYSTEM OPERATION, AS WELL AS COORDINATION REQUIREMENTS. COORDINATE ALL PLUMBING WORK WITH ARCHITECTURAL DRAWINGS, EXISTING CONDITIONS, AND OTHER TRADES PRIOR TO BID OR START OF WORK.
2. PLUMBING WORK SHALL CONFORM TO APPLICABLE CODES AS ADOPTED BY THE LOCAL AUTHORITY HAVING JURISDICTION. REFER TO ARCHITECTURAL CODE PLANS FOR SPECIFIC CODE REFERENCES.
3. EXACT LOCATION AND ELEVATIONS OF ALL EXISTING UTILITIES SHALL BE VERIFIED PRIOR TO ANY INSTALLATION OF CONNECTIONS THEREOF. ALL CONNECTIONS TO EXISTING UTILITIES)E.G. DOMESTIC WATER, SEWER, VENT, AND NATURAL GAS) SHALL BE MADE WITH APPROVAL OF THE ADMINISTRATIVE AUTHORITY AND THE RESPECTIVE UTILITY COMPANIES.
4. SANITARY WASTE AND VENT PIPING BELOW GRADE SHALL BE SCHEDULE 40 PVC WITH SOLVENT-WELDED JOINTS.
5. SANITARY WASTE AND VENT PIPING ABOVE GRADE SHALL BE NO-HUB CAST IRON IN RETURN AIR PLENUM APPPLICATIONS. PVC OR ABS PIPING CAN BE USED IN AREAS OTHER THAN RETURN AIR PLENUMS AS ALLOWED BY CODE.
6. SLOPE SANITARY PIPING AS FOLLOWS: 1/4" PER FOOT FOR PIPE SIZES 2-1/2" AND SMALLER, AND 1/8" PER FOOT SLOPE FOR PIPE SIZES 3" AND LARGER.
7. COORDINATE CONDENSATE DRAIN REQUIREMENTS WITH THE HVAC CONTRACTOR AND OTHER TRADES.
8. CONDENSATE DRAIN PIPING SHALL BE TYPE M COPPER PIPING WITH WROUGHT FITTINGS AND SOLDERED JOINTS IN RETURN AIR PLENUM APPLICATIONS. PVC CAN BE USED IN AREAS OTHER THAN RETURN AIR PLENUMS AS ALLOWED BY CODE.
9. SLOPE CONDENSATE DRAIN PIPING AS FOLLOWS: 1/8" PER FOOT FOR ALL PIPE SIZES.
10. PROVIDE WATER SUPPLY SHUT-OFF VALVES ON EACH TOILET ROOM GROUP AND TO MISC. EQUIPMENT.
11. PROVIDE SIZE "A" WATER HAMMER ARRESTORS ON SUPPLY TO ALL PLUMBING FIXTURES.
12. PROVIDE STOP VALVES ON ALL INDIVIDUAL PLUMBING FIXTURE SUPPLIES.
13. COORDINATE SELECTION OF ALL PLUMBING FIXTURES WITH ARCHITECT AND OWNER, ALL HANDICAPPED FIXTURES (WHERE REQUIRED) SHALL COMPLY WITH A.D.A. REQUIREMENTS.
14. DOMESTIC WATER PIPING ABOVE GRADE SHALL BE TYPE L COPPER WITH WROUGHT FITTINGS AND SOLDERED JOINTS.
15. INSULATE NEW DOMESTIC COLD WATER, HOT WATER, HOT WATER RECIRCULATION, AND INTERIOR CONDENSATE DRAIN PIPING WITH MINIMUM 1" FIBERGLASS INSULATION (MINIMUM r-4.0) WITH PAPER COVERING.
16. INSTALL ALL PLUMBING EQUIPMENT, FIXTURES, VALVES, ETC. PER MANUFACTURER'S INSTALLATION REQUIREMENTS. PROVIDE ADDITIONAL APPURTENANCES PER MANUFACTURER'S INSTALLATION REQUIREMENTS.
17. INSTALL CLEANOUTS AT EVERY END OF SANITARY PIPING RUNS, AT MINIMUM OF EVERY 100'-0" OF SANITARY PIPING, AND AT EVERY CHANGE IN DIRECTION GREATER THAN 45 DEG.. REFER TO SECTION 708 OF THE INTERNATIONAL PLUMBING CODE FOR ADDITIONAL REQUIREMENTS.
18. PLUMBING CONTRACTOR SHALL INSPECT ALL PLUMBING EQUIPMENT TO REMAIN. REPORT ANY DEFICIENCIES TO OWNER PRIOR TO START OF WORK.
19. CONTRACTOR SHALL LABEL ALL PIPING, VALVES AND EQUIPMENT WITH MANUFACTURER STANDARD LABELING SYSTEMS. COORDINATE WITH OWNER FOR FINAL EQUIPMENT DESIGNATIONS.
20. ALL ROOF PENETRATIONS SHALL BE PERFORMED BY THE LANDLORD'S ROOFING CONTRACTOR SO AS ROOF WARRANTY IS MAINTAINED.

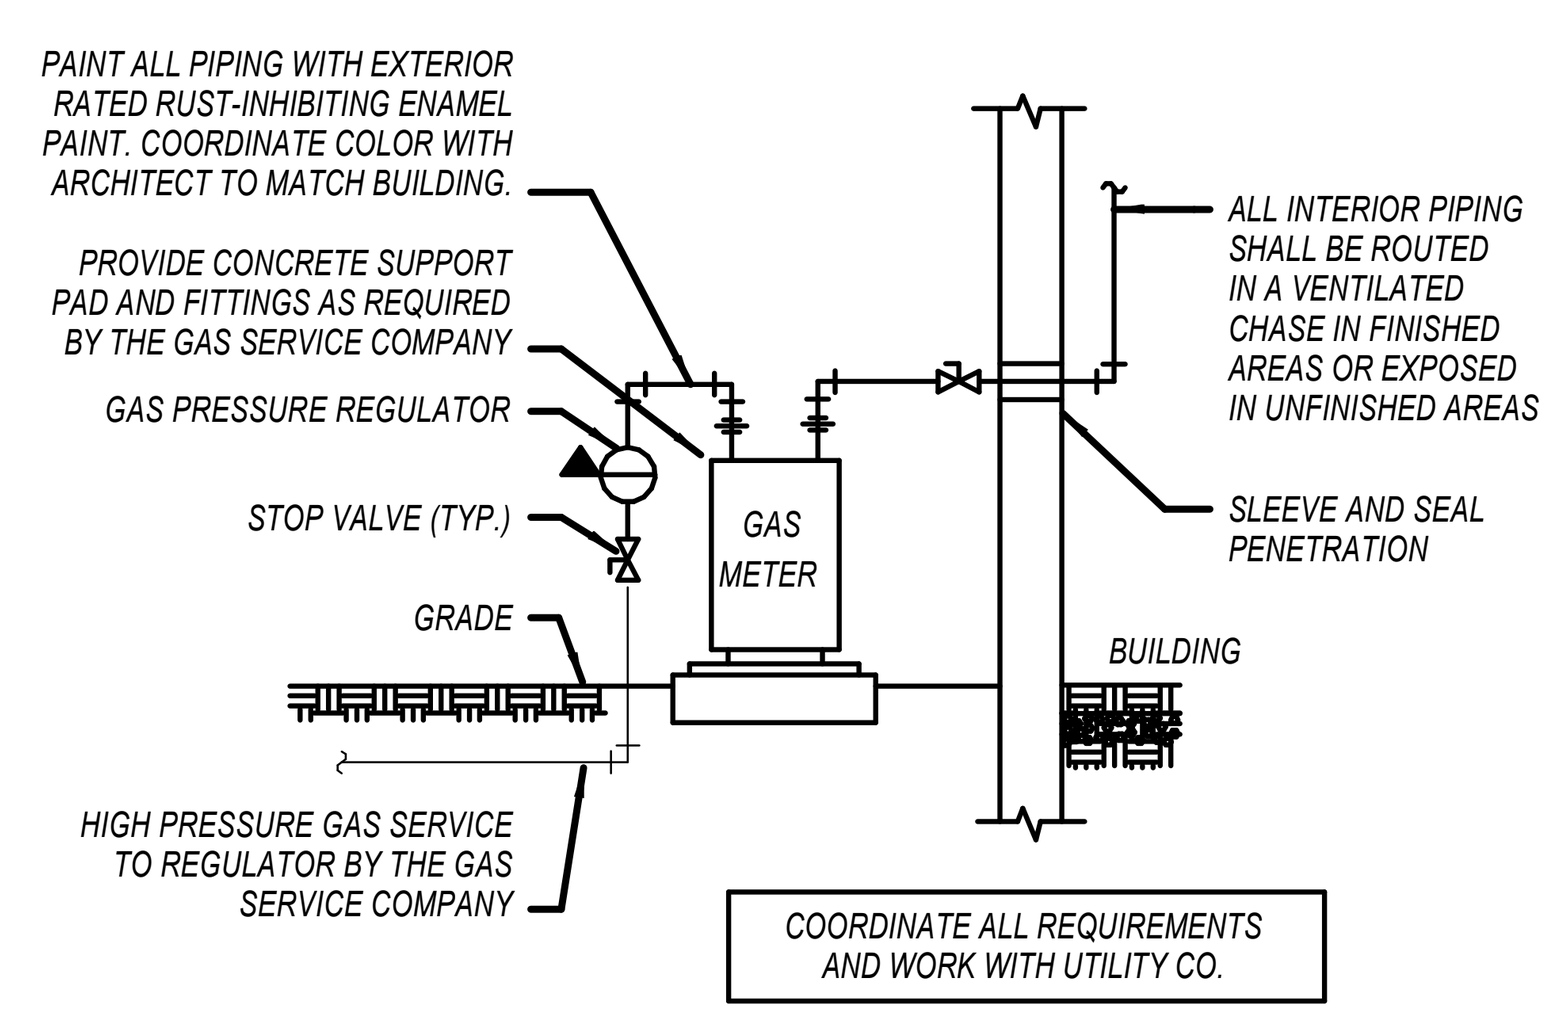

GAS SERVICE DETAIL
NOT TO SCALE 513-02

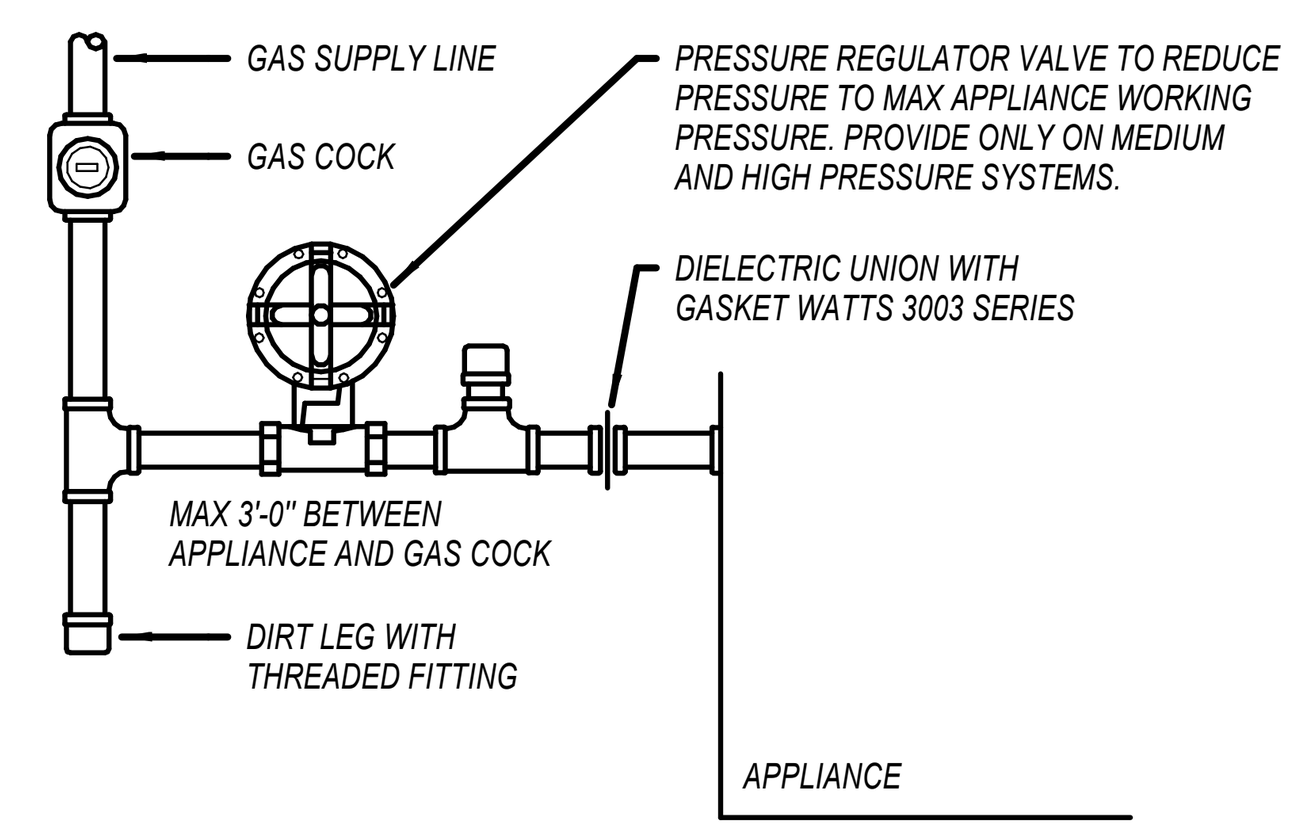

TYPICAL GAS CONNECTION
NOT TO SCALE 528-02

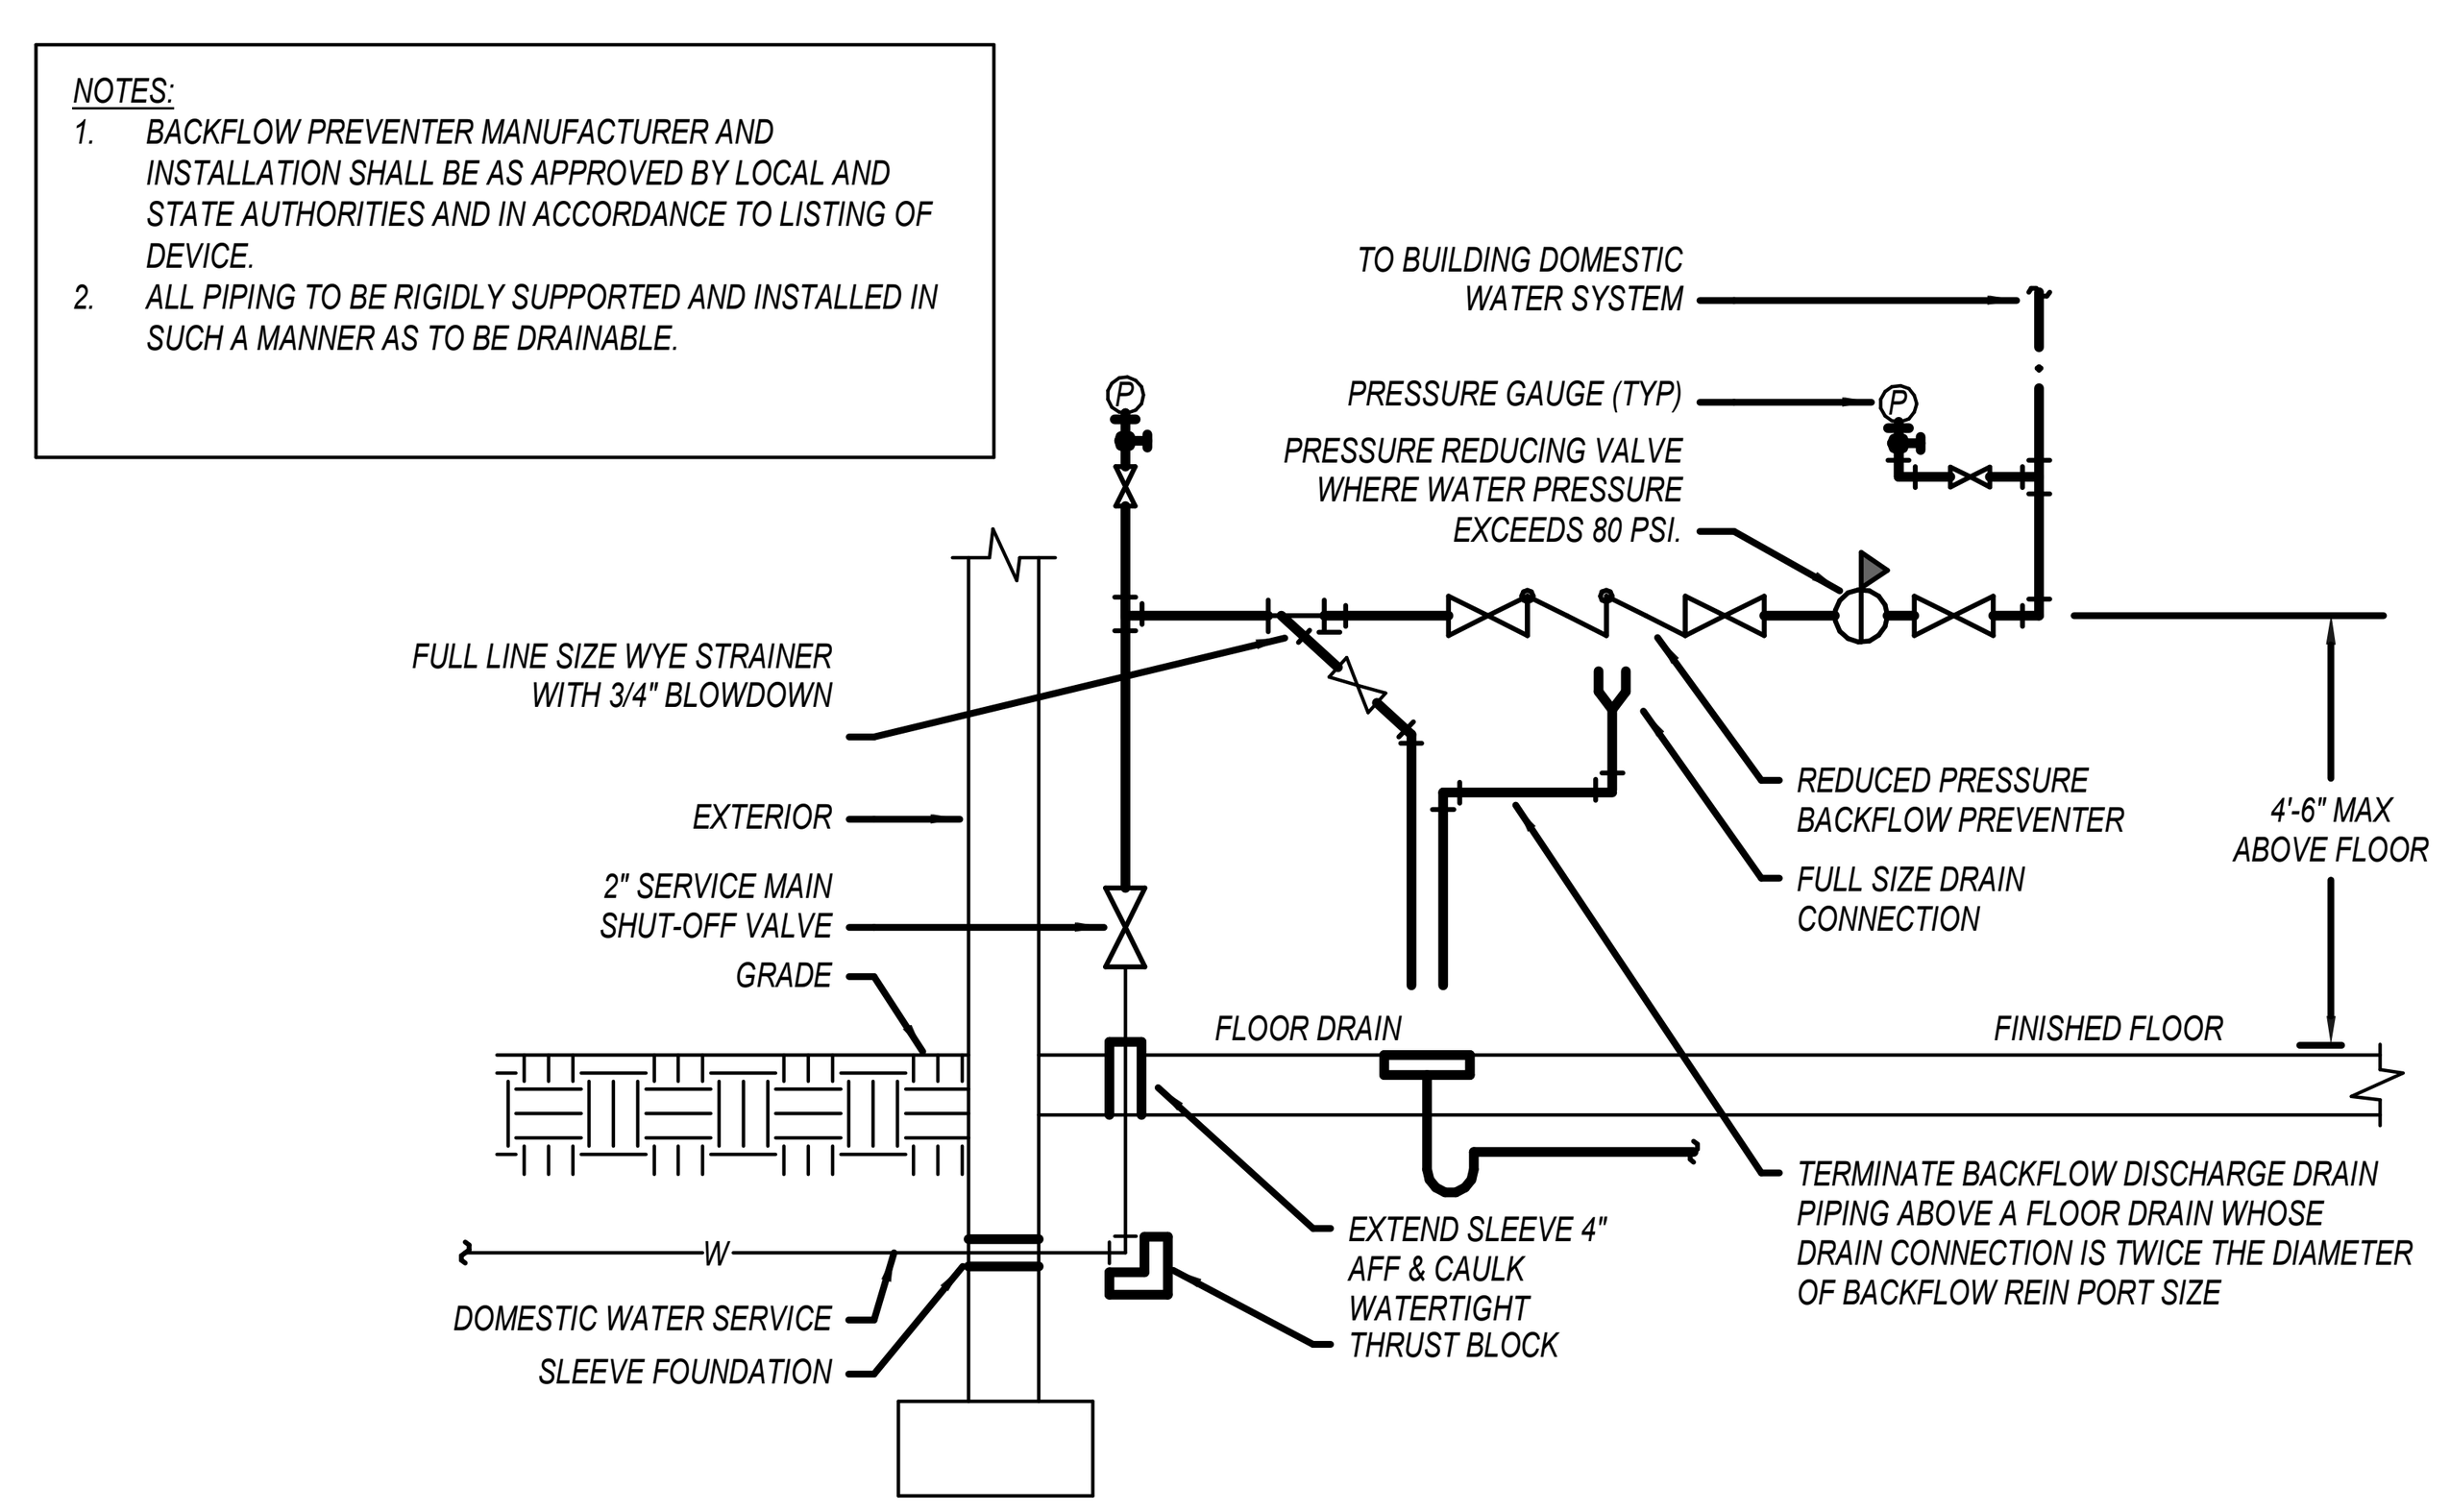

WATER SERVICE
REDUCED PRESSURE BACKFLOW PREVENTER DETAIL
NOT TO SCALE 511-02

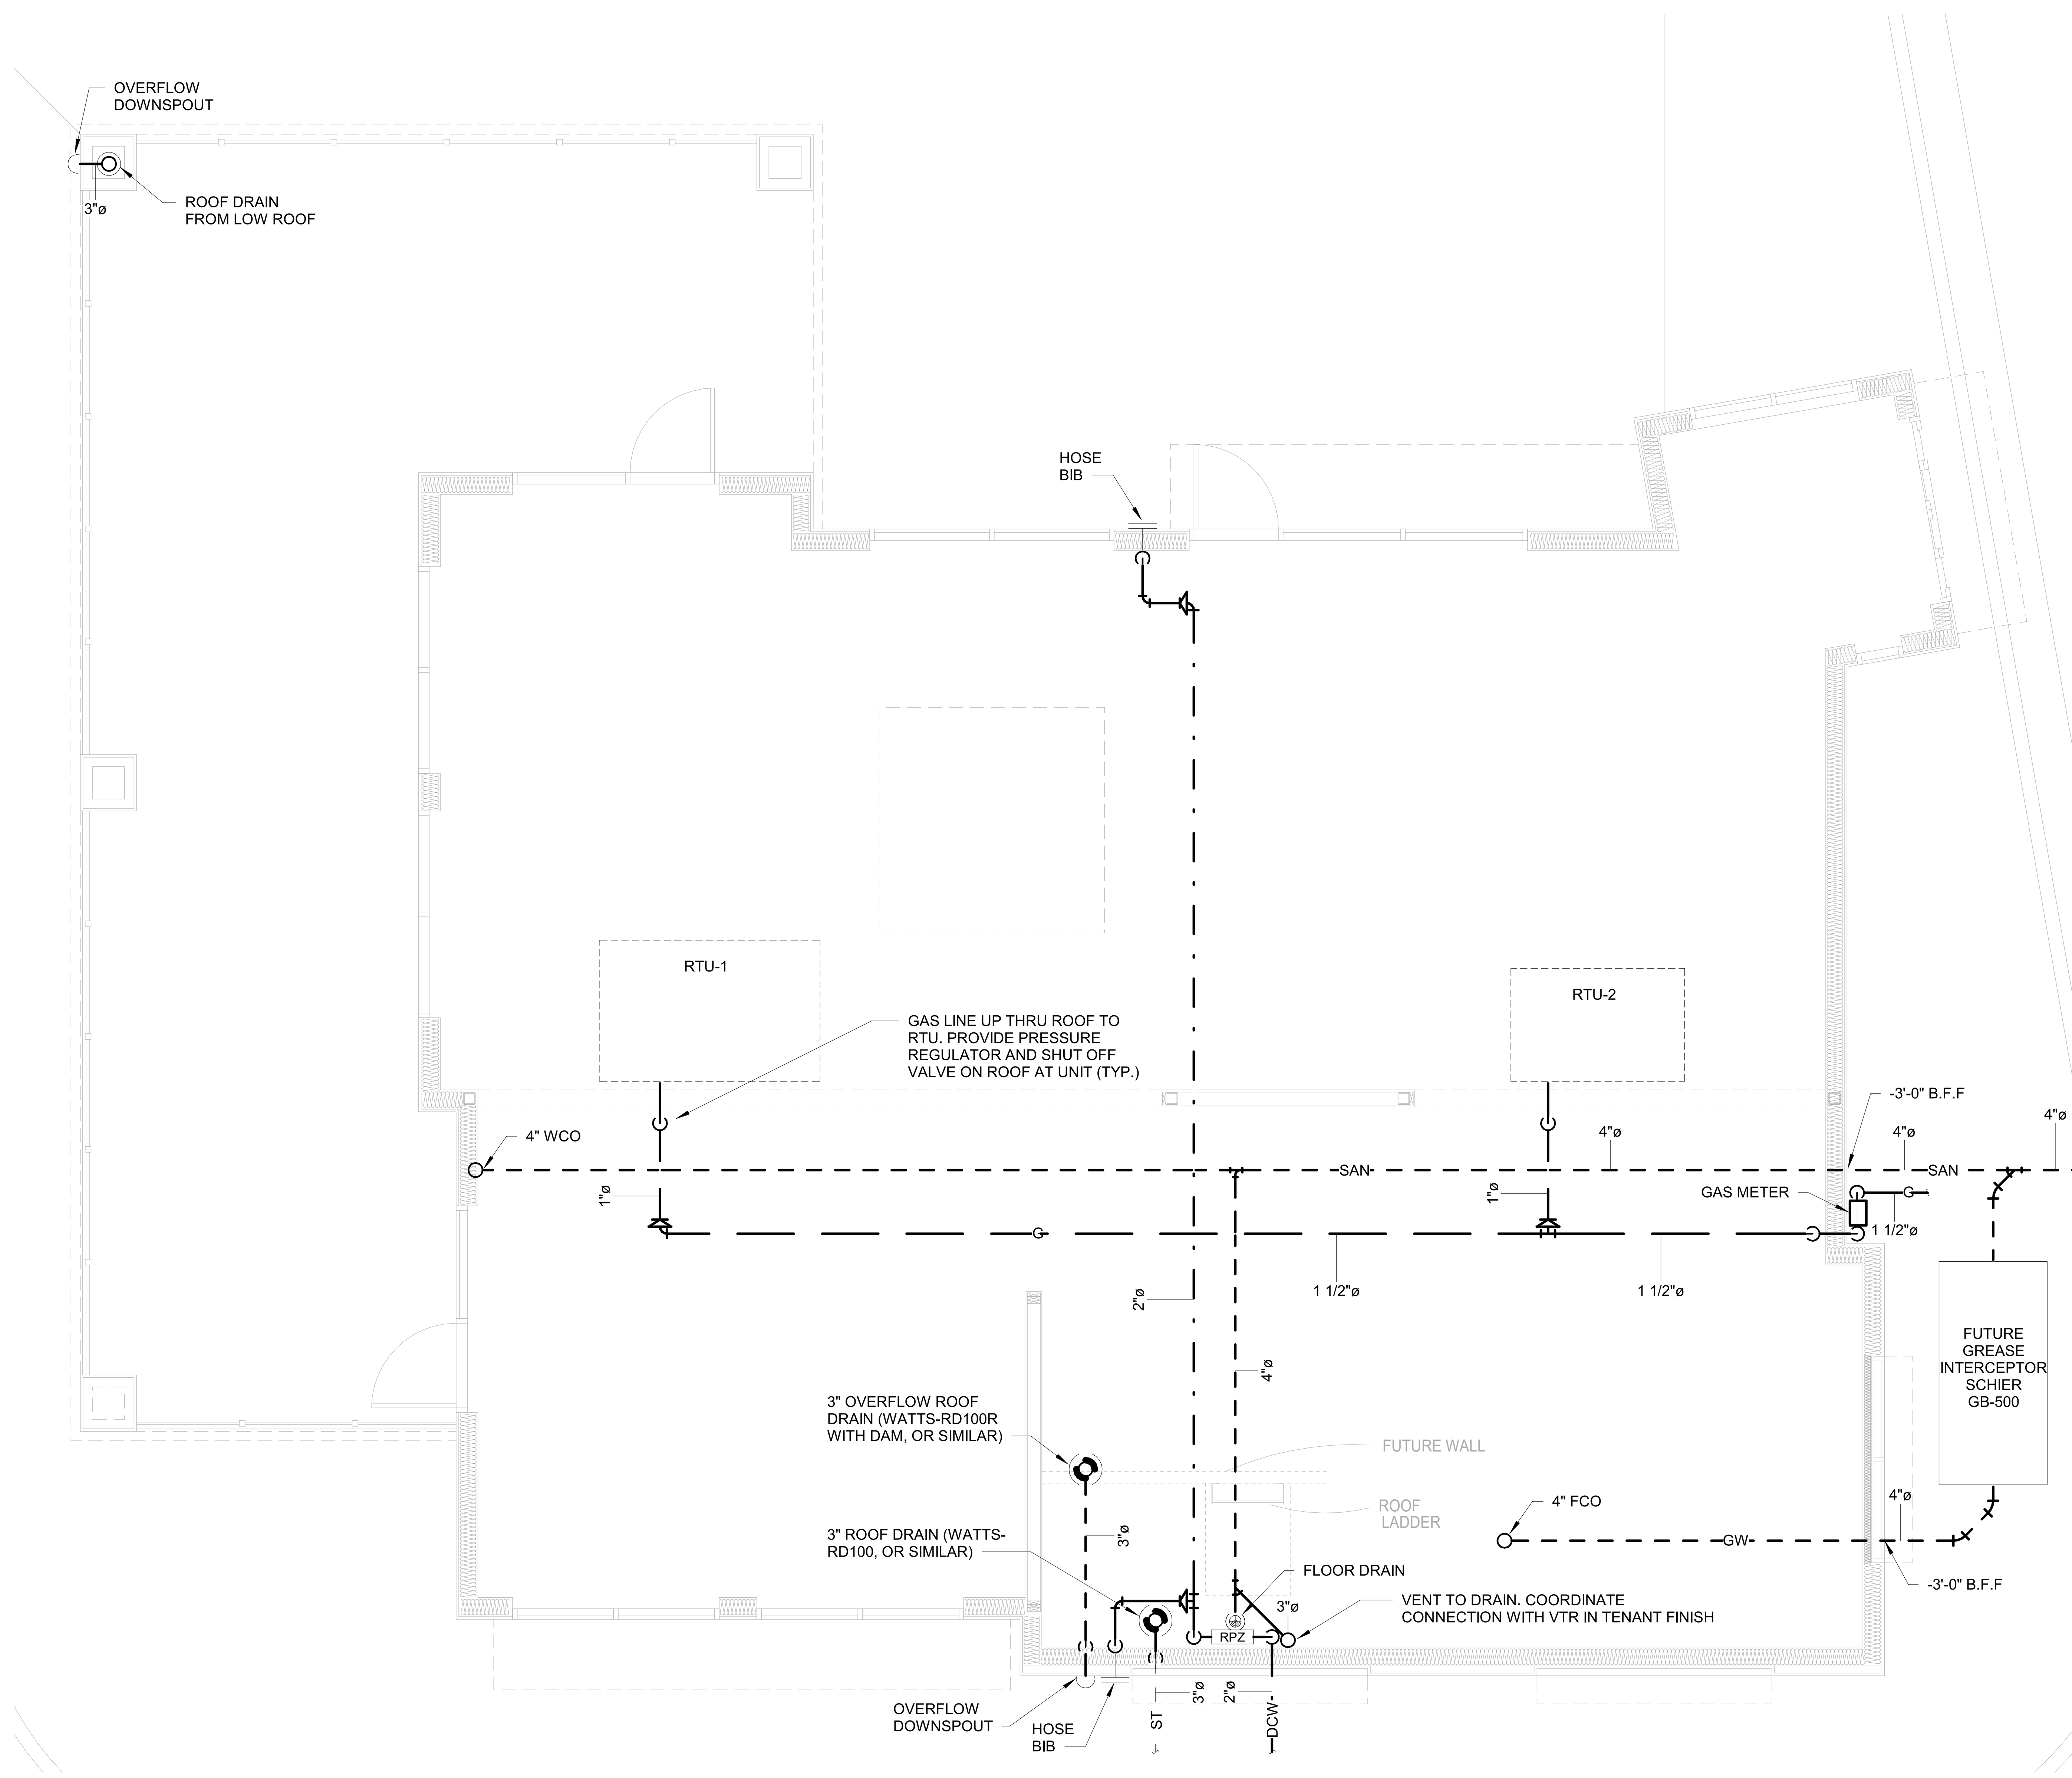

1 PLUMBING PLAN
1/4" = 1'-0"

THOMAS J. ELLIS JR. LICENSED 13520 11/26/2025 KANSAS PROFESSIONAL ENGINEER
11/26/2025

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC
ARCHITECTURE · PLANNING · INTERIOR DESIGN

Mr. D's DONUTS
14485 METCALF AVE.
OVERLAND PARK, KS

ISSUE DATE: 11/26/2025
SHEET NUMBER:
P1
KAI JOB NO. 2506-C

MECHANICAL GENERAL NOTES:
1. DRAWINGS ARE SCHEMATIC IN NATURE AND BASED ON PRELIMINARY SITE OBSERVATION AND ORIGINAL DESIGN DRAWINGS (WHEN AVAILABLE). PRIOR TO BID, CONTRACTOR SHALL INVESTIGATE THE PROJECT SITE AND BECOME FULLY AWARE OF ALL FIELD CONDITIONS, CURRENT SYSTEM OPERATION, AS WELL AS COORDINATION REQUIREMENTS. COORDINATE ALL MECHANICAL WORK WITH ARCHITECTURAL DRAWINGS, EXISTING CONDITIONS, AND OTHER TRADES PRIOR TO BID OR START OF WORK.
2. MECHANICAL WORK SHALL CONFORM TO APPLICABLE CODES AS ADOPTED BY THE LOCAL AUTHORITY HAVING JURISDICTION. REFER TO ARCHITECTURAL CODE PLANS FOR SPECIFIC CODE REFERENCES.
3. COORDINATE MECHANICAL WORK WITH ALL OTHER PROJECT TRADES (E.G. ARCHITECTURAL, STRUCTURAL, ELECTRICAL, PLUMBING, FIRE SPRINKLER, ETC.).
4. COORDINATE WITH ELECTRICAL CONTRACTOR FOR REQUIRED ELECTRICAL POWER WIRING. PROVIDE ALL CONTROL WIRING AND FINAL CONTROL DEVICE (E.G. THERMOSTATS.)
5. FABRICATE AND INSTALL DUCTWORK PER SMACNA RECOMMENDATIONS FOR THE PRESSURE CLASSIFICATIONS ENCOUNTERED.
   A. MEDIUM PRESSURE SUPPLY AIR (UPSTREAM OF VAV TERMINAL UNITS): +6.0 IN.WG.
   B. LOW PRESSURE SUPPLY AIR (DOWNSTREAM OF VAV TERMINAL UNITS): +2.0 IN.WG.
   C. RETURN AIR: -1.0 IN.WG.
   D. EXHAUST AIR (UPSTREAM OF FAN): -2.0 IN.WG.
   E. EXHAUST AIR (DOWNSTREAM OF FAN): +1.0 IN.WG.
6. PROVIDE DUCT WRAP INSULATION FOR ALL ROUND AND RECTANGULAR SUPPLY AIR DUCTWORK. DUCT WRAP INSULATION SHALL BE 2" THICK, MINIMUM R-5.0 FIBERGLASS DUCT WRAP WITH VAPOR BARRIER.
7. CONTRACTOR OPTION: PROVIDE INTERNAL LINER INSULATION FOR ALL RECTANGULAR SUPPLY AIR DUCTWORK. INTERNAL LINER INSULATION SHALL BE 1" THICK, 2 LB/FT^3 ACOUSTICAL DUCT LINER INSULATION WITH MINIMUM R-5.0.
8. PROVIDE INTERNAL LINER INSULATION FOR ALL RECTANGULAR RETURN AIR DUCTWORK. INTERAL LINER INSULATION SHALL BE 1" THICK, 2 LB/FT^3 ACOUSTICAL DUCT LINER INSULATION.
9. DUCT DIMENSIONS SHOWN ON THE PLANS INDICATE THE FREE AREA DIMENSIONS. INCREASE SHEET METAL DIMENSIONS AS REQUIRED TO MEET FREE AREA DIMENSIONS WITH LINER INSTALLED.
10. FLEXIBLE DUCTWORK SHALL HAVE 2" THICK, MINIMUM R-5.0 INSULATION. FLEXIBLE DUCTWORK SHALL NOT EXCEED 5'-0" IN LENGTH FOR SUPPLY AIR APPLICATIONS AND 3'-0" IN LENGTH FOR RETURN AIR AND EXHAUST AIR APPLICATIONS.
11. PROVIDE BALANCING DAMPERS IN DUCT TAKE-OFFS TO AIR DEVICES IN LAY-IN CEILINGS, IN THE NECKS OF AIR DEVICES IN GYP BOARD CEILINGS, AND IN THE NECKS OF SIDE WALL AIR DEVICES FOR PROPER AIR BALANCING.
12. TOILET ROOM EXHAUST FANS SHALL BE AS SCHEDULED. PROVIDE A MINIMUM OF 75 CFM EXHAUST PER FLUSH FIXTURE.
13. COORDINATE ALL REQUIRED ROOF PENETRATIONS WITH ROOFING CONTRACTOR TO AVOID ROOF WARRANTY CONFLICTS.
14. VERIFY AVAILABLE SPACE ABOVE ALL CEILINGS PRIOR TO FABRICATION OR INSTALLATION OF ANY DUCTWORK. COORDINATE DUCT INSTALLATION WITH OTHER TRADES.
15. ALL DIMENSIONS SHOWN IN PLAN ARE IN INCHES, UNLESS EXPLICITLY LABELED OTHERWISE.
16. PROVIDE ACCESS PANELS AND ADEQUATE CLEARANCE FOR ACCESS OF ALL EQUIPMENT, VALVES, DAMPERS, AND DEVICES.
17. MECHANICAL CONTRACTOR SHALL INSPECT ALL MECHANICAL EQUIPMENT TO REMAIN. REPORT ANY DEFICIENCIES TO OWNER PRIOR TO START OF WORK.

ROOFTOP UNIT SCHEDULE

TAG	DESCRIPTION	MANUFACTURER /MODEL	NOMINAL TONNAGE	SA CFM	OA CFM	GAS HEAT CAPACITY	V/PH/HZ	MCA/MOCP	WEIGHT(#)	REMARKS
RTU-1	GAS FIRED DX RTU	CARRIER/48FCE N08	7.5	2700	500	120 MBH	208/3/60	39/50	800	1,2,3,4
RTU-2	GAS FIRED DX RTU	CARRIER/48FCE N04	3	1100	200	82 MBH	208/3/60	25/30	500	1,3,4

REMARKS:
1. PROVIDE UNIT WITH TWO-STAGE COOLING.
2. PROVIDE WITH TWO-STAGE HEATING.
3. PROVIDE WITH 7-DAY PROGRAMMABLE THERMOSTAT.
4. PROVIDE WITH RETURN AIR DUCT DETECTOR.

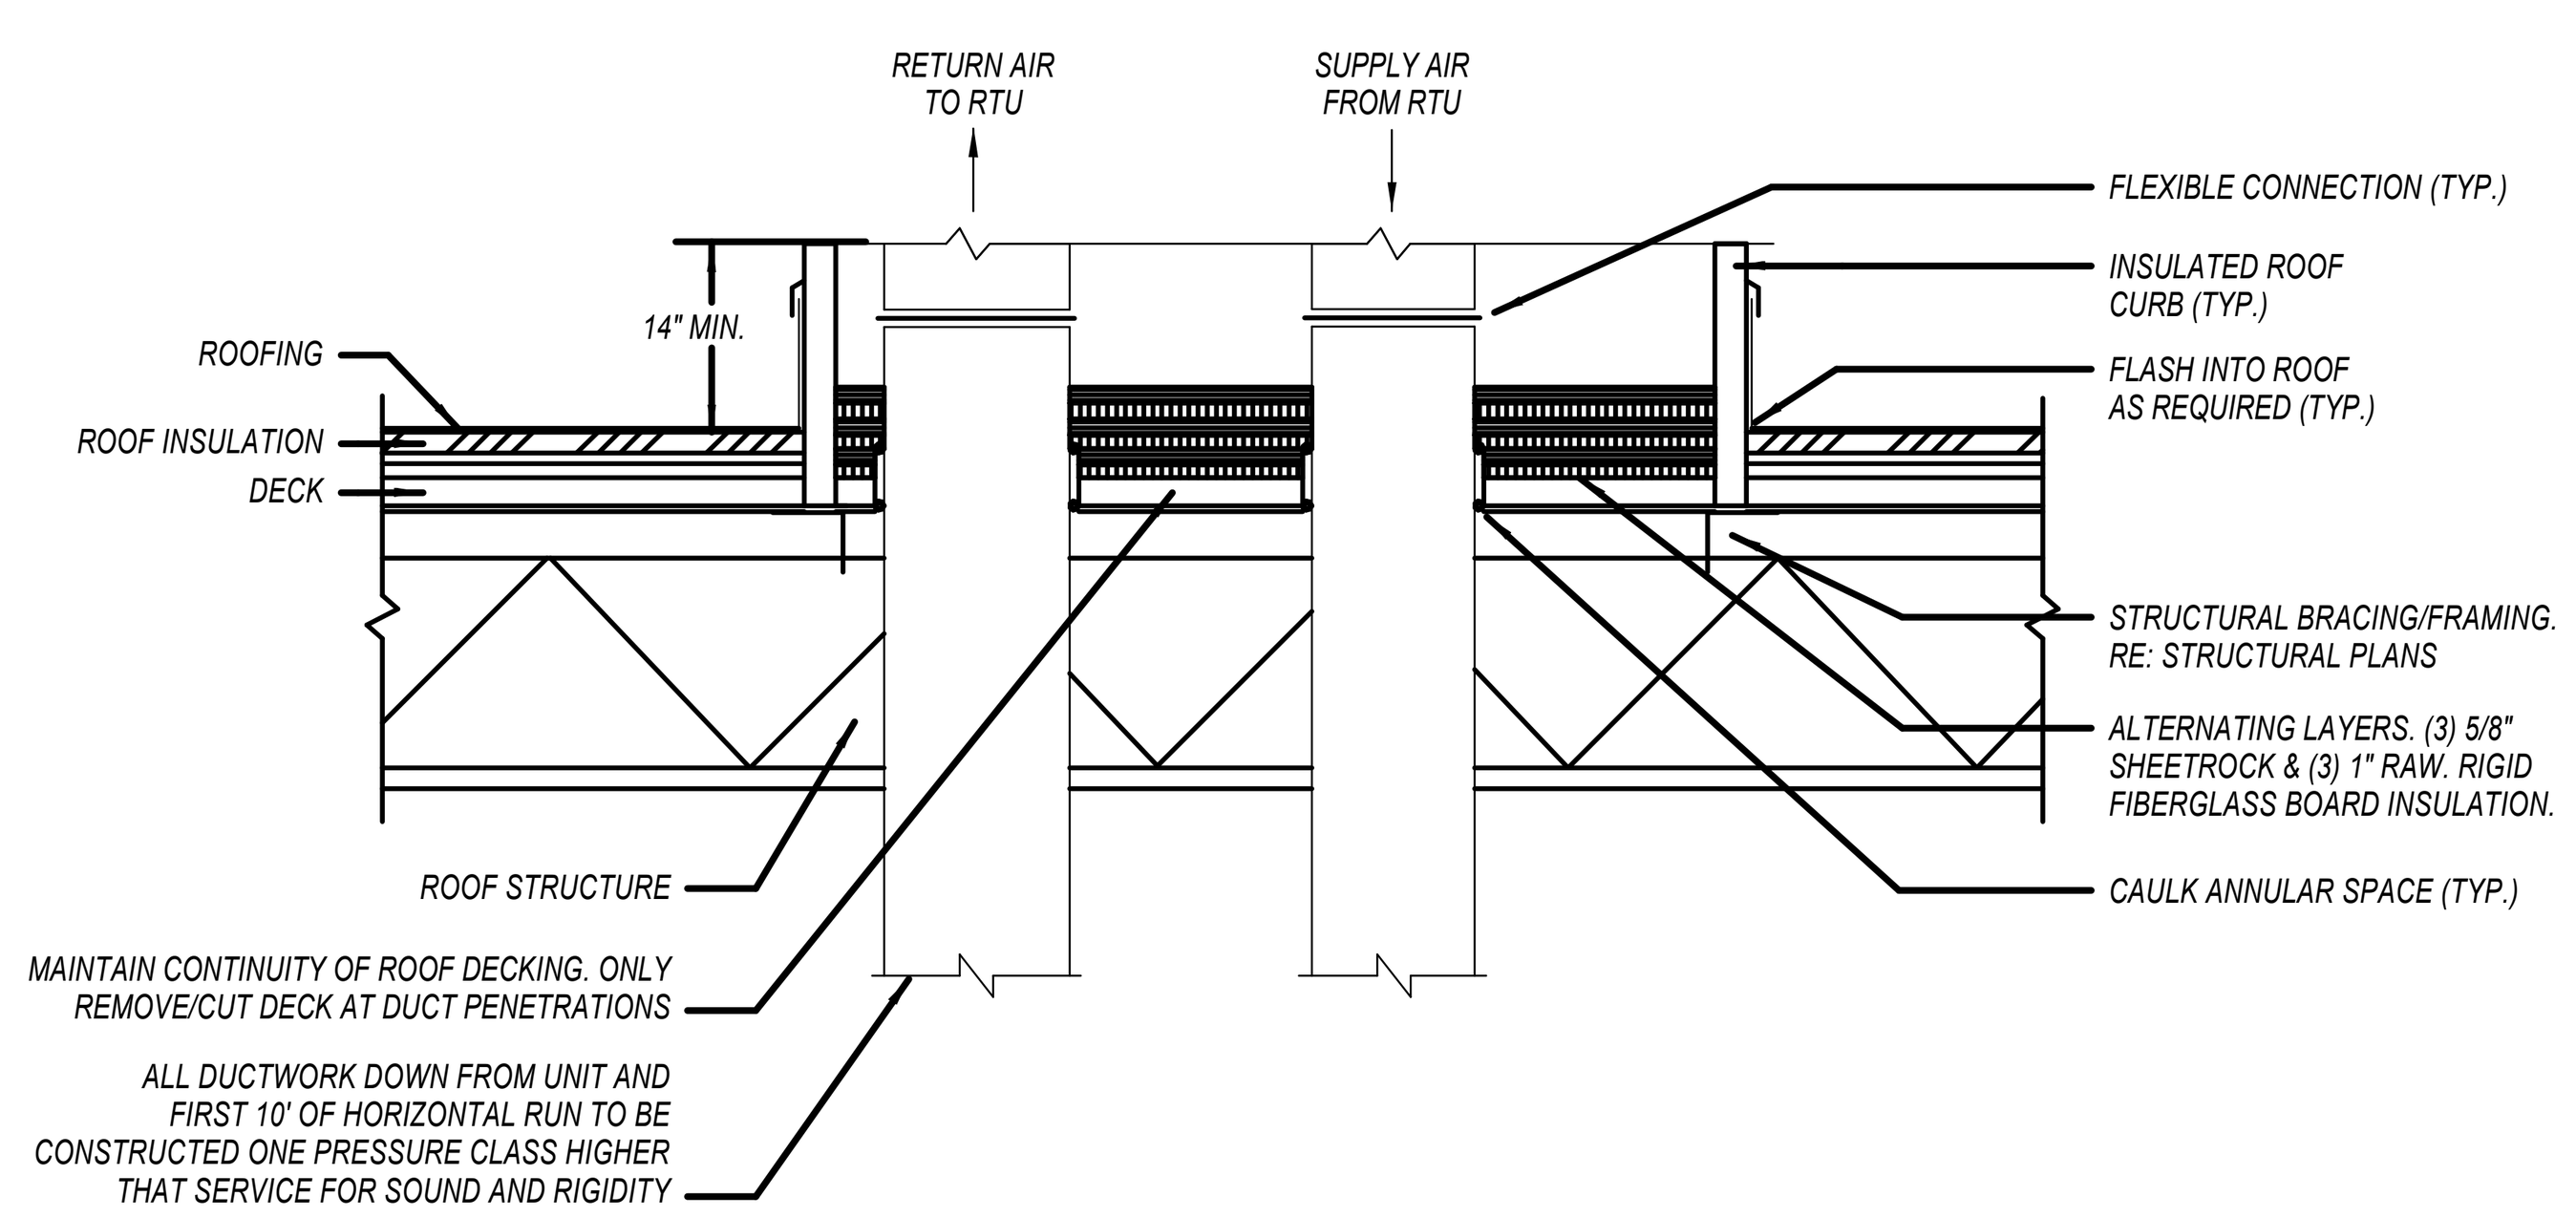

ROOFTOP UNIT CURB DETAIL

NOT TO SCALE 561-01

1 MECHANICAL PLAN
1/4" = 1'-0"

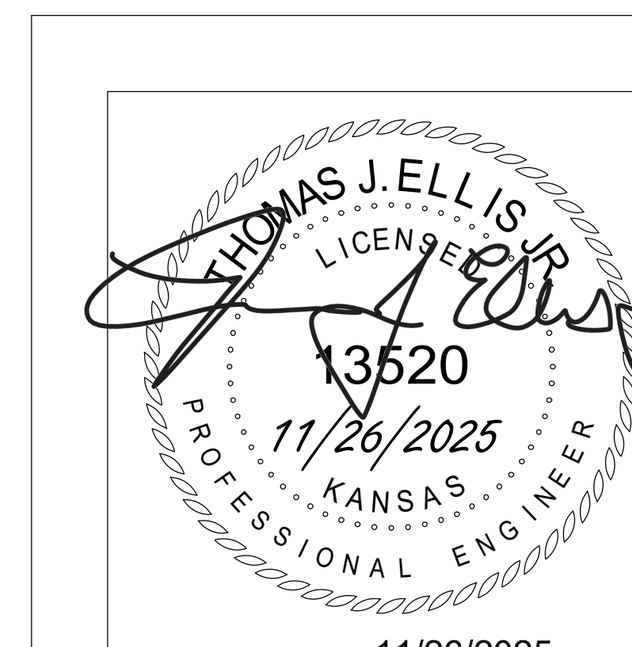

11/26/2025

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC

ARCHITECTURE · PLANNING · INTERIOR DESIGN

Mr. D's DONUTS

14485 METCALF AVE.
OVERLAND PARK, KS

ISSUE DATE: 11/26/2025

SHEET NUMBER:

M1

KAI JOB NO. 2506-C

LINETYPES LEGEND:

- NEW
- EXISTING OR BY OTHERS
- DEMOLITION

LIGHTING & CONTROLS LEGEND:

- CEILING MOUNTED LIGHT FIXTURE, 2'x2' OR 2'x4'
- CEILING MOUNTED LIGHT FIXTURE, 2'x2' OR 2'x4' (NIGHT LIGHT OR EMERGENCY CIRCUIT)
- STRIP LIGHT FIXTURE. REFER TO FIXTURE SCHEDULE FOR LENGTH.
- WALL-MOUNT SCONCE OR WALL BRACKET LIGHT FIXTURE.
- RECESSED WALL WASH CAN LIGHT FIXTURE.
- RECESSED, SURFACE, OR STEM HUNG LIGHT FIXTURE.
- SINGLE FACE EXIT LIGHT FIXTURE, WALL OR CEILING MOUNT, WITH FIELD CONFIGURABLE ARROWS. PROVIDE DIRECTIONAL ARROWS AS INDICATED ON DRAWINGS. SHADED AREA INDICATES EXIT LIGHT FACE.
- DOUBLE FACE EXIT LIGHT FIXTURE, WALL OR CEILING MOUNT, WITH FIELD CONFIGURABLE ARROWS. PROVIDE DIRECTIONAL ARROWS AS INDICATED ON DRAWINGS. SHADED AREA INDICATES EXIT LIGHT FACE.
- COMBINATION SINGLE FACE EXIT/EMERGENCY LIGHT FIXTURE, WALL OR CEILING MOUNT, WITH FIELD CONFIGURABLE ARROWS. PROVIDE DIRECTIONAL ARROWS AS INDICATED ON DRAWINGS. SHADED AREA INDICATES EXIT LIGHT FACE.

NOTE: REFER TO LIGHT FIXTURE SCHEDULE AND ARCHITECTURAL DRAWINGS FOR ADDITIONAL INFORMATION AND MOUNTING HEIGHTS.

EXIT AND EMERGENCY LIGHTS SHALL BE CONNECTED TO UNSWITCHED LIGHTING CIRCUIT THAT SERVES AREA THAT EXIT/EMERGENCY LIGHT IS LOCATED.

- $ SINGLE POLE WALL MOUNT TOGGLE SWITCH. MOUNT AT +48"AFF TO CENTER OF SWITCH.
- $ WALL MOUNTED OCCUPANCY SENSOR SWITCH. MOUNT AT +48"AFF TO CENTER OF SWITCH.
- $ WALL MOUNTED OCCUPANCY SENSOR SWITCH WITH 0-10V DIMMING CONTROL. MOUNT AT +48"AFF TO CENTER OF SWITCH.
- $ WALL MOUNTED LOW VOLTAGE SWITCH WITH 0-10V DIMMING CONTROL. MOUNT AT +48"AFF TO CENTER OF SWITCH.
- DS OS OS CEILING MOUNTED OCCUPANCY OR DAYLIGHT SENSORS.
- RCX RCX D ROOM CONTROLLER/POWER PACK FOR LIGHT FIXTURE CONTROL. 'X' INDICATES ZONES, 'D' INDICATES DIMMING.

REFER TO LIGHTING CONTROLS SCHEDULE FOR LIGHTING CONTROLS DEVICE INFORMATION.

POWER LEGEND:

- LINE INDICATES DEVICE ABOVE COUNTER (TYP).
- DUPLEX RECEPTACLE MOUNTED AT +18"AFF TO CENTER OF RECEPTACLE (UNO). ABOVE COUNTER RECEPTACLES SHALL BE +6" COUNTERTOP (UNO). REFER TO ARCHITECTURAL ELEVATIONS FOR MORE INFO.
- DUPLEX ISOLATED-GROUND RECEPTACLE MOUNTED AT +18"AFF TO CENTER OF RECEPTACLE (UNO). ABOVE COUNTER RECEPTACLES SHALL BE +6" COUNTERTOP (UNO). REFER TO ARCHITECTURAL ELEVATIONS FOR MORE INFO.
- DUPLEX RECEPTACLE ON GENERATOR POWER, MOUNTED AT +18"AFF TO CENTER OF RECEPTACLE (UNO). ABOVE COUNTER RECEPTACLES SHALL BE +6" COUNTERTOP (UNO). REFER TO ARCHITECTURAL ELEVATIONS FOR MORE INFO.
- FLOOR-MOUNTED DUPLEX OR FOURPLEX RECEPTACLE MOUNTED IN PVC FLOORBOX, OR POKE-THRU
- SPECIAL RECEPTACLE, NUMBER REFERS TO "NEMA" CONFIGURATION. MOUNT AT +18"AFF TO CENTER OF RECEPTACLE (UNO). SHADE INDICATES ON GENERATOR.
- FOURPLEX RECEPTACLE MOUNTED AT +18"AFF TO CENTER OF RECEPTACLE (UNO). RECEPTACLES SHOWN TO BE ABOVE COUNTER SHALL BE +48"AFF (UNO)
- FLUSH MOUNT COMBINATION POWER AND VOICE/DATA FLOORBOX.
- VOICE OPENING. PROVIDE 3/4" EMT CONDUIT STUB TO ABOVE CEILING FOR FUTURE CABLING. DEVICES SHOWN TO BE COUNTER SHALL BE +48"AFF (UNO).
- DATA OPENING. PROVIDE 3/4" EMT CONDUIT STUB TO ABOVE CEILING FOR FUTURE CABLING. DEVICES SHOWN TO BE COUNTER SHALL BE +48"AFF (UNO).
- COMBO VOICE/DATA OPENING. PROVIDE 3/4" EMT CONDUIT STUB TO ABOVE CEILING FOR FUTURE CABLING. DEVICES SHOWN TO BE COUNTER SHALL BE +48"AFF (UNO).
- FLUSH FLOOR MOUNT VOICE/DATA OUTLET MOUNTED IN PVC FLOORBOX.
- DISCONNECT SWITCH, STARTER, & COMBINATION STARTER/DISCONNECT SWITCH. SIZE AS INDICATED ON DRAWINGS.
- ELECTRICAL PANEL BOARD, FLUSH OR SURFACE MOUNT
- J JUNCTION BOX
- EMERGENCY POWER OFF 'EPO' PUSH-BUTTON STI MODEL NUMBER #SS2249PO-EN OR EQUAL FLUSH OR SURFACE MOUNT.

NOTE: LINE THROUGH DEVICE INDICATES TO BE MOUNTED ABOVE COUNTERTOP OR CABINET. REFER TO ARCHITECTURAL ELEVATIONS FOR MOUNTING HEIGHTS IF NOT INDICATED ON POWER PLAN.

REFER TO LIGHTING CONTROL DEVICE SCHEDULE AND ARCHITECTURAL DRAWINGS FOR FURTHER INFORMATION.

ABBREVIATIONS LEGEND:

AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
ED	EXISTING TO BE DEMOLISHED
EM	EMERGENCY
ER	EXISTING TO BE RELOCATED
ETR	EXISTING TO REMAIN
EWC	ELECTRIC WATER COOLER
GFCI	GROUND FAULT CURRENT INTERRUPTER
NL	NIGHT LIGHT
TR	TAMPER RESISTANT
UNO	UNLESS NOTED OTHERWISE
USB	RECEPTACLE TO HAVE (2) USB CHARGING PORTS
WP/GFI	WEATHER PROTECTED 'IN-USE' COVER / GFCI

WIRING LEGEND:

- HOMERUN TO PANELBOARD WITH NUMBER AND SIZE OF CONDUCTORS INDICATED ON PLANS. WHEN NO WIRING TICK MARKS ARE SHOWN, CONTRACTOR SHALL ASSUME MINIMUM OF (3) #12 CONDUCTORS.
- LIGHTING CONTROLS CATEGORY CABLE PER MANUFACTURERS RECOMENDATIONS.
- GROUNDED CONDUCTOR.
- CONDUIT OR CIRCUIT BREAK/CONTINUATION.
- CONDUIT WITH ENDCAP FOR FUTURE USE.
- GROUNDING SOURCE.
- CONNECT TO EXISTING

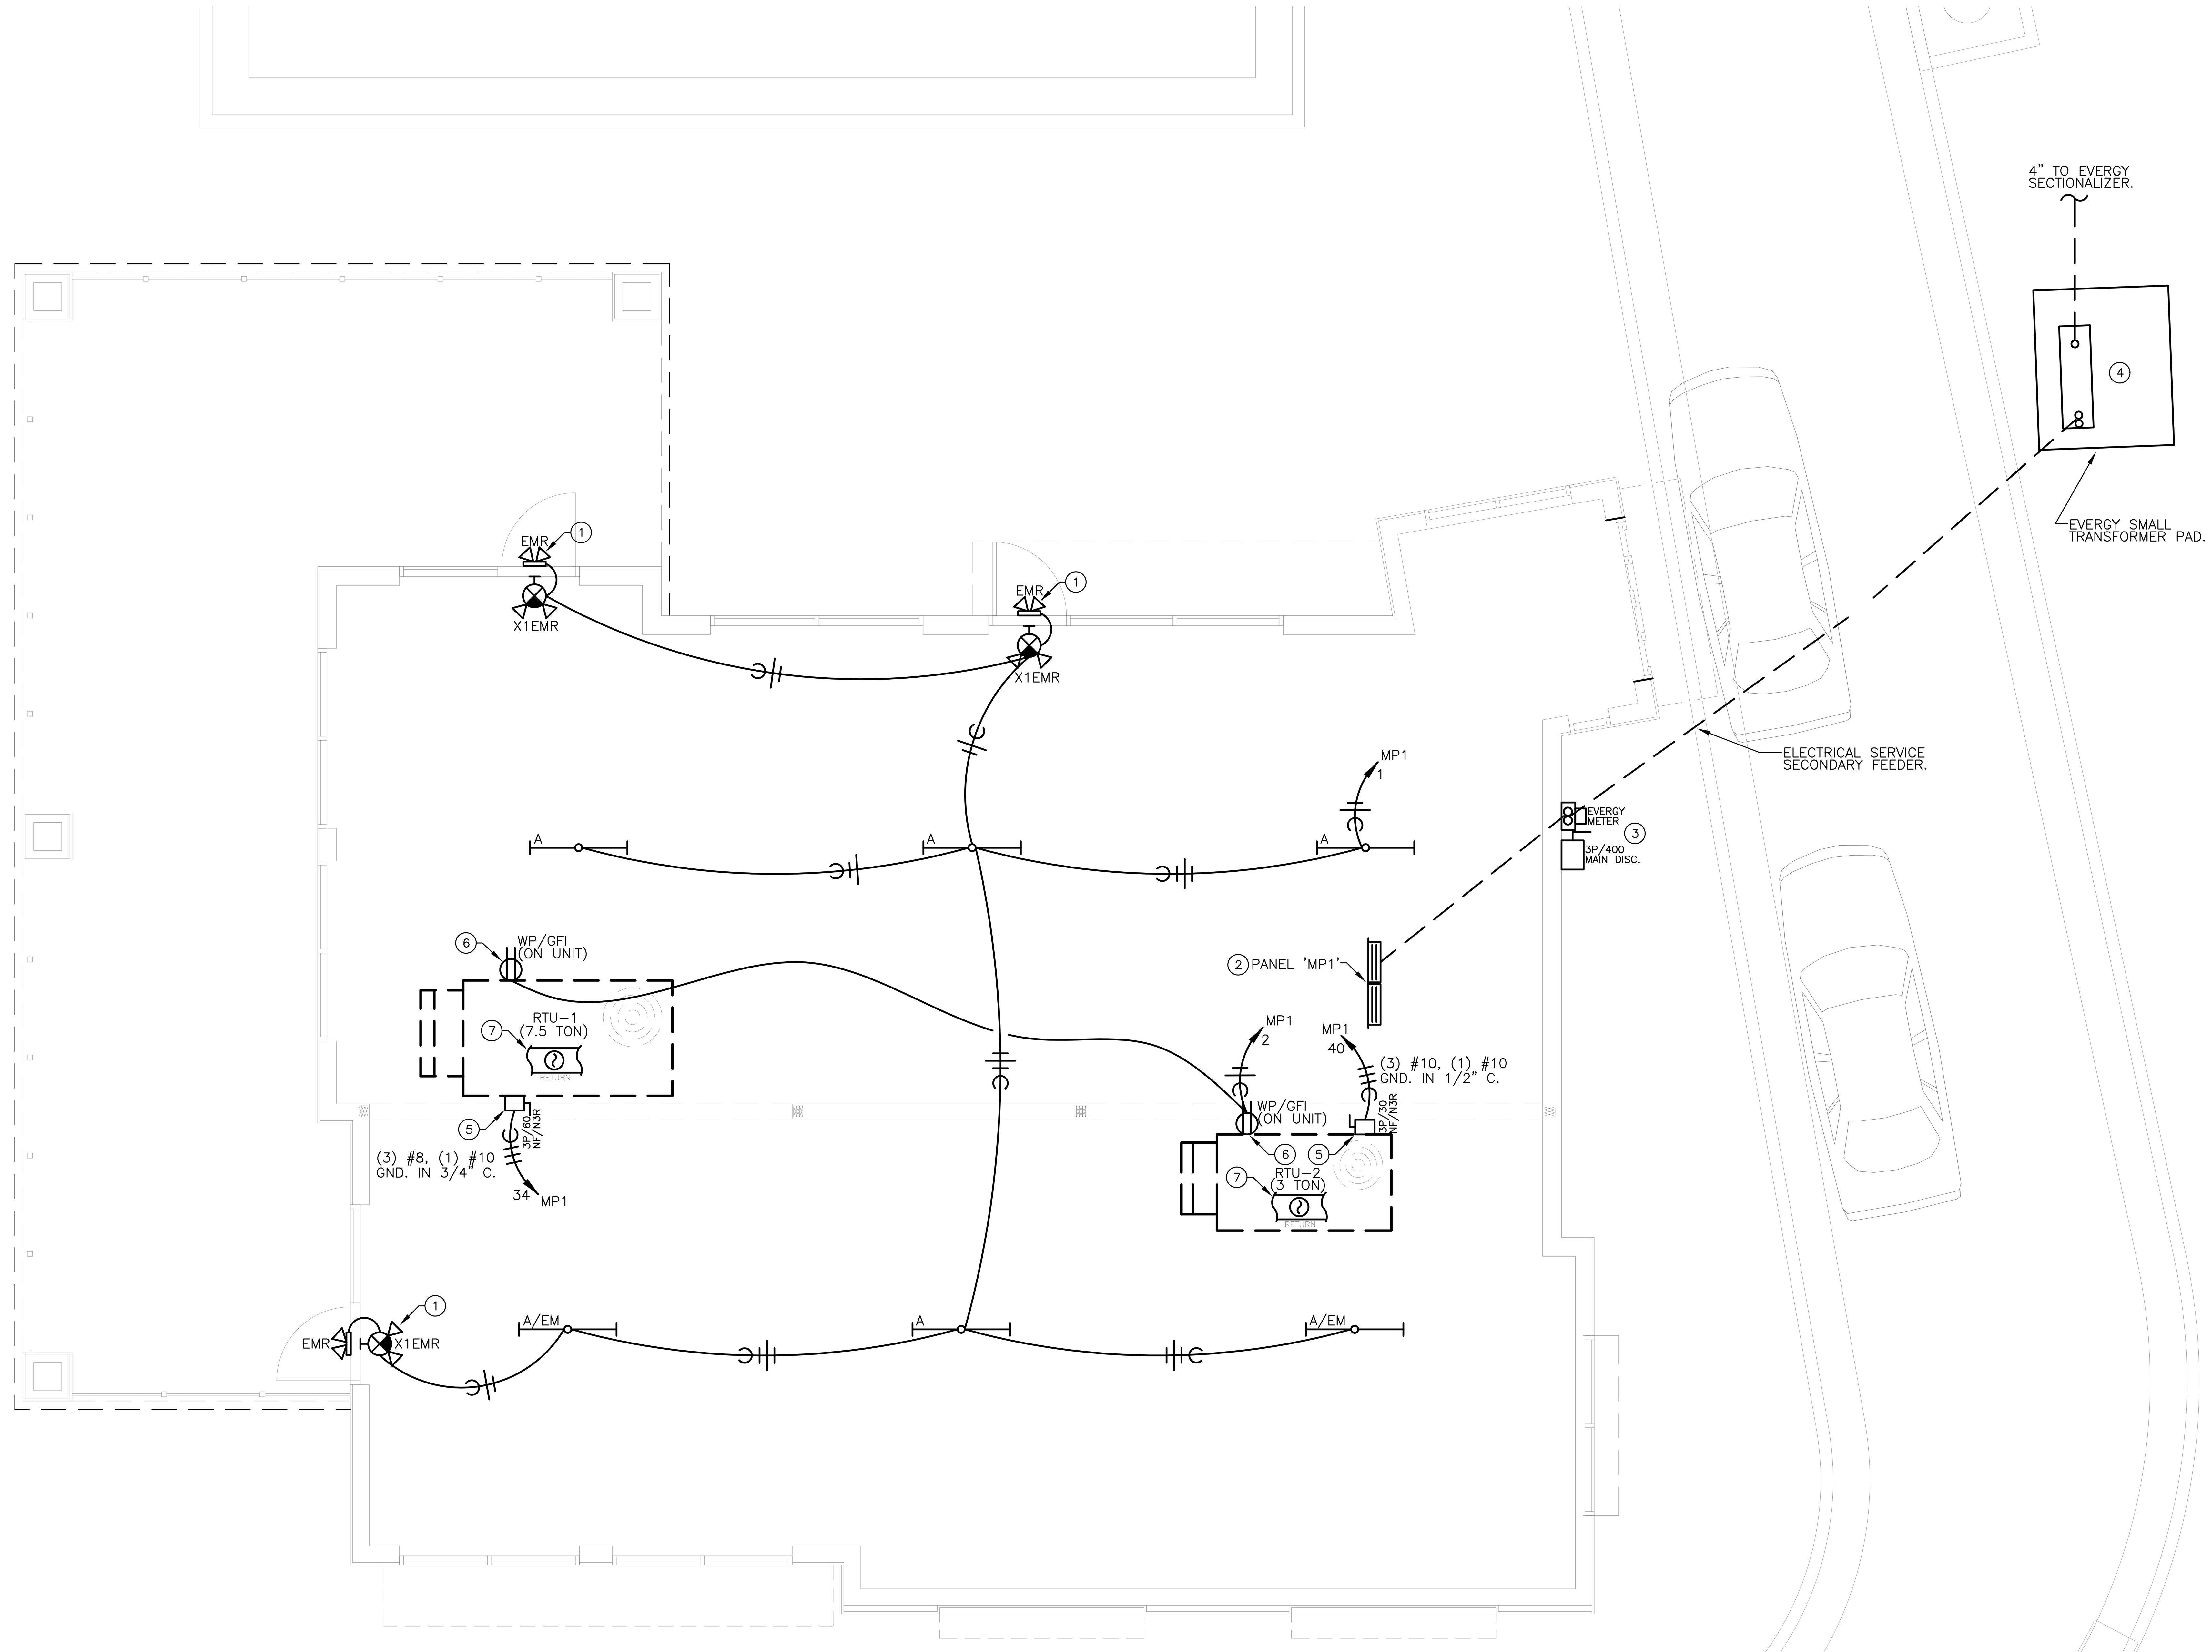

1 FLOOR PLAN – ELECTRICAL
SCALE: 1/4" = 1'-0"

ELECTRICAL PLAN NOTES:

1. EXTERIOR EMERGENCY LIGHT AND INTERIOR EXIT/EMERGENCY FIXTURE SHALL BE PROVIDED TO MEET EGRESS LIGHTING REQUIREMENTS. COORDINATE LOCATION OF FIXTURES WITH ARCHITECT PRIOR TO INSTALLATION.
2. NEW PANEL 'MP1' SHALL BE LOCATED TO WORK WITH FUTURE KITCHEN LAYOUT. COORDINATE FINAL LOCATION WITH ARCHITECT AND TENANT FINISH DRAWINGS PRIOR TO ROUGH-IN.
3. ELECTRICAL SERVICE MAIN DISCONNECT SWITCH SHALL BE LOCATED ON EXTERIOR OF BUILDING.
4. NEW EVERGY TRANSFORMER AND CONCRETE PAD. PAD SHALL BE PROVIDED BY CONTRACTOR. COORDINATE LOCATION WITH EVERGY PLANNER, ARCHITECT AND SITE UTILITIES PLAN.
5. FURNISH AND INSTALL UNIT MOUNTED NEMA '3R' DISCONNECT SWITCH FOR ROOF-TOP UNIT (RTU). CONFIRM FINAL LOCATION OF RTU WITH MECHANICAL CONTRACTOR.
6. PROVIDE 120V ELECTRICAL CONNECTION TO INTEGRAL WP/GFI RECEPTACLE PROVIDED WITH RTU.
7. RETURN AIR SMOKE DETECTOR FURNISHED WITH ROOF TOP UNIT. PROVIDE 120V CONNECTION OFF OF RECEPTACLE CIRCUIT AS REQUIRED, AND LEAVE TEST RESET BUTTON IN ACCESSIBLE LOCATION FOR FINAL INSTALL UNDER FUTURE TENANT FINISH.

THOMAS J. ELLIS JR.
LICENSED
13520
11/26/2025
KANSAS
PROFESSIONAL ENGINEER
THOMAS J. ELLIS JR.
KS PE LICENSE #13520

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC

AR·HITE·TURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center

Mr. D's DONUTS

14485 METCALF AVE.
OVERLAND PARK, KANSAS

DATE	NOV. 26, 2025
REVISED	
SHEET NUMBER	E1.0
OF SHEETS	
KAI JOB NO. 2506-C	

LIGHT FIXTURE SCHEDULE										
TYPE	MANUFACTURER	MODEL	LIGHT SOURCE	WATTS	VOLTAGE	COLOR TEMP	DIMMABLE	FINISH	DESCRIPTION	NOTES
A	ACUITY LITHONIA (OR EQUAL)	CSS-L48-4000LM-MVOLT-40K-80CRI	INTEGRAL LED	40	UNV	4000	0-10V / 10%	ARCHITECT TO CONFIRM	LED STRIP FIXTURE CABLE MOUNTED, FIELD TUNABLE LUMEN OUTPUT. 4000K. 'EM' FIXTURE SHALL BE PROVIDED WITH INTEGRAL EMERGENCY 90 MINUTE BATTERY PACK	1-4
X1EMR	LITHONIA QUANTUM SERIES (OR EQUAL)	LHQM-LED-R-HO-M6	INTEGRAL LED	3.8	UNV	NA	NA	WHITE	COMBINATION EMERGENCY EGRESS /SINGLE FACE LED EXIT LIGHT FIXTURE WITH BATTERY PACK, RED LETTERS AND FIELD CONFIGURED ARROWS.	1-4
EMR	LITHONIA QUANTUM SERIES (OR EQUAL)	ERE-GY-SGL-WP-RD	INTEGRAL LED	6	-	NA	NA	WHITE	SINGLE LED REMOTE HEAD HEAD EMERGENCY EGRESS FIXTURE MOUNTED ABOVE EXTERIOR EGRESS DOOR, AND POWER OFF OF HIGH-OUTPUT BATTERY IN ADJACENT COMBINATION EXIT/EMERGENCY LIGHT.	1-4

NOTES:
1. COORDINATE ALL LIGHT FIXTURE SELECTIONS AND/OR SUBSTITUTIONS WITH ARCHITECT, OWNER AND/OR ENGINEER PRIOR TO ORDER.
2. PROVIDE LIGHTING CONTROLS THAT ARE COMPATIBLE WITH FIXTURES PROVIDED.
3. COORDINATE WITH ARCHITECT, OWNER AND/OR ENGINEER FOR DIMMING REQUIREMENTS PRIOR TO INSTALLATION.
4. PROVIDE ALL COMPONENTS AND ACCESSORIES AS REQUIRED FOR A COMPLETE AND OPERABLE INSTALLATION.

PANELBOARD MP1

BUS AMPS:	400A	LOCATION:	KITCHEN AREA	GROUND BUS:	YES
MAIN SIZE / TYPE:	MLO	NEMA RATING:	NEMA 1	ISOL. GROUND BUS:	NO
VOLTS/PHASE:	208Y/120V, 3PH, 4W	S.E. RATED:	NO	FEED THRU LUGS:	NO
MOUNTING:	FLUSH	AIC RATING:	10k AIC	SECTIONS:	2 SECTION PANEL

CKT	CIRCUIT	BREAKER		WIRE	NOTES	LOAD	CONNECTED PER PHASE (VA)			LOAD	NOTES	WIRE	BREAKER		CIRCUIT	CKT
#	DESCRIPTION	AMPS	P	SIZE		(VA)	A	B	C	(VA)		SIZE	P	AMPS	DESCRIPTION	#
1	LIGHTING - TEMPORARY & EXIT/EM	20	1			400	760			360			1	20	RECEPTACLES - ROOF	2
3	LIGHTING - PARKING LOT	20	1		TS	280		280		0			1	20	SPARE	4
5	SPARE	20	1			0			0	0			1	20	SPARE	6
7	SPARE	20	1			0	0			0			1	20	SPARE	8
9	SPARE	20	1			0		0		0			1	20	SPARE	10
11	SPARE	20	1			0			0	0			1	20	SPARE	12
13	SPARE	20	1			0	0			0			1	20	SPARE	14
15	SPARE	20	1			0		0		0			1	20	SPARE	16
17	SPARE	20	1			0			0	0			1	20	SPARE	18
19	SPARE	20	1			0	0			0			1	20	SPARE	20
21	SPARE	20	1			0		0		0			1	20	SPARE	22
23	SPARE	20	1			0			0	0			1	20	SPARE	24
25	SPARE	20	1			0	0			0			1	20	SPARE	26
27	SPARE	20	1			0		0		0			1	20	SPARE	28
29	SPARE	20	1			0			0	0			1	20	SPARE	30
31	SPARE	20	1			0	3,750			3,750			-	-	-	32
33	SPARE	20	1			0		3,750		3,750	FP	#8 CU	3	50	ROOF TOP UNIT 'RTU-1' (7.5 TON)	34
35	SPARE	20	1			0			3,750	3,750			-		-	36
37	SPARE	20	1			0	1,500			1,500			-	-	-	38
39	SPARE	20	1			0		1,500		1,500	FP	#10 CU	3	30	ROOF TOP UNIT 'RTU-2' (3 TON)	40
41	SPARE	20	1			0			1,500	1,500			-		-	42
SECTION: 2																
43	SPARE	20	1			0	0			0			1	20	SPARE	44
45	SPARE	20	1			0		0		0			1	20	SPARE	46
47	SPARE	20	1			0			0	0			1	20	SPARE	48
49	SPARE	20	1			0	0			0			1	20	SPARE	50
51	SPARE	20	1			0		0		0			1	20	SPARE	52
53	SPARE	20	1			0			0	0			1	20	SPARE	54
55	SPACE ONLY					0	0			0			1	20	SPARE	56
57	SPACE ONLY					0		0		0					SPACE ONLY	58
59	SPACE ONLY					0			0	0					SPACE ONLY	60
61	SPACE ONLY					0	0			0					SPACE ONLY	62
63	SPACE ONLY					0		0		0					SPACE ONLY	64
65	SPACE ONLY					0			0	0					SPACE ONLY	66
67	SPACE ONLY					0	0			0					SPACE ONLY	68
69	SPACE ONLY					0		0		0					SPACE ONLY	70
71	SPACE ONLY					0			0	0					SPACE ONLY	72
73	SPACE ONLY					0	0			0					SPACE ONLY	74
75	SPACE ONLY					0		0		0					SPACE ONLY	76
77	SPACE ONLY					0			0	0					SPACE ONLY	78
79	SPACE ONLY					0	0			0					SPACE ONLY	80
81	SPACE ONLY					0		0		0					SPACE ONLY	82
83	SPACE ONLY					0			0	0					SPACE ONLY	84
						PER PHASE SUB-TOTALS	6,010	5,530	5,250							

TOTAL CONNECTED PANELBOARD (VA)	16,790	LEGEND:
TOTAL CONNECTED PANELBOARD (AMPS)	47	TS - VIA TIME SWITCH / ST - SHUNT TRIP
TOTAL PANELBOARD DEMAND (VA)	16,960	FA - FIRE ALARM / RED / LOCKING TAB / LCK - LOCKING TAB
TOTAL PANELBOARD DEMAND (AMPS)	47	EM - EMERGENCY LTG. / LOCKING TAB / GF - GROUND FAULT INTERRUPTER
		FP - REFER TO FLOOR PLAN DRAWING. / OL - RE: ONE-LINE DIAGRAM

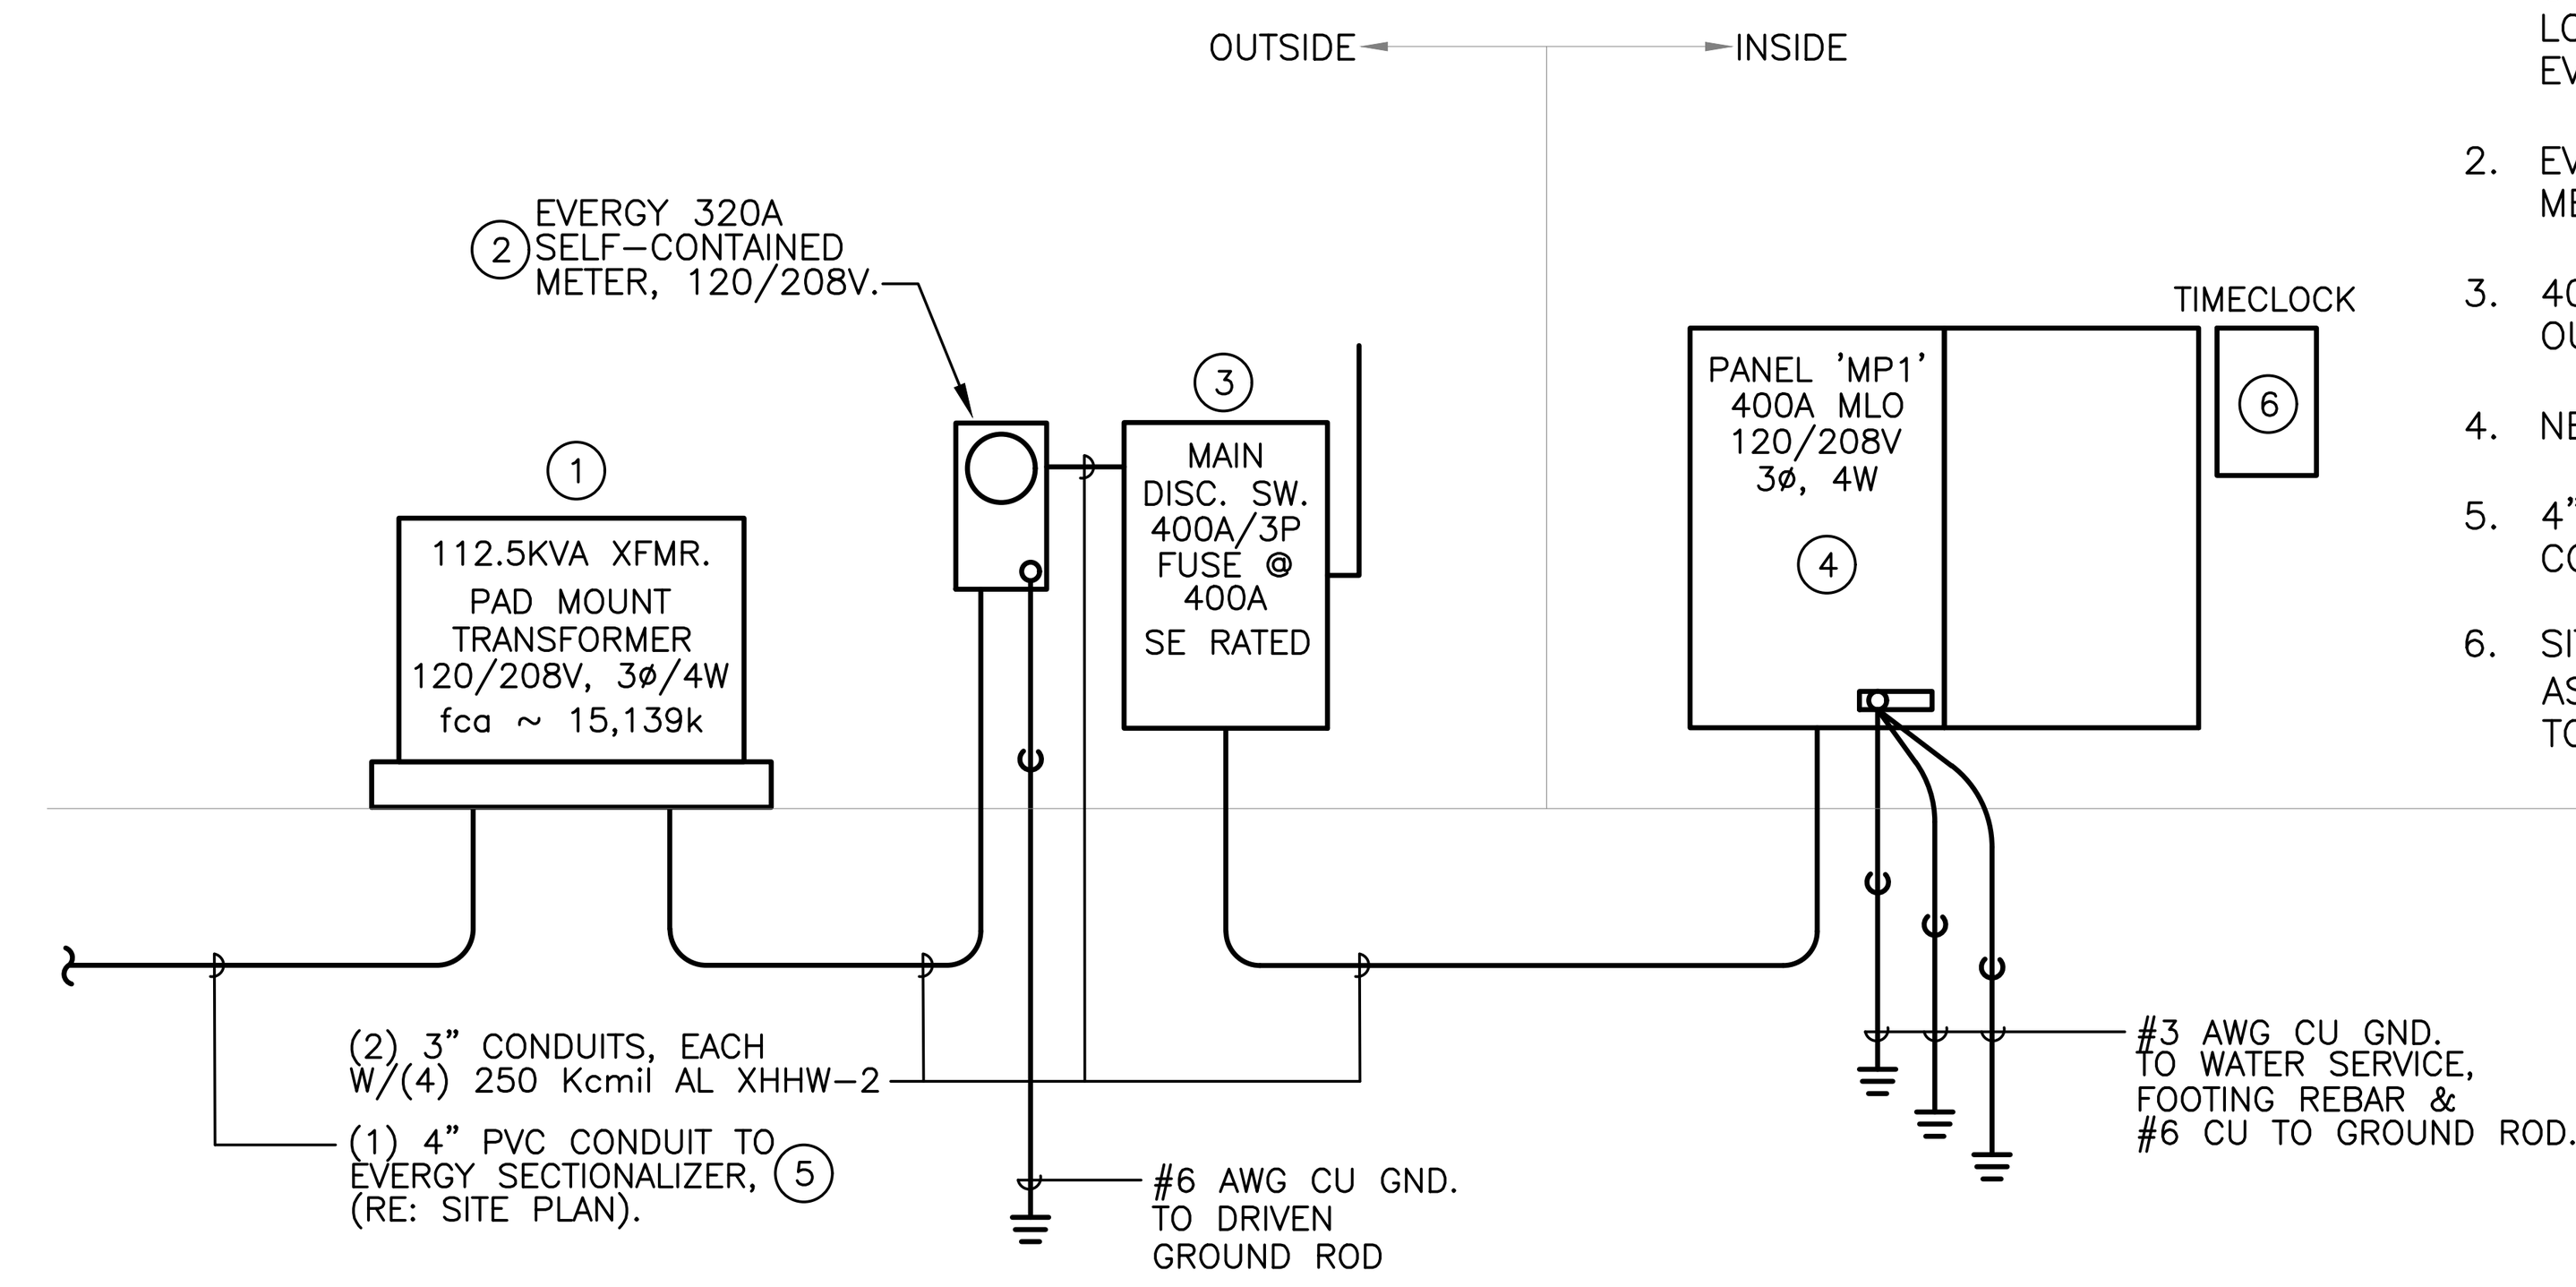

1 ELECTRICAL RISER PLAN
NO SCALE:

RISER PLAN NOTES:

1. EVERGY PROVIDED PAD MOUNT TRANSFORMER AND CONTRACTOR PROVIDED CONCRETE PAD. COORDINATE LOCATION WITH ARCHITECT, SITE UTILITIES PLAN AND EVERGY PLANNER.
2. EVERGY APPROVED 320A SELF-CONTAINED 120/208V METER.
3. 400A/3P FUSIBLE MAIN DISCONNECT SWITCH LOCATED ON OUTSIDE OF BUILDING.
4. NEW PANEL 'MP1'.
5. 4" PVC CONDUIT FOR EVERGY UTILITY PRIMARY CONDUCTORS. COORDINATE ROUTE WITH EVERGY PLANNER.
6. SITE LIGHTING TIMECLOCK, 2-POLE, 7 DAY ASTRONOMICAL. INTERMATIC #ET8215C OR SIMILAR. SPARE TO BE USED FOR FUTURE SIGNAGE.

ELECTRICAL GENERAL NOTES:

- DRAWINGS ARE SCHEMATIC IN NATURE AND BASED ON PRELIMINARY SITE OBSERVATION. PRIOR TO BID, CONTRACTOR SHALL INVESTIGATE THE PROJECT SITE AND BECOME FULLY AWARE OF ALL FIELD CONDITIONS, CURRENT SYSTEM OPERATION AS WELL AS COORDINATION REQUIREMENTS. COORDINATE ALL MECHANICAL WORK WITH ARCHITECTURAL DRAWINGS, EXISTING CONDITIONS AND OTHER TRADES PRIOR TO BID OR START OF WORK.
- ELECTRICAL WORK SHALL CONFORM TO APPLICABLE CODES AS ADOPTED BY THE LOCAL AUTHORITY HAVING JURISDICTION. REFER TO ARCHITECTURAL CODE PLANS FOR SPECIFIC CODE REFERENCES.
- COORDINATE ELECTRICAL WORK WITH ALL OTHER PROJECT TRADES (E.G. ARCHITECTURAL, STRUCTURAL, ELECTRICAL, PLUMBING, FIRE SPRINKLER, ETC.).
- COORDINATE EXACT LOCATIONS OF ALL LIGHT FIXTURES AND ELECTRICAL DEVICES WITH ARCHITECTURAL DRAWING AND OTHER TRADES PRIOR TO ROUGH-IN. COORDINATE ALL WORK WITH OTHER TRADES AND EXISTING CONDITIONS AS REQUIRE TO PROPERLY INSTALL ALL SYSTEMS.
- INSTALL PULL STRING IN ALL EMPTY CONDUIT/RACEWAY. TERMINATE CONDUIT STUB-UP WITH A NYLON BUSHING.
- ELECTRICAL CONTRACTOR SHALL INSPECT ALL ELECTRICAL EQUIPMENT TO REMAIN. REPORT ANY DEFICIENCIES TO OWNER PRIOR TO START OF WORK.
- ALL CONDUCTORS SHALL BE INSTALLED IN METALLIC (EMT) CONDUIT, AND INSTALLED IN A NEAT AND WORKMANLIKE MANNER PER THE RECOGNIZED EDITION OF THE NATIONAL ELECTRIC CODE (NEC). CONDUIT SHALL BE 1/2" MINIMUM USING STEEL SET-SCREW FITTINGS. HOME RUNS SHALL CONFORM TO NEC REQUIREMENTS FOR CONDUIT FILL, AND SHALL CONTAIN NO MORE THAN 6 CURRENT CARRYING CONDUCTORS. IF NEUTRALS ARE SHARED FOR ANY REASON, CIRCUIT BREAKER TIE HANDLES SHALL BE INSTALLED AT THE PANEL
- ALL CONDUCTORS SHALL BE COPPER UNLESS OTHERWISE NOTED. CONDUCTOR INSULATIONS SHALL BE RATED FOR THEIR USE. CONDUCTORS EXPOSED TO WATER SHALL HAVE INSULATION RATED FOR WET CONDITIONS, INSULATION TYPES THWN OR XHHW. INTERIOR BUILDING WIRING SHALL BE THHN.
- AT CONTRACTOR'S OPTION, MC CABLE CAN BE USED IN FURRED WALLS, ABOVE CEILINGS AND IN OTHER CONCEALED SPACES WHERE ALLOWED BY NEC.
- HOME RUNS SHALL BE ROUTED IN EMT CONDUIT ALL THE WAY BACK TO THE PANEL. EXPOSED POWER WIRING SHALL BE IN EMT. ALL INSTALLATIONS SHALL BE PER NEC REQUIREMENTS.
- LIGHT FIXTURE WHIPS (MC OR 1/2" FLEX) SHALL USE #12 CONDUCTORS. FIXTURE WHIPS SHALL BE SUPPORTED PER NEC REQUIREMENTS AND BE NO LONGER THAN 8'.
- ALL CONDUCTORS SHALL BE COPPER WITH #12 AWG MINIMUM, (UNLESS NOTED OTHERWISE).
- CONTRACTOR SHALL LABEL ALL RECEPTACLES, BOXES, PANELBOARDS, ETC. WITH PANEL, CIRCUIT NUMBER, ETC. WITH PANEL AND CIRCUIT NUMBERS. RECEPTACLE COVERPLATES SHALL BE LABELED USING PRINTED LABEL WITH 1/2" HIGH LETTERS. COORDINATE WITH OWNER FOR FINAL PANEL AND EQUIPMENT DESIGNATIONS AND LABELING REQUIREMENTS.
- FOR GFI RECEPTACLES ON THE SAME CIRCUIT, THE FIRST DEVICE IN THE CIRCUIT MY PROVIDE GFI PROTECTION FOR THE DOWNSTREAM DEVICES.

THOMAS J. ELLIS JR. LICENSED 13520 11/26/2025 KANSAS PROFESSIONAL ENGINEER
THOMAS J. ELLIS JR.
KS PE LICENSE #13520

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC
AR·HITE·TURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center
Mr. D's DONUTS
14485 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 26, 2025
REVISED
SHEET NUMBER
E2.0
OF SHEETS
KAI JOB NO. 2506-C

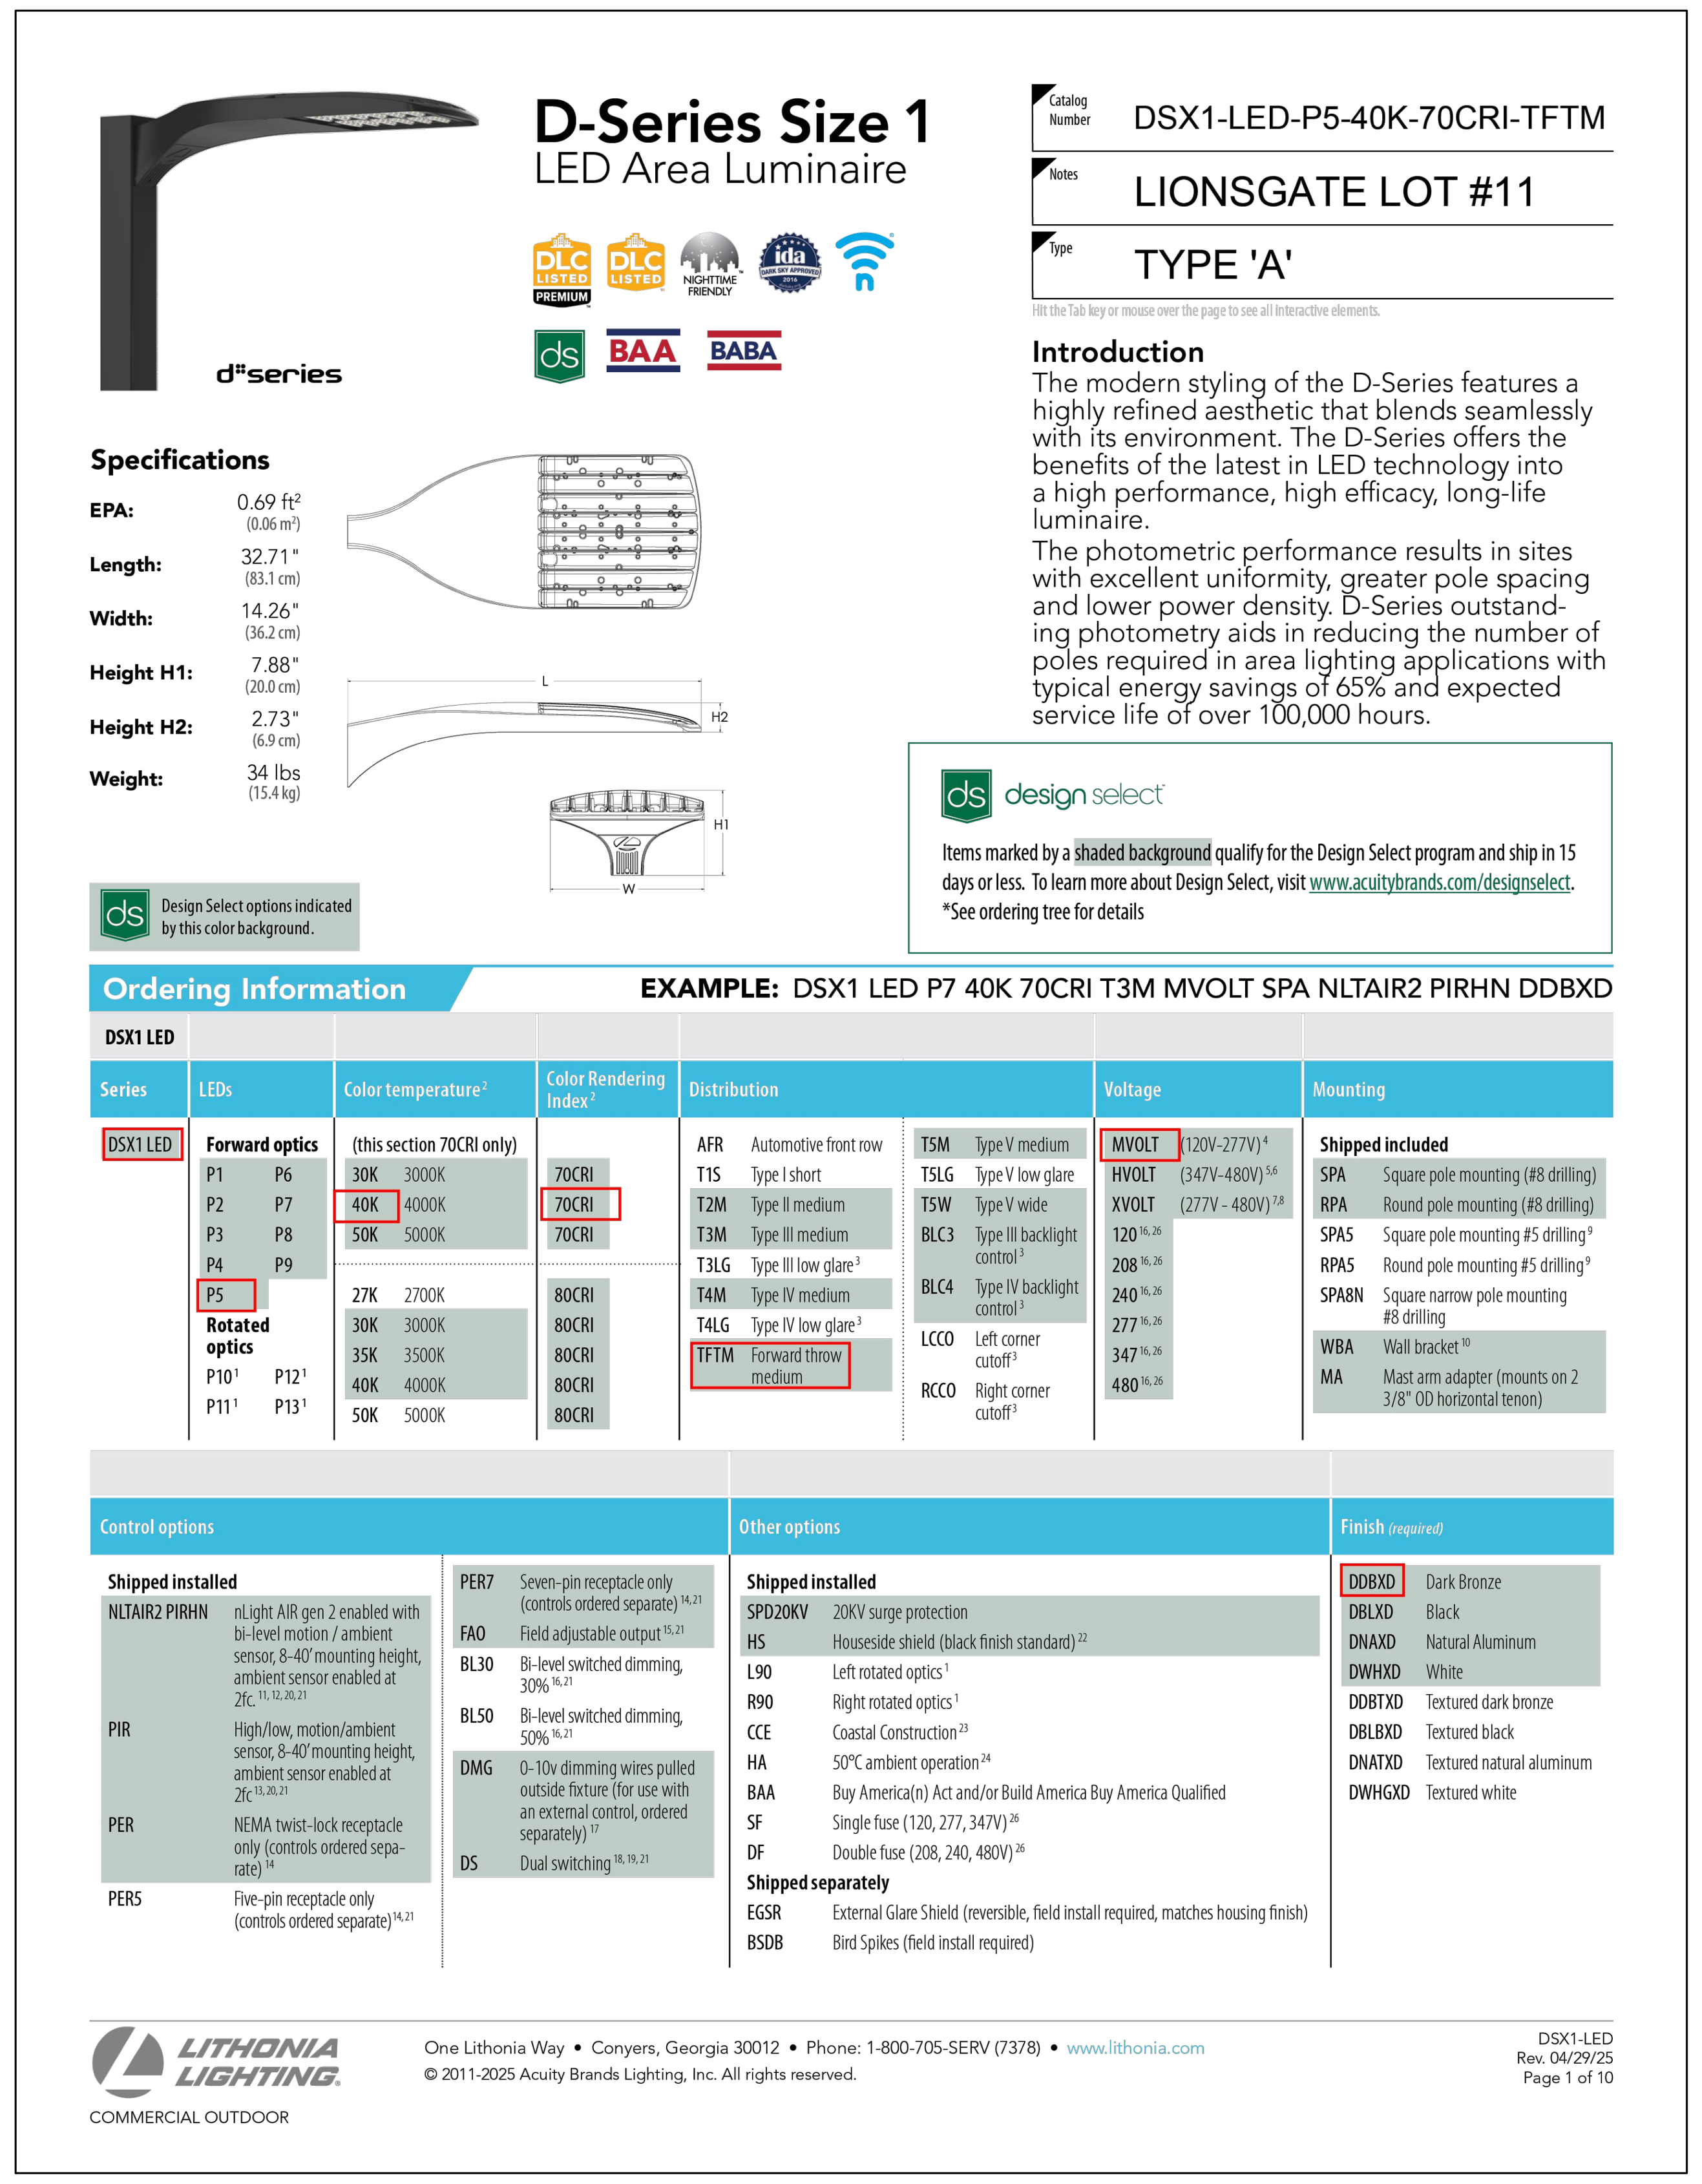
D-Series Size 1
LED Area Luminaire

Catalog Number	DSX1-LED-P5-40K-70CRI-TFTM
Notes	LIONSGATE LOT #11
Type	TYPE 'A'

Specifications

EPA: 0.69 ft² (0.06 m²)
Length: 32.71" (83.1 cm)
Width: 14.26" (36.2 cm)
Height H1: 7.88" (20.0 cm)
Height H2: 2.73" (6.9 cm)
Weight: 34 lbs (15.4 kg)

Introduction

The modern styling of the D-Series features a highly refined aesthetic that blends seamlessly with its environment. The D-Series offers the benefits of the latest in LED technology into a high performance, high efficacy, long-life luminaire.

The photometric performance results in sites with excellent uniformity, greater pole spacing and lower power density. D-Series outstanding photometry aids in reducing the number of poles required in area lighting applications with typical energy savings of 65% and expected service life of over 100,000 hours.

design select

Items marked by a shaded background qualify for the Design Select program and ship in 15 days or less. To learn more about Design Select, visit www.acuitybrands.com/designselect.
*See ordering tree for details

Ordering Information EXAMPLE: DSX1 LED P7 40K 70CRI T3M MVOLT SPA NLTAIR2 PIRHN DDBXD

LITHONIA LIGHTING
COMMERCIAL OUTDOOR

One Lithonia Way • Conyers, Georgia 30012 • Phone: 1-800-705-SERV (7378) • www.lithonia.com
© 2011-2025 Acuity Brands Lighting, Inc. All rights reserved.

DSX1-LED
Rev. 04/29/25
Page 1 of 10

2 LUMINAIRE CUT-SHEET

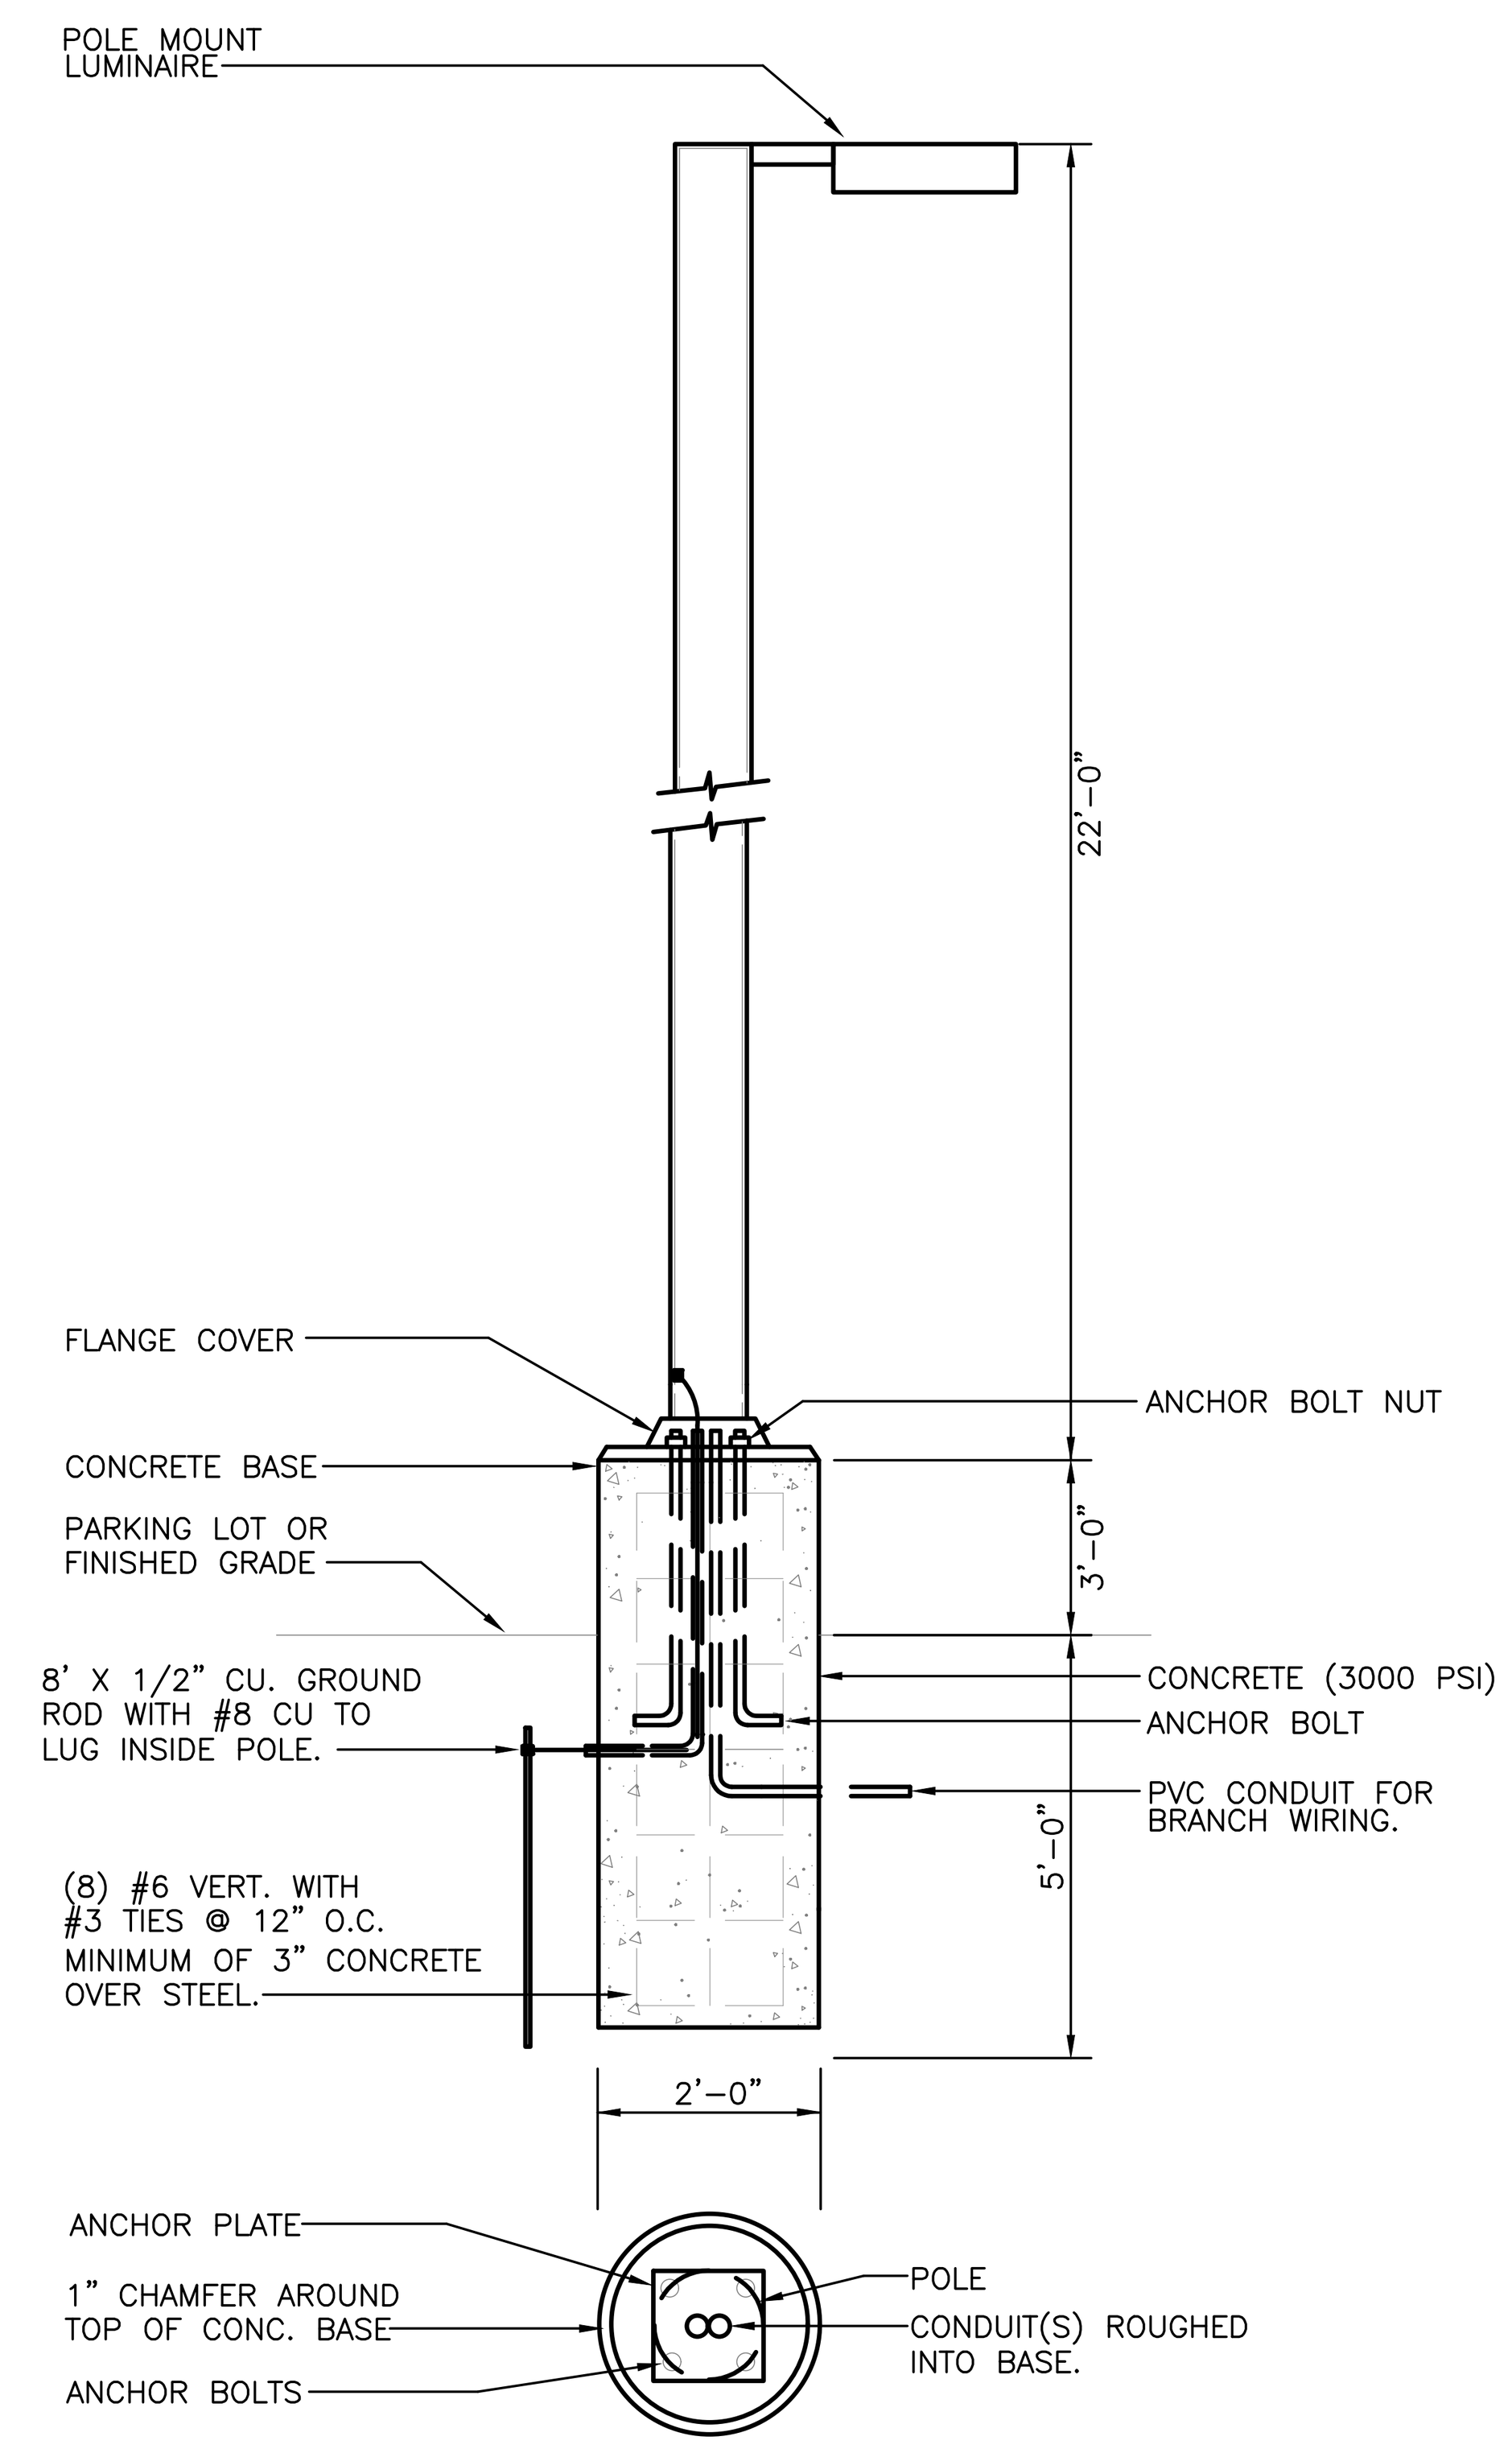

3 POLE AND BASE DETAIL
NOT TO SCALE.

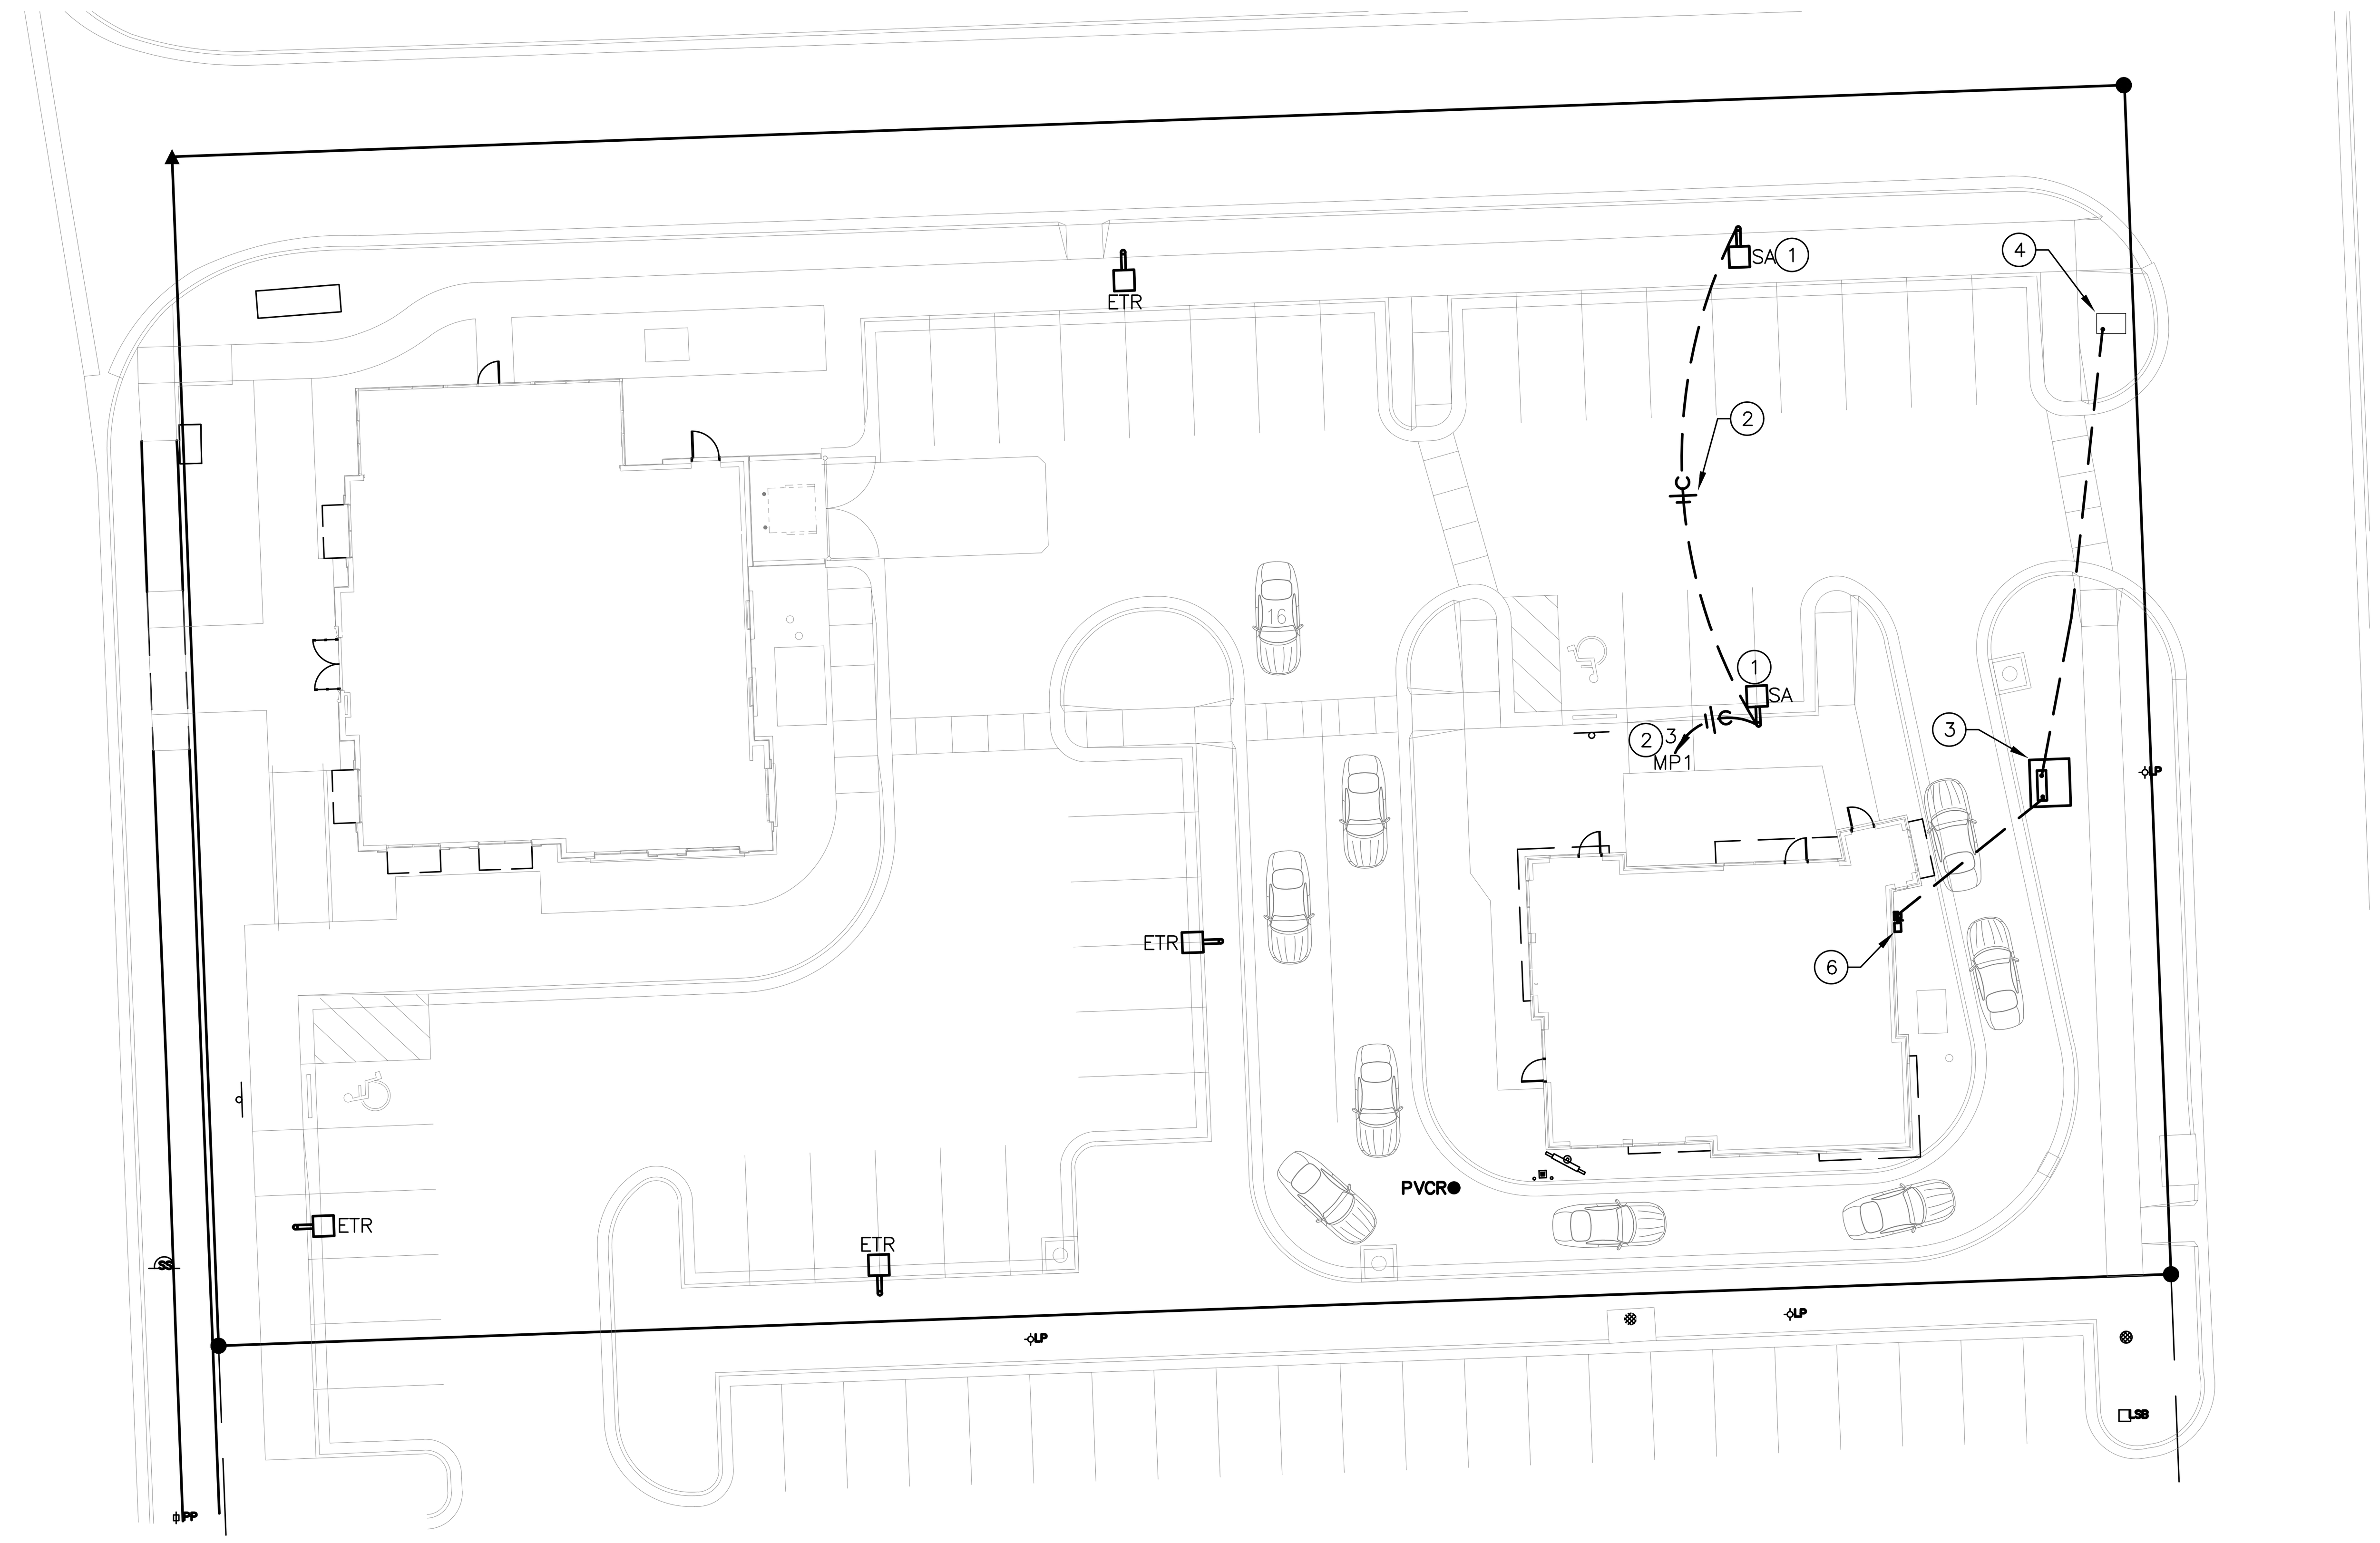

1 SITE ELECTRICAL PLAN
SCALE: 1" = 20'

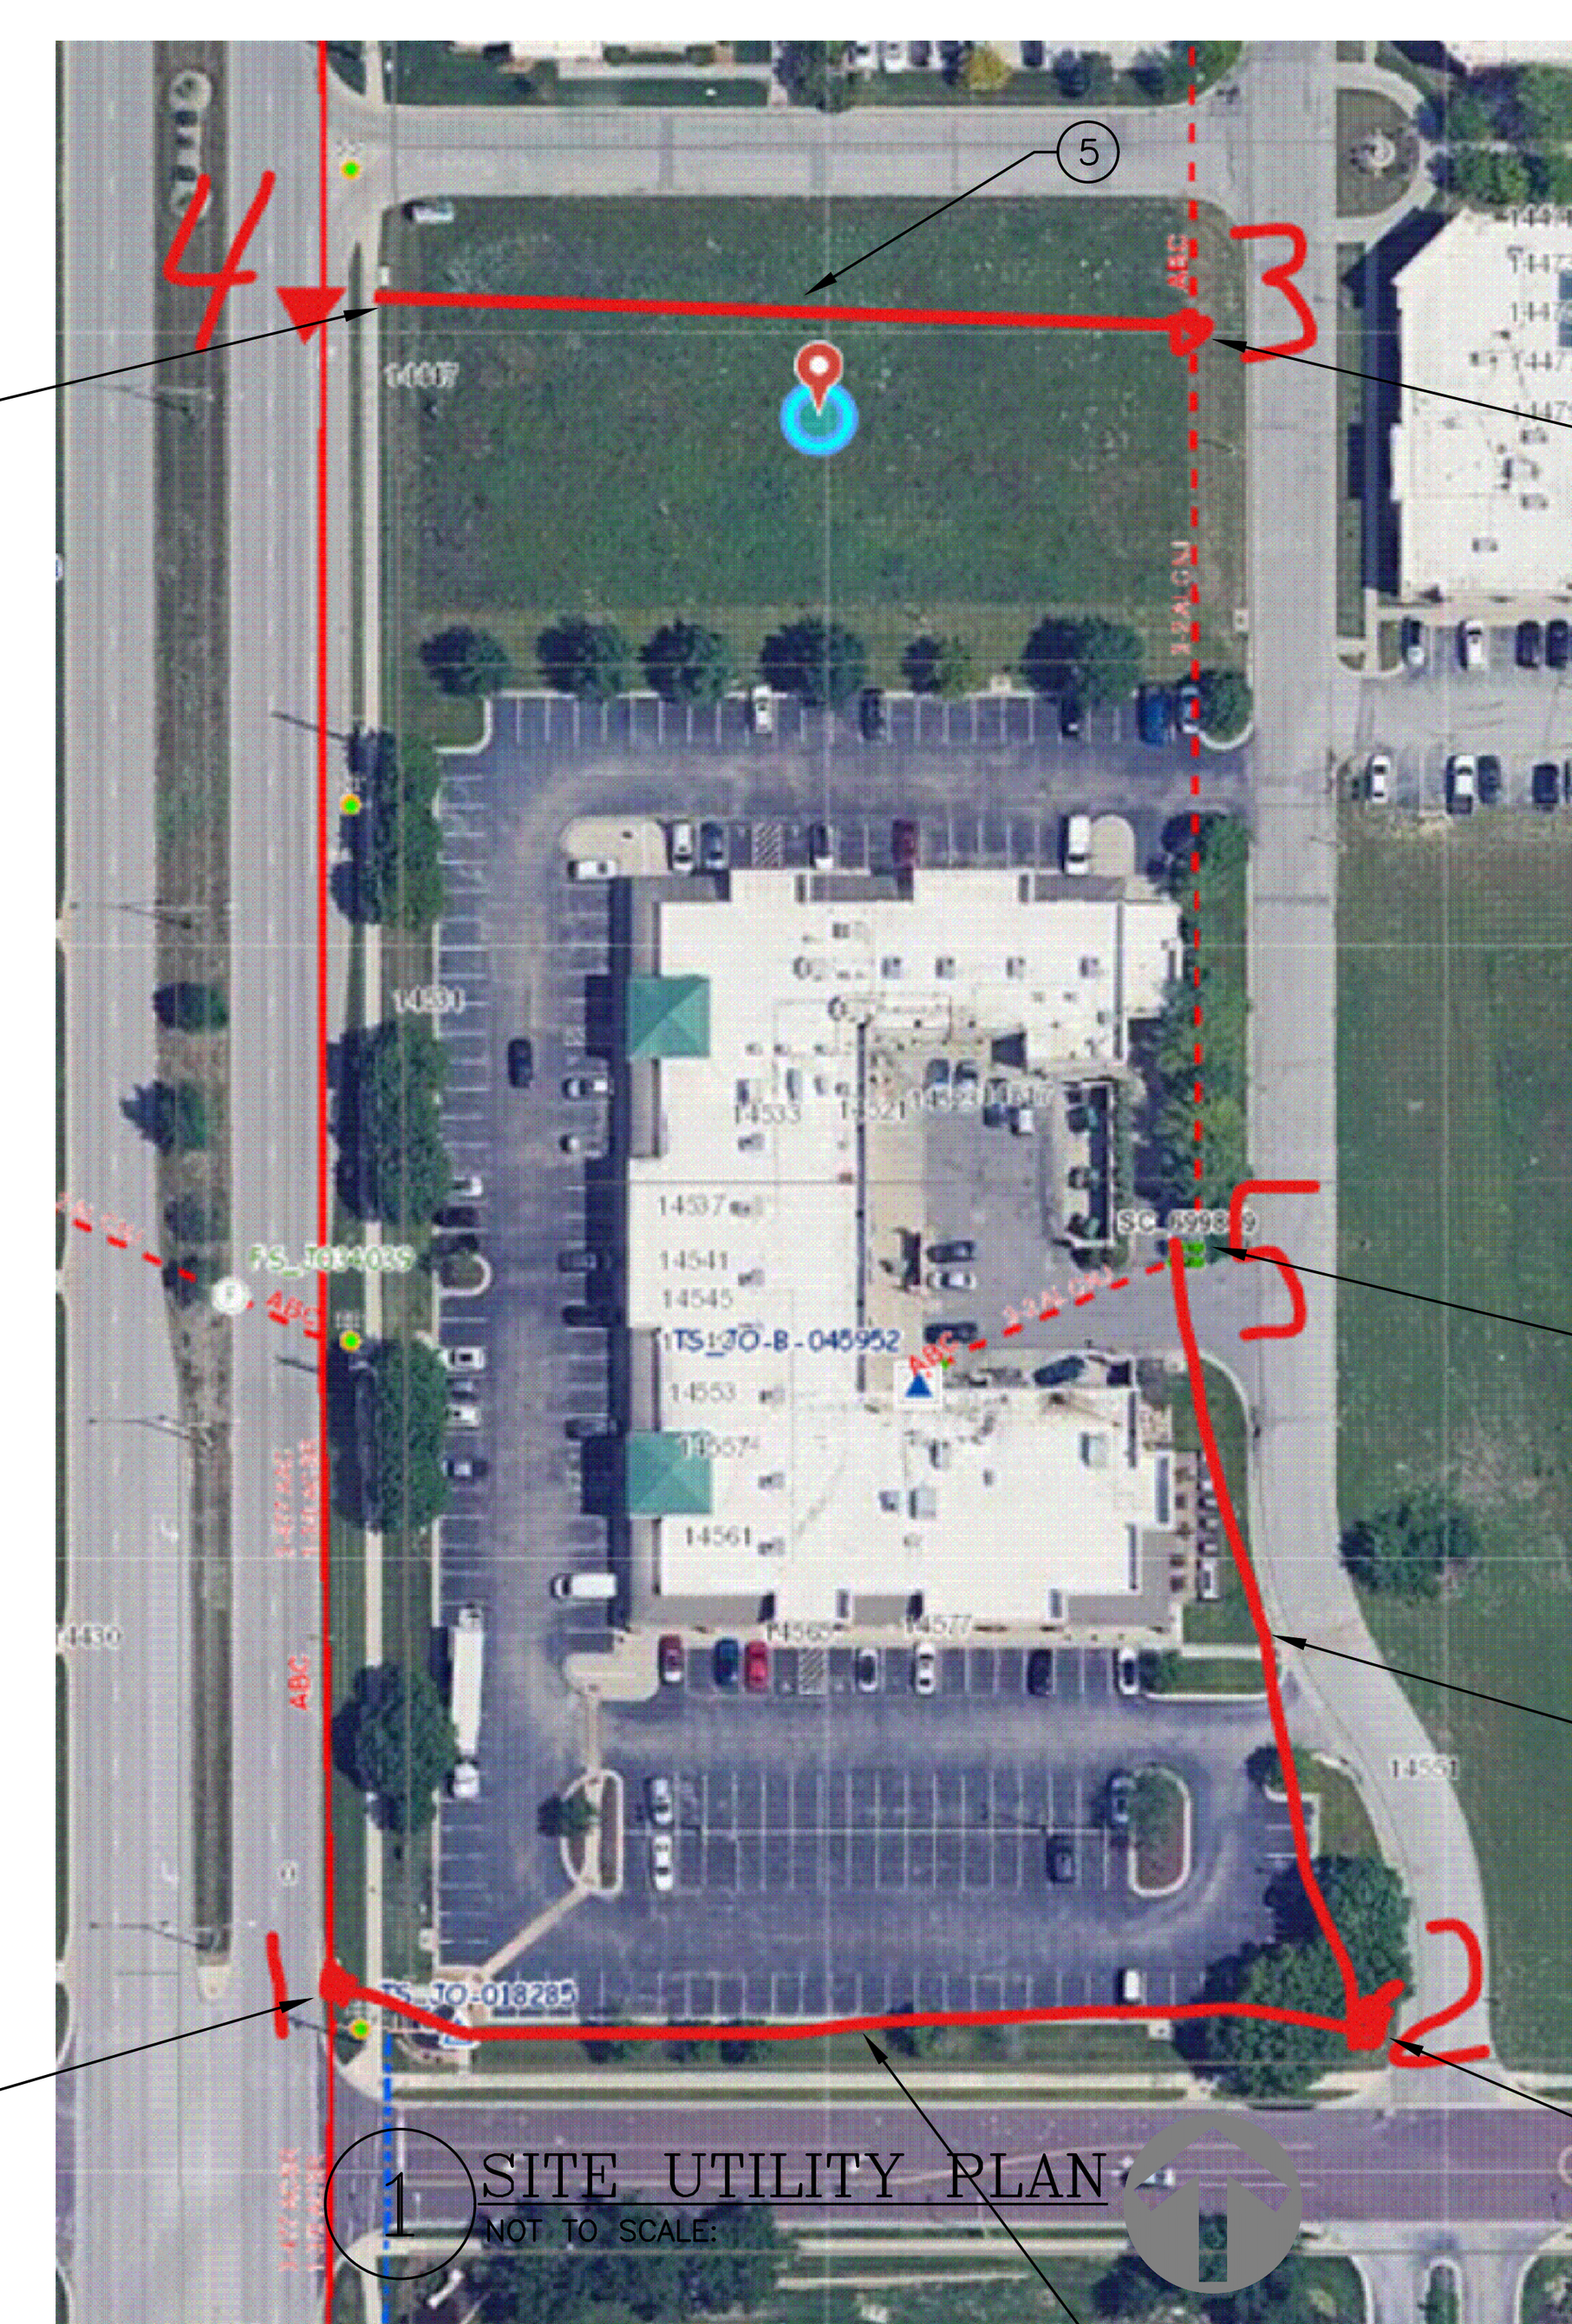

1 SITE UTILITY PLAN
NOT TO SCALE

Schedule

Symbol	Label	Image	QTY	Catalog Number	Description	Lamp	Number Lamps	Lumens per Lamp	LLF	Wattage	Polar Plot
◻	SA		5	DSX1 LED P5 40K 70CRI TFTM	D-Series Size 1 Area Luminaire P5 Performance Package 4000K CCT 70 CRI Forward Throw	LED	1	18,017	0.91	138.16	

SITE UTILITY PLAN NOTES:

1. EVERGY SHALL SET NEW POLE AT THIS LOCATION.
2. CONTRACTOR SHALL INSTALL NEW EVERGY PROVIDED SECTIONALIZER, WHICH SHALL BE INSTALLED PER EVERGY STANDARDS.
3. EXISTING EVERGY SECTIONALIZER LOCATION TO REMAIN. CONTRACTOR TO STUB 4" UTILITY CONDUIT INTO BASE COMING FROM SOUTH.
4. CONTRACTOR SHALL INSTALL NEW EVERGY PROVIDED SECTIONALIZER OVER EXISTING EVERGY PRIMARY FEEDER, AND TURN NEW CONDUITS UP INTO BASE. REFER TO SITE ELECTRICAL PLAN FOR EXACT LOCATION.
5. CONTRACTOR SHALL BORE OR TRENCH 4" PVC CONDUIT BETWEEN SECTIONALIZER AND POLE LOCATIONS.

NOTE: ALL WORK SHALL BE COORDINATED WITH EVERGY, EXISTING UTILITIES AND CONDITIONS.

SITE ELECTRICAL PLAN NOTES:

1. NEW SITE LIGHTING LUMINAIRE. COORDINATE POLE EXACT LOCATIONS WITH CIVIL DRAWINGS TO AVOID SEWER AND OTHER NEW AND EXISTING BURIED UTILITIES.
2. ROUTE (3) #10 AWG CU THWN CONDUCTOR IN 3/4" MINIMUM PVC CONDUIT BELOW GRADE. TAMP TRENCH WITH BACKFILL AFTER INSTALLATION OF CONDUIT.
3. APPROXIMATE LOCATION OF NEW EVERGY PADMOUNT TRANSFORMER AND PAD. EXTEND 4" PRIMARY CONDUIT TO EXISTING EVERGY SECTIONALIZER. PAD SHALL BE BY ELECTRICAL CONTRACTOR PER EVERGY STANDARDS.
4. APPROXIMATE LOCATION OF EXISTING EVERGY SECTIONALIZER. COORDINATE EXACT LOCATION WITH EVERGY PLANNER.
5. EXISTING EVERGY SECTIONALIZER TO REMAIN.
6. NEW EVERGY METER AND MAIN DISCONNECT LOCATION. CONFIRM FINAL LOCATION WITH ARCHITECT.

THOMAS J. ELLIS JR. LICENSED PROFESSIONAL ENGINEER 13520 KANSAS 11/26/2025
THOMAS J. ELLIS JR.
KS PE LICENSE #13520

DAVID A. KASTER, RA,NCARB,LEED-AP
ROGER A. KASTER, ARCHITECT
MICHAEL L. HOWARD, ARCHITECT

7304 WEST 130th STREET
SUITE 170
OVERLAND PARK, KANSAS 66213
TELEPHONE (913) 681-1200
WEB SITE www.kasterarchitects.com

KASTER ARCHITECTS INC
AR·HITE·TURE · PLANNING · INTERIOR DESIGN

LOT 11: Lionsgate Shopping Center
Mr. D's DONUTS
14485 METCALF AVE.
OVERLAND PARK, KANSAS

DATE NOV. 26, 2025
REVISED
SHEET NUMBER
E3.0
OF SHEETS
KAI JOB NO. 2506-C