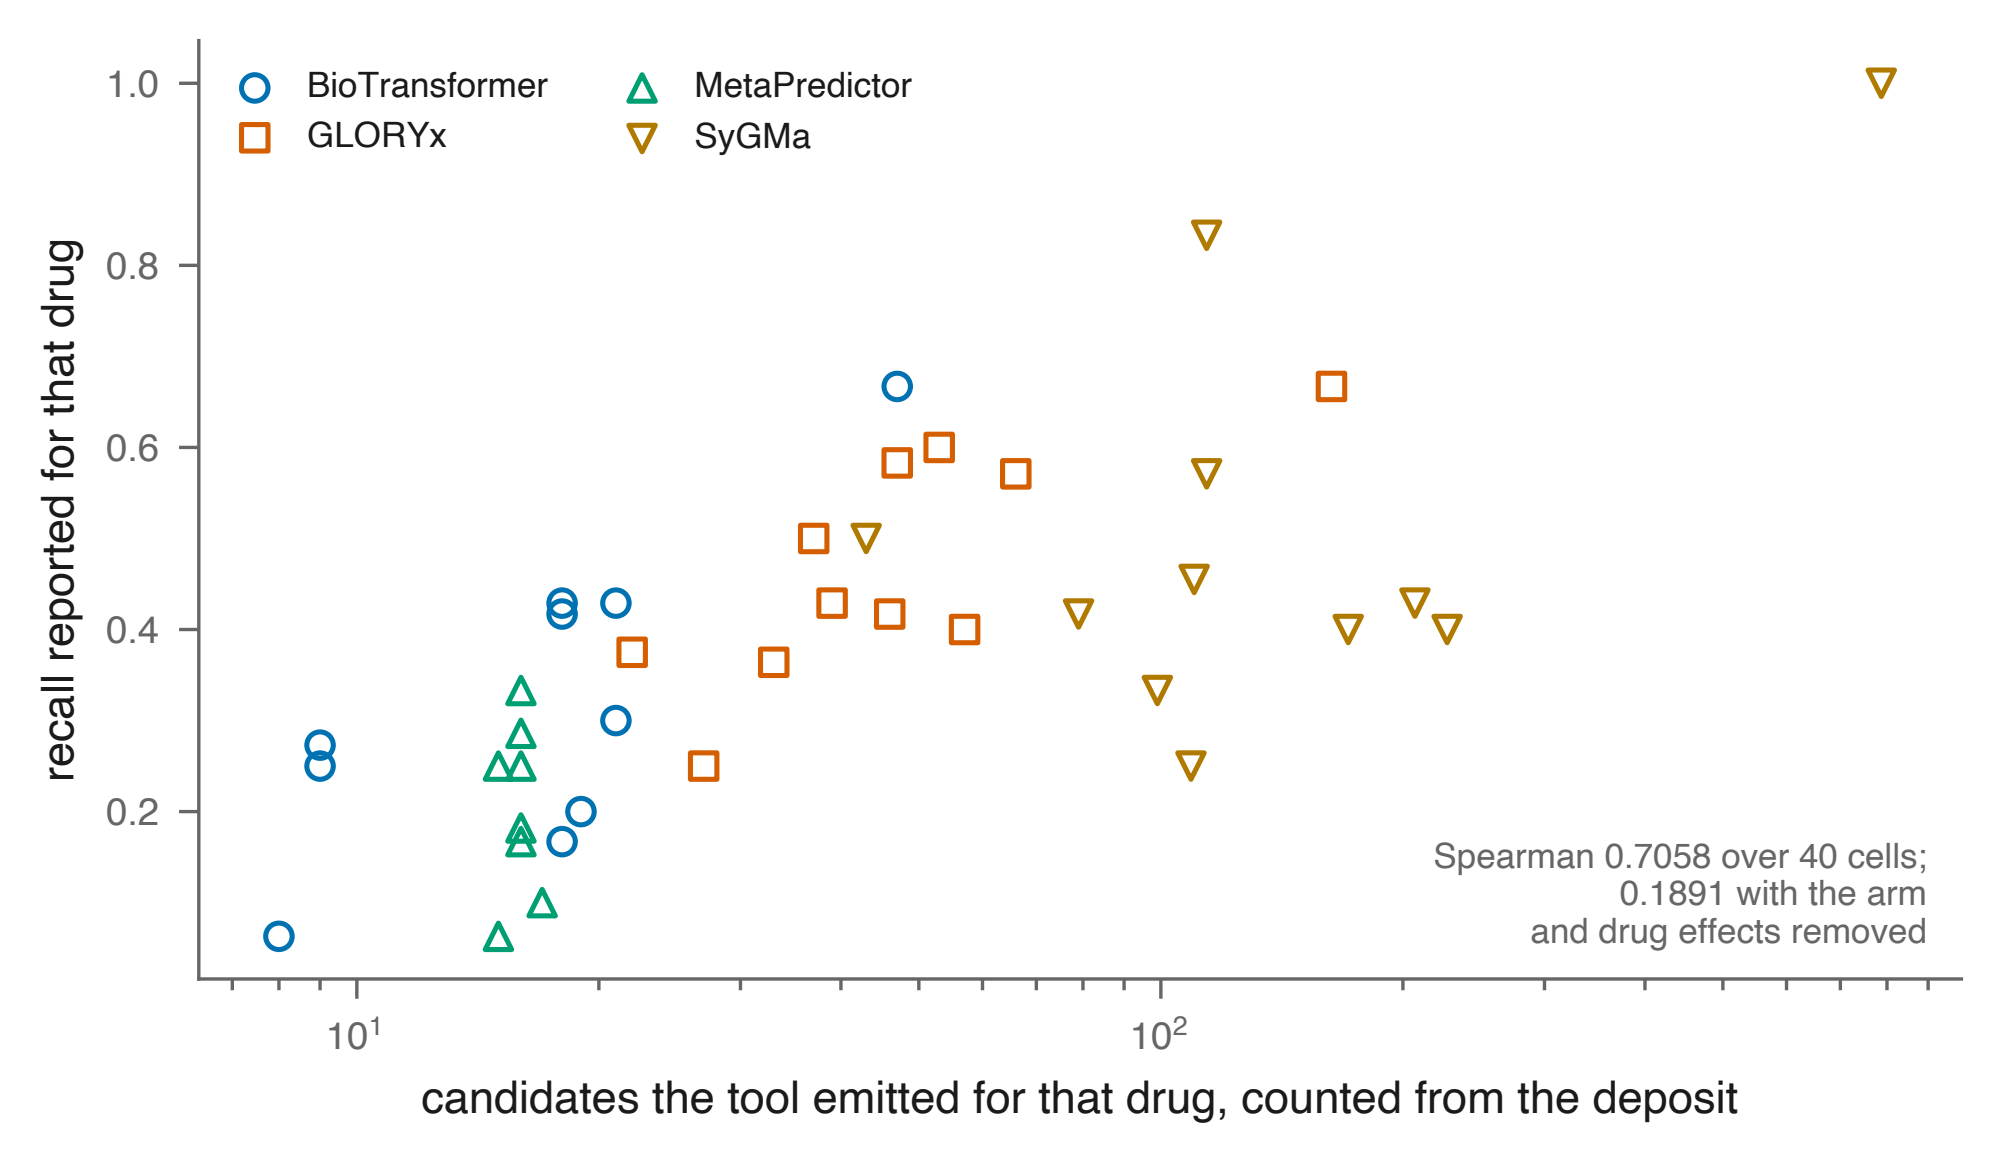
BioTransformer
GLORYx
MetaPredictor
SyGMa
recall reported for that drug
1.0
0.8
0.6
0.4
0.2
10^1
10^2
candidates the tool emitted for that drug, counted from the deposit
Spearman 0.7058 over 40 cells;
0.1891 with the arm
and drug effects removed