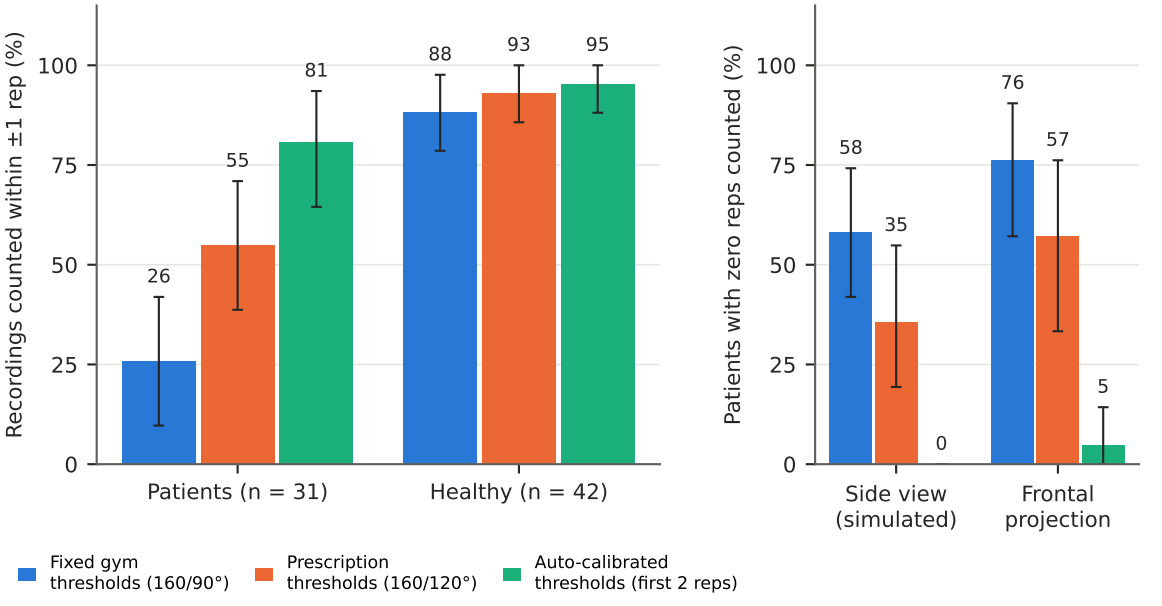
A KIMORE squat, simulated side view
Recordings counted within ±1 rep (%)
0
25
50
75
100
26
55
81
88
93
95
Patients (n = 31)
Healthy (n = 42)
B Missed entirely, by view
Patients with zero reps counted (%)
0
25
50
75
100
58
35
0
76
57
5
Side view (simulated)
Frontal projection
Fixed gym thresholds (160/90°)
Prescription thresholds (160/120°)
Auto-calibrated thresholds (first 2 reps)