
PANEL DESIGNATION	SERVICE	MAIN	BUS RATING	SPACES
PANEL A - MAIN	120/240V 1Φ 3W	200A MAIN BREAKER	200A	40
LOCATION: GARAGE, NORTH WALL	MANUFACTURER / MODEL: SQUARE D QO140M200	FED FROM: UTILITY METER	CIRCUITS: 28	SPACE USAGE: 32 USED / 8 OPEN

CIRCUIT DESCRIPTION	TRIP	CKT
RANGE / OVEN	40A 2P	1, 3
KITCHEN COUNTERTOP RECEPTACLES [LEFT OF SINK]	20A AFCI/GFCI	5
KITCHEN COUNTERTOP RECEPTACLES [RIGHT OF SINK]	20A AFCI/GFCI	7
DISHWASHER	20A TIED	9
GARBAGE DISPOSAL [MWBC WITH CKT 9]	20A TIED	11
REFRIGERATOR	20A	13
BEDROOM 1	15A AFCI	15
BEDROOM 2	15A AFCI	17
PRIMARY BEDROOM	15A AFCI	19
BATHROOMS RECEPTACLES	20A GFCI	21
LIVING ROOM & DINING ROOM	15A AFCI	23
MICROWAVE	20A	25
SMOKE DETECTORS	15A	27
EV CHARGER [GARAGE]	50A 2P	29, 31
SPACE	—	33
SPACE	—	35
SPACE	—	37
SPACE	—	39

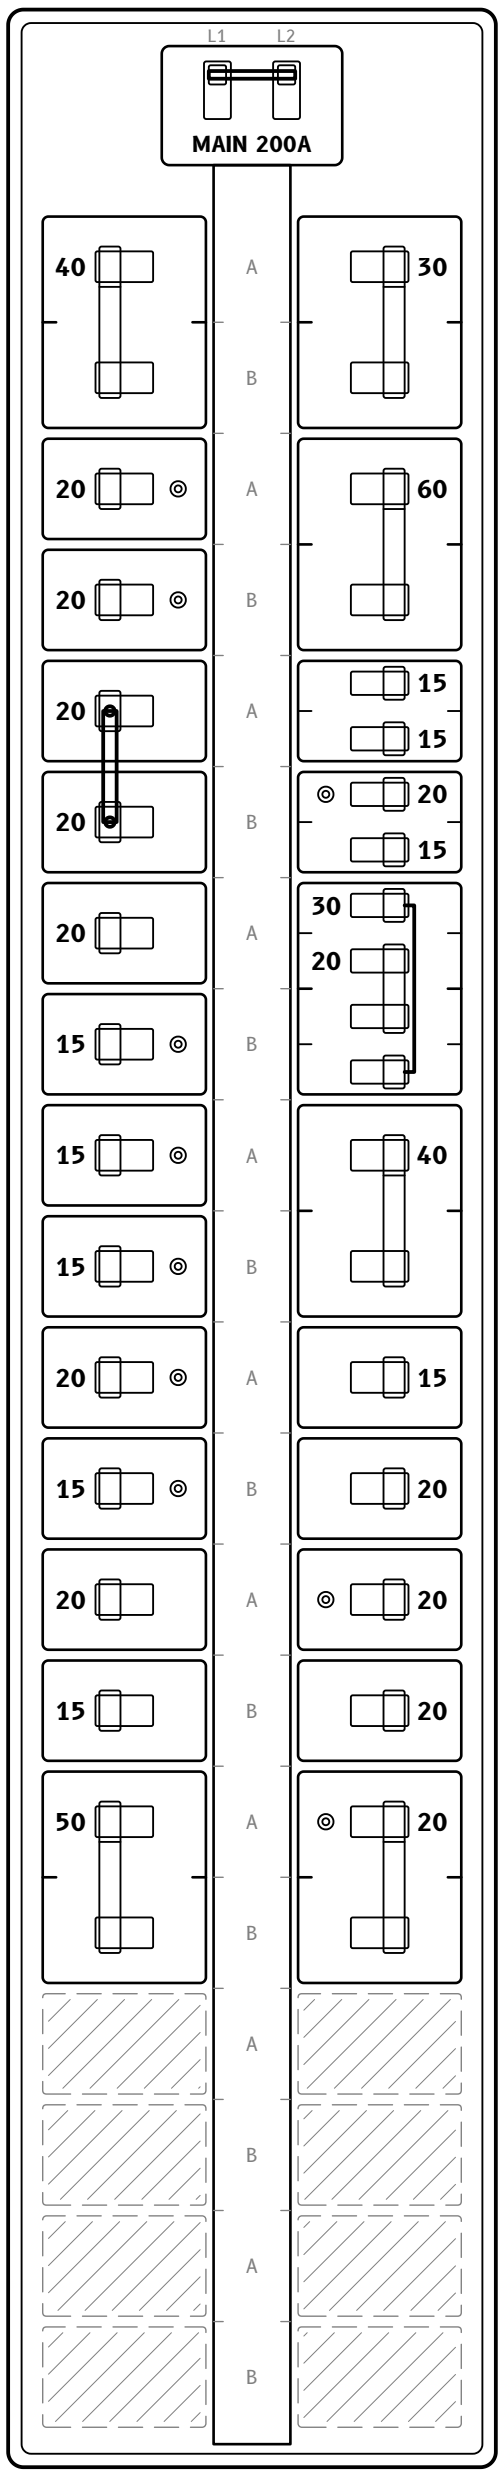

CKT	TRIP	CIRCUIT DESCRIPTION
2, 4	30A 2P	CLOTHES DRYER
6, 8	60A 2P	SUBPANEL B - DETACHED WORKSHOP
10A	15A	HALL & STAIR LIGHTING
10B	15A	FRONT PORCH LIGHTS
12A	20A GFCI	GARAGE RECEPTACLES
12B	15A	GARAGE DOOR OPENER
14A, 14B	30A 2P	OUTER 14A/16B — WATER HEATER
16A, 16B	20A 2P	INNER 14B/16A — WELL PUMP
18, 20	40A 2P	A/C CONDENSER
22	15A	FURNACE / AIR HANDLER
24	20A	LAUNDRY RECEPTACLE
26	20A GFCI	EXTERIOR RECEPTACLES
28	20A	SPARE
30, 32	20A 2P SURGE	WHOLE-HOUSE SURGE PROTECTOR
34	—	SPACE
36	—	SPACE
38	—	SPACE
40	—	SPACE

NOTES

1. Circuits 9 and 11 are a multi-wire branch circuit sharing a neutral; handle tie required.
2. Verify circuit identification with a circuit tracer before working on any circuit.
3. Grounding electrode: two ground rods, 6 ft apart, at the meter base.

PROJECT / PROPERTY
1234 EXAMPLE STREET

DRAWING TITLE
PANEL A - MAIN — PANEL DIRECTORY

DRAWN BY	DATE	SCALE
D. PANZINO	2026-10-15	NONE

SIZE	DWG NO.	REV	SHEET
B	E-101	A	1 OF 2