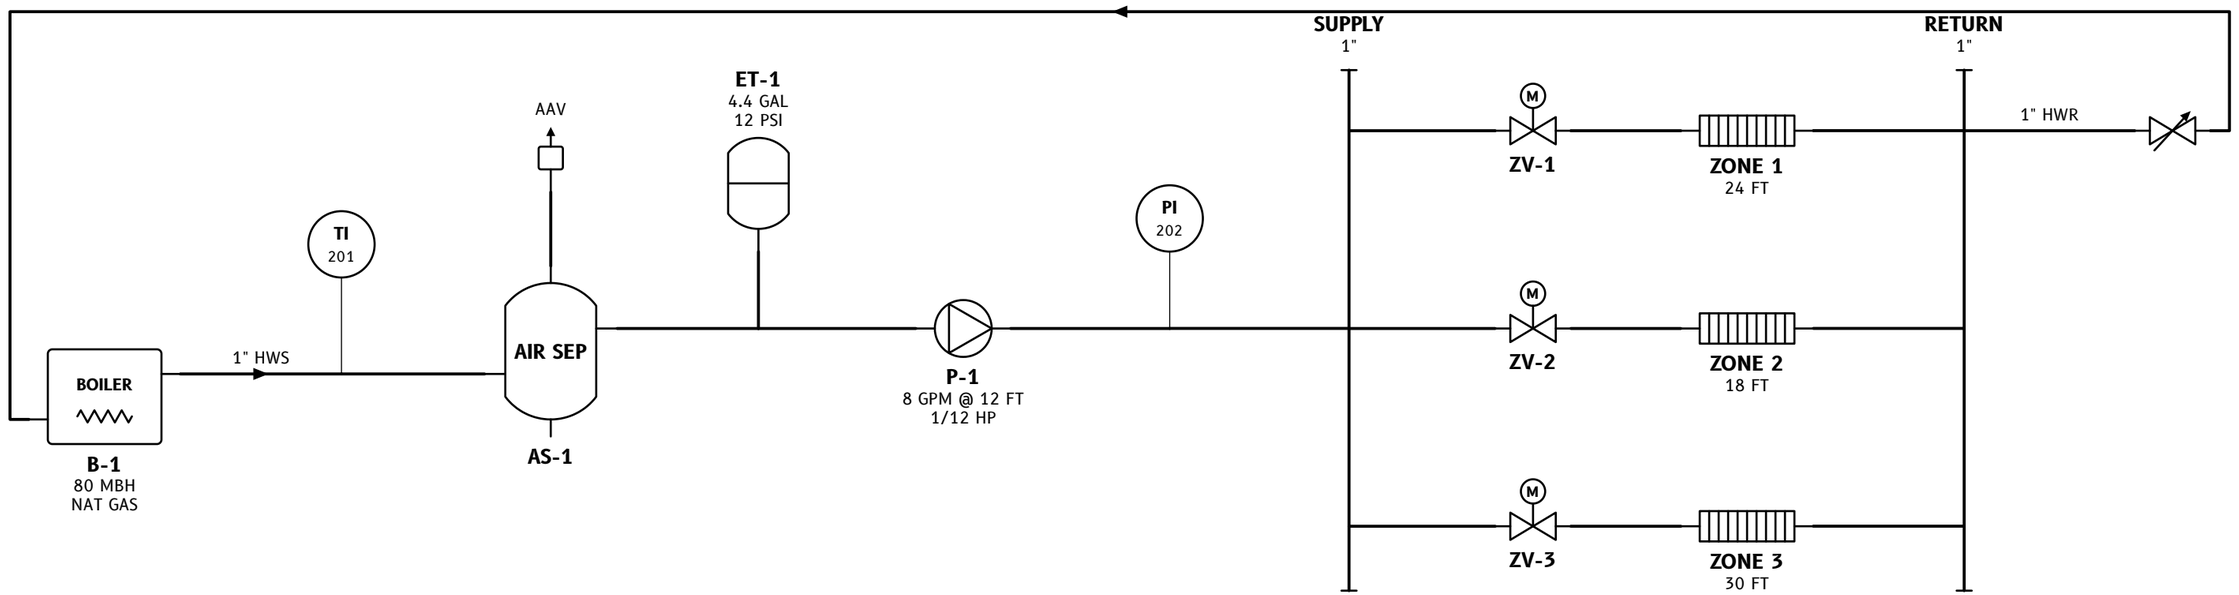

NOTES

1. Fill pressure 12 psi cold. Boiler outlet setpoint 160°F.

PROJECT / PROPERTY

1234 EXAMPLE STREET

DRAWING TITLE

HYDRONIC HEATING — PIPING & INSTRUMENTATION DIAGRAM

DRAWN BY	DATE	SCALE
D. PANZINO	2026-10-15	NONE

SIZE	DWG NO.	REV	SHEET
B	M-002	A	1 OF 1