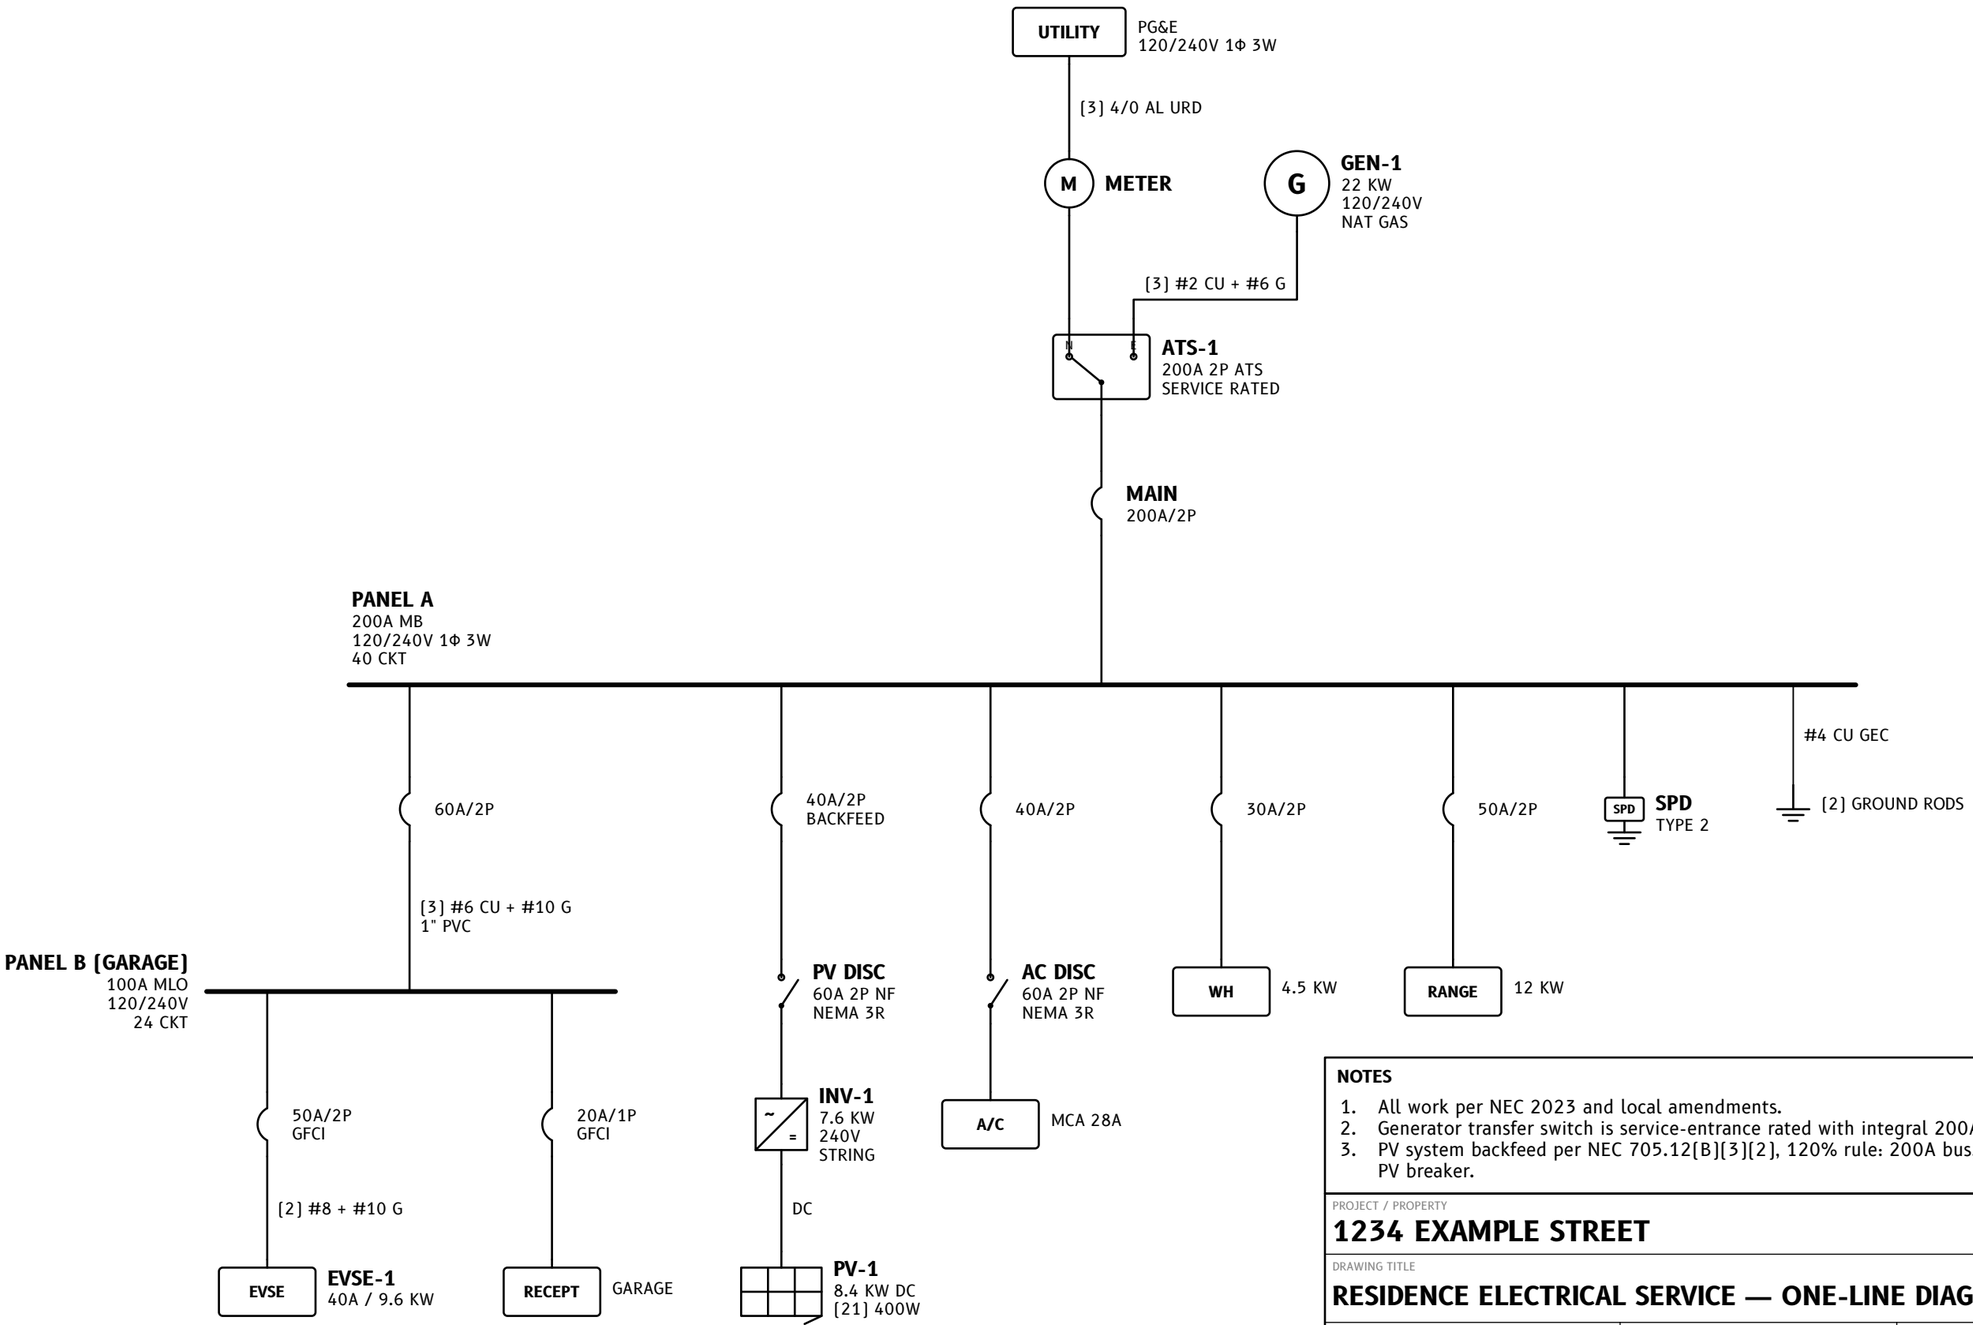

NOTES

1. All work per NEC 2023 and local amendments.
2. Generator transfer switch is service-entrance rated with integral 200A main.
3. PV system backfeed per NEC 705.12[B][3][2], 120% rule: 200A bus, 200A main, 40A PV breaker.

PROJECT / PROPERTY

1234 EXAMPLE STREET

DRAWING TITLE

RESIDENCE ELECTRICAL SERVICE — ONE-LINE DIAGRAM

DRAWN BY	DATE	SCALE
D. PANZINO	2026-10-15	NONE

SIZE	DWG NO.	REV	SHEET
B	E-001	A	1 OF 1