
PANEL DESIGNATION	SERVICE	MAIN	BUS RATING	SPACES
PANEL A - MAIN	120/240V 1Φ 3W	200A MAIN BREAKER	200A	40
LOCATION: GARAGE, NORTH WALL	MANUFACTURER / MODEL: SQUARE D QO140M200	FED FROM: UTILITY METER	CIRCUITS: 28	SPACE USAGE: 32 USED / 8 OPEN

CIRCUIT DESCRIPTION	TRIP	CKT
RANGE / OVEN	40A 2P	1
		3
KITCHEN COUNTERTOP RECEPTACLES (LEFT OF SINK)	20A AFCI/GFCI	5
KITCHEN COUNTERTOP RECEPTACLES (RIGHT OF SINK)	20A AFCI/GFCI	7
DISHWASHER	20A TIED	9
GARBAGE DISPOSAL (MWBC WITH CKT 9)	20A TIED	11
REFRIGERATOR	20A	13
BEDROOM 1	15A AFCI	15
BEDROOM 2	15A AFCI	17
PRIMARY BEDROOM	15A AFCI	19
BATHROOMS RECEPTACLES	20A GFCI	21
LIVING ROOM & DINING ROOM	15A AFCI	23
MICROWAVE	20A	25
SMOKE DETECTORS	15A	27
EV CHARGER (GARAGE)	50A 2P	29
		31
SPACE	—	33
SPACE	—	35
SPACE	—	37
SPACE	—	39

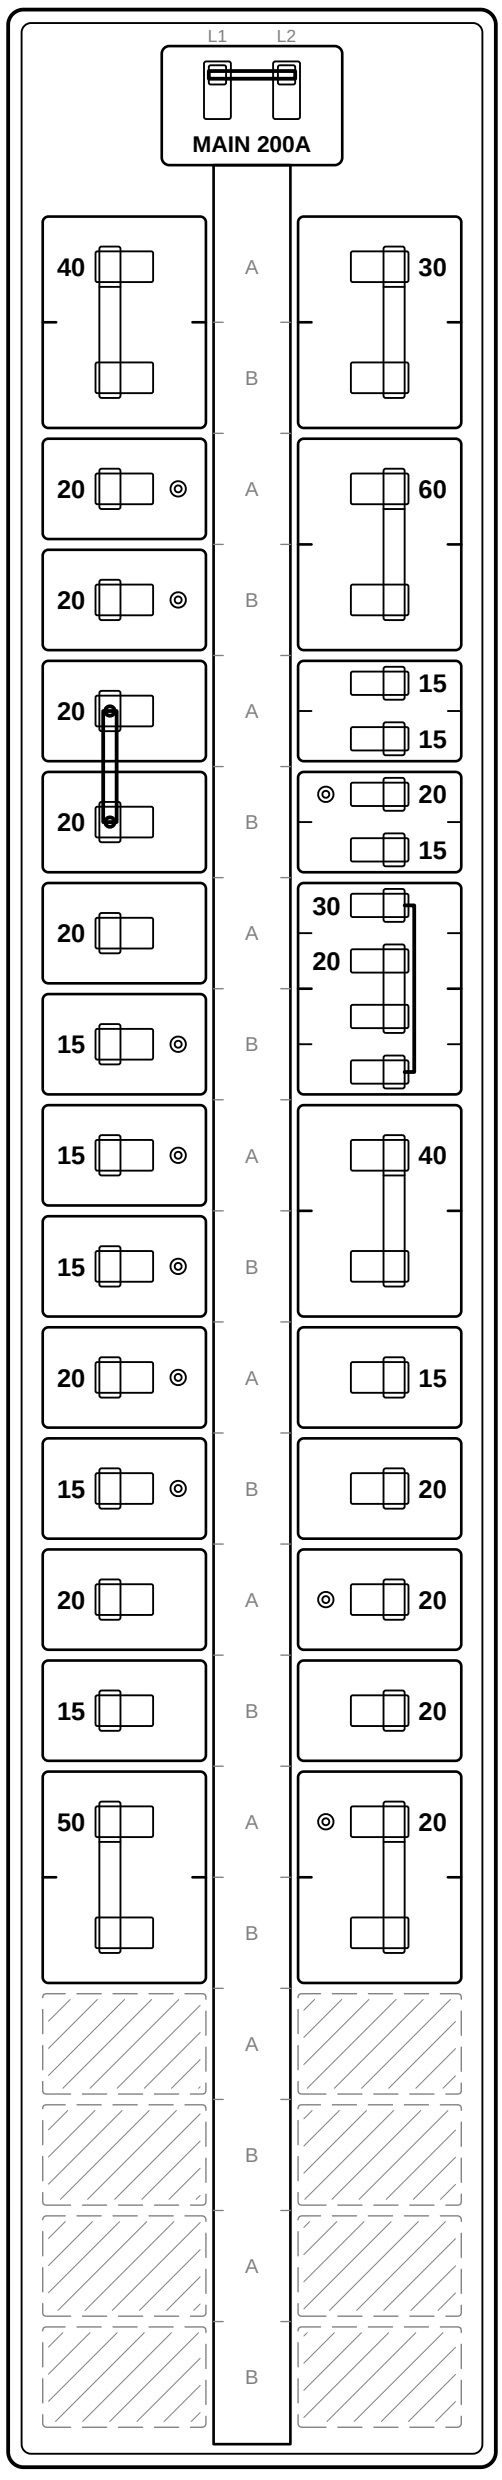

CKT	TRIP	CIRCUIT DESCRIPTION
2	30A 2P	CLOTHES DRYER
4		
6	60A 2P	SUBPANEL B - DETACHED WORKSHOP
8		
10A	15A	HALL & STAIR LIGHTING
10B	15A	FRONT PORCH LIGHTS
12A	20A GFCI	GARAGE RECEPTACLES
12B	15A	GARAGE DOOR OPENER
14A	30A 2P	OUTER 14A/16B WATER HEATER
14B		
16A	20A 2P	INNER 14B/16A WELL PUMP
16B		
18	40A 2P	A/C CONDENSER
20		
22	15A	FURNACE / AIR HANDLER
24	20A	LAUNDRY RECEPTACLE
26	20A GFCI	EXTERIOR RECEPTACLES
28	20A	SPARE
30	20A 2P SURGE	WHOLE-HOUSE SURGE PROTECTOR
32		
34	—	SPACE
36	—	SPACE
38	—	SPACE
40	—	SPACE

NOTES

1. Circuits 9 and 11 are a multi-wire branch circuit sharing a neutral; handle tie required.
2. Verify circuit identification with a circuit tracer before working on any circuit.
3. Grounding electrode: two ground rods, 6 ft apart, at the meter base.

PROJECT / PROPERTY			
1234 EXAMPLE STREET			
DRAWING TITLE			
PANEL A - MAIN — PANEL DIRECTORY			
DRAWN BY: D. PANZINO	DATE: 2026-10-15	SCALE: NONE	
SIZE: **B**	DWG NO.: E-101	REV: **A**	SHEET: 1 OF 2