Efficiency

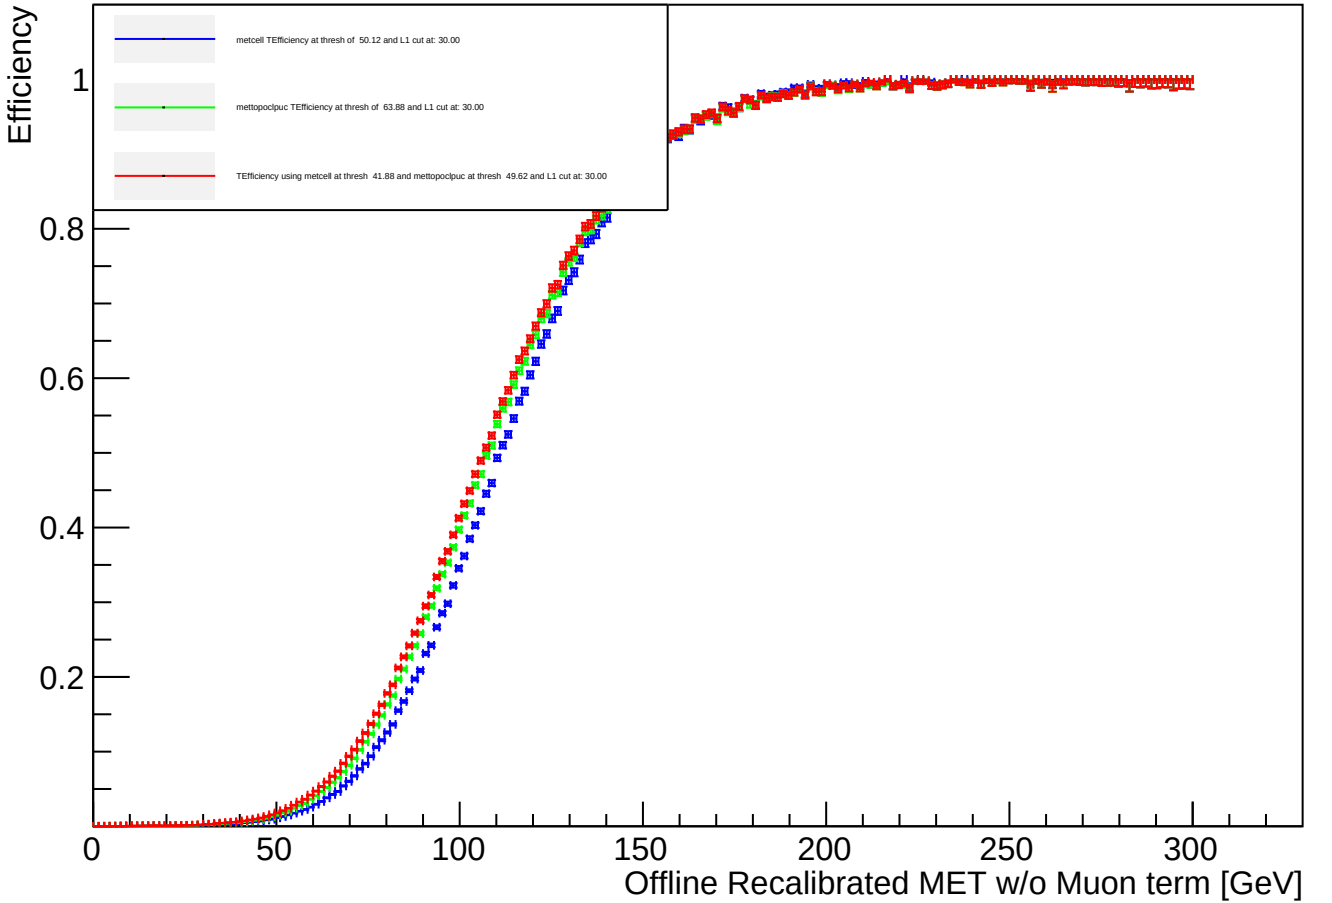
Efficiency
metcell TEfficiency at thresh of 50.12 and L1 cut at: 30.00
mettopoclpuc TEfficiency at thresh of 63.88 and L1 cut at: 30.00
TEfficiency using metcell at thresh 41.88 and mettopoclpuc at thresh 49.62 and L1 cut at: 30.00
1
0.8
0.6
0.4
0.2
0
50
100
150
200
250
300
Offline Recalibrated MET w/o Muon term [GeV]