

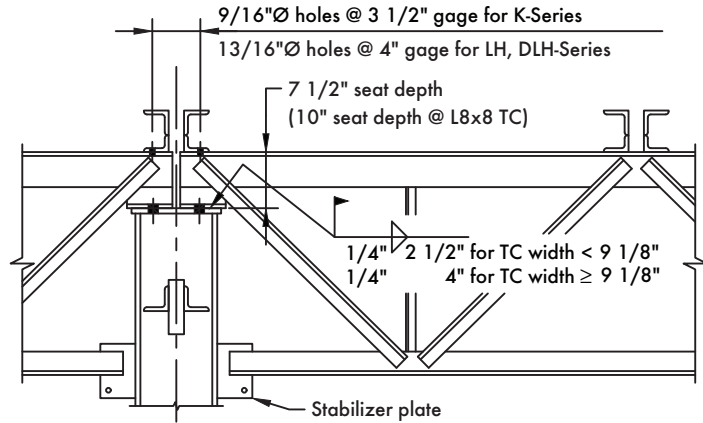
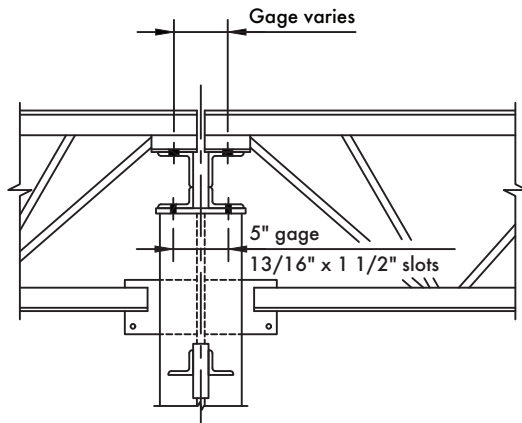
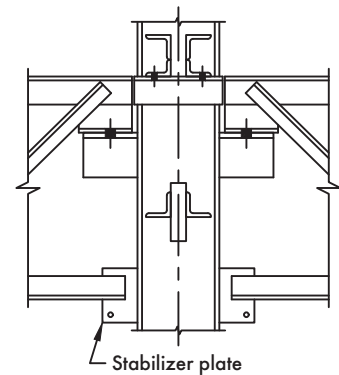


Standard Joist Girder Details and Notes

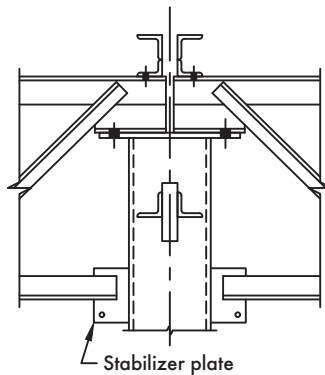


NEW MILLENNIUM STANDARDS FOR JOIST GIRDERS

"TC" indicates Top Chord

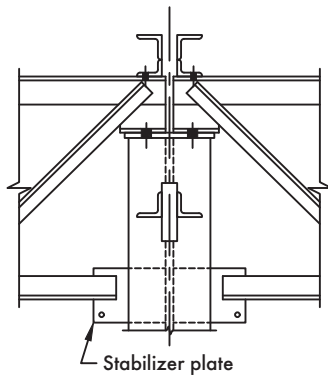

STANDARD COLUMN CONNECTIONS

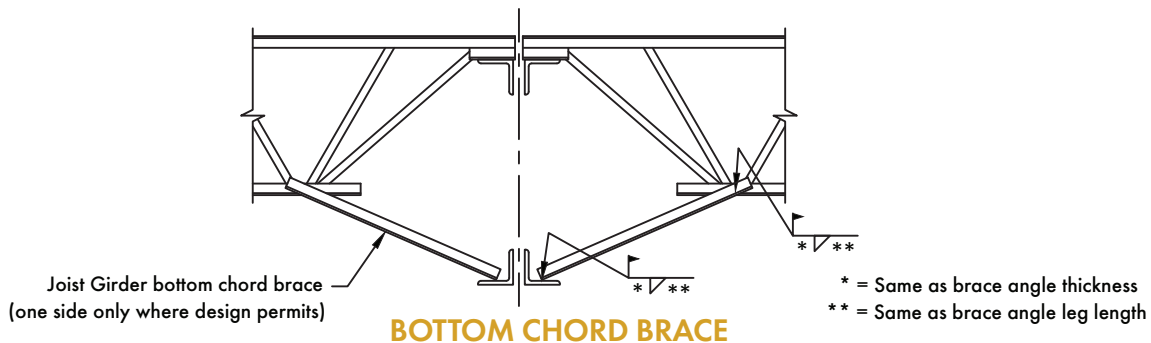

Joist Girder dimensions shown are standard with New Millennium. Under certain conditions changes are necessary and will be noted on the joist placement drawings.

The New Millennium standard connection for Joist Girders to columns is 13/16" x 1 1/2" slots utilizing a 5" gage with ASTM A325 3/4" diameter bolts (bolts are by others). In addition to the bolted connection, welds can also be specified if required to transmit horizontal forces. The final connection shall be made by welding or as designated by the **specifying professional**.

Stabilizer plates (not sized nor provided by New Millennium) are required on the columns located at the bottom chord of the Joist Girder to brace the Joist Girder from overturning during the erection process. Welding the bottom chord to the stabilizer plate should not be done unless required to resist horizontal forces. This should only be done after the dead loads have been applied.

Joists are connected to the Joist Girders by welding except that joists 40' and longer shall be bolted to Joist Girders.

The Joist Girder bottom chord must be braced so that its slenderness ratio about the Y axis does not exceed 240. New Millennium will supply bottom chord braces as required by the design.