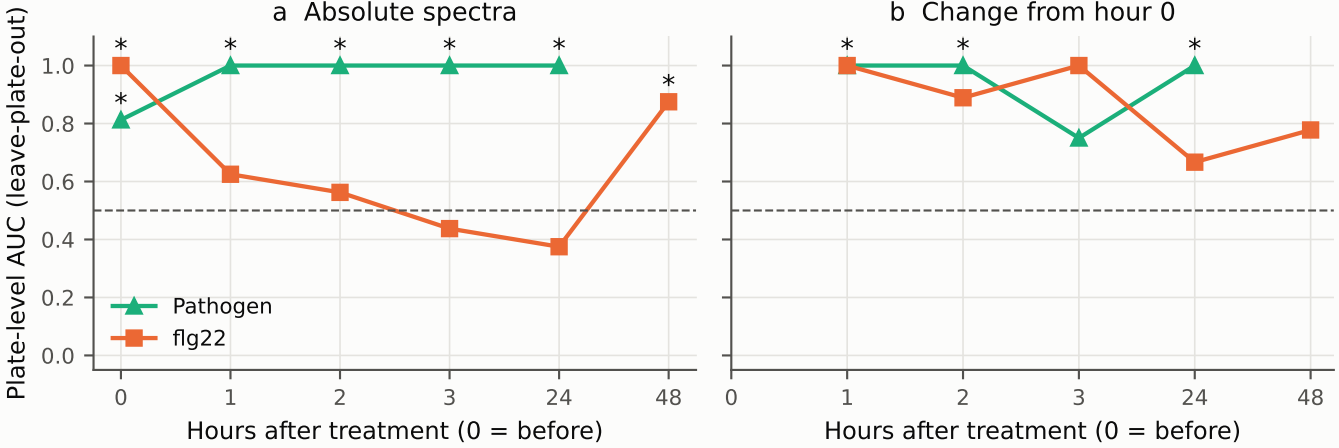
a Absolute spectra
b Change from hour 0
Plate-level AUC (leave-plate-out)
1.0
0.8
0.6
0.4
0.2
0.0
Pathogen
flg22
0
1
2
3
24
48
Hours after treatment (0 = before)
Hours after treatment (0 = before)