

MARKET STRUCTURE MULTI TF CHART

Quick Guide

Rev. 1

CONTENTS

A compact map of the Quick Start Guide. Page numbers below exclude the cover page.

1. GETTING STARTED 2

2. FIRST SETUP 3

3. LEARN THE SCREEN 5

4. ESSENTIAL CONTROLS 13

5. DISPLAY PRESETS 15

6. MULTI-TIMEFRAME 18

7. LABELS YOU WILL SEE 21

8. DAILY USE 23

9. TIPS & BEST PRACTICES 24

10. TRADING TIPS 26

NEXT STEPS 38

FIRST PUBLIC RELEASE

Visualization + alerts + manual decision support. Auto Trading is not available in MS 1.1 Release 1.

1. GETTING STARTED

Install from MQL5 Market and attach MS 1.1

MS 1.1 is purchased from the MQL5 Market. After purchase and activation, choose the installed Expert Advisor or Indicator version in MetaTrader 5. There is no manual file-copy installation step for the normal end user.

Version	Navigator path

FIRST PUBLIC RELEASE

Visualization + alerts + manual decision support. Auto Trading is not available in MS 1.1 Release 1.



2 Example chart after attachment. Visible objects depend on the active timeframe, selected preset, enabled Reference TFs

1.1 Example chart after attachment. The same chart-reading workflow applies to the Expert Advisor and Indicator versions.


Visible objects depend on the active timeframe, selected preset, enabled Reference TFs and the current market state.

2. FIRST SETUP

Wait for the final chart state

After attachment, MS 1.1 prepares chart history, the Main TF structure and any enabled Reference TF context. Do not judge the chart while an update cycle is still running.

History and alert categories are configured from MS 1.1 Inputs. HistoryRenderBars is 250 bars by default. Pattern and Structure notifications can be enabled independently, while the panel ALERTS switch remains the Master delivery control.

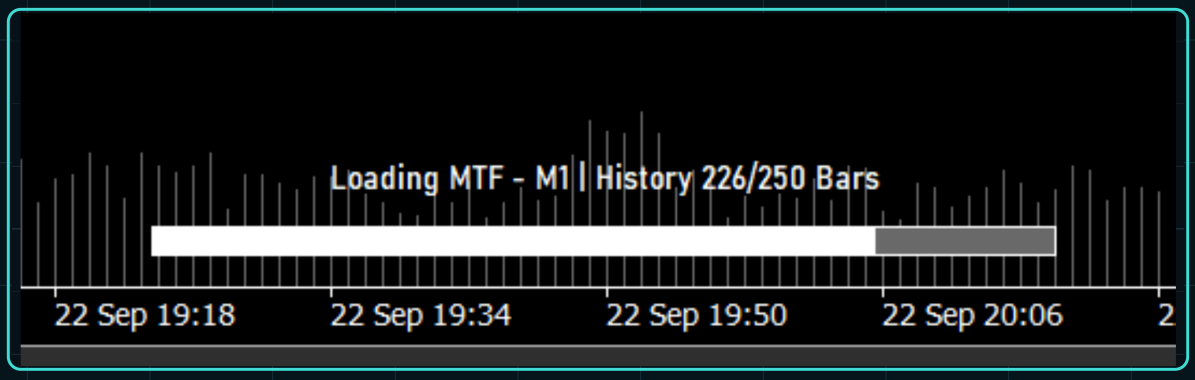

2.1 First-load history progress. Wait until loading completes; MS 1.1 is still building the required chart state.


2.2 Public MS 1.1 Inputs

Input	Default	Purpose
HistoryRenderBars	250	History depth used for rendering/rebuilds.
MS_EnablePatternAlerts	true	Pattern-notification category ON/OFF.
MS_EnableStructureAlerts	true	Structure-notification category ON/OFF.
MS_EnableTelegramAlerts	true	Allows eligible alerts to be mirrored to Telegram.
MS_TelegramChatID	blank	Your numeric Telegram Chat ID.
MS_TelegramSendTestOnInit	false	Use true for the first Telegram connection test, then false.

Important - alert controls

Pattern Alerts and Structure Alerts are separate category switches in MS 1.1 Inputs. They control notification delivery only; they do not disable chart calculations. For normal live delivery, the panel ALERTS Master must also be ON. Telegram setup is covered in the separate MS 1.1 Telegram Alerts User Guide.

2.3 COMPLETED CHART STATE

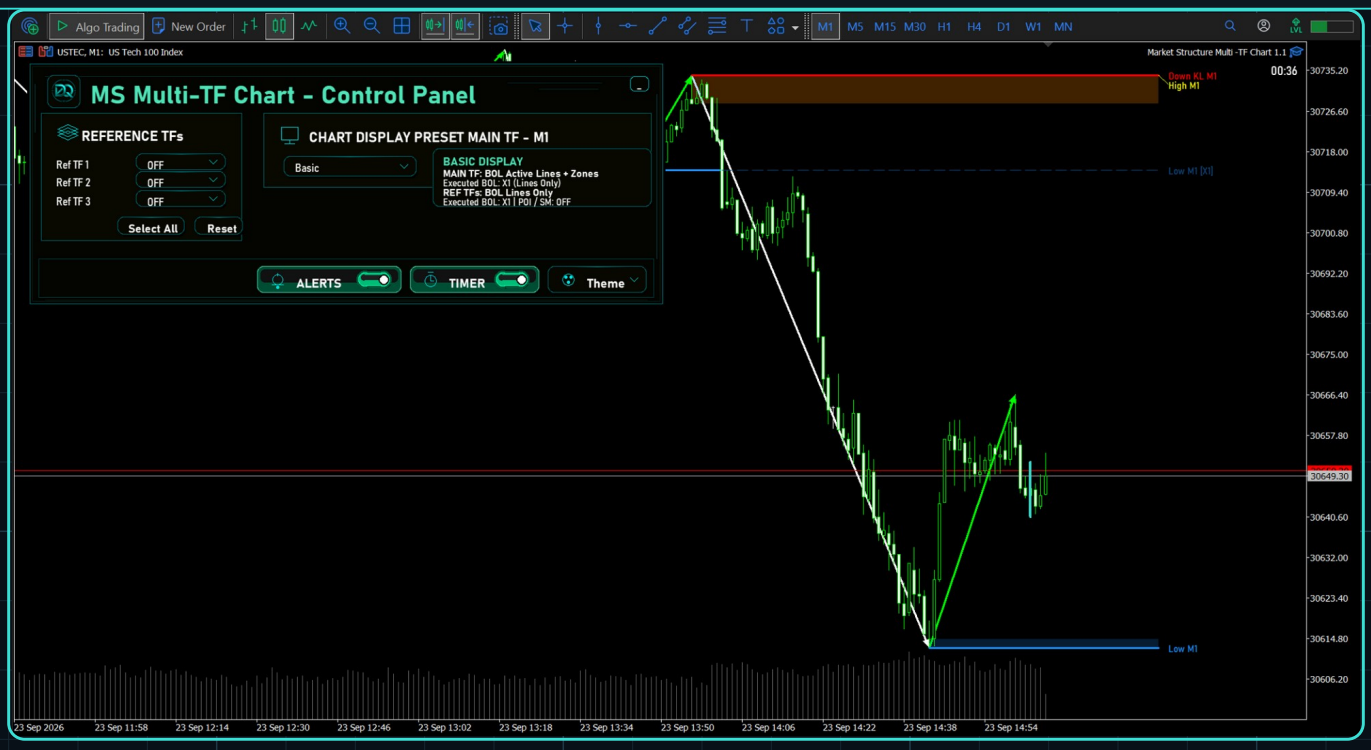

Once loading and synchronization are complete, the final chart state can include trend structure, levels, labels, active zones and any enabled Reference TF context. A clean chart may still show only a few objects; MS 1.1 displays the structure that currently exists.

3. LEARN THE SCREEN

Your Chart in 60 Seconds

Use this reading map to identify the information layers you will use repeatedly.

#	What it points to	How to read it
1	Trend arrows	Accepted directional structure chain.
2	BOL / key levels	Structural breakout-validation references.
3	POI / SM areas	Demand / Supply areas from confirmed structure.
4	Right-side object stack	Object type, source timeframe and lifecycle.
5	Reference-timeframe context	Additional timeframe structure overlaid on the Main TF.
6	Range	Active containment structure and Range BO context.

READING ORDER

Trend -> Range -> BOL -> nearest POI/SM -> Reference TF context -> alerts/patterns.

3.1 TREND ARROWS




HOW IT IS CREATED

Created when MS 1.1 confirms a new directional structural leg. The arrow connects accepted structural pivots and shows the committed UP or DOWN direction.

WHAT TO NOTICE

Read the confirmed arrow chain first. A confirmed leg can extend only when a stronger valid endpoint appears.

3.2 BOL / KEY LEVELS

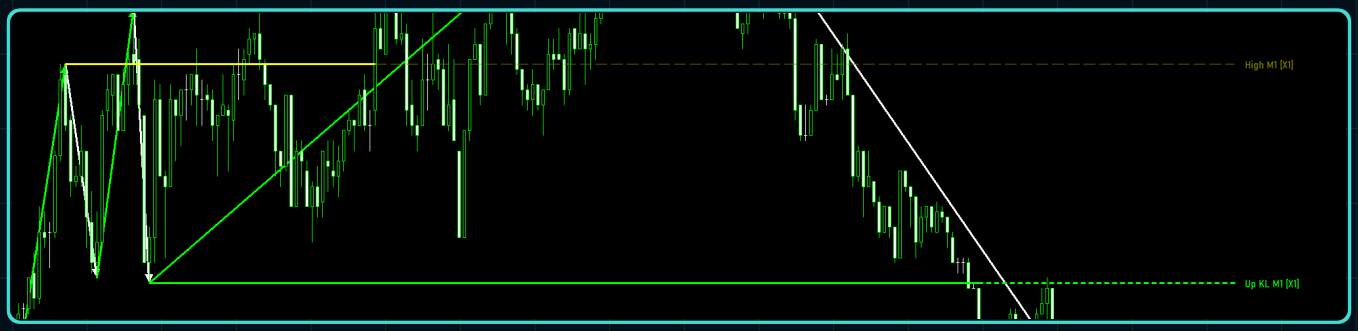

HOW IT IS CREATED

BOL (Break of Level) is the structural line MS 1.1 watches to decide whether price has genuinely broken an important level. Price touching or wicking through it is not enough; the required closed-candle confirmation must pass.

WHAT TO NOTICE

BOL can represent Current High/Low, Key Level, a POI boundary or Range High/Low breakout context.

3.3.1 POI / SM AREAS



HOW IT IS CREATED

POI areas are created from confirmed Demand / Supply structure. A stronger qualifying POI can be upgraded to SM when the stricter SM conditions are satisfied.

WHAT TO NOTICE

Zones are context, not stand-alone signals. Read them with Trend, Range and the nearest structural level.

3.3.2 POI / SM AREAS



HOW IT IS CREATED

The same POI / SM logic can create several visible areas at different structural prices. Labels identify direction, source timeframe and lifecycle state.

WHAT TO NOTICE

Fresh and historical depth depends on the active preset or Custom settings.

3.4 RIGHT-SIDE OBJECT STACK




HOW IT IS CREATED

The label rail is created from the objects currently displayed on the chart. Each label identifies the object and source timeframe and, where applicable, its lifecycle depth.

WHAT TO NOTICE

Read the labels closest to current price first, then move outward through the stack.

3.5 REFERENCE-TIMEFRAME CONTEXT

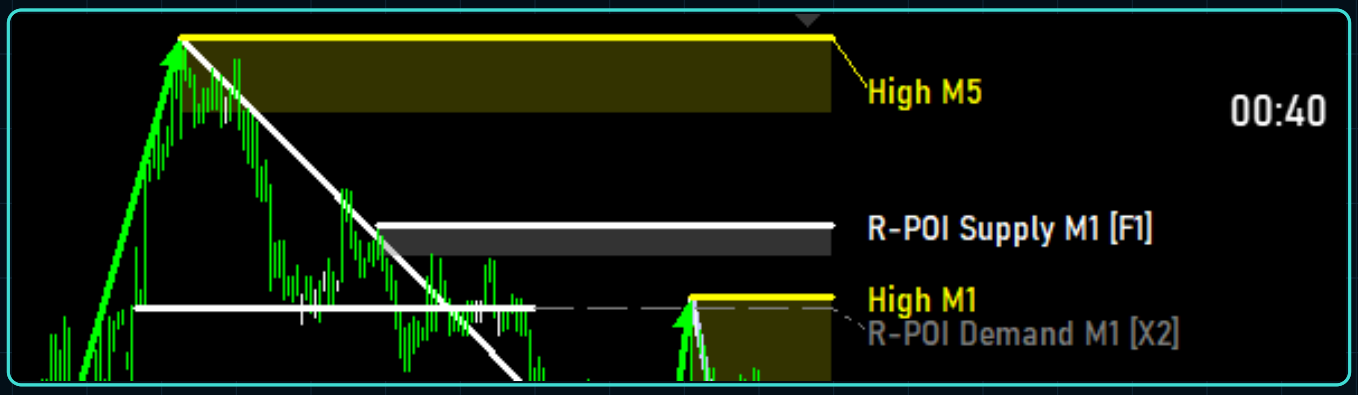


HOW IT IS CREATED

Created when a Reference TF is enabled. MS 1.1 calculates that additional timeframe and overlays its confirmed structure on the active Main TF chart.

WHAT TO NOTICE

The timeframe in each label tells you where that structure comes from. A higher timeframe is a common use case, but a Reference TF is simply an additional selected timeframe.

3.6 RANGE

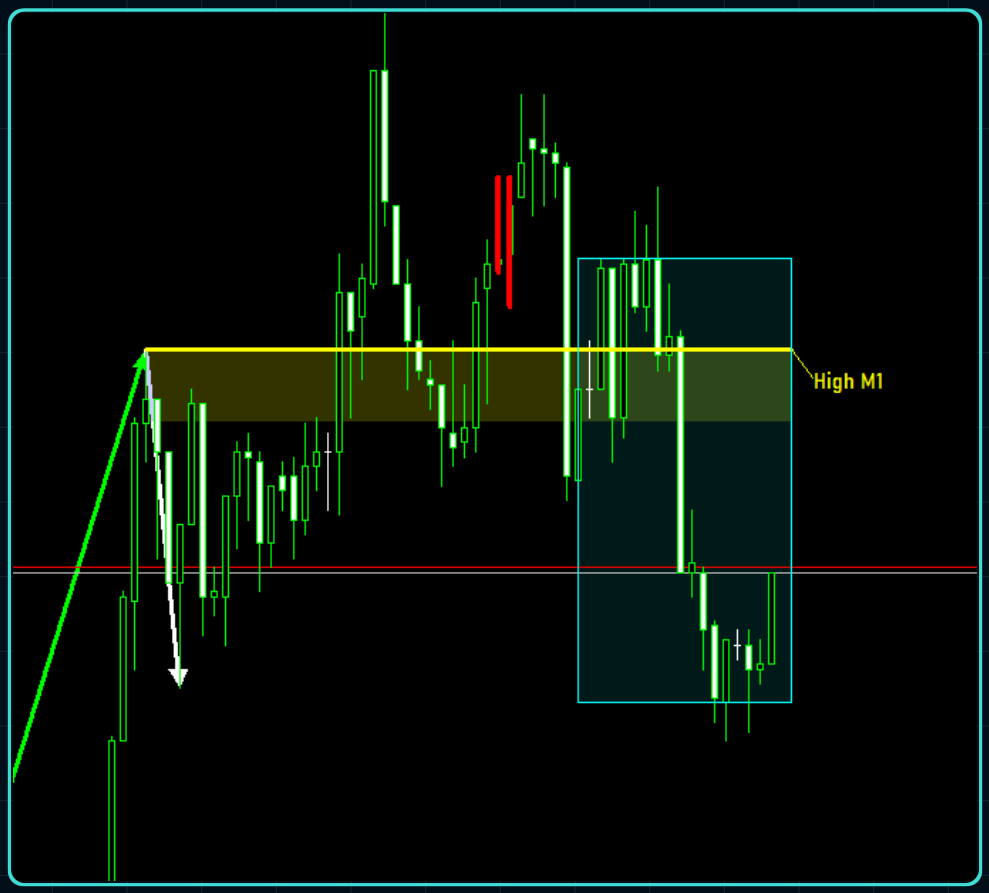

HOW IT IS CREATED

Created when the Range state machine confirms a valid containment structure. The visible Range is tracked until it shifts or a valid Range breakout is confirmed.

WHAT TO NOTICE

A wick outside that closes back inside can be a sweep / fake breakout rather than a valid Range BO.

RANGE HIGH / LOW LABELS - RH / RL


RH = Range High: the upper boundary of the active Range.

RL = Range Low: the lower boundary of the active Range.

These are Range boundaries, not the ordinary structural High / Low levels.

4. ESSENTIAL CONTROLS


Control Panel Essentials

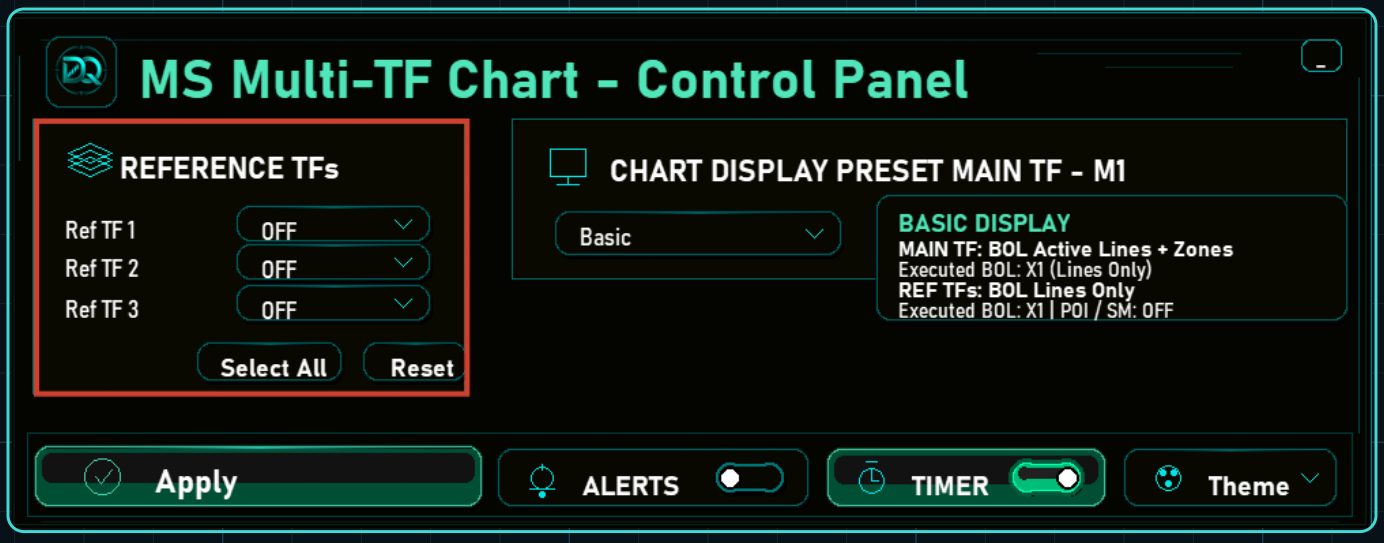

4.1 Reference TF block. Ref TF1, Ref TF2 and Ref TF3 choose additional timeframes to use as Reference TFs. Leave a slot OFF when you do not want that timeframe.

IMPORTANT - REFERENCE TF ZONES

Selecting a Reference TF here selects the timeframe only. It does not automatically turn on its zones. For Reference-TF BOL / POI / SM zone control, switch to Custom and enable the required Zone toggles for that Ref TF.

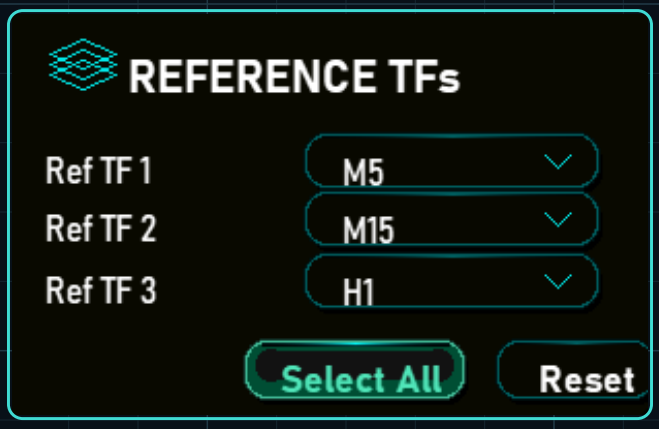

4.2 Example Reference TF selection. M5, M15 and H1 are examples. Choose Reference TFs that add useful context relative to the current Main TF.

4.3 SELECT ALL / RESET & 4.4 GLOBAL CONTROLS



4.3 Select All and Reset. Select All applies the available selections across the current Reference TF setup. Reset clears the current selection state.

4.4 Apply, Alerts, Timer and Theme

Press Apply after changing settings. ALERTS is the Master notification switch. Timer toggles the current-candle timer and Theme changes the panel appearance.

Alert delivery - quick logic

Pattern Input	Structure Input	Panel ALERTS	Normal result
ON	ON	OFF	No Pattern/Structure alert delivery
ON	OFF	ON	Pattern alerts only
OFF	ON	ON	Structure alerts only
ON	ON	ON	Both categories can alert


Remember

The two category switches are MS_EnablePatternAlerts and MS_EnableStructureAlerts in MS 1.1 Inputs. Turning a category OFF suppresses notifications for that category, not the underlying calculations. Telegram mirrors eligible alerts only when Telegram Alerts is enabled/configured. For Telegram setup, see the separate Telegram Alerts User Guide.


5. DISPLAY PRESETS

Choose the Right Preset

MS 1.1 provides five display modes: Basic, Performance, Standard, Full and Custom. Start with Standard for a balanced everyday view, then reduce or add detail as needed.

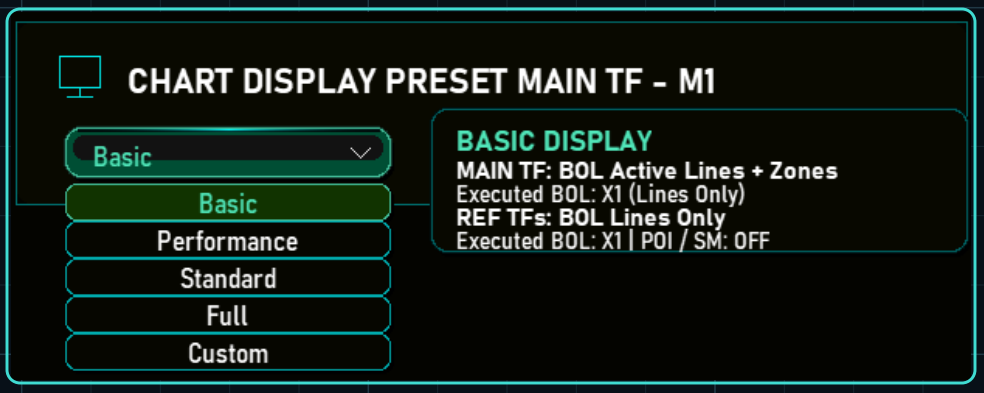


5.1 Basic display. The cleanest preset, focused on active BOL context for a minimal structure view.

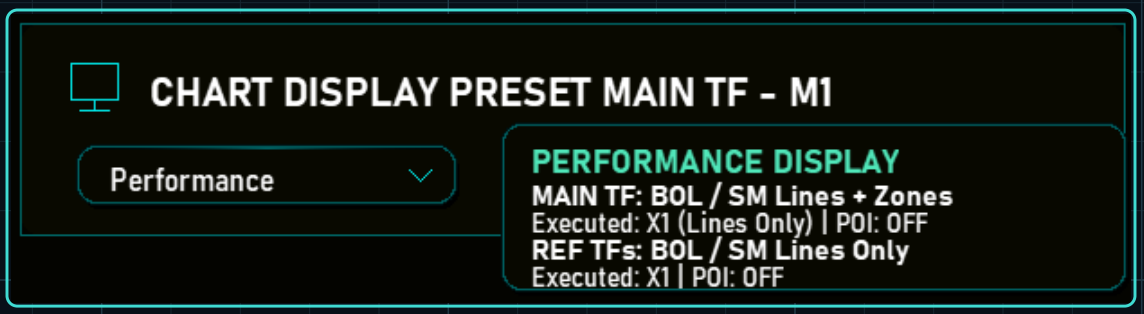


5.2 Performance display. Adds SM visibility while remaining lighter than richer presets.

5.3 STANDARD / 5.4 FULL / 5.5 CUSTOM

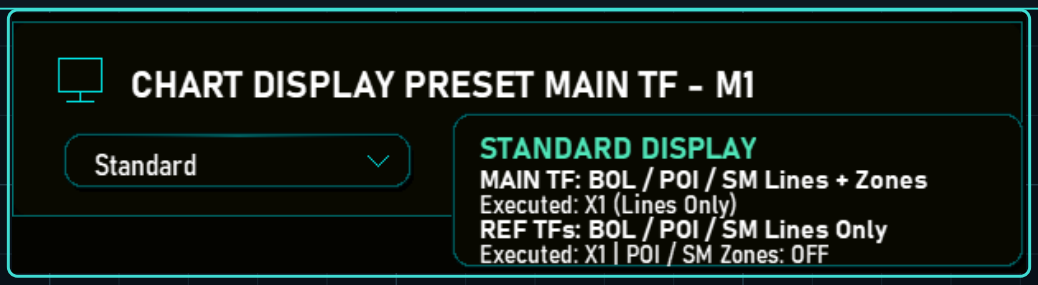

5.3 Standard. Adds POI alongside BOL and SM. This is the balanced everyday view.

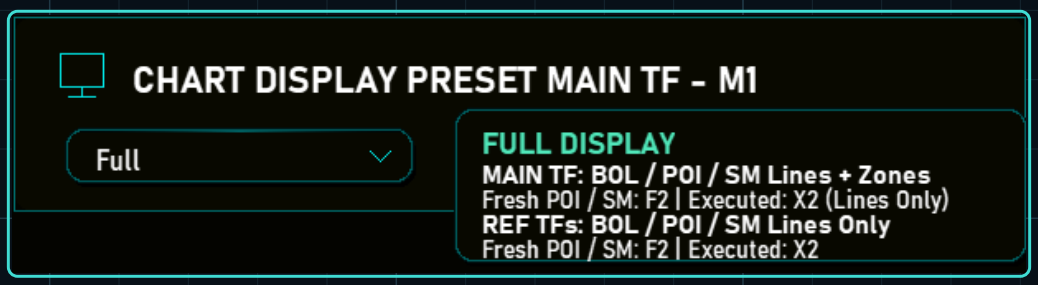


5.4 Full. Shows the deepest standard structure context with richer fresh / executed visibility.



5.5 Custom. Opens manual object controls for both the Main TF and Reference TF slots.

5.6 MAIN-TF CUSTOM CONTROLS

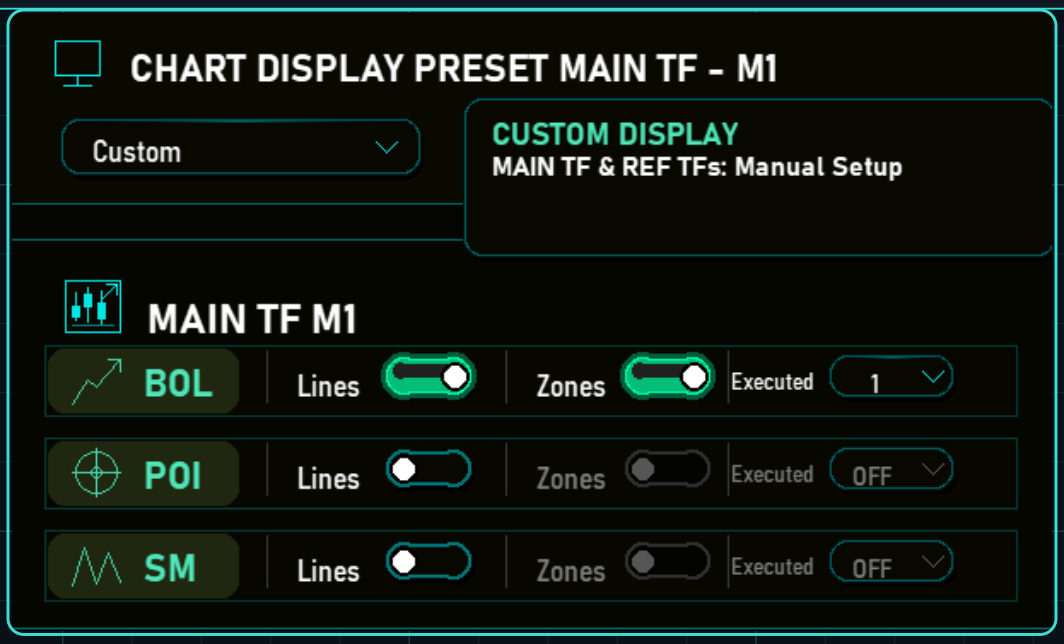

In Custom mode, BOL, POI and SM can be controlled separately on the Main TF. Each block has Lines and Zones toggles plus an Executed selector.


EXECUTED SELECTOR

Executed means the structure line / zone has already been broken by price and is retained as historical context. OFF hides this broken history. X1 / X2 (or selector 1 / 2) controls how much executed / historical depth is shown. It does **not** mean that a market order was executed.

6. MULTI-TIMEFRAME


Main TF and Reference TFs

The Main TF is the active MetaTrader chart timeframe. Reference TFs add structure from additional selected timeframes on the same chart so local execution context and broader structure can be read together. A higher timeframe is a common use case, but Reference TF does not inherently mean higher timeframe.

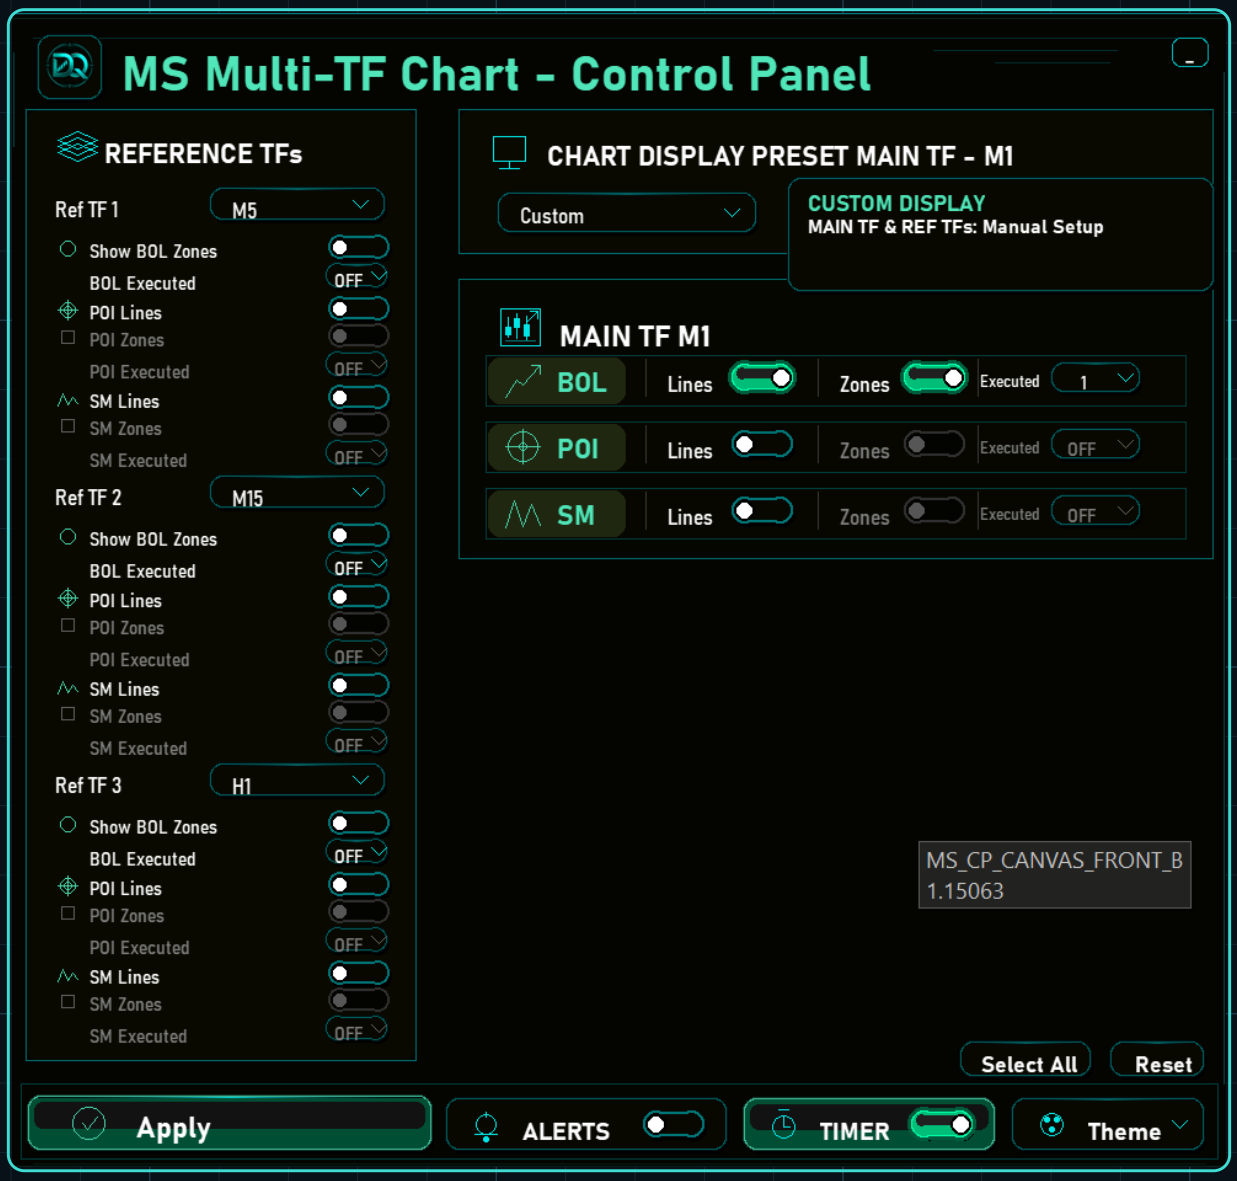


6.1 Main TF + active Reference TFs. Custom mode can show the Main-TF controls and enabled Reference-TF controls together.

6.2 EXPANDED REFERENCE-TF CONFIGURATION

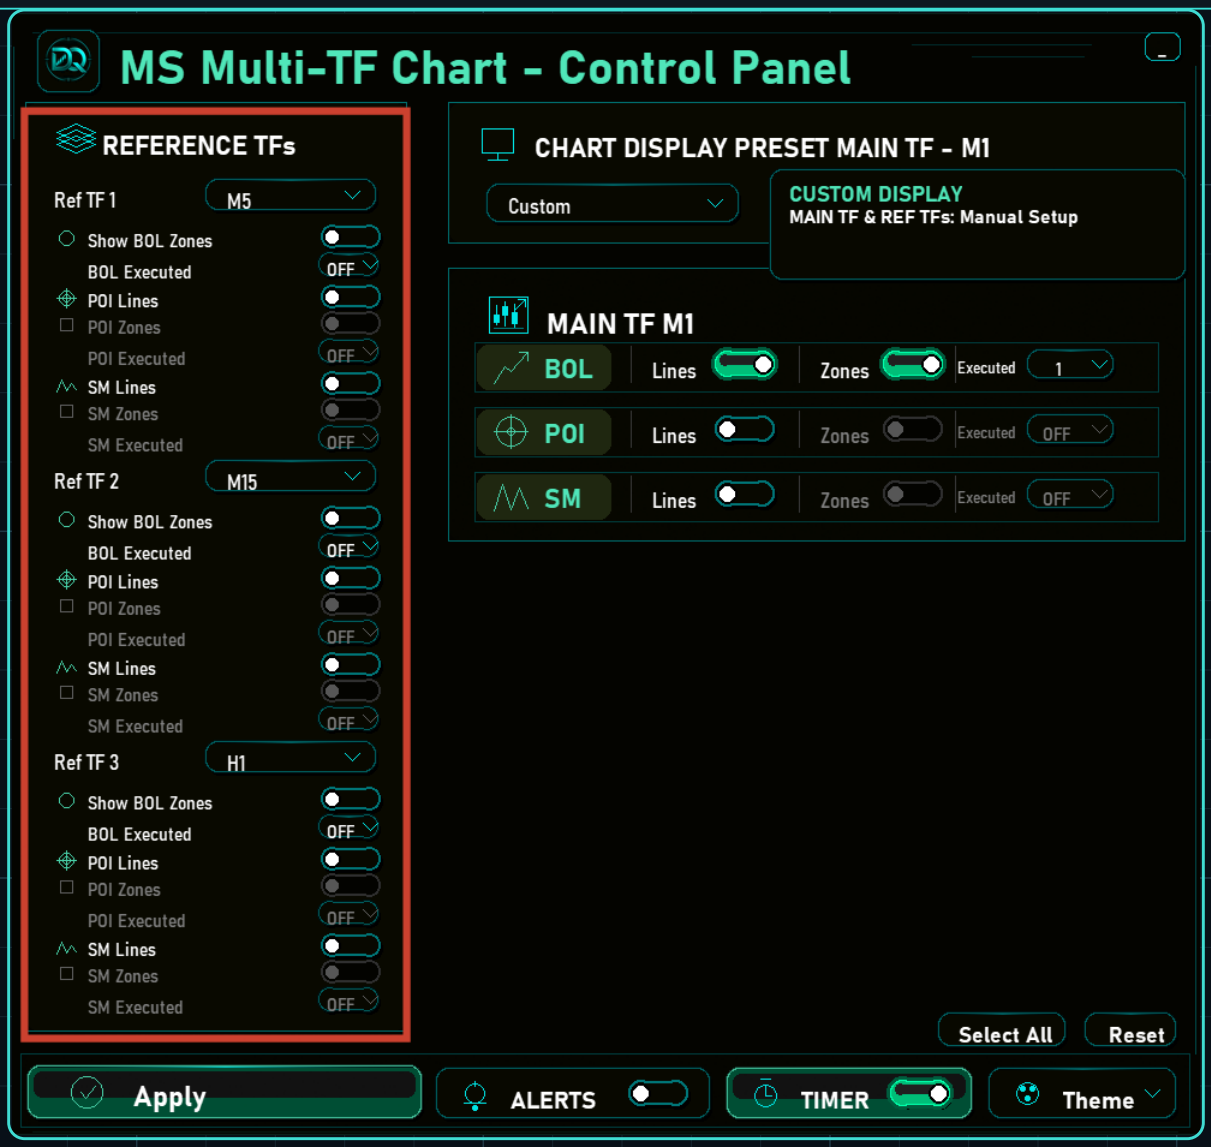


For each Reference TF slot, Custom mode lets you choose BOL Zones / Executed, POI Lines / Zones / Executed and SM Lines / Zones / Executed independently.

6.3 FULL CUSTOM VIEW

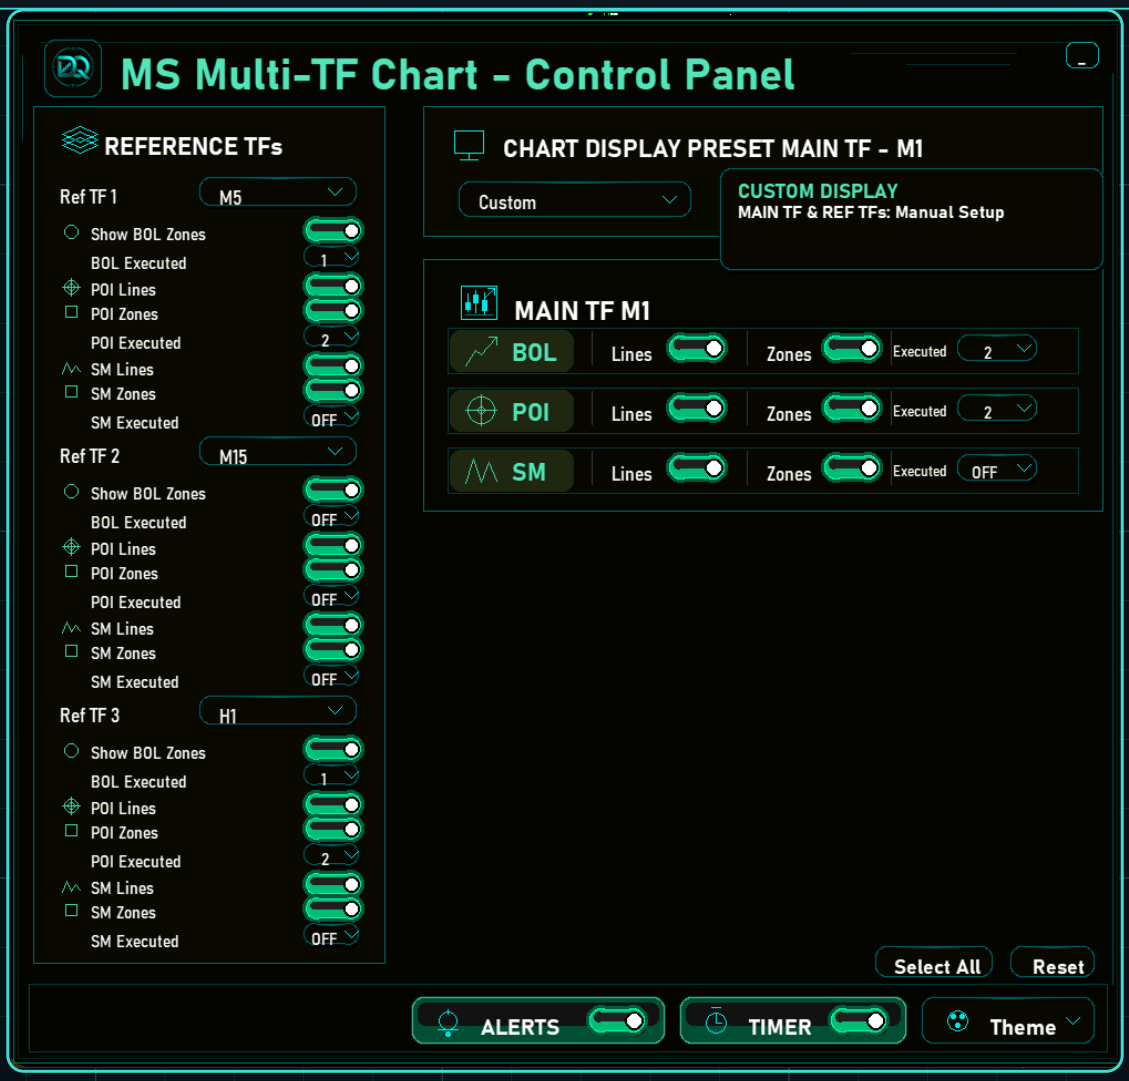

Use Custom when presets are not specific enough. This view gives direct per-object control for the Main TF and enabled Reference TFs, including zones.

6.4 REFERENCE-TIMEFRAME LABELS ON MAIN TF

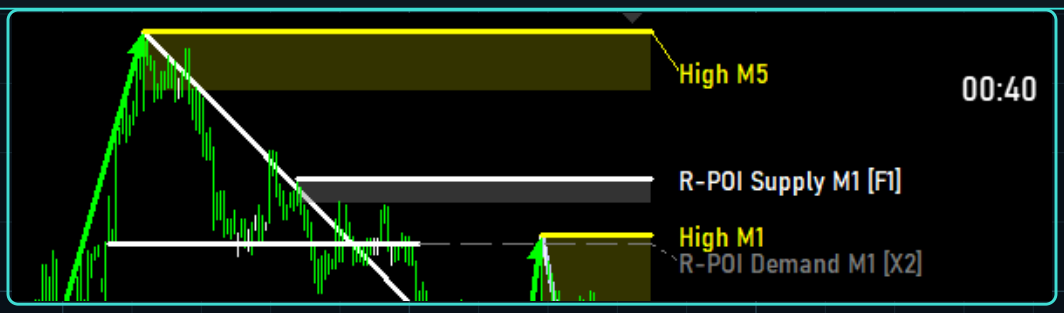

Read the source timeframe directly from the label (for example M5, M15 or H1) and compare it with the current Main TF. The label timeframe tells you where the structure was calculated; Reference-TF objects are simply overlaid on the Main-TF chart for context. **R- does not mean Reference TF.** R- marks an object created after a confirmed Range Breakout.

7. LABELS YOU WILL SEE

Object names, timeframe and lifecycle


The right-side label rail tells you what an object is, which timeframe it comes from and, where applicable, its lifecycle state. Read the nearest labels around current price first.

Label	Definition
High / Low	Structural High / Low level used by the market-structure engine.
Up KL	Bullish Key Level associated with upward structure.
Down KL	Bearish Key Level associated with downward structure.
POI Demand	Demand Point of Interest - structural origin area on the demand side.
POI Supply	Supply Point of Interest - structural origin area on the supply side.
R-POI Demand / Supply	POI created after a confirmed Range Breakout. R- does NOT mean Reference TF.
SM	Smart Money Structure - a stricter qualified POI class.
SM*	Premium / sweep-confirmed SM variant where supported.
M1 / M5 / M15 / H1 ...	Source timeframe of the object.
F1 / F2	Fresh visible-depth slot.
X1 / X2	Executed / historical visible-depth slot; the structure has already been broken.
Range / R-BO	Active Range structure / confirmed Range Breakout context.
RH / RL	Range High (upper boundary) / Range Low (lower boundary).

IMPORTANT DISTINCTION

RH/RL belong to the active Range. High / Low belong to the structural level family.
The R- prefix means post-Range-breakout and is NOT the same as RH/RL.

7.1 HOW TO READ A LABEL

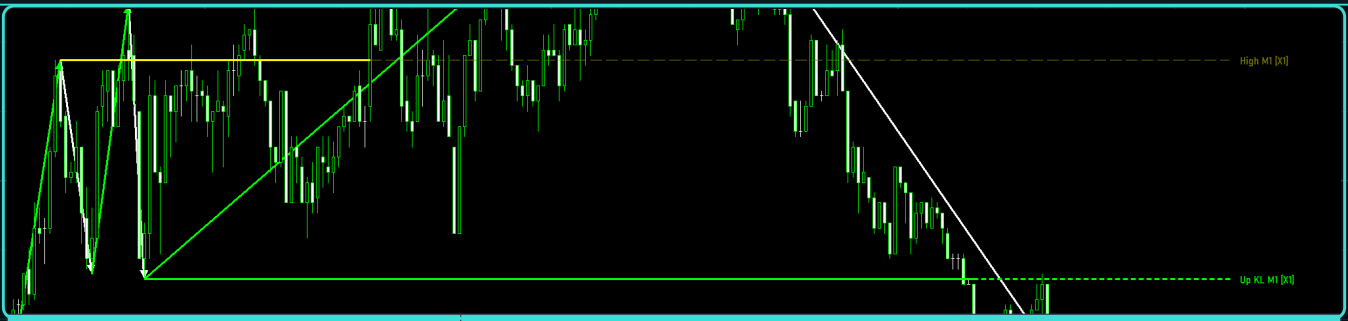

Example	Read it as
High M5	Structural High calculated from M5.
Up KL M1 [X1]	Bullish Key Level from M1 retained as executed / historical depth 1.
POI Demand M1 [F1]	Fresh Demand POI from M1, fresh slot 1.
R-POI Supply M1 [F1]	Fresh Supply POI created after a confirmed Range BO on M1.
SM Supply M15 [X2*]	Premium / sweep-confirmed SM Supply from M15 in executed / historical depth 2.

QUICK RULE

[R- after Range BO] + [Object / direction] + [Timeframe] + [Lifecycle]. Not every label uses every part.

ADDITIONAL LABEL EXAMPLES

RH M1: active Range High boundary from M1.
RL M1: active Range Low boundary from M1.
Unlike a generic High / Low, these labels identify the active Range limits.

8. DAILY USE

A Simple Daily Workflow

1. Attach the installed MS 1.1 Expert Advisor or Indicator version from Navigator.
2. Expert Advisor path: Navigator > Expert Advisors > Market. Indicator path: Navigator > Indicators > Market.
3. Wait for the loading / synchronization cycle to finish.
4. Choose a preset (Standard is a practical starting point).
5. Enable only the Reference TFs you really want to see.
6. Press Apply after changing settings.
7. Read the chart in order: Trend -> Range -> BOL -> nearest POI/SM -> Reference TF context.
8. Use alerts as assistance. Pattern/Structure category delivery is controlled from MS 1.1 Inputs and the panel ALERTS Master.
9. For Telegram Alerts, see the MS 1.1 Telegram Alerts User Guide.

Same workflow for both versions

The Expert Advisor and Indicator versions use the same market-structure reading workflow, presets, Reference-TF logic and public MS 1.1 Inputs described in this guide.

9. TIPS & BEST PRACTICES

Practical habits for a cleaner, faster workflow

9.1 Wait for the chart to finish updating
Do not judge missing lines, zones or labels while MS 1.1 is still loading or synchronizing. Evaluate the chart only after the update cycle has completed.

9.2 Start simple
Begin with Standard and one useful Reference TF. Add more structure only when the extra information answers a specific question.

9.3 Use Custom when you need zones
The basic Reference TF selector chooses the timeframe. For individual BOL / POI / SM Lines, Zones and Executed visibility, switch to Custom mode.

9.4 Use the same reading order every time
Trend -> Range -> BOL -> nearest POI/SM -> Reference TF context -> alerts/patterns.

9.5 Read the nearest structure first
When many labels are visible, start with the objects closest to current price and then move outward through the label stack.

9.6 - 9.10 PRACTICAL WORKFLOW TIPS

9.6 Remember what R- means

R- identifies structure created after a confirmed Range Breakout. It does not mean Reference TF. The timeframe is shown separately by M1, M5, M15, H1 and so on.

9.7 Keep space on the right side of the chart

Use Chart Shift and a sensible zoom level so the label rail and connectors remain readable and do not crowd live candles.

9.8 Do not overload the chart

If the chart becomes difficult to read, reduce Reference TF count or historical depth before adding more objects.

9.9 Allow synchronization after major changes

After changing timeframe or symbol, wait for normal synchronization to finish. After the computer resumes from sleep, MS 1.1 clears the previous runtime chart state and reloads the last applied panel setup from current broker history using the configured HistoryRenderBars. The Main TF and enabled Reference TFs load again; wait for the final committed state before judging the chart.

9.10 Use alerts as assistance

For Telegram Alerts, see the MS 1.1 Telegram Alerts User Guide.

BEST STARTING SETUP

Standard + 1 useful Reference TF. Keep the chart clean first. Add more Reference TFs or Custom detail only when needed.

10. TRADING TIPS

How to read directional bias from market structure

10.1 Start with directional bias

Read the confirmed Trend chain first. A sequence of accepted UP arrows supports a bullish structural bias; accepted DOWN arrows support a bearish structural bias. Do not flip bias because of one opposite candle.

10.2 Check whether a Range is active

Price inside an Active Range is a waiting / neutral state. A valid Range BO UP strengthens upside structure; a valid Range BO DOWN strengthens downside structure. A wick outside that closes back inside is not a confirmed Range BO.

10.3 Use BOL as the next decision point

BOL is an important structural line that MS 1.1 watches for a real break. Price can touch or wick through the line without confirming anything. When the required closed-candle confirmation passes beyond the relevant BOL, the system can accept the breakout and update the structure.

10.4 Read price relative to POI / SM

Reaction from Demand while structure is bullish supports upside. Rejection from Supply while structure is bearish supports downside. A strong opposing zone directly ahead is an obstacle and should reduce directional confidence.

10.5 - 10.8 BUILDING A STRONGER DIRECTIONAL CASE

10.5 Check Reference TF alignment
Example: M1 bullish + M5 bullish + Demand from an additional reference timeframe below price gives stronger bullish context. If M1 is bullish but M15/H1 is bearish or strong Supply sits directly above, the lower-TF rise may be only a correction.

10.6 Separate continuation from reversal
An opposite arrow alone does not guarantee a full reversal. A stronger reversal case needs a real structural change: important level break -> new opposite structure -> continuation in the new direction.

10.7 Bullish bias checklist
Trend UP + no blocking Active Range (or Range BO UP) + bullish BOL confirmation + Demand support + Reference TF alignment + no major Supply immediately above.

10.8 Bearish bias checklist
Trend DOWN + no blocking Active Range (or Range BO DOWN) + bearish BOL confirmation + Supply rejection + Reference TF alignment + no major Demand immediately below.

10.9 - 10.10 WHEN TO ACT - AND WHEN TO WAIT

10.9 When NOT to choose a direction
Do not force a bullish or bearish bias when Range is active, Main TF and Reference TFs strongly conflict, price is trapped between nearby Demand and Supply, or the chart is still synchronizing.

10.10 The 10-second reading formula
TREND -> RANGE -> BOL -> POI/SM -> REF TF -> DIRECTIONAL BIAS. Use this order before considering alerts or patterns.

BULLISH BIAS

UP structure + bullish breakout + Demand support + supportive Reference TF context.

BEARISH BIAS

DOWN structure + bearish breakout + Supply rejection + supportive Reference TF context.

WAIT

Active Range or strong multi-timeframe conflict = do not force a directional call.

Directional bias is not a price guarantee. MS 1.1 organizes confirmed market structure and context. Treat the result as a structural probability framework, not certainty or a stand-alone trading signal.

10.11 FULL MARKET-STRUCTURE WALKTHROUGH

The following screenshots show one continuous scenario containing bullish structure, an active containment / Range phase, upside breakout, fresh post-Range-BO structure, rejection from Supply, bearish structure and a later bullish recovery. The point is to read the **sequence**, not one isolated candle.

HOW TO READ THE SEQUENCE


At every step use the same order: Trend -> Range -> BOL -> nearest POI/SM -> Reference TF context -> directional bias.

10.11.1 STEP 1 - STRUCTURE IS STILL CONTAINED BELOW SUPPLY




The chart shows a prior UP leg followed by a sharp DOWN leg to a lower structural Low. Price then recovers, but it is still trading below the nearby **POI Supply M1 [X1]** / High area and well below the upper **Down KL M1**. The important point is that bullish recovery alone is not yet a confirmed upside break. The surrounding levels define the next decision area.

10.11.2 STEP 2 - BULLISH EXPANSION REACHES THE UPPER STRUCTURE

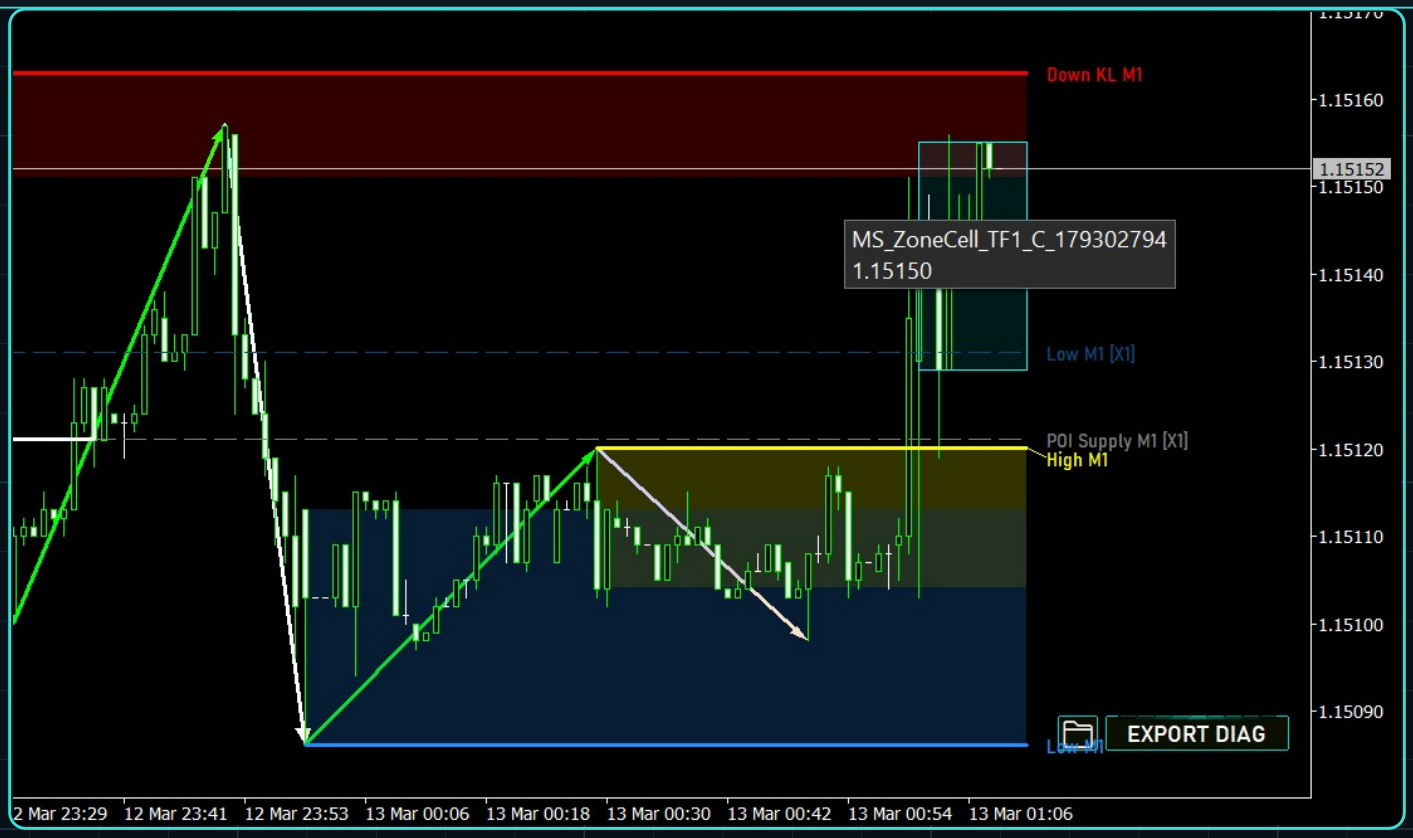

Price accelerates upward from the lower structure and pushes through the previously visible local containment. It trades back above the historical **Low M1 [X1]** and approaches the upper Key-Level / Supply area. This is where the BOL logic becomes important: the move is strong, but the system still needs the required confirmation through the relevant structural line.

10.11.3 STEP 3 - UPPER BOL / KEY LEVEL IS TESTED

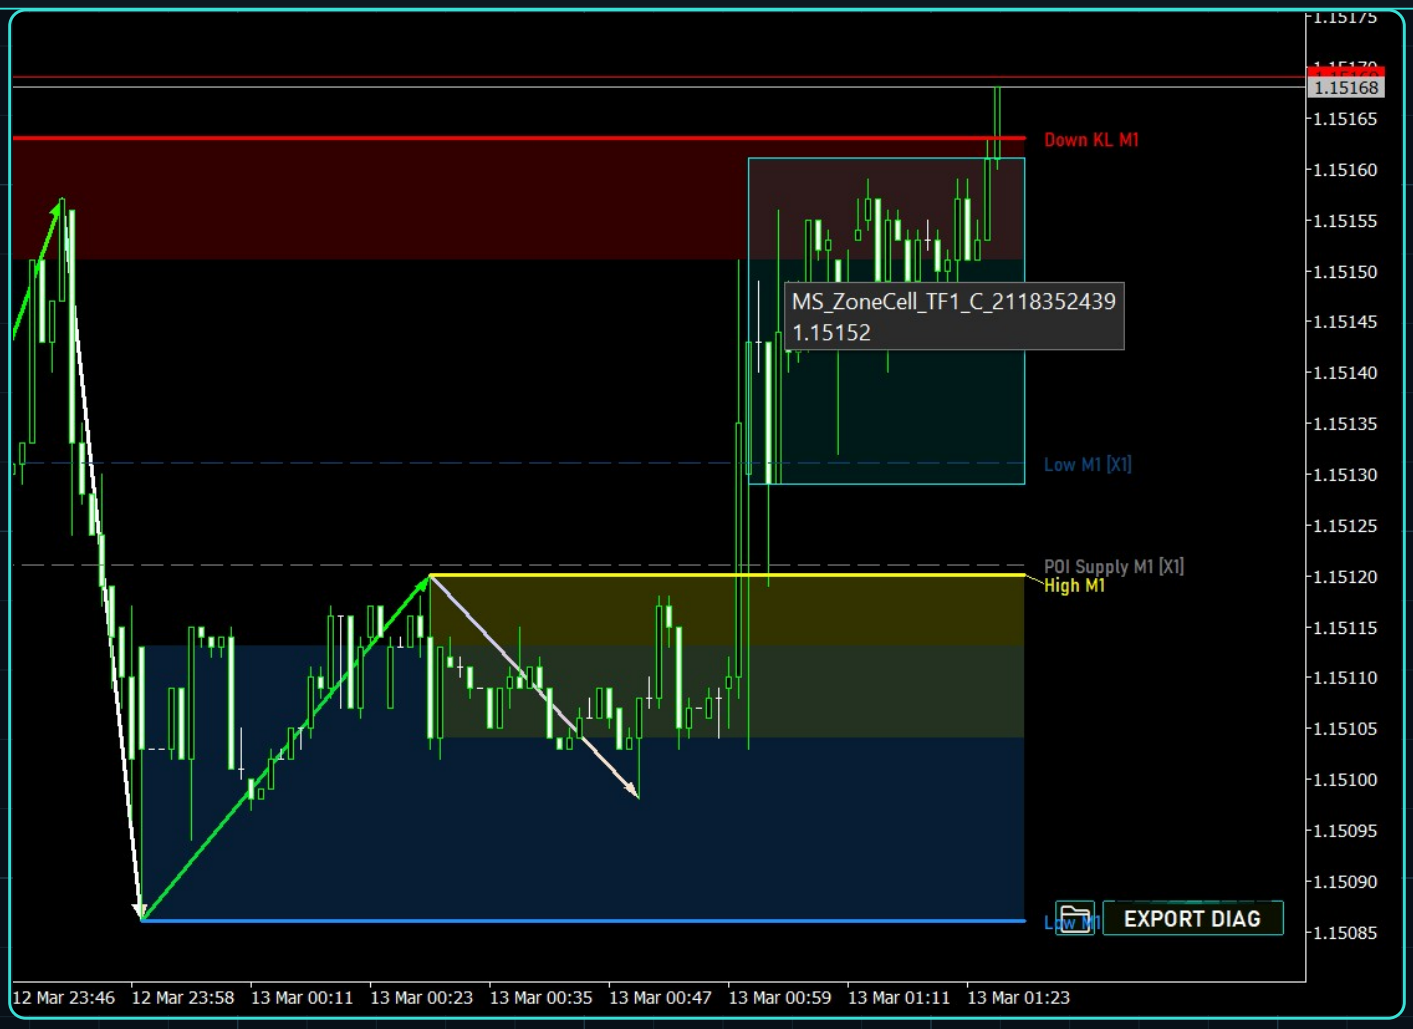


The bullish leg continues and price presses into the upper **Down KL M1** area. The move is now testing the level that can confirm a structural change. The screenshot is useful because it shows why a touch alone is not enough; MS 1.1 is watching whether the breakout rules are actually satisfied.

10.11.4 STEP 4 - UPSIDE STRUCTURE IS ACCEPTED AND NEW POST-RANGE-BO CONTEXT APPEARS



After the confirmed upside break, the chart shows a new strong UP leg and fresh structure above. The former **Down KL** is now shown as **Down KL M1 [X1]** - historical / executed context. A fresh **R-POI Demand M1 [F1]** appears after the Range BO. The R- prefix means **post-Range-Breakout**, not Reference TF.

10.11.5 STEP 5 - PRICE PAUSES BELOW FRESH SUPPLY

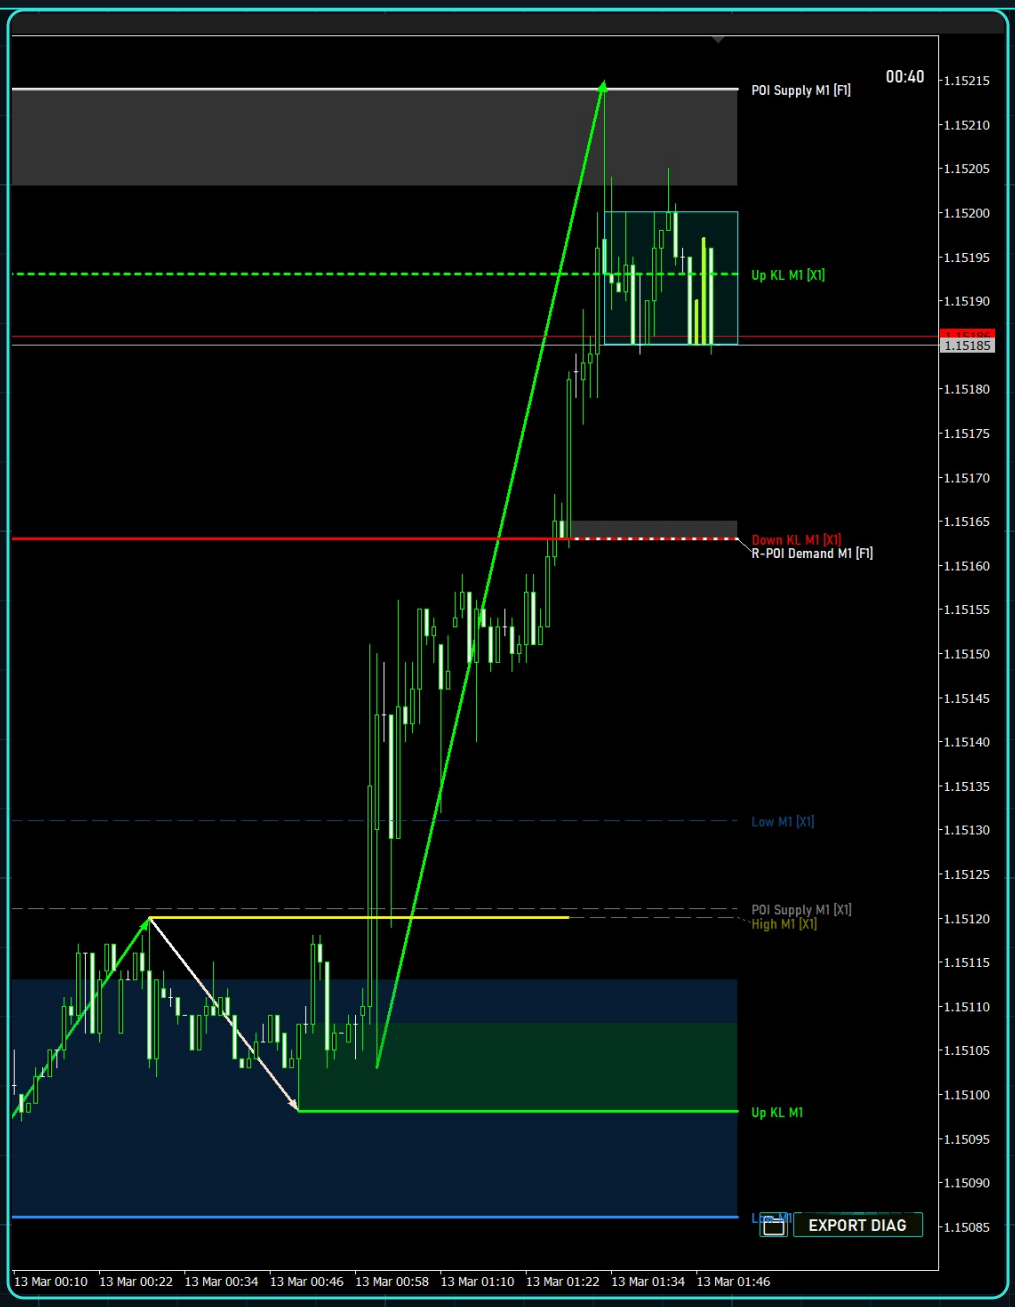


Price is now trading below the fresh **POI Supply M1 [F1]** while the earlier bullish breakout structure remains visible underneath. The compact consolidation near the top is a warning not to assume endless continuation. A strong opposing Supply directly above reduces bullish room and creates a decision area.

10.11.6 STEP 6 - REJECTION FROM THE UPPER STRUCTURE STARTS A BEARISH LEG



The chart now shows rejection from the upper High / Supply area and a confirmed DOWN structural leg. A fresh **R-POI Supply M1 [F1]** is visible near the top, while the lower **R-POI Demand M1 [F1]** becomes the next important support area. This is the transition from bullish expansion into a bearish structural response.

10.11.7 STEP 7 - BEARISH BREAKOUT REACHES THE LOWER STRUCTURE

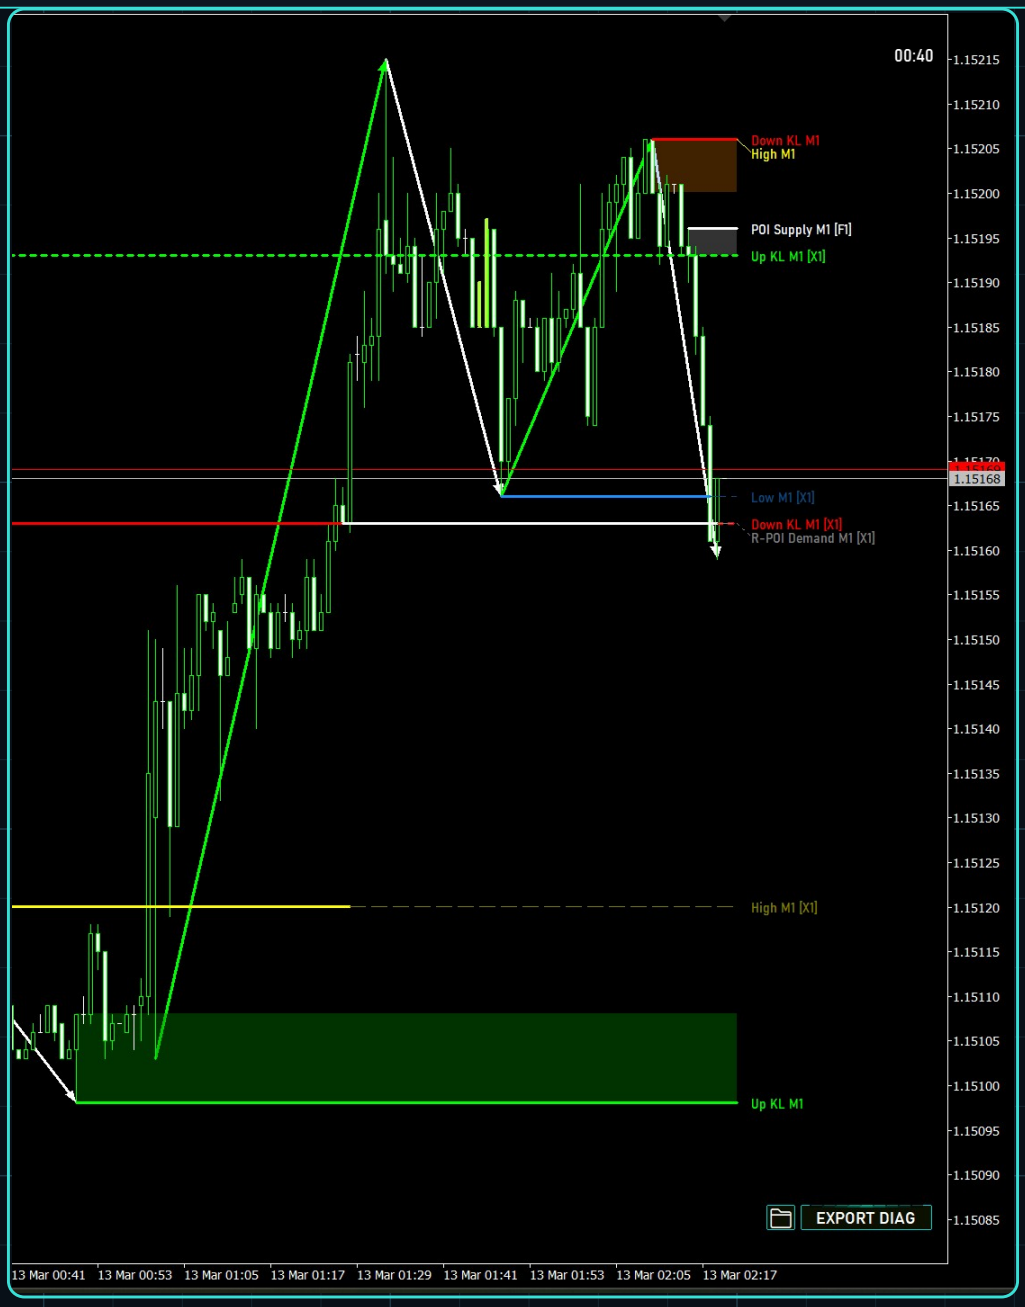

The bearish leg continues through the lower decision area. **Down KL M1 [X1]** and the post-Range-BO Demand are being broken / converted to historical context, and a new lower structure is established. At this stage the chart no longer supports a simple continuation-up reading; the confirmed DOWN leg has become the dominant local structure.

10.11.8 STEP 8 - A NEW BULLISH RECOVERY DEVELOPS FROM LOWER SUPPORT



After the bearish move, price later forms a new bullish recovery from the lower structural area. The chart shows a fresh **POI Demand M1 [F1]** below price and a new **High M1** above, while older levels remain as X1 historical references. This completes the cycle: bullish leg -> containment / Range -> upside BO -> Supply rejection -> bearish leg -> later bullish recovery. The user should follow the changing structure rather than keep the original bias forever.

NEXT STEPS

Need more detail? Continue with the full **MS 1.1 User Manual** for complete object logic, synchronization behavior, troubleshooting and deeper examples.

Need the candlestick reference? Use the **Official 56-Pattern Appendix** in the User Manual.

Need support? Use the DemQora documentation / support channel and include the MS 1.1 build, symbol, timeframe, preset, exact reproduction steps, screenshot(s) and relevant Experts / Journal log.

FIRST PUBLIC RELEASE

Visualization + alerts + manual decision support. Auto Trading is not available in MS 1.1 Release 1.

RISK REMINDER

BOL, POI, SM, Trend, Range, patterns and breakout states are analytical information, not guarantees of future price movement. The user remains responsible for interpretation and risk management.

Product: **MS 1.1 - Market Structure Multi-TF Chart**
Company: **DemQora Technologies**