



TR-75 DFIG SSCI EMT — Stator d-axis Current (all scenarios)

Vertical dotted line: perturbation onset. SSCI onset expected for comp > ~35% (fr < RSC BW ≈ 29 Hz)


S1 (0%) fr=0% → 0.0 Hz $\lambda=-14.3$ Np/s

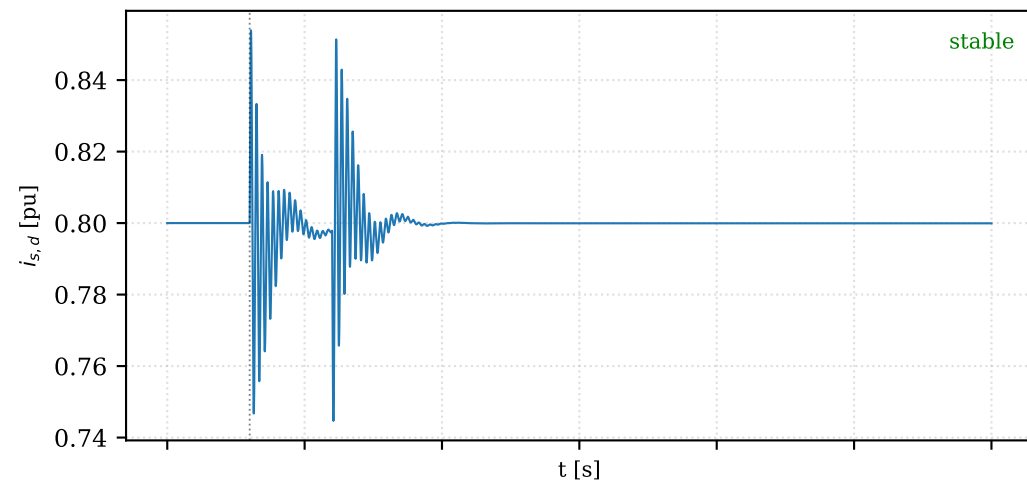


S2 (20%) fr=20% → 22.4 Hz $\lambda=-0.0$ Np/s

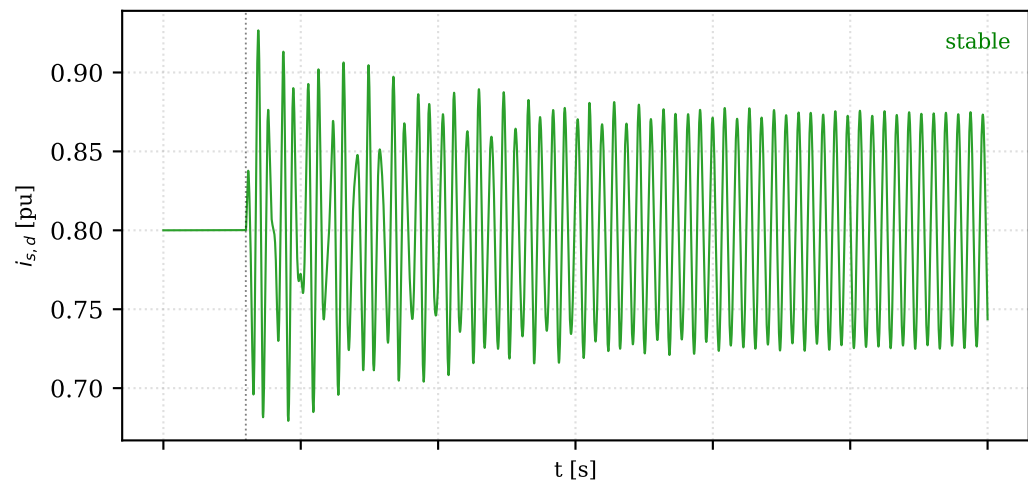


S3 (30%) fr=30% → 27.4 Hz $\lambda=+0.8$ Np/s

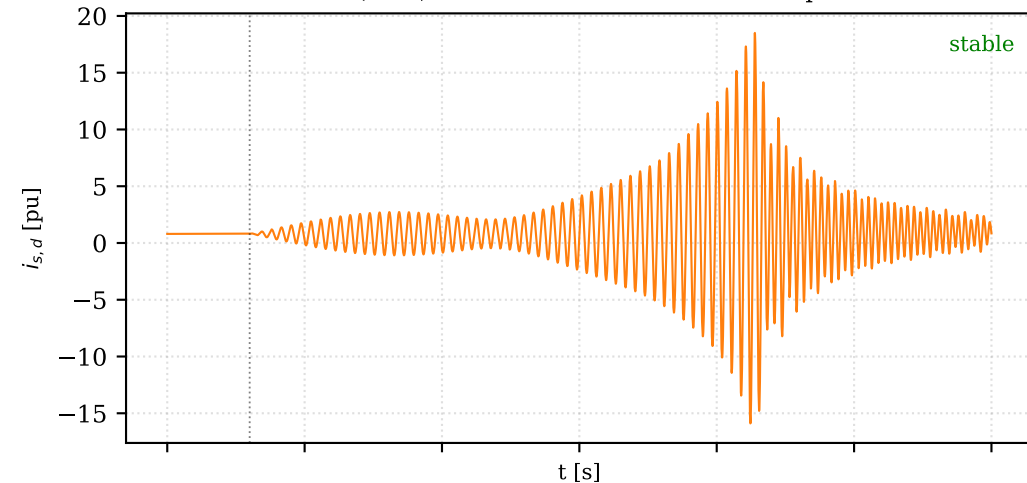

S4 (40%) fr=40% → 31.6 Hz $\lambda=-1.1$ Np/s

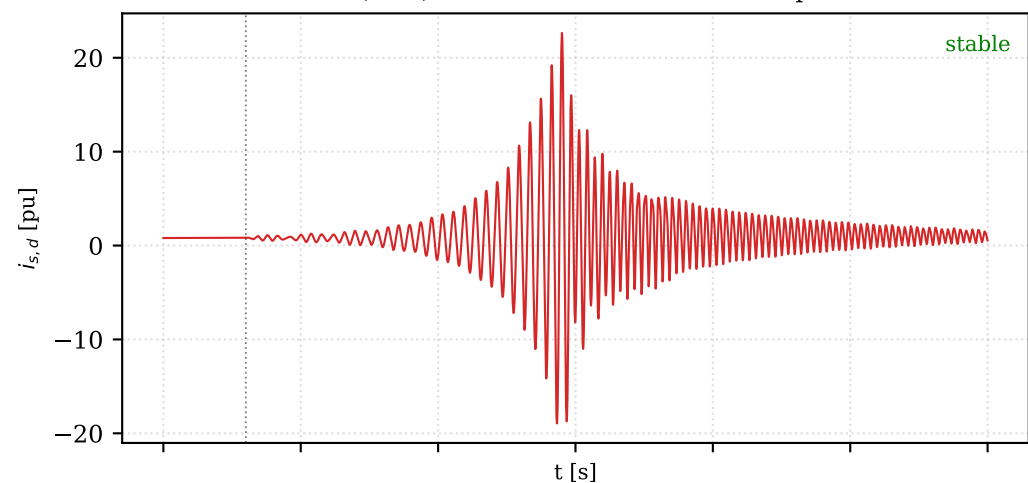

S5 (50%) fr=50% → 35.4 Hz $\lambda=-1.4$ Np/s

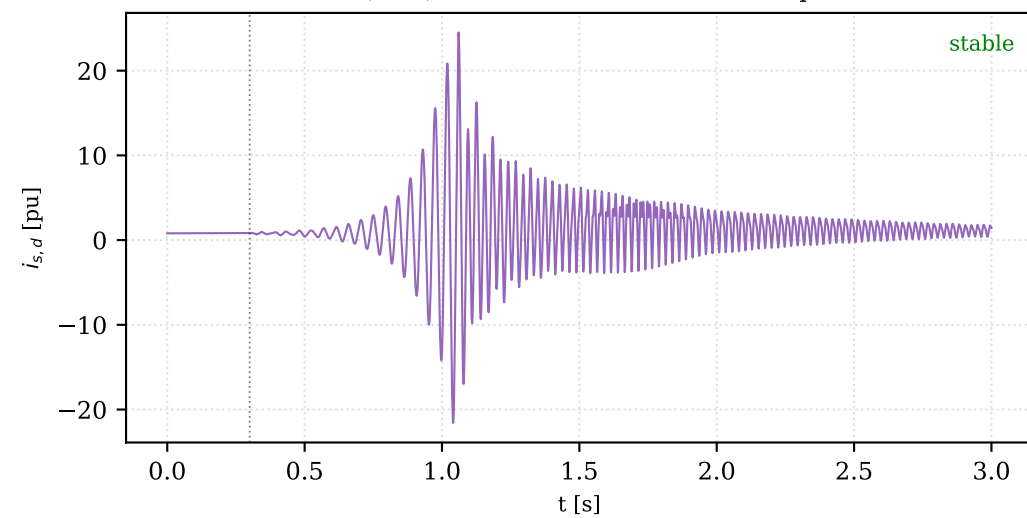

S6 (60%) fr=60% → 38.7 Hz $\lambda=-1.3$ Np/s

