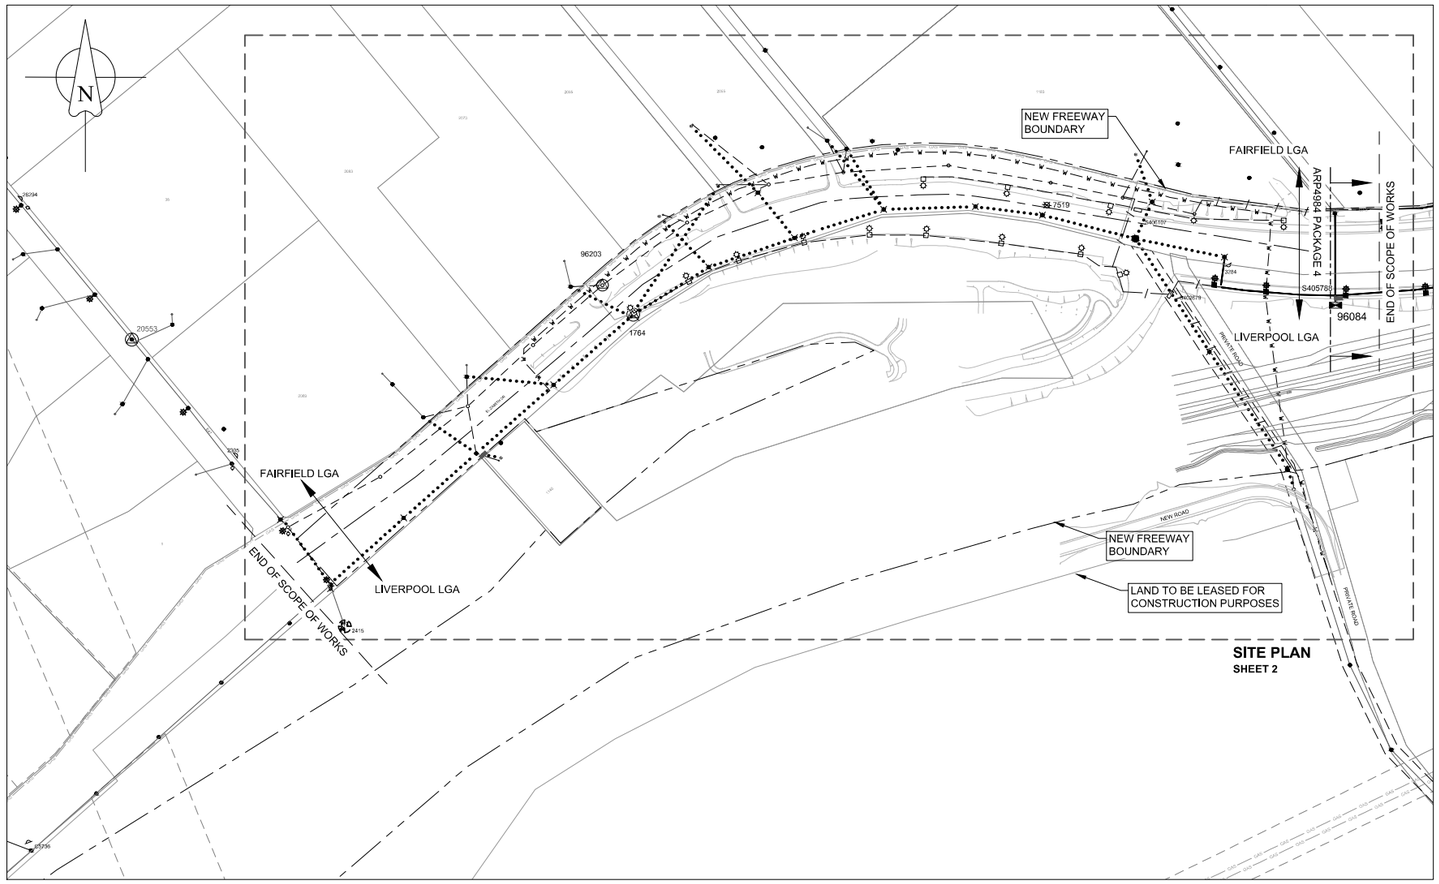

LOCATION PLAN

0 40 80 120 160 200m

40302010

SCALE 1:2000 @ A1

HV TRENCH LENGTH	: 395m
LV TRENCH LENGTH	: 591m
TOTAL TRENCH LENGTH: 986m	

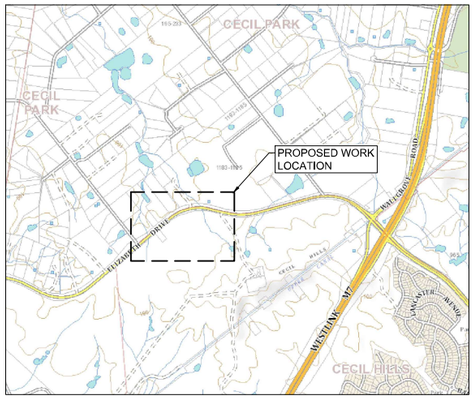

LOCATION MAP

(NTS)

KEY DOCUMENTS TABLE

THE CERTIFICATION OF THIS PROJECT IS SUPPORTED BY THE FOLLOWING KEY DOCUMENTS

DOCUMENT NAME	NOTATION DATE
SUMMARY ENVIRONMENTAL REPORT (SER)	15/12/2023
AGREEMENT FOR ENTRY, GRANT and CREATION OF EASEMENT - FPJ5013	N/A
EQUIPMENT TO BE RETURNED TO ENDEAVOUR ENERGY - FPJ4252	15/12/2023
EQUIPMENT TO BE RETURNED TO ENDEAVOUR ENERGY - FPJ4253	N/A
TELECOMMUNICATION ASSET AGREEMENT - FPJ4184	28/03/2023
DESIGNER'S SAFETY REPORT	15/12/2023
LIST ANY KEY DOCUMENTS SUPPORTING THE CERTIFICATION:	
1. M12 EIS APPENDIX I ABORIGINAL CULTURAL HERITAGE ASSESSMENT REPORT	October 2019
2. APPROVED DISPENSATION FORM 0048 FOR INSTALLING 17M POLE	7/07/2023
3. TINSW SKETCH SR 5334 FILE NO. : SF'2019/158153	20/11/2020
4. TINSW LETTER FOR CONFIRMATION OF ACCESS TO EE ASSETS	12/02/2024

CAUTION :

HIGH PRESSURE GAS MAINS IN VICINITY OF PROPOSED WORK AREA. PRIOR TO ANY EXCAVATION IN THIS AREA MUST CONTACT TO HIGH PRESSURE RESPONSE COORDINATOR ON **1300 665 380**

PIONEER COST SHARE REIMBURSEMENT SCHEME

Pre-Calculated Reimbursement for Customers Load up to 50kVA

Asset	Asset Cost Estimate ($)	Unit Quantity	Prospective New Customer Numbers	Maximum Reimbursement per New Customer Connected ($)	Maximum Reimbursement Amount ($)
HV Mains					N/A
LV Mains					N/A
Substation					N/A

NOTE:
- THIS PROJECT ASSUMES COMPLETION OF ARP4984.
- ASP LEVEL 2 WORK WILL BE CARRIED AS PER NSW INSTALLATION RULE AND SHOWN FOR INFORMATION ONLY AND NOT PART OF THIS CERTIFICATION
- ASP LEVEL 1 / CONTRACTOR TO MAINTAIN MINIMUM EXISTING STREET LIGHT LUX LEVEL DURING CONSTRUCTION
- AN ABORIGINAL HERITAGE IMPACT PERMIT (AHIP) HAS BEEN OBTAINED BY THE DEVELOPER OF THE ROAD (AHIP). THE ASP LEVEL 1 HAS THE RESPONSIBILITY OF LIAISING WITH THE DEVELOPER TO ENSURE THAT THE CONDITIONS OF THE AHIP ARE ADHERED TO AT ALL TIMES.

THIS DRAWING SUPPLIES PROPOSED M12 ROAD UPGRADE

C.A.P. NO	FILE NO	LOT NO	NO OF LOT	DEVELOPER	DEVELOPERS REP	PHONE NO
ARP4983		N/A	N/A	TINSW	JAMES JOHN	M : 0438626359

NOTE:
- THIS PROJECT ASSUMES THE COMPLETION OF ARP4984.

NOTES

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH RELEVANT ENDEAVOUR ENERGY'S STANDARDS AND THE NETWORK CONNECTION POLICY.
2. ENDEAVOUR ENERGY CONTACT PHONE: 131081
3. CERTIFICATION SHALL LAPSE WHERE:
   (i) NOTICE OF INTENT HAS NOT BEEN RECEIVED WITHIN SIX (6) MONTHS OF THIS CERTIFICATION, OR
   (ii) CONSTRUCTION HAS BEEN INTERRUPTED FOR MORE THAN SIX (6) MONTHS.
   WHERE DESIGN CERTIFICATION HAS LAPSED THE DESIGN MUST BE RESUBMITTED FOR CERTIFICATION BY THE ACCREDITED DESIGNER.
4. ATTENTION:
   PERMANENT SURVEY MARKS MAY EXIST IN THIS AREA. THESE ARE TO BE LOCATED BY A SURVEYOR PRIOR TO COMMENCEMENT OF WORK.
5. ATTENTION:
   ALL SERVICES SEARCHES MUST BE CHECKED BEFORE CONSTRUCTION.
6. WARNING
   LIVE ENDEAVOUR ENERGY CABLES & OTHER SERVICES IN THIS AREA. PLEASE CONTACT DIAL BEFORE YOU DIG ON TELEPHONE: 1100 FOR SEARCHES TWO DAYS PRIOR TO EXCAVATION.
7. ATTENTION:
   SERVICE PROVIDER TO NOTIFY ENDEAVOUR ENERGY'S ASSET DATA CUSTOMER DEPT. DAILY WHEN CABLE WORKS IS IN PROGRESS. TELEPHONE 131081.
8. OPERATION LIMITATIONS
   UNLESS APPROVED OTHERWISE, INTERRUPTION TO ANY CUSTOMER'S SUPPLY MUST BE AVOIDED. THE FOLLOWING ALTERNATIVES SHOULD BE CONSIDERED:
   -MOBILE GENERATORS & SUBSTATIONS
   -LIVE LINE WORK
   -DESIGN ALTERNATIVES
   -LOW VOLTAGE PARALLELS
   -WORK PRACTICES/STANDARDS
   THE COST IS TO BE FUNDED BY THE CUSTOMER/DEVELOPER
9. REIMBURSEMENTS WILL BE PAID TO THE NOMINATED PARTY ON THE LETTER OF INTENT AFTER THE WORKS HAVE BEEN COMPETED AND THE LETTER OF ACCEPTANCE HAS BEEN ISSUED. THE REIMBURSED AMOUNT IS SHOWN IN THE FUNDING ARRANGEMENTS FOR SCOPE OF WORK. ANY DISAGREEMENT WITH THE AMOUNT SHOULD BE RESOLVED WITH ENDEAVOUR ENERGY PRIOR TO THE COMMENCEMENT OF WORKS.
10. AN EARTH CONNECTION WARNING LABEL MUST BE INSTALLED WHERE EARTH CONDUCTOR OR AN EXTENDED EARTH GRID IS TO BE CONNECTED TO LV STREET NEUTRAL TO ACHIEVE AN MEN SYSTEM AS PER EDI 0006. REFER TO DRAWING No.348245.
11. HAVE ALL THE EXISTING ASSETS BEEN FIELD CHECKED AND ARE ACCURATE AT THE TIME OF DESIGN? YES / ~~NO~~
12. QUANTITIES AND DIMENSIONS GIVEN ON THIS DRAWING ARE BASED ON DESIGN INFORMATION AND SITE CONDITIONS AT THE TIME OF DESIGN. AS THEY MIGHT CHANGE, THE BUILDER OF THIS PROJECT MUST CHECK ALL QUANTITIES AND DIMENSION ON SITE PRIOR TO TENDERING AND PRIOR TO CONSTRUCTION.
13. ENVIRONMENTAL MANAGEMENT STANDARD EMS001 IS PART OF THE DESIGN.

FUNDING ARRANGEMENTS FOR SCOPE OF WORKS

ASP LEVEL 1 ELECTRICAL WORKS		CUSTOMER
ENDEAVOUR ENERGY SUPPLIED MATERIALS	CUSTOMER FUNDED NON-CONTESTABLE WORKS	CUSTOMER FUNDED
- Nil	- Network switching, substation commissioning, contract inspection and ancillary fees.	Includes but not limited to: - Pegging of property boundaries & infrastructure locations - Providing site access - Own service & service connection - Confirm finished ground levels
ENDEAVOUR ENERGY FUNDED & CONSTRUCTED		
Works Required Prior to Completion of Customer Contestable Project: - Nil	Works Required in Association of Customer Contestable Project: - Nil	
ENDEAVOUR ENERGY FUNDED & ASP L1 CONSTRUCTED – REIMBURSEMENT (exc GST)	CUSTOMER FUNDED CONTESTABLE WORKS	EXISTING DUCT USAGE CHARGES (exc GST): Nil
Pole Sub - 200kVA Pole Transformer $5,675 Total EE Capital Contribution (exduding PM & Design) $5,675 EE Capital Contribution (HV reimbursed) $6,225	All other works and materials including but not limited to: - Trenching - Underbores - Duct Installation - Cable laying and/or installations	CO-ORDINATION SUPPLY REQUIRED DATE (TO BE CONFIRMED BY THE CUSTOMER): Third Quarter of 2023 ASSET TO BE RETURNED TO NEAREST ENDEAVOUR ENERGY DEPOT BY L1 ASP - 1 x 11kV 100kVA Pole Top Trf - HD CU 7/2.00 LV CABLE (APPROX. 368m) ALL REMOVED COPPER CONDUCTORS ARE TO BE RETURNED TO EE DEPOT.

ATTENTION

ALL SERVICES SEARCHES MUST BE CHECKED BEFORE CONSTRUCTION.

BEFORE YOU DIG
www.byda.com.au

COMMUNICATION ASSETS ALTERATION/RELOCATION

Telecommunication Assets are / ~~are not~~ affected by this project.
The construction ASP must coordinate the work with the following Telecommunication Companies:

Comms Co.	Contact Name	Phone No.	Initial Contact Date	Arrangement Details and Date Agreed
NBN	Kenny D'Cruz	289188319	'23-Dec-2022	60 working days notice / 28/03/2023

Technical details of the arrangements are available from the Design ASP.

CERTIFIED BY ENDEAVOUR ENERGY

Amendment: D
Date Approved: 12-11-2024
Examiner's Signature: Ali Siddiqui
Print Name: Ali Siddiqui

This Certification is issued subject to Endeavour Energy's Standard Certification Terms

AUTHORISATION OF ESTIMATE VALUE OF ENDEAVOUR ENERGY FUNDED ASSETS FOR ARP4983

Signed: Ali Siddiqui

Print Name: Ali Siddiqui

Service Number: 39231

Funding Amount: $6,225

Date: 12-11-2024

DESIGN COMPLIANCE AND INDEMNITY

This design complies with Endeavour Energy's relevant standards as current at this time and as listed on the Endeavour Energy Accredited Service Provider'sInternet site. These standards include, but are not limited to:

CP: Connection Policy
EMS: Environmental Management Standard
MCI: Mains Construction Instruction
MDI: Mains Design Instruction
PDI: Protection Design Instruction
SDI: Substation Design Instruction
SAD 0001: Design Drawing Standard
MMI: Mains Maintenance Instruction
SMI: Substation Maintenance Instruction
LDI 0001: Public lighting Electrical Design Element

Additionally, where relevant, the design complies with AS/NZS 7000 "Overhead Line Design - Detailed Procedures" published by The Australian Standards.

WSP Australia Pty Ltd indemnifies Endeavour Energy for any loss or damage resulting from non-compliance of the design with the above standards.

Signed:
Name: Darshan Shrestha
Service Provider Number: 5045 Date: 6/09/2024

WORKS COMPLETED/FIELD BOOK

CONSTRUCTED BY:
WORKS COMPLETED:
SIGNATURE: DATE:
INSPECTED BY:
SIGNATURE: DATE:

ASSET RECORDING

I:
OF:
CONTACT No.:
HEREBY CERTIFY THAT ASSETS MARKED AS-BUILT ON THIS DRAWING HAVE BEEN RECORDED AS PER ENDEAVOR ENERGY STANDARD SAD 0004.
SIGNATURE:
DATE:

Cadastre: © Land and Property Information 2016

AMENDMENTS		
A	ORIGINAL ISSUE	
	DRAFT No. 05	
B	11/03/2024	
CHK'D	P. P.	
DRWN	D. S.	
	MOVE POLE / PILLAR LOCATION AND REPLACED POLE	
C	8/04/2024	
CHK'D	P. P.	
DRWN	D. S.	
	MOVE POLE REF '61' & ESTABLISH STJ AT REF '60'	
D	4/11/2024	
CHK'D	P. P.	
DRWN	D. S.	
	UPRATE POLE SUB AT REF 28 & REVISED EARTHING REF 61	

CLIENT: JOHN HOLLAND M7-M12 Integration Project; NSW GOVERNMENT Transport for NSW

wsp
Level 27, Ernst & Young Centre
680 George Street
Sydney NSW 2000
GPO BOX 5394
Sydney NSW 2001 Australia
Telephone +61 2 9272 5100
Facsimile +61 2 9272 5101
Email: sydney@wsp.com
ASP REF/ACCREDIATION NO. - 5045

TEMPLATE VERSION No.5.20

© THIS DRAWING AND THE COPYRIGHT THEREIN IS THE PROPERTY OF ENDEAVOUR ENERGY AND MAY NOT BE COPIED, REPRODUCED, DISTRIBUTED, LOANED OR USED WITHOUT THE WRITTEN CONSENT OF ENDEAVOUR ENERGY

REFERENCE DRAWING'S	
ULL1937	CONNECTION OF LOAD

WORK ORDERS	
GENERAL	
OVERHEAD	
UNDERGROUND	
SUBSTATIONS	

CAMS File No.	ARP4983
AM PROJ. No.	
HV SWITCHING	3284
EE DEPOT	HOXTON PARK
EE REGION	CENTRAL
HV OP DIAG	KEMPS CREEK 1 D11
LOCAL GOV AREA	LIVERPOOL

ORIGINAL SCALE

DRAWN	DARSHAN S
DATE	17/07/2023
CH'D	PRAMOD P

DO NOT SCALE
DIMENSIONS IN METRES
GDA94/MGA56 COORDINATE SYSTEM
DESIGN DARSHAN S

ELIZABETH DRIVE
CECIL PARK
ARP4983
ASSET RELOCATION
M12 EAST - ELIZABETH DRIVE CONNECTION

Endeavour Energy

A1 | 526458 | D

SHEET No 1 OF 9 SHEETS

92119

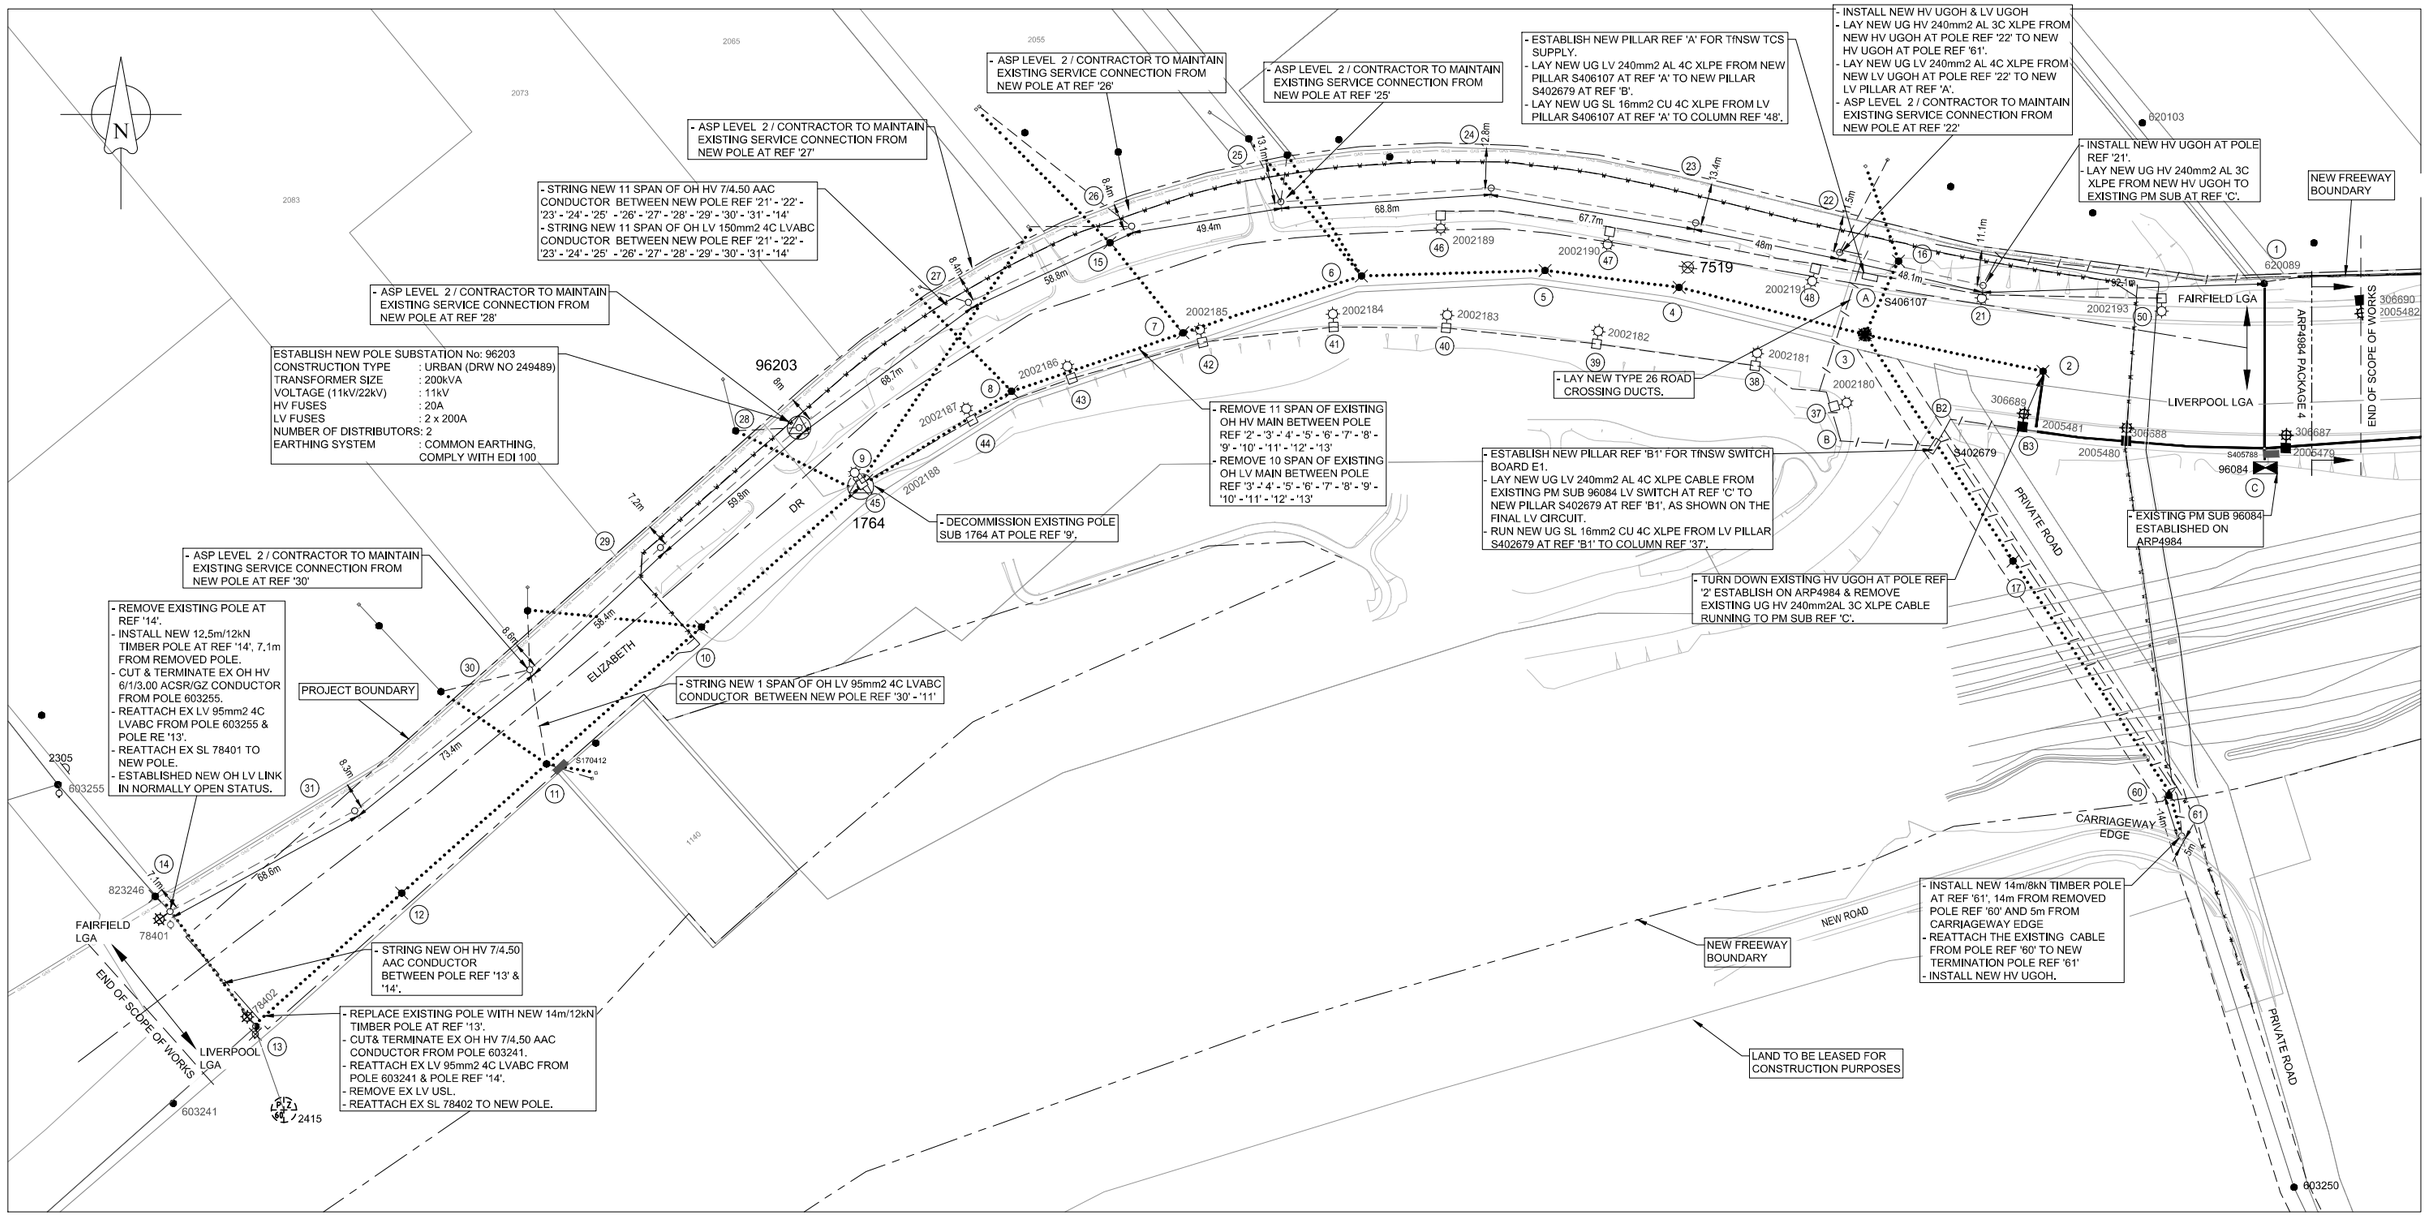

SITE PLAN LEGEND

- NEW LV TRENCH
- STRING NEW OH CABLE
- EXISTING UNDERGROUND MAINS
- EXISTING OH CABLE
- REMOVE CONDUCTOR
- EXISTING DUCTS
- LGA DEMARCATION
- EXISTING LANTERN
- REMOVE LANTERN
- NEW LANTERN
- EXISTING POLE
- REMOVE POLE
- EXISTING COLUMN
- NEW COLUMN
- EXISTING PILLAR
- PADMOUNT SUBSTATION
- POLE SUBSTATION
- NEW PILLAR
- LV LINK (N/O)
- NEW POLE
- NEW HV TRENCH
- REPLACE POLE
- HV ABS (N/C)
- HV USL (N/C)
- GAS — HIGH PRESSURE GAS
- WATER MAIN
- NEW FREEWAY BOUNDARY
- EXISTING 9,145m WIDTH ENDEAVOUR ENERGY EASEMENT

SITE PLAN

0 20 40 60 80 100m

2015 10 5

SCALE 1:1000 @ A1

Cadastre: © Land and Property Information 2016

ASP LEVEL 2 TO RE-ESTABLISH EXISTING SERVICE CONNECTION.

NOTE:
- NEW SL LUMINARIES NUMBER ARE NOT SHOWN ON THE DESIGN FOR CLARITY PURPOSE.

ATTENTION

ALL SERVICES SEARCHES MUST BE CHECKED BEFORE CONSTRUCTION.

BEFORE YOU DIG
www.byda.com.au

CERTIFIED BY ENDEAVOUR ENERGY
Amendment: D
Date Approved: 12-11-2024
Examiner's Signature: Ali Siddiqui
Print Name: Ali Siddiqui
This Certification is issued subject to Endeavour Energy's Standard Certification Terms

WORKS COMPLETED/FIELD BOOK
CONSTRUCTED BY:
WORKS COMPLETED:
SIGNATURE: DATE:
INSPECTED BY:
SIGNATURE: DATE:

ASSET RECORDING
I:
OF:
CONTACT No.:
HEREBY CERTIFY THAT ASSETS MARKED AS-BUILT ON THIS DRAWING HAVE BEEN RECORDED AS PER ENDEAVOR ENERGY STANDARD SAD 0004.
SIGNATURE:
DATE:

AMENDMENTS		
A	ORIGINAL ISSUE	
	DRAFT No. 05	
B	11/03/2024	
	CHK'D	P. P.
	DRWN	D. S.
	MOVE POLE / PILLAR LOCATION AND REPLACED POLE	
C	8/04/2024	
	CHK'D	P. P.
	DRWN	D. S.
	MOVE POLE REF '61' & ESTABLISH STJ AT REF '60'	
D	4/11/2024	
	CHK'D	P. P.
	DRWN	D. S.
	CORRUPTE POLE SUB AT REF 28 & REVISED EARTHING REF 61	

CLIENT:
JOHN HOLLAND M7–M12 Integration Project
NSW GOVERNMENT Transport for NSW

wsp
Level 27, Ernst & Young Centre
680 George Street
Sydney NSW 2000
GPO BOX 5394
Sydney NSW 2001 Australia
Telephone +61 2 9272 5100
Facsimile +61 2 9272 5101
Email sydney@wsp.com
ASP REF/ACCREDIATION NO. - 5045

TEMPLATE VERSION No.5.20

© THIS DRAWING AND THE COPYRIGHT THEREIN IS THE PROPERTY OF ENDEAVOUR ENERGY AND MAY NOT BE COPIED, REPRODUCED, DISTRIBUTED, LOANED OR USED WITHOUT THE WRITTEN CONSENT OF ENDEAVOUR ENERGY

REFERENCE DRAWING'S		WORK ORDERS		CAMS File No.	ARP4983
ULL1937	CONNECTION OF LOAD	GENERAL		AM PROJ. No.	
		OVERHEAD		HV SWITCHING	3284
		UNDERGROUND		EE DEPOT	HOXTON PARK
		SUBSTATIONS		EE REGION	CENTRAL
				HV OP DIAG	KEMPS CREEK 1 D11
				LOCAL GOV AREA	LIVERPOOL

ORIGINAL SCALE

DRAWN	DARSHAN S
DATE	17/07/2023
CH'D	PRAMOD P
DESIGN	DARSHAN S

DO NOT SCALE
DIMENSIONS IN METRES
GDA94/MGA56 COORDINATE SYSTEM

ELIZABETH DRIVE
CECIL PARK
ARP4983
ASSET RELOCATION
M12 EAST - ELIZABETH DRIVE CONNECTION

Endeavour Energy

A1 | 526458 | D

SHEET No 2 OF 9 SHEETS

92119

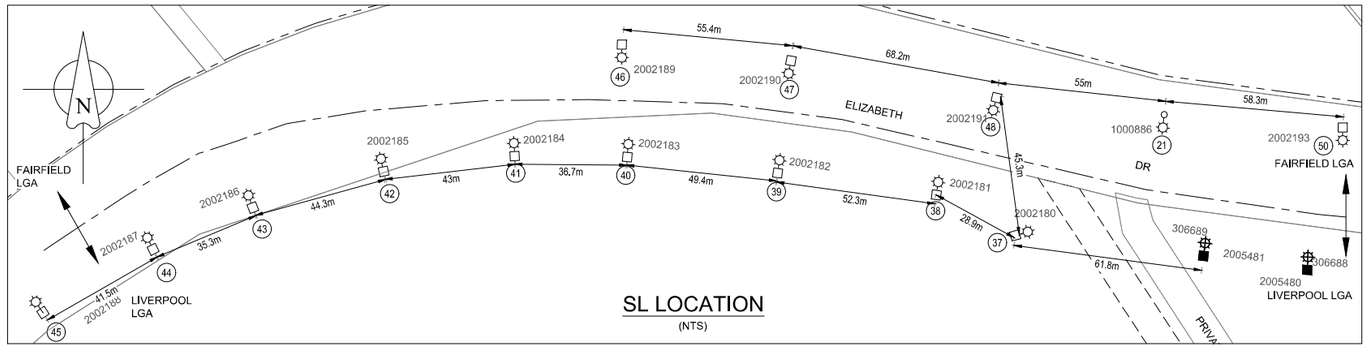

SL LOCATION
(NTS)

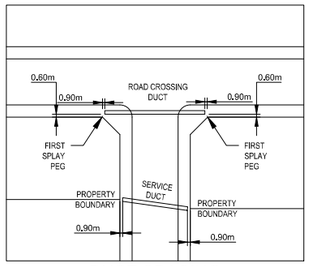

DUCT SPACING
NTS

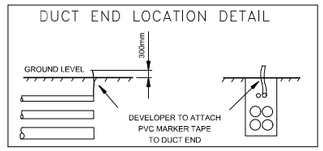

DUCT DECLARATION

I _____

OF _____

CONTACT NUMBER _____

HEREBY CERTIFY THAT THE DUCTS SHOWN ON THIS DRAWING HAVE BEEN INSTALLED IN ACCORDANCE WITH THIS DRAWING & ENDEAVOR ENERGY STANDARDS MDI0028 & MC6006. THE DUCT DEPTHS AND LOCATIONS AT EACH END HAVE BEEN CORRECTLY MARKED ON THIS DRAWING AS PER ENDEAVOR ENERGY STANDARD SAD0004.

THE INSTALLATION OF THE DUCTS WAS

COMMENCED ON _____

& COMPLETED ON _____

SIGNATURE _____

LAND SURVEYOR REGISTERED UNDER SURVEYING AND SPATIAL INFORMATION ACT 2002

NOTE:
- THIS PROJECT ASSUMES THE COMPLETION OF ARP4984.

ASP LEVEL 2 TO RE-ESTABLISH EXISTING SERVICE CONNECTION.

ATTENTION

ALL SERVICES SEARCHES MUST BE CHECKED BEFORE CONSTRUCTION.

DUCT BREAKDOWN TABLE

Route	Configuration	Route Length (m)	Reimbursement (m) x ($)	Existing Duct Usage Charge (m) x ($)
1 - C	(Existing Road Underbore) RMS ROAD 1500 LV HV	56	NIL	NIL
1 - 21, B2-61	(New Duct) NATURAL STRIP 750 LV HV	98	NIL	NIL
C - B3	(Existing Duct) FOOTPATH 750 SL LV HV	81	NIL	NIL
B3 -2	(Existing Duct) NATURAL STRIP 750 HV	20	NIL	NIL
B3 - B2	(New Duct) FOOTPATH 750 LV HV	28	NIL	NIL
B2 - B	(New Road Crossing) COUNCIL ROAD 750 SL LV HV	37	NIL	NIL
B - 37	(New Duct) NATURAL STRIP 750 SL LV HV	10	NIL	NIL
37 - A	(Road Underbore) EXISTING RMS ROAD 1500 SL LV HV	42	NIL	NIL
A - 22	(New Duct) FOOTPATH 750 LV HV	16	NIL	NIL
37-38-39-40-41-42-43-44-45, A-50,A-48, 48-47-46	(New Duct) FOOTPATH 600 SL	591	NIL	NIL
B2-61	(New Duct) NATURAL STRIP 750 HV Earthing	164	NIL	NIL
		1123 m	NIL	NIL

DUCT LEGEND

NEW TRENCH | SPARE DUCT | DUCT WITH NEW CABLE | DUCT WITH EXISTING CABLE | REMOVE DUCT | REMOVE CABLE | REMOVE DUCT & CABLE

SPARE DUCT REQUIREMENT
1. IN AREAS WHERE ADDITIONAL DUCTS ARE REQUIRED THE SPARE DUCT IS INCLUDED IN THE PVC DUCT SCHEDULE & THE SECTION SHOWN.
2. SPARE SL DUCTS HAVE BEEN PROVIDED AND RESERVED FOR CLIENTS FUTURE USE.

NOTE
1. DUCT LENGTHS AND ARRANGEMENTS TO BE CONFIRMED ON SITE.
2. ALL TRENCH SECTIONS ARE TO BE READ & VIEWED FROM NODE TO NODE AS NOMINATED.
3. FOR ALL REQUIRED/SHOWN CROSSING DUCT WORK, REFER TO TYPICAL ARRANGEMENT INCLUDED ON THIS PAGE.
* THE EXISTING 125mm SPARE CONDUIT IS USED TO LAY THE EARTHING CABLE DUE TO THE ABSENCE OF SPARE 50MM DUCT. THIS ADJUSTMENT IS REQUIRED FOLLOWING A CHANGE IN THE EARTHING DESIGN REQUESTED BY EE IN DESIGN AMENDMENT D.

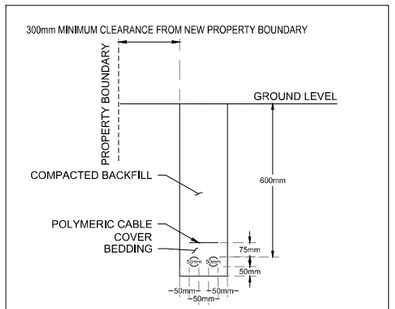

TYPE 20 DUCT ARRANGEMENT
FOOTPATH
(NTS)

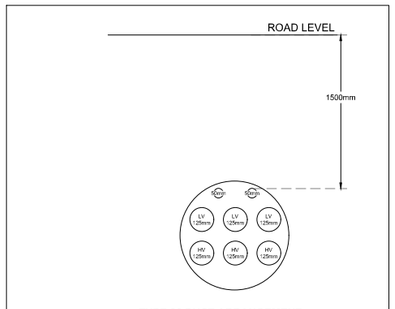

TYPE 26 DUCT ARRANGEMENT
EXISTING RMS ROAD UNDERBORE
(NTS)

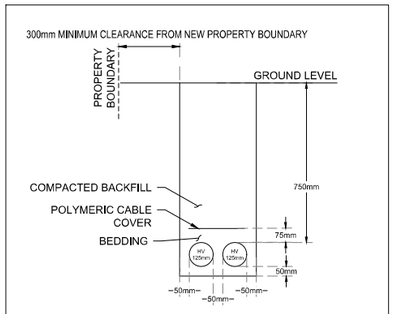

TYPE 04 DUCT ARRANGEMENT
FOOTPATH
(NTS)

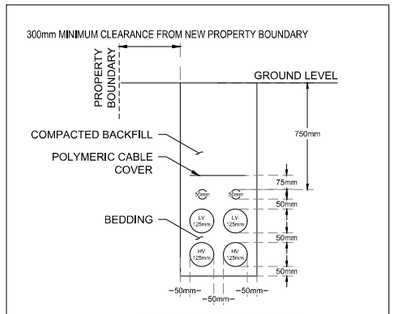

TYPE 24 DUCT ARRANGEMENT
FOOTPATH
(NTS)

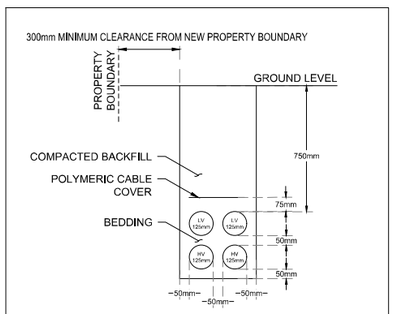

TYPE 04 DUCT ARRANGEMENT
FOOTPATH
(NTS)

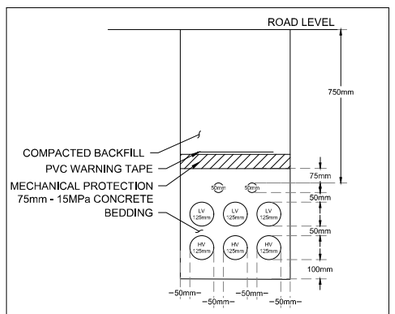

TYPE 26 DUCT ARRANGEMENT
COUNCIL ROAD CROSSING
(NTS)

BEFORE YOU DIG
www.byda.com.au

CERTIFIED BY ENDEAVOUR ENERGY
Amendment: D
Date Approved: 12-11-2024
Examiner's Signature: Ali Siddiqui
Print Name: Ali Siddiqui
This Certification is issued subject to Endeavour Energy's Standard Certification Terms

WORKS COMPLETED/FIELD BOOK
CONSTRUCTED BY: _____
WORKS COMPLETED: _____
SIGNATURE: _____ DATE: _____
INSPECTED BY: _____
SIGNATURE: _____ DATE: _____

ASSET RECORDING
I: _____
OF: _____
CONTACT No.: _____
HEREBY CERTIFY THAT ASSETS MARKED AS-BUILT ON THIS DRAWING HAVE BEEN RECORDED AS PER ENDEAVOR ENERGY STANDARD SAD 0004.
SIGNATURE: _____
DATE: _____

Cadastre: © Land and Property Information 2016

AMENDMENTS

A	ORIGINAL ISSUE	
	DRAFT No. 05	
B	1	11/03/2024
	CHK'D	P. P.
	DRWN	D. S.
	MOVE POLE / PILLAR LOCATION AND REPLACED POLE	
C	1	8/04/2024
	CHK'D	P. P.
	DRWN	D. S.
	MOVE POLE REF 61' & ESTABLISH STJ AT REF 60'	
D	1	4/11/2024
	CHK'D	P. P.
	DRWN	D. S.
	UPDATE POLES SUB AT REF 28 & REVISED EARTHING REF 61	

CLIENT:
JOHN HOLLAND M7→M12 Integration Project
NSW GOVERNMENT Transport for NSW

wsp
Level 27, Ernst & Young Centre
680 George Street
Sydney NSW 2000
GPO BOX 5394
Sydney NSW 2001 Australia
Telephone +61 2 9272 5100
Facsimile +61 2 9272 5101
Email: sydney@wsp.com
ASP REF/ACCREDIATION NO. - 5045

TEMPLATE VERSION No 5.20

© THIS DRAWING AND THE COPYRIGHT THEREIN IS THE PROPERTY OF ENDEAVOUR ENERGY AND MAY NOT BE COPIED, REPRODUCED, DISTRIBUTED, LOANED OR USED WITHOUT THE WRITTEN CONSENT OF ENDEAVOUR ENERGY

REFERENCE DRAWING'S	
ULL1937	CONNECTION OF LOAD

WORK ORDERS	
GENERAL	
OVERHEAD	
UNDERGROUND	
SUBSTATIONS	

CAMS File No.	ARP4983
AM PROJ. No.	
HV SWITCHING	3284
EE DEPOT	HOXTON PARK
EE REGION	CENTRAL
HV OP DIAG	KEMPS CREEK 1 D11
LOCAL GOV AREA	LIVERPOOL

ORIGINAL SCALE

DRAWN	DARSHAN S
DATE	17/07/2023
CH'D	PRAMOD P

DO NOT SCALE
DIMENSIONS IN METRES
GDA94/MGA56 COORDINATE SYSTEM
DESIGN DARSHAN S

ELIZABETH DRIVE
CECIL PARK
ARP4983
ASSET RELOCATION
M12 EAST - ELIZABETH DRIVE CONNECTION

Endeavour Energy

A1 | 526458 | D

SHEET No 5 OF 9 SHEETS

92119