



NYU Langone Medical Center - Science Building

ASF/Unit: 105 & 183 sqft

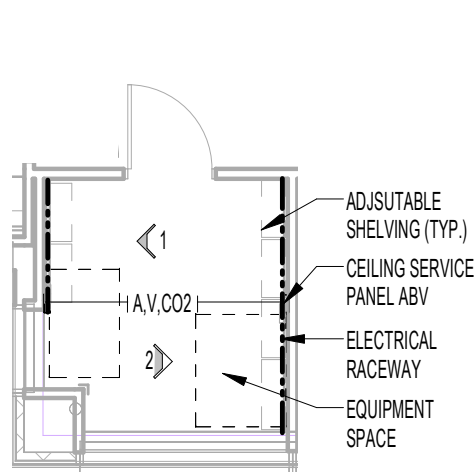

TYPE 1

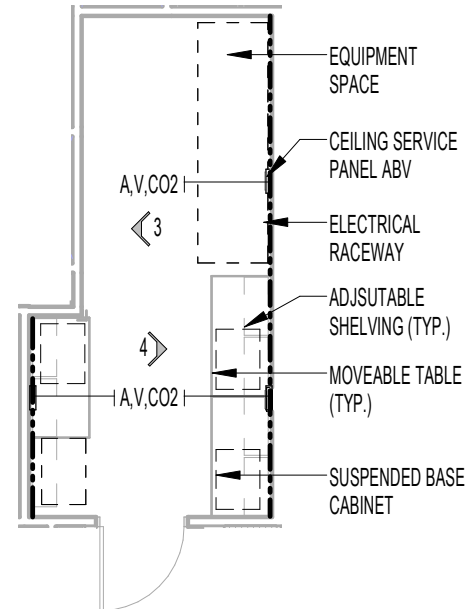

TYPE 2

Workshop - Type 1 & 2

Architectural

Floor: Non PVC Comp. Tile w/ 4" Cove
 Walls: Painted GWB
 Ceiling: ACT
 Ceiling Height: 9'-0"
 Doors / Openings: 42" Minimum
 Casework: Moveable Tables w/ Base Cab. & Adj. Shelving
 Countertop Material: Epoxy Resin
 Sink Material: N/A
 Special Requirements:

Electrical

Lighting: 75 - 100 f.c. @ 37" A.F.F.
 Standby Power: (1) 120V/20A @ each Raceway
 UPS: N/A
 Voice/Data: (2) 2 Pack (1 per wall)
 Voltage: 120V / 20A (2-Channel Raceway)
 Receptacle Density: 2'-0" O.C.
 Special Requirements: (1) Recep @ 18" A.F.F. @ each wall;
 (2) 208V @ (1 per wall)


Mechanical

Temperature: 72°F +/- 2°F
 Relative Humidity: 25% Min - 50% Max.
 Air Changes: 4 - 6 Min.
 Air Circulation: 100% Exhaust
 Hours of Operation: 24 Hours
 Pressure: In
 Exhausting Equipment: N/A
 Equipment Heat Load: 16 Watts / sqft
 Special Requirements:


Plumbing

Laboratory Water: N/A
 Piped Services: Air, Vacuum, CO2
 Specialty Services: N/A
 Drains: N/A
 Eyewash: N/A
 Safety Shower / Station: As per NFPA 30
 Special Requirements: Wall/Ceiling Service Panel


NYU Langone Medical Center - Science Building

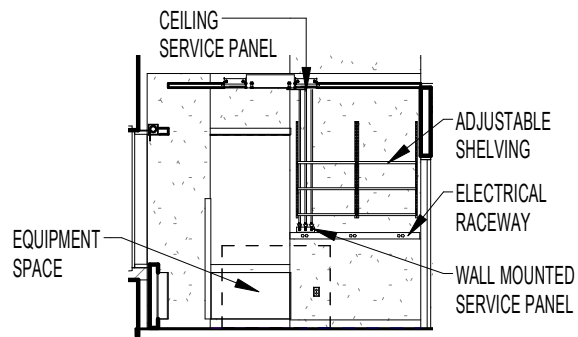


ELEVATION 1
(TYPE 1)

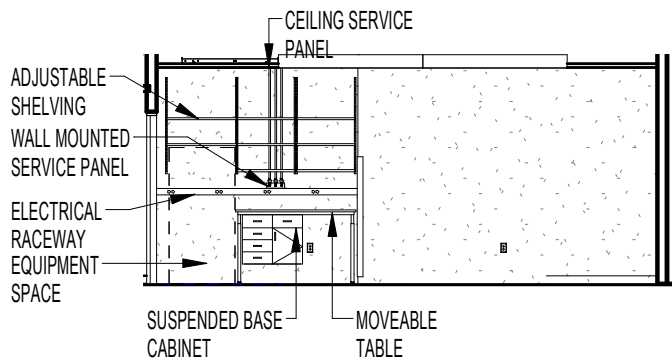

ELEVATION 3
(TYPE 2)

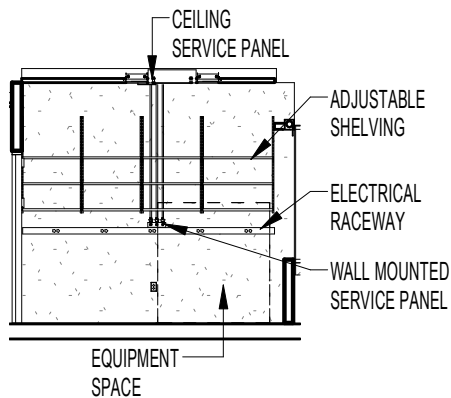

ELEVATION 2
(TYPE 1)

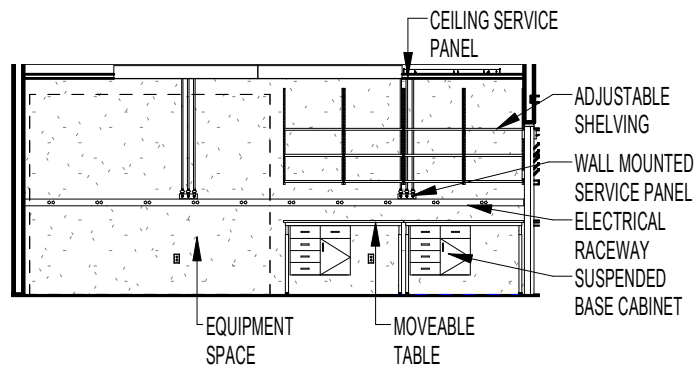

ELEVATION 4
(TYPE 2)