


DIFFERENTIAL PRESSURE GAUGE

Date: February 28, 2025 | Time: 9:25 | Booth ID: SB-01

Environmental Data

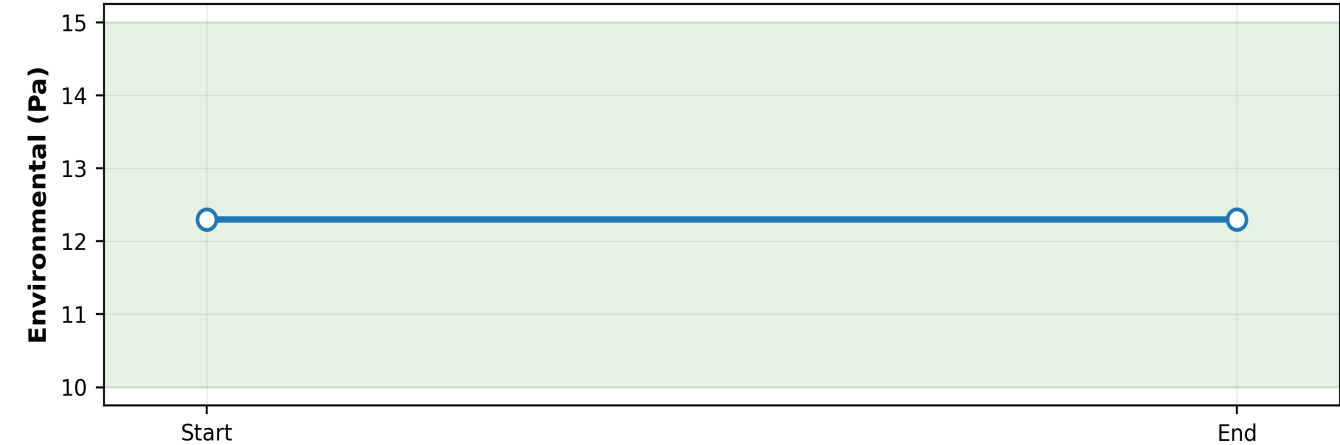

MEASUREMENT DETAILS

Parameter	Value	Unit	Acceptance Criteria	Status
Differential Pressure	12.3	Pa	10.0 - 15.0 Pa	✓ PASS

INSTRUMENT INFORMATION

HEPA Integrity	Pass
Type of Monitoring	Monthly
Instrument Calibration Status	Y
CFU Count	N/A
Remarks	Monthly summary OK

SYSTEM GENERATED DOCUMENT

Calibration Due: August 29, 2026

This document is automatically generated and does not require manual signature.