


DIFFERENTIAL PRESSURE GAUGE

Date: January 18, 2025 | Time: 9:20 | Booth ID: SB-02 | Model: TH-DL2000

Differential Pressure Monitoring

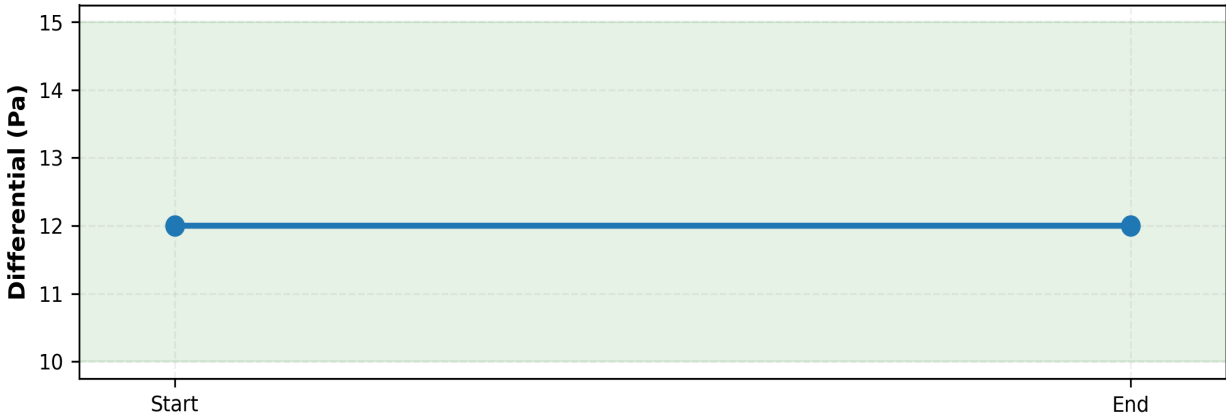

DAILY SUMMARY STATISTICS

Parameter	Value	Range	Status
Differential Pressure	12.0	10.0-15.0 Pa	✓ PASS

INSTRUMENT INFORMATION

HEPA Integrity	Pass
Comments	Weekly check. All parameters OK.



System generated | Serial: TH-DL2000-2558 | Cal Due: 2025-12-31