


DIFFERENTIAL PRESSURE GAUGE

Date: January 25, 2025 | Time: 9:00 | Booth ID: SB-02 | Model: TH-DL2000

Differential Pressure Monitoring

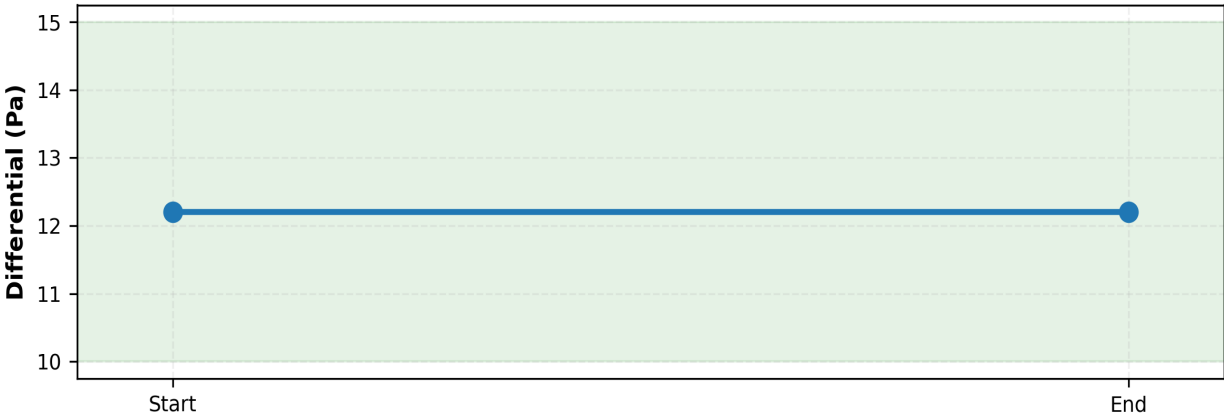

DAILY SUMMARY STATISTICS

Parameter	Value	Range	Status
Differential Pressure	12.2	10.0-15.0 Pa	✓ PASS

INSTRUMENT INFORMATION

HEPA Integrity	Pass
Comments	Pre-sampling check for Packaging Materials.

