


# DIFFERENTIAL PRESSURE GAUGE

Date: January 31, 2025 | Time: 9:10 | Booth ID: SB-02 | Model: TH-DL2000

## Differential Pressure Monitoring

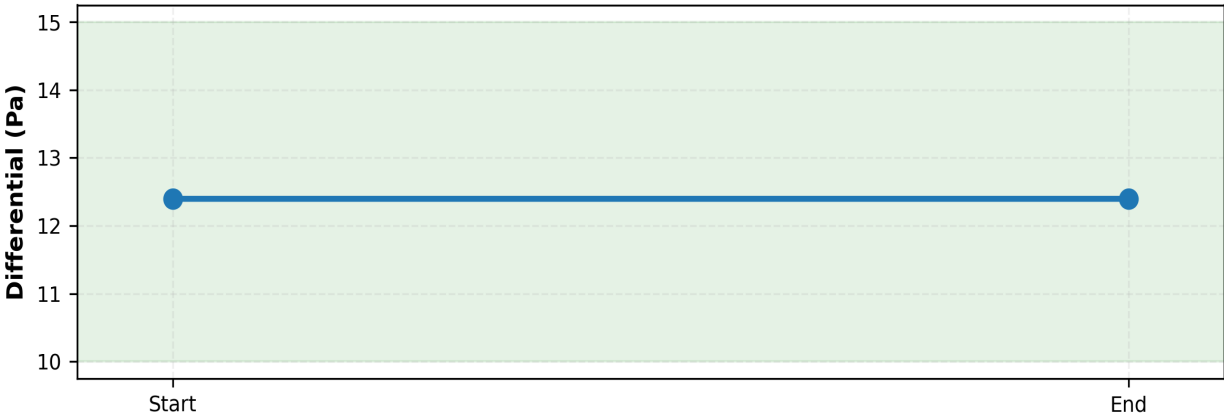

## DAILY SUMMARY STATISTICS

Parameter	Value	Range	Status
Differential Pressure	12.4	10.0-15.0 Pa	✓ PASS

## INSTRUMENT INFORMATION

HEPA Integrity	Pass
Comments	Monthly summary OK.

