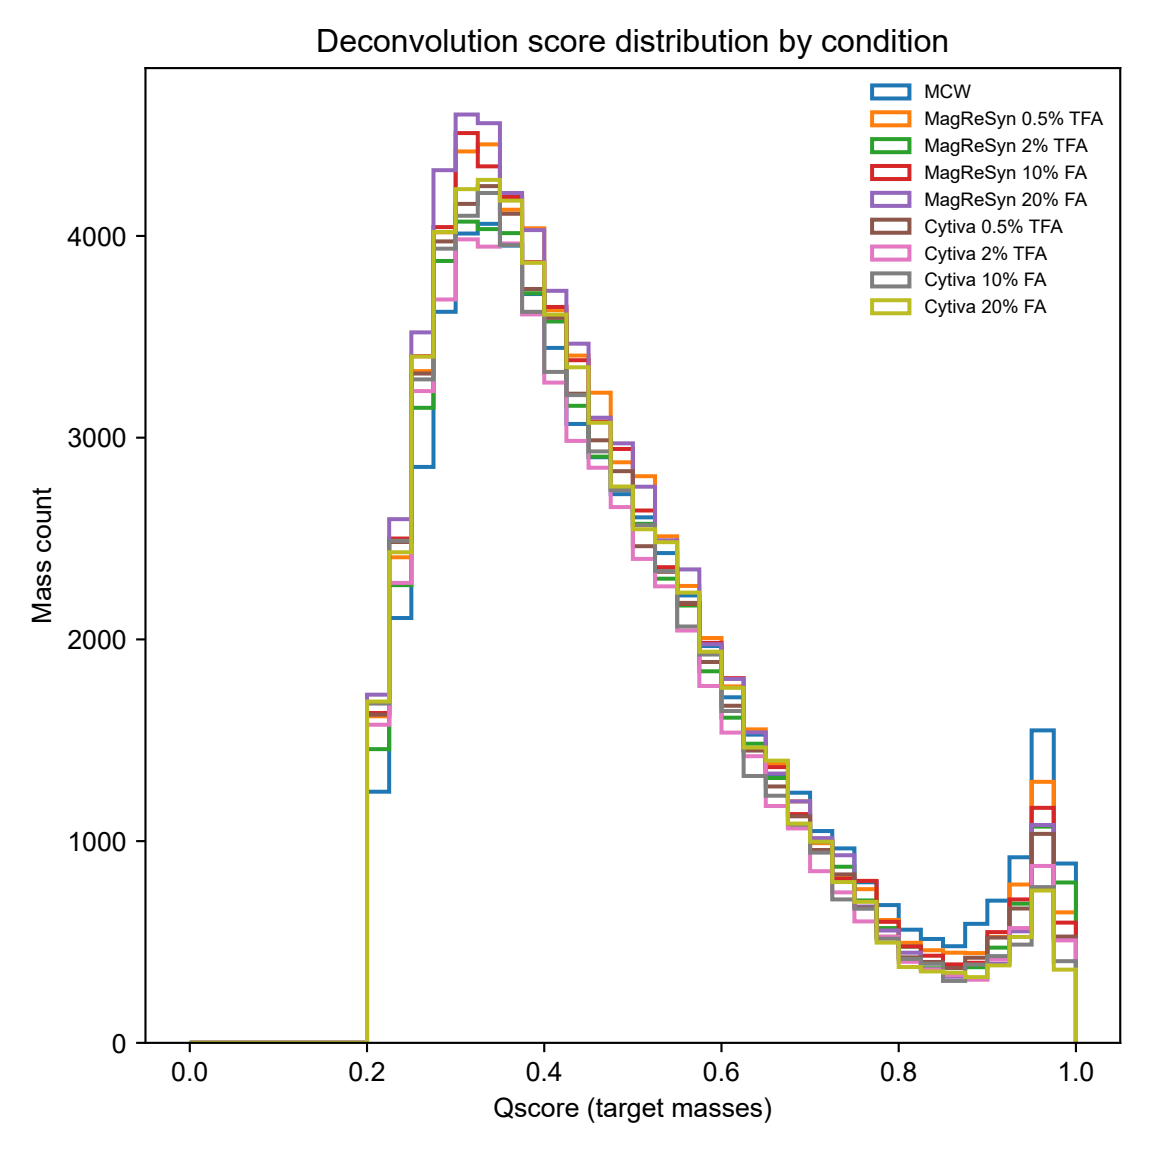
Deconvolution score distribution by condition
MCW
MagReSyn 0.5% TFA
MagReSyn 2% TFA
MagReSyn 10% FA
MagReSyn 20% FA
Cytiva 0.5% TFA
Cytiva 2% TFA
Cytiva 10% FA
Cytiva 20% FA
Mass count
0
1000
2000
3000
4000
0.0
0.2
0.4
0.6
0.8
1.0
Qscore (target masses)