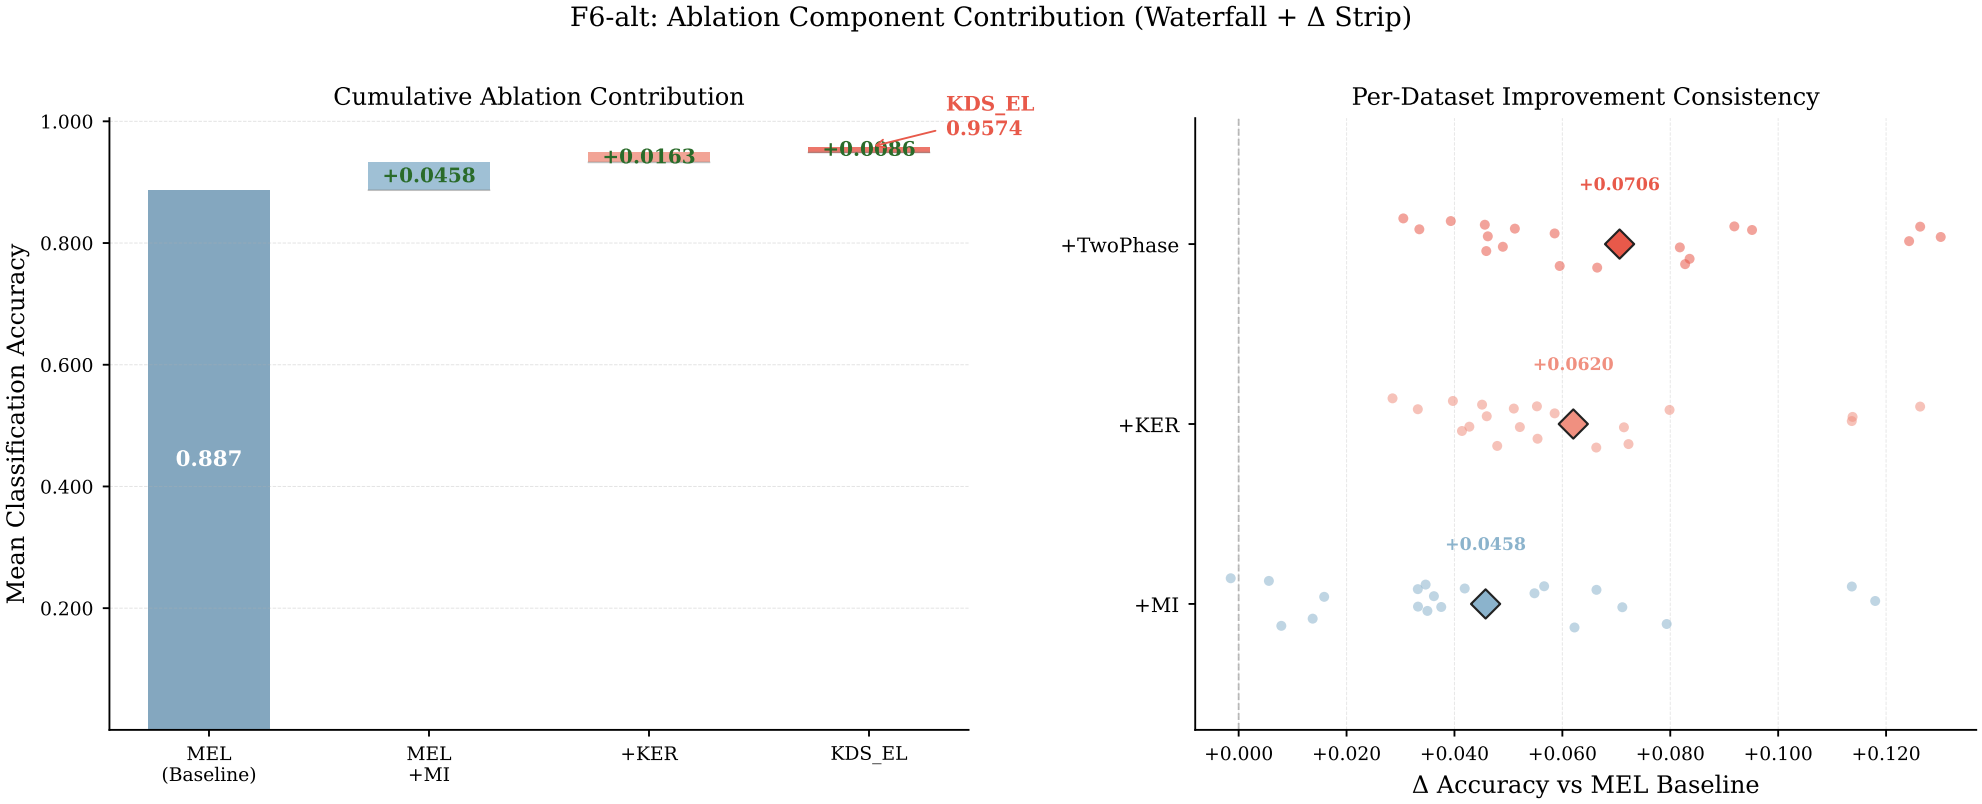
F6-alt: Ablation Component Contribution (Waterfall + Δ Strip)
Cumulative Ablation Contribution
Mean Classification Accuracy
1.000
0.800
0.600
0.400
0.200
0.887
+0.0458
+0.0163
+0.0086
KDS_EL
0.9574
MEL
(Baseline)
MEL
+MI
+KER
KDS_EL
Per-Dataset Improvement Consistency
+TwoPhase
+KER
+MI
+0.0706
+0.0620
+0.0458
+0.000
+0.020
+0.040
+0.060
+0.080
+0.100
+0.120
Δ Accuracy vs MEL Baseline