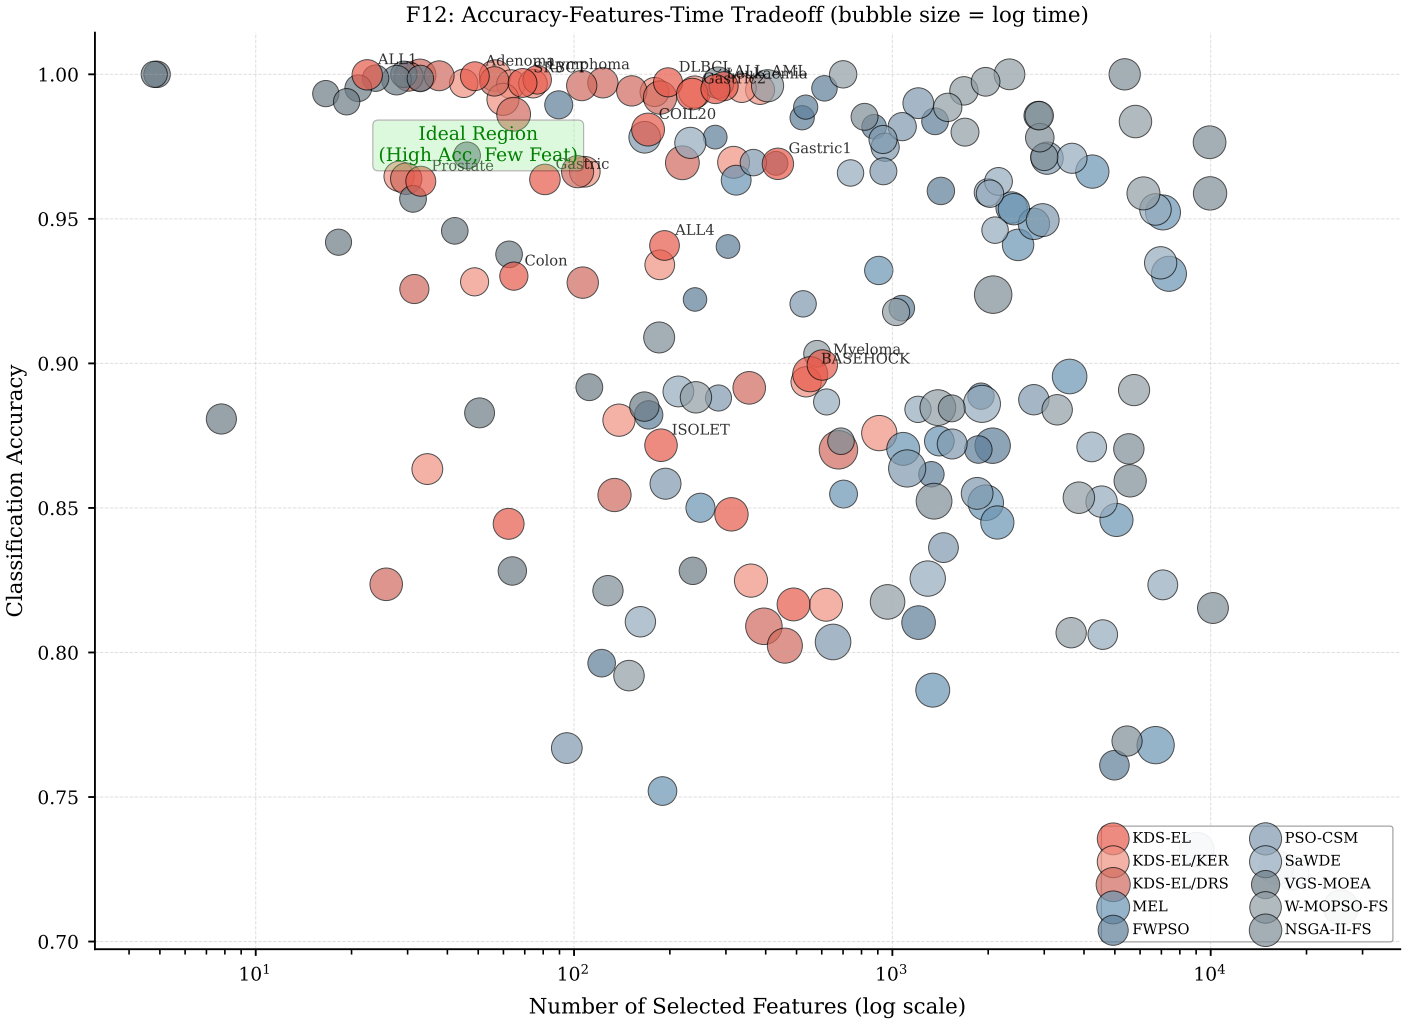

F12: Accuracy-Features-Time Tradeoff (bubble size = log time)
Classification Accuracy
Number of Selected Features (log scale)
1.00
0.95
0.90
0.85
0.80
0.75
0.70
10^1
10^2
10^3
10^4
Ideal Region
(High Acc, Few Feat)
ALL1
Adenoma
Lymphoma
DLBCL
Gastric2
Leukemia
ALL_AML
COIL20
Gastric1
Prostate
Gastric
ALL4
Colon
Myeloma
BASEHOCK
ISOLET
KDS-EL
KDS-EL/KER
KDS-EL/DRS
MEL
FWPSO
PSO-CSM
SaWDE
VGS-MOEA
W-MOPSO-FS
NSGA-II-FS