
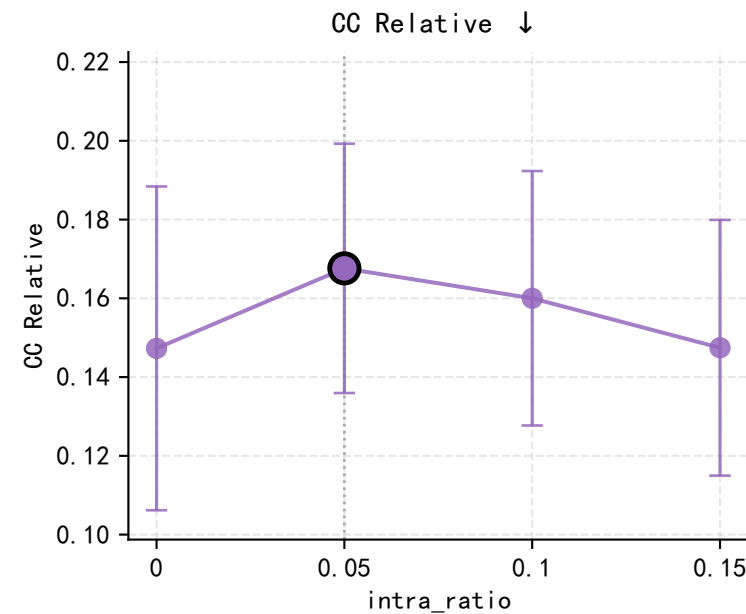
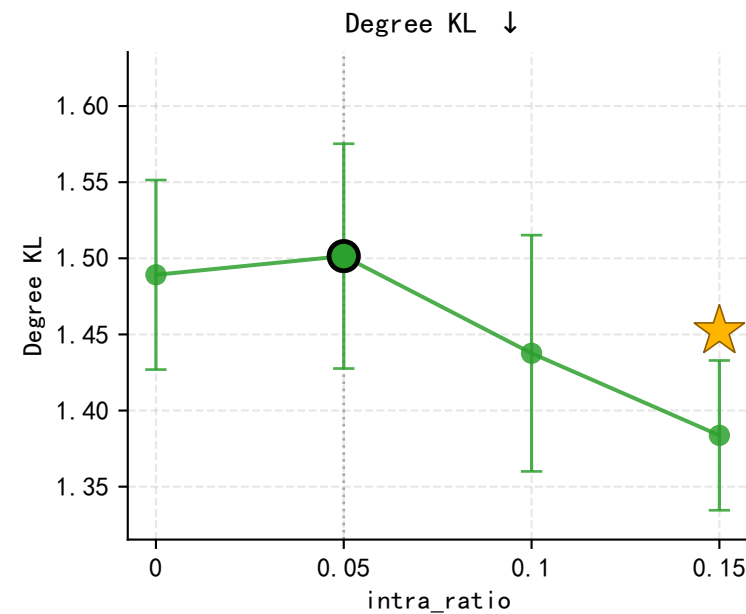
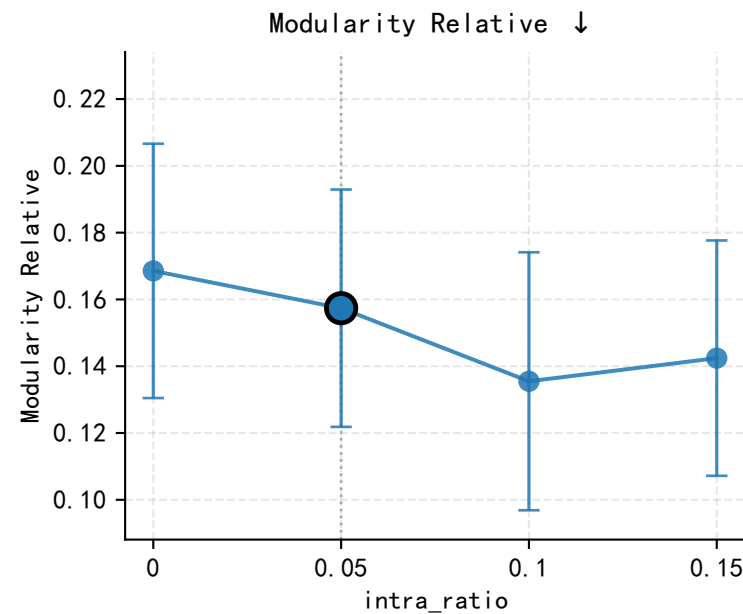


intra_ratio 敏感性扫描 ($\varepsilon = 2.0$, 30 reps, 误差棒为 95% CI)

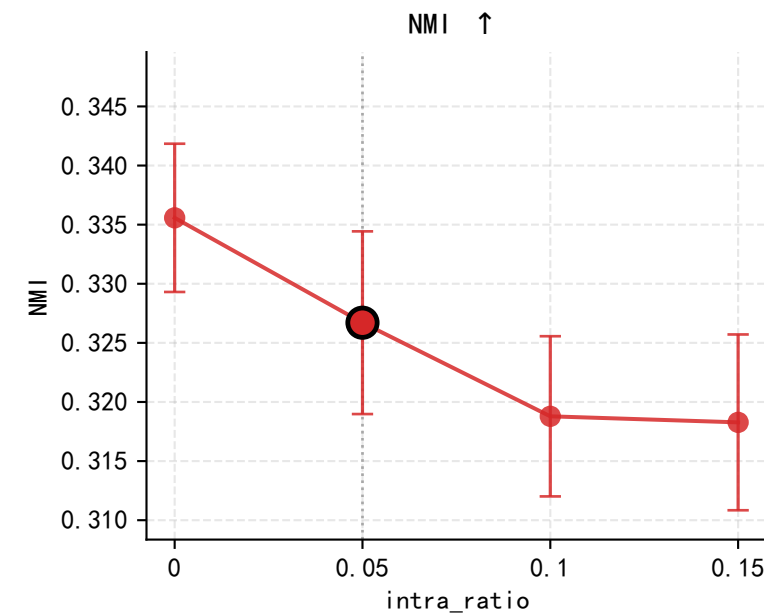

● 默认取值 ★ 与默认显著不同 ($p < 0.05$, Welch t-test) 默认值