




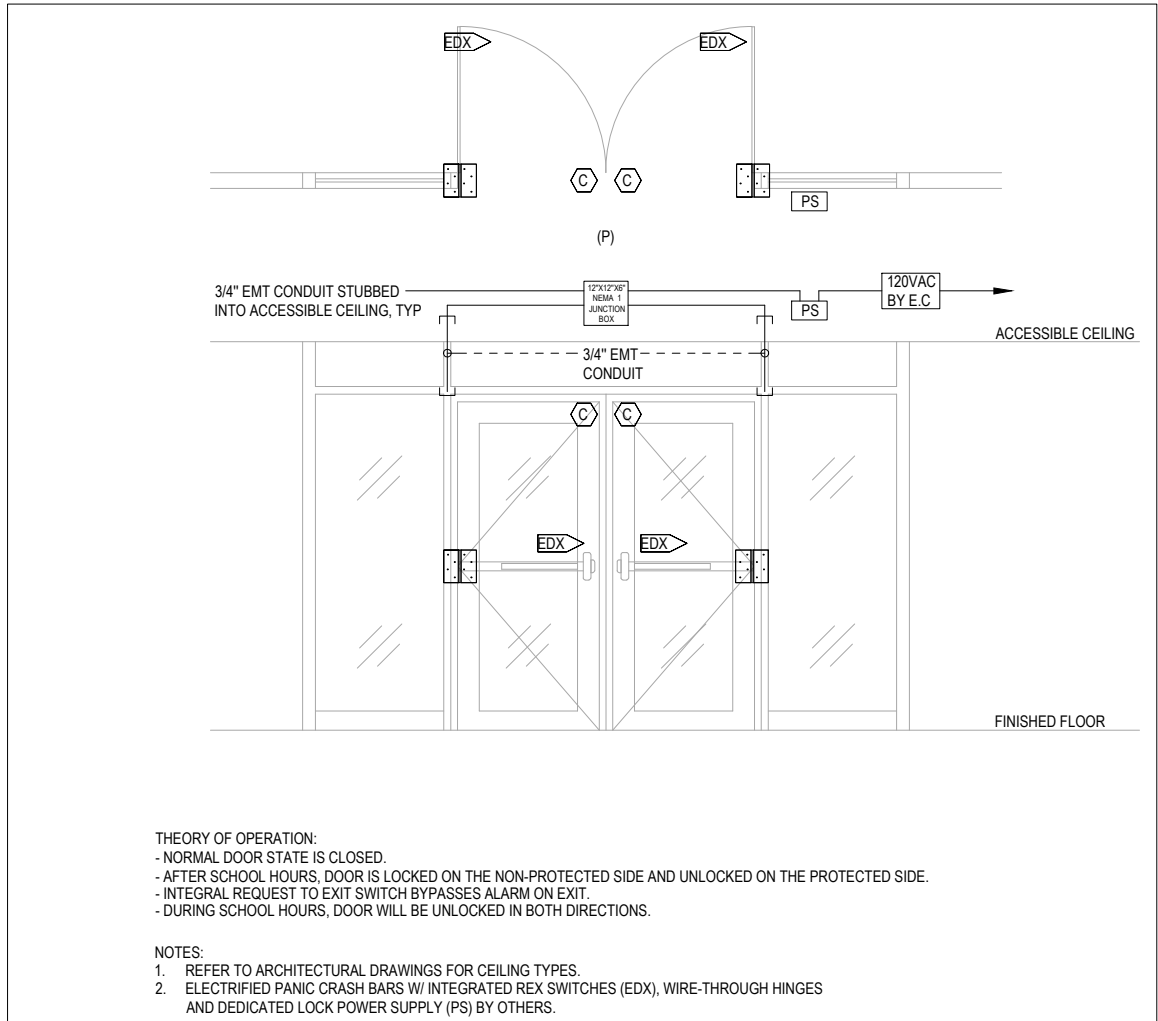


4 DOUBLE DOOR - EXIT DEVICE - UNLOCK ONLY
SCALE: NONE

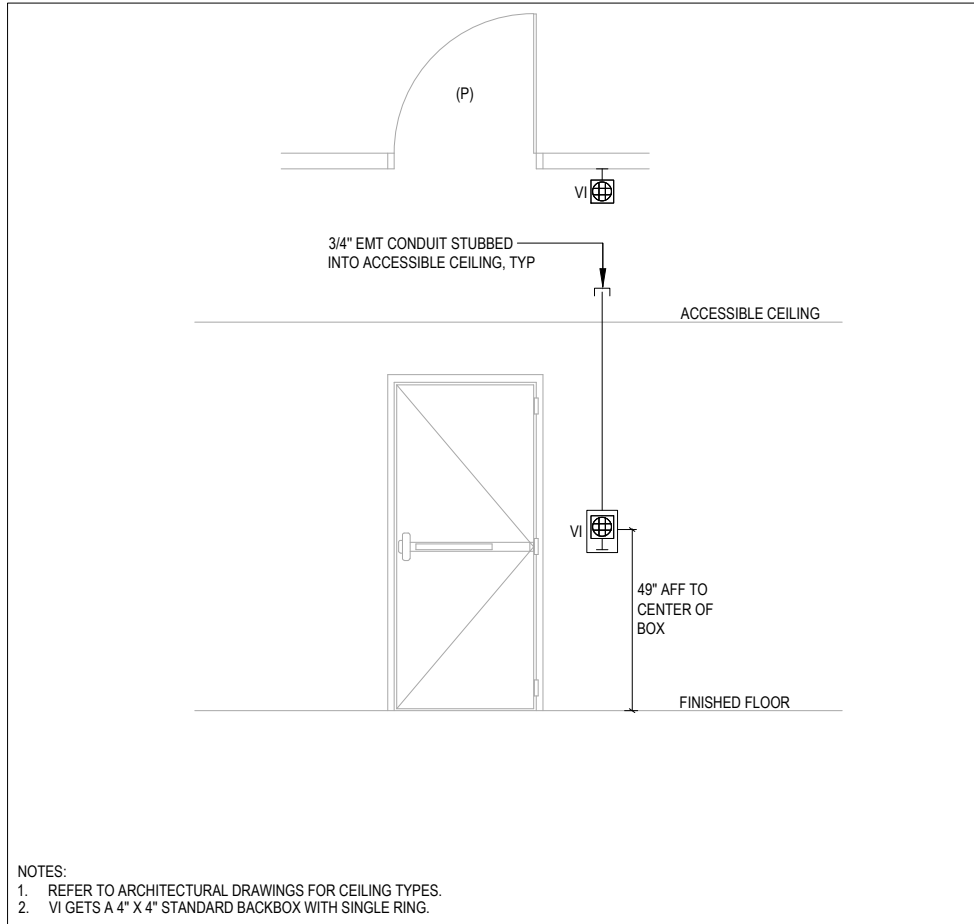

3 IP VIDEO INTERCOM
SCALE: NONE

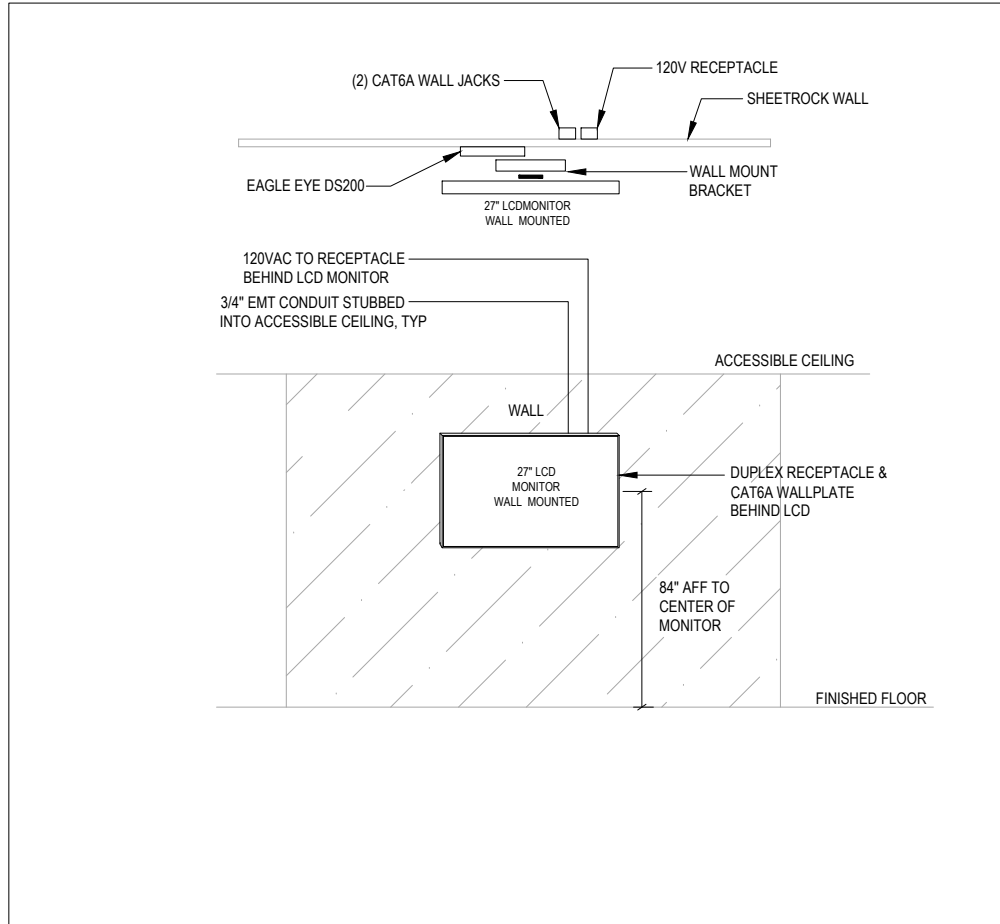

2 CAMERA VIEWING STATION
SCALE: NONE

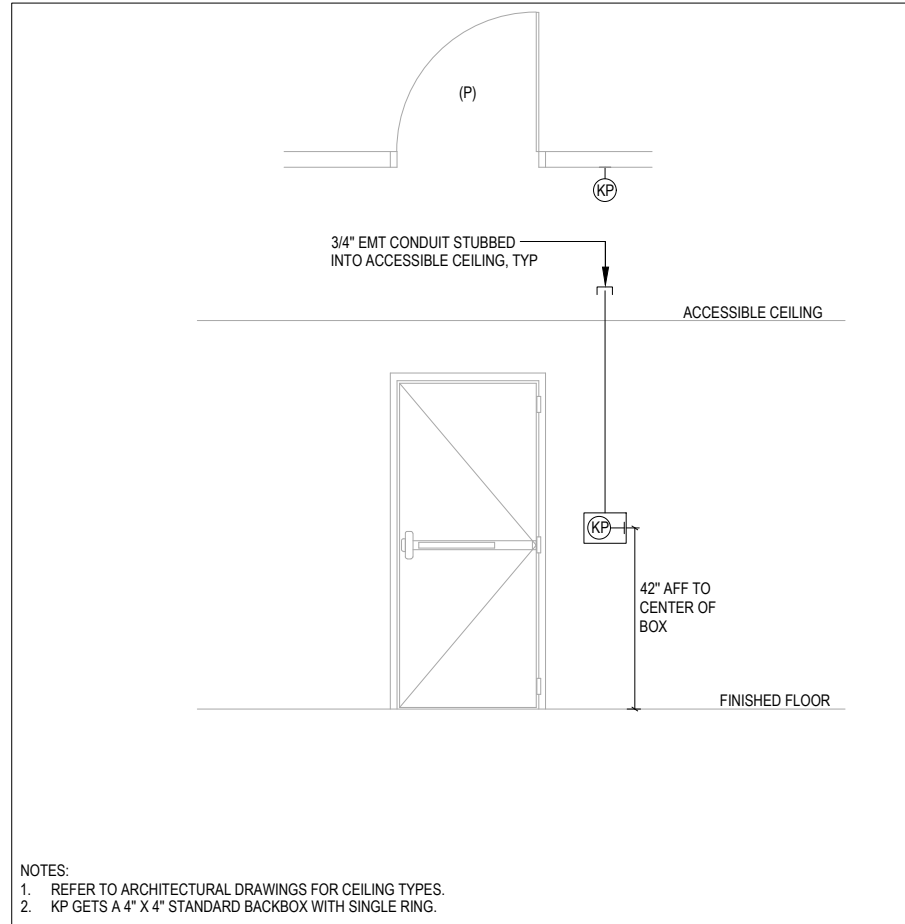

1 KEYPAD (ARMING/DISARMING)
SCALE: NONE

- ### DOOR DETAIL SHEET NOTES
- REFER TO SHEET TO D1 FOR ABBREVIATIONS, GENERAL NOTES, AND SYMBOLS DEFINITIONS.
 - THE DIAGRAMS ON THIS SHEET ARE SHOWN AS A GUIDELINE FOR ROUGH-IN CONFIGURATION. INDIVIDUAL DOORS MAY VARY. ADJUST THE INSTALLATION TO SUIT EACH INSTANCE, INCLUDING CONDUIT ROUTING CONFIGURATION AND QUANTITY, AND DEVICE LOCATIONS.
 - REFER TO THE DOOR SCHEDULE FOR INDIVIDUALLY ASSIGNED DOOR DETAILS.
 - SUBMIT INDIVIDUAL DOOR DETAILS TO MATCH PROJECT REQUIREMENTS.
 - DASHED COMPONENTS AND LINES INDICATE ITEMS ON THE OPPOSITE SIDE OF THE WALL.
 - PROVIDE (1) 3/4\"/>
 - INSTALL JUNCTION BOXES AND POWER SUPPLIES ABOVE ACCESSIBLE CEILINGS ON THE PROTECTED SIDE OF DOORS. WHERE COMPONENTS OCCUR BELOW CEILINGS, OR IN OPEN TO ABOVE AREAS, INSTALL JUNCTION BOXES FLUSH TO WALL AND INSTALL CONDUITS CONCEALED WITHIN THE WALL.
 - TERMINATE SECURITY CABLE TO TRANSFER HINGE AND LOCK BODY. COORDINATE INSTALLATION WITH THE DOOR HARDWARE PROVIDER.
 - FOR DOORS WITH FAIL-SAFE LOCKING HARDWARE AND IN THE PATH OF EGRESS, ACTIVATION OF THE BUILDING FIRE ALARM SYSTEM WILL AUTOMATICALLY UNLOCK FAIL-SAFE DOORS IN THE PATH OF EGRESS. DOORS WILL REMAIN LATCHED. PROVIDE FIRE ALARM SYSTEM INTERFACE RELAY ADJACENT TO FAIL-SAFE LOCK POWER SUPPLY. COORDINATE WITH ARCHITECTURAL DRAWINGS, DOOR HARDWARE SCHEDULE AND SPECIFICATIONS, AND FIRE ALARM DRAWINGS FOR DOORS IN THE PATH OF EGRESS.
 - DOORS AND FRAMES ARE FACTORY-FABRICATED FOR SECURITY DEVICES INCLUDING LOCK WIRE PATHWAY.



ST. IGNATIUS COLLEGE PREPARATORY

2001 37th Ave, San Francisco, CA 94116

STAMP

COMPLIANT LOGO

TEECOM

10 California Street
Suite 100
San Francisco, CA 94107
(415) 397-2800
www.teecom.com

DR1 STAMP

REV

DATE

DESCRIPTION

1

09/10/2025

AGENDAM E. SUBMIT FOR PERMIT

2

09/10/2025

ISSUED FOR CONSTRUCTION

3

09/10/2025

DYNAMIC SECURITY PLANS

DETAILS - SECURITY

NONE

T6.14