

- SHEET NOTES
- A. REFER TO SHEET T6.01 FOR ABBREVIATIONS, GENERAL NOTES, AND SYMBOL DEFINITIONS.

B. REFER TO SHEET T6.02 FOR PRIMARY PATHWAY REQUIREMENTS AND DEFINITIONS.

C. REFER TO SHEET T6.03 AND T6.04 FOR OUTLETS/DEVICES SECONDARY PATHWAY AND CABLING REQUIREMENTS.

D. SERVE OUTLETS/DEVICES ON THIS SHEET FROM TELECOM ROOMS AS NOTED.

E. REFER TO SECURITY INSTALLATION DETAILS FOR SECONDARY PATHWAY REQUIREMENTS, SYSTEM INTERFACES, AND COMPONENT CONFIGURATIONS.


F. INSTALL SECONDARY PATHWAYS ALONG THE MOST DIRECT ROUTES TO PRIMARY PATHWAYS OR SERVING ROOM.

G. INSTALL HORIZONTAL CABLES ALONG THE MOST DIRECT PRIMARY PATHWAY ROUTE TO THE SERVING TELECOM ROOM.

H. PROVIDE APPROVED FIRESTOP SYSTEMS AT PENETRATIONS THROUGH FIRE BARRIERS, SMOKE BARRIERS, AND SMOKE PARTITIONS TO MAINTAIN RATINGS.

I. ACP (ACCESS CONTROL PANELS) WILL BE WIRED TO LOG AND PROGRAMMED TO FORWARD CRITICAL ALARM SIGNALS FROM SELECT INTRUSION-RELATED SECURITY DEVICES INTO THE BURGLAR/INTRUSION ALARM SYSTEM. THIS INCLUDES SIGNALS FROM LA (LOCAL AUDIBLE SOUNDER), REVERES, EMERGENCY DC (DOOR CONTACTS), AND CARD READER TO (CARD READER - FORCED OPEN) ALARMS. THE SYSTEMS INTEGRATION WILL BE SYNCHRONIZED VIA HARDWIRED JUMPERS FROM ACP RELAY OUTPUTS OVER TO EDC (BURGLAR ZONE EXPANDER) UNITS. THE INTERCONNECTING WIRING WILL BE MADE WITHIN THE SECURITY ENCLOSURES AT EACH CORRESPONDING MOP/DC CLOSET.

J. HATCHED BOX OUTLINES DEPICT TWO READERS THAT CONTROL ACCESS INTO THE SAME DOOR OR ELEVATOR CAB.

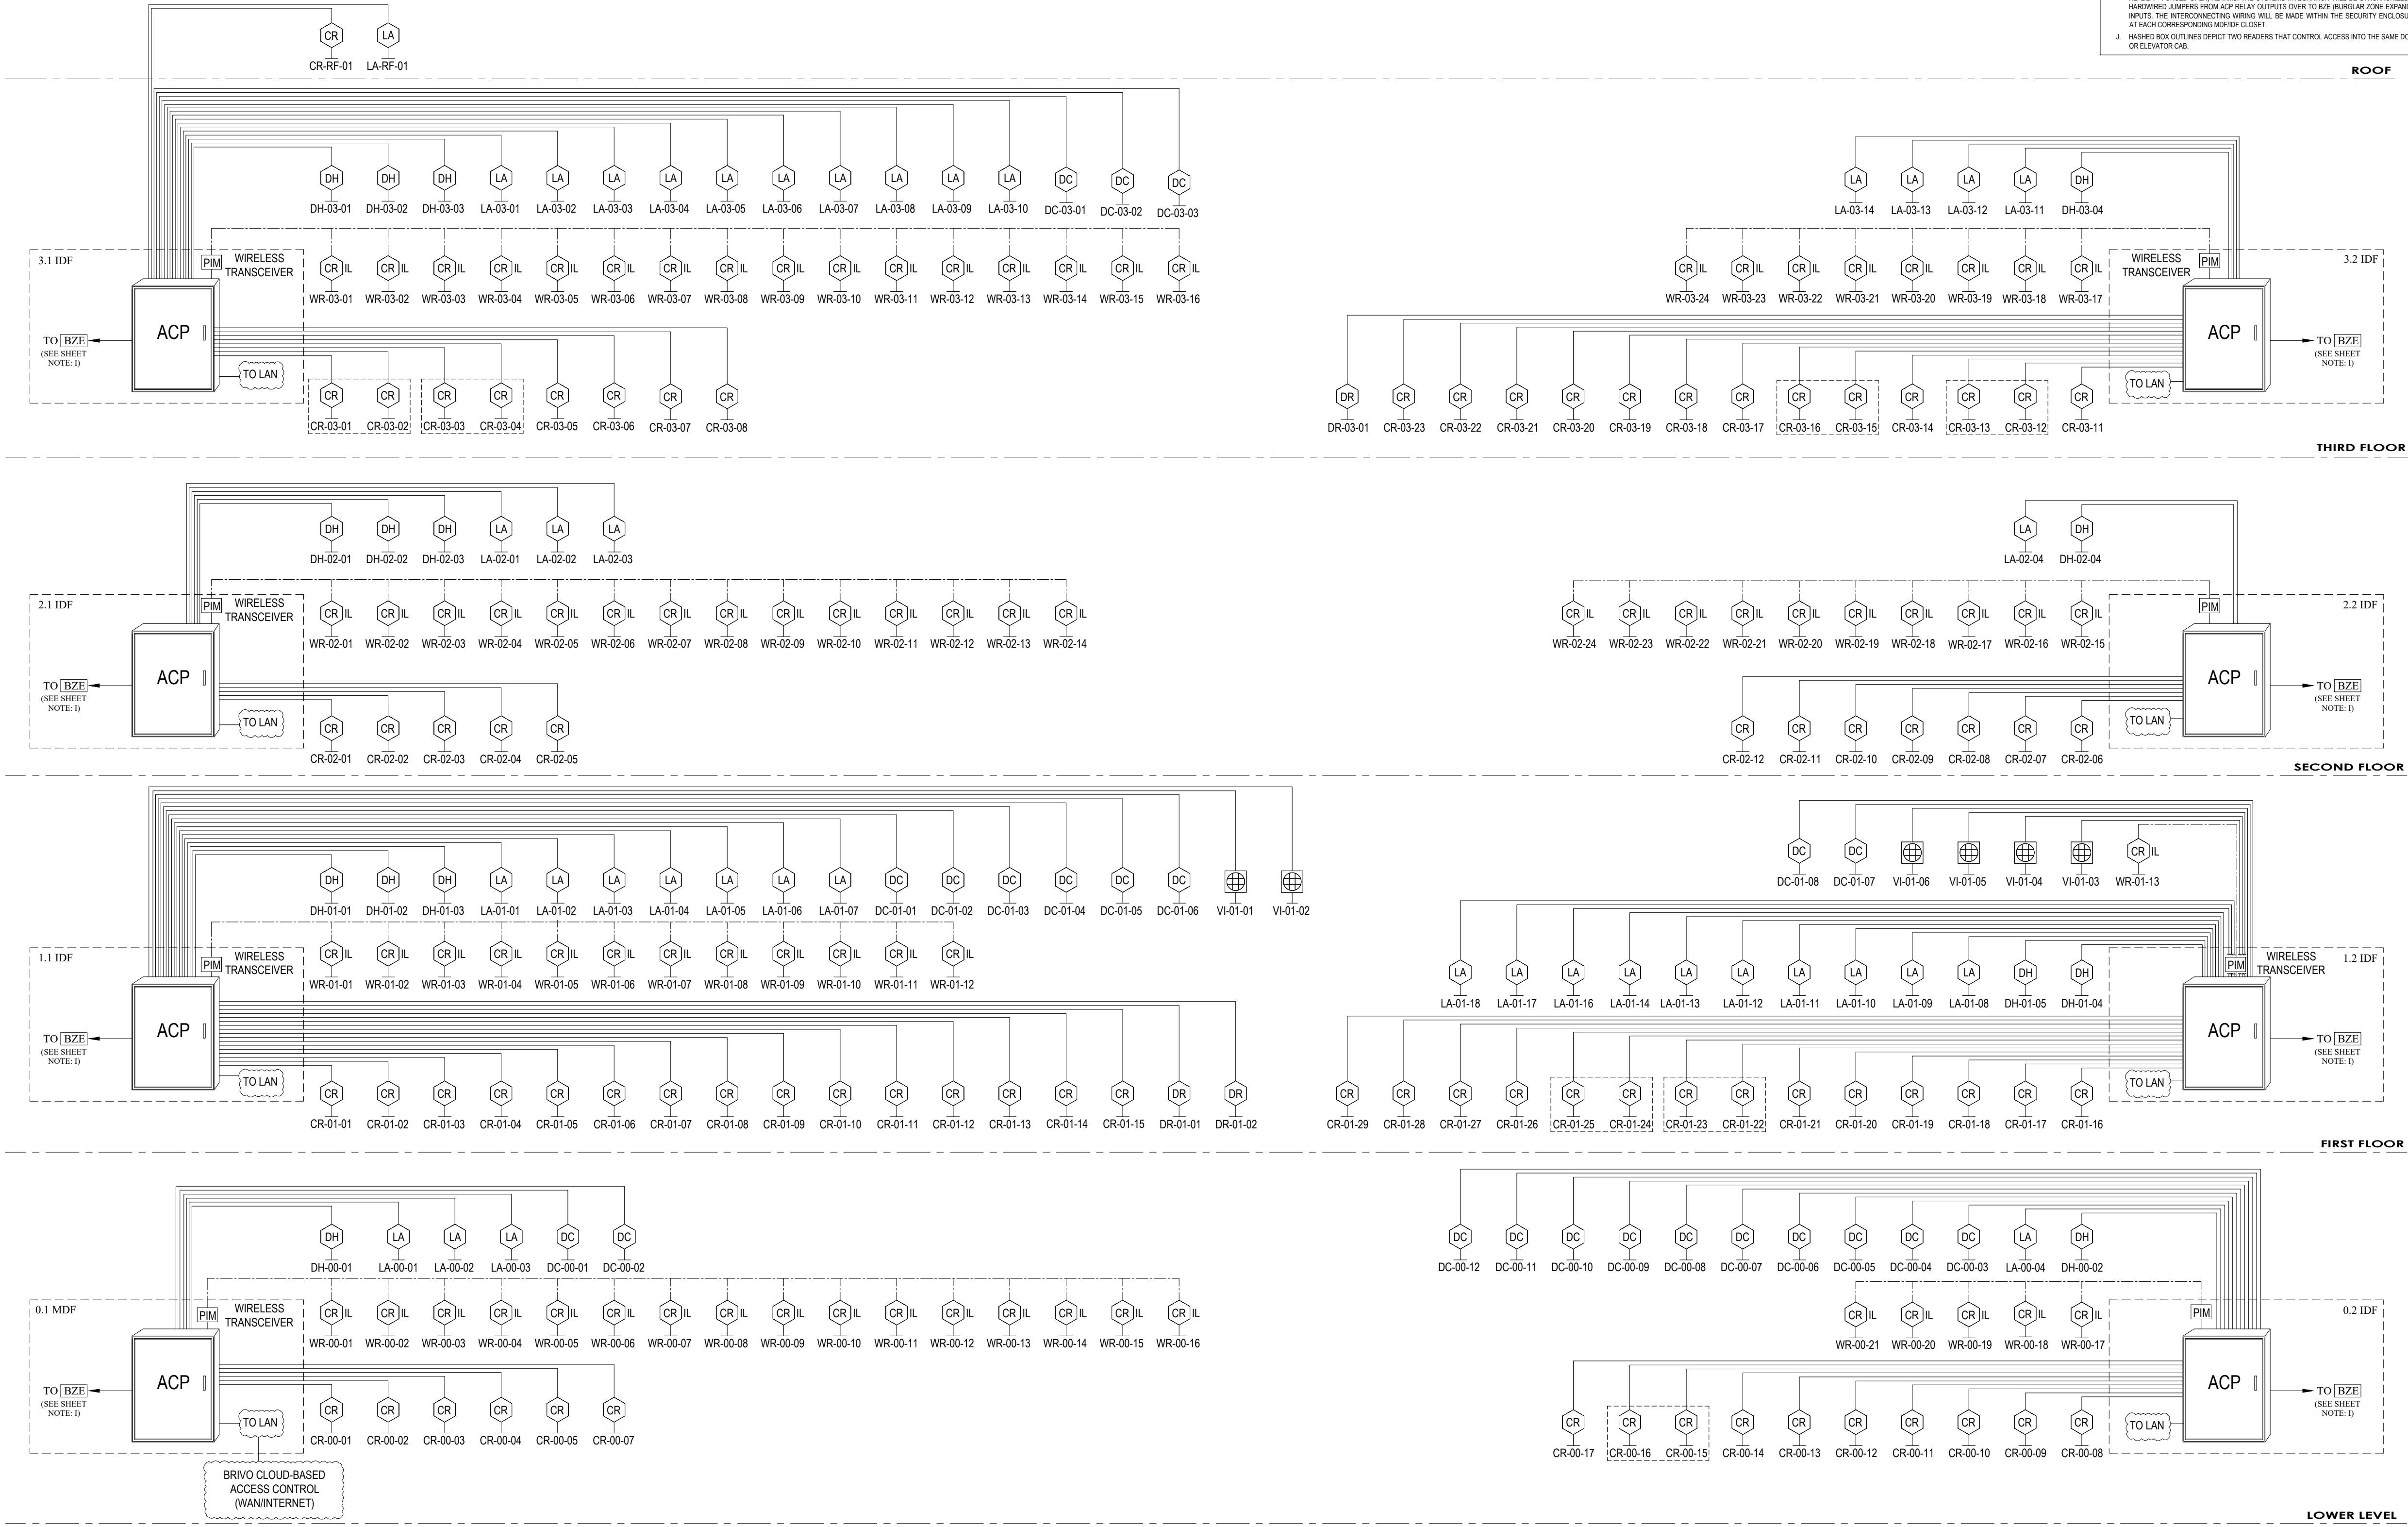

A

ACCESS CONTROL SYSTEM RISER DIAGRAM

SCALE: N.T.S.



ST. IGNATIUS COLLEGE PREPARATORY

ACCESS CONTROL SYSTEM RISER DIAGRAM

T6.08

ST. IGNATIUS COLLEGE PREPARATORY

2001 37th Ave, San Francisco, CA 94116

DATE: 05/03/2024

DESCRIPTION: DRAWING SECURITY PLANS

REV: 1

STAMP

CONSULTANT LOGO

TEECOM

© California State

San Francisco, CA

94116

2001 37th Ave