



09/30/2026	DYNAMIC SECURITY PLANS
------------	------------------------


2001 37th Ave, San Francisco, CA 94116

INTRUSION ALARM SYSTEM RISER DIAGRAM

T6.09

8. REFER TO SHEET T-01 FOR OBSERVATIONS, GENERAL NOTES, AND SYMBOL DEFINITIONS.
9. REFER TO SHEET T-02 FOR PRIMARY PATHWAY REQUIREMENTS AND DEFINITIONS.
10. REFER TO SHEET T-03 AND T-04 FOR OUTLETS/DESIGNS SECONDARY PATHWAY AND CABLING REQUIREMENTS.
11. SERVE OUTLETS/DESIGNS ON THIS SHEET FROM TELECOM ROOMS AS NOTED.
12. REFER TO SECURITY INSTALLATION DETAILS FOR SECONDARY PATHWAY REQUIREMENTS, SYSTEM INTERFACES, AND COMPONENT CONFIGURATIONS.
13. INSTALL SECONDARY PATHWAYS ALONG THE MOST DIRECT ROUTES TO PRIMARY PATHWAYS OR TO THE NEAREST TELECOM ROOM.
14. INSTALL TELECOM CABLES ALONG THE MOST DIRECT PRIMARY PATHWAY ROUTE TO THE SERVING TELECOM ROOM.
15. PROVIDE APPROVED FIRESTOP SYSTEMS AT PENETRATIONS THROUGH FIRE BARRIERS, SMOKE BARRIERS, AND SMOKE PARTITIONS TO MAINTAIN RATES.

1. ACIP ACCESS CONTROL PANELS WILL BE WIRRED TO LOG AND FORWARD CRITICAL ALARM SIGNALS TO THE SECURITY MONITORING CENTER. THIS INCLUDES SIGNALS FROM A LOCK, AUDIBLE SMOKE DEVICES, EMERGENCY DOOR CONTACTS, AND CARD SWEEP DETECTORS. FORCED ENTRY AND SECURITY INTEGRATION WILL BE SYNCHRONIZED VIA HARDWIRED JAMMING AND JAMPER RELAY OUTPUTS OVER SIZE 12 AWG CABLES TO THE SECURITY MONITORING CENTER. THE INTERCONNECTING WIRING WILL BE MADE WITHIN THE SECURITY ENCLOSURES AT EACH CORRESPONDING MOD/JCP LOC.

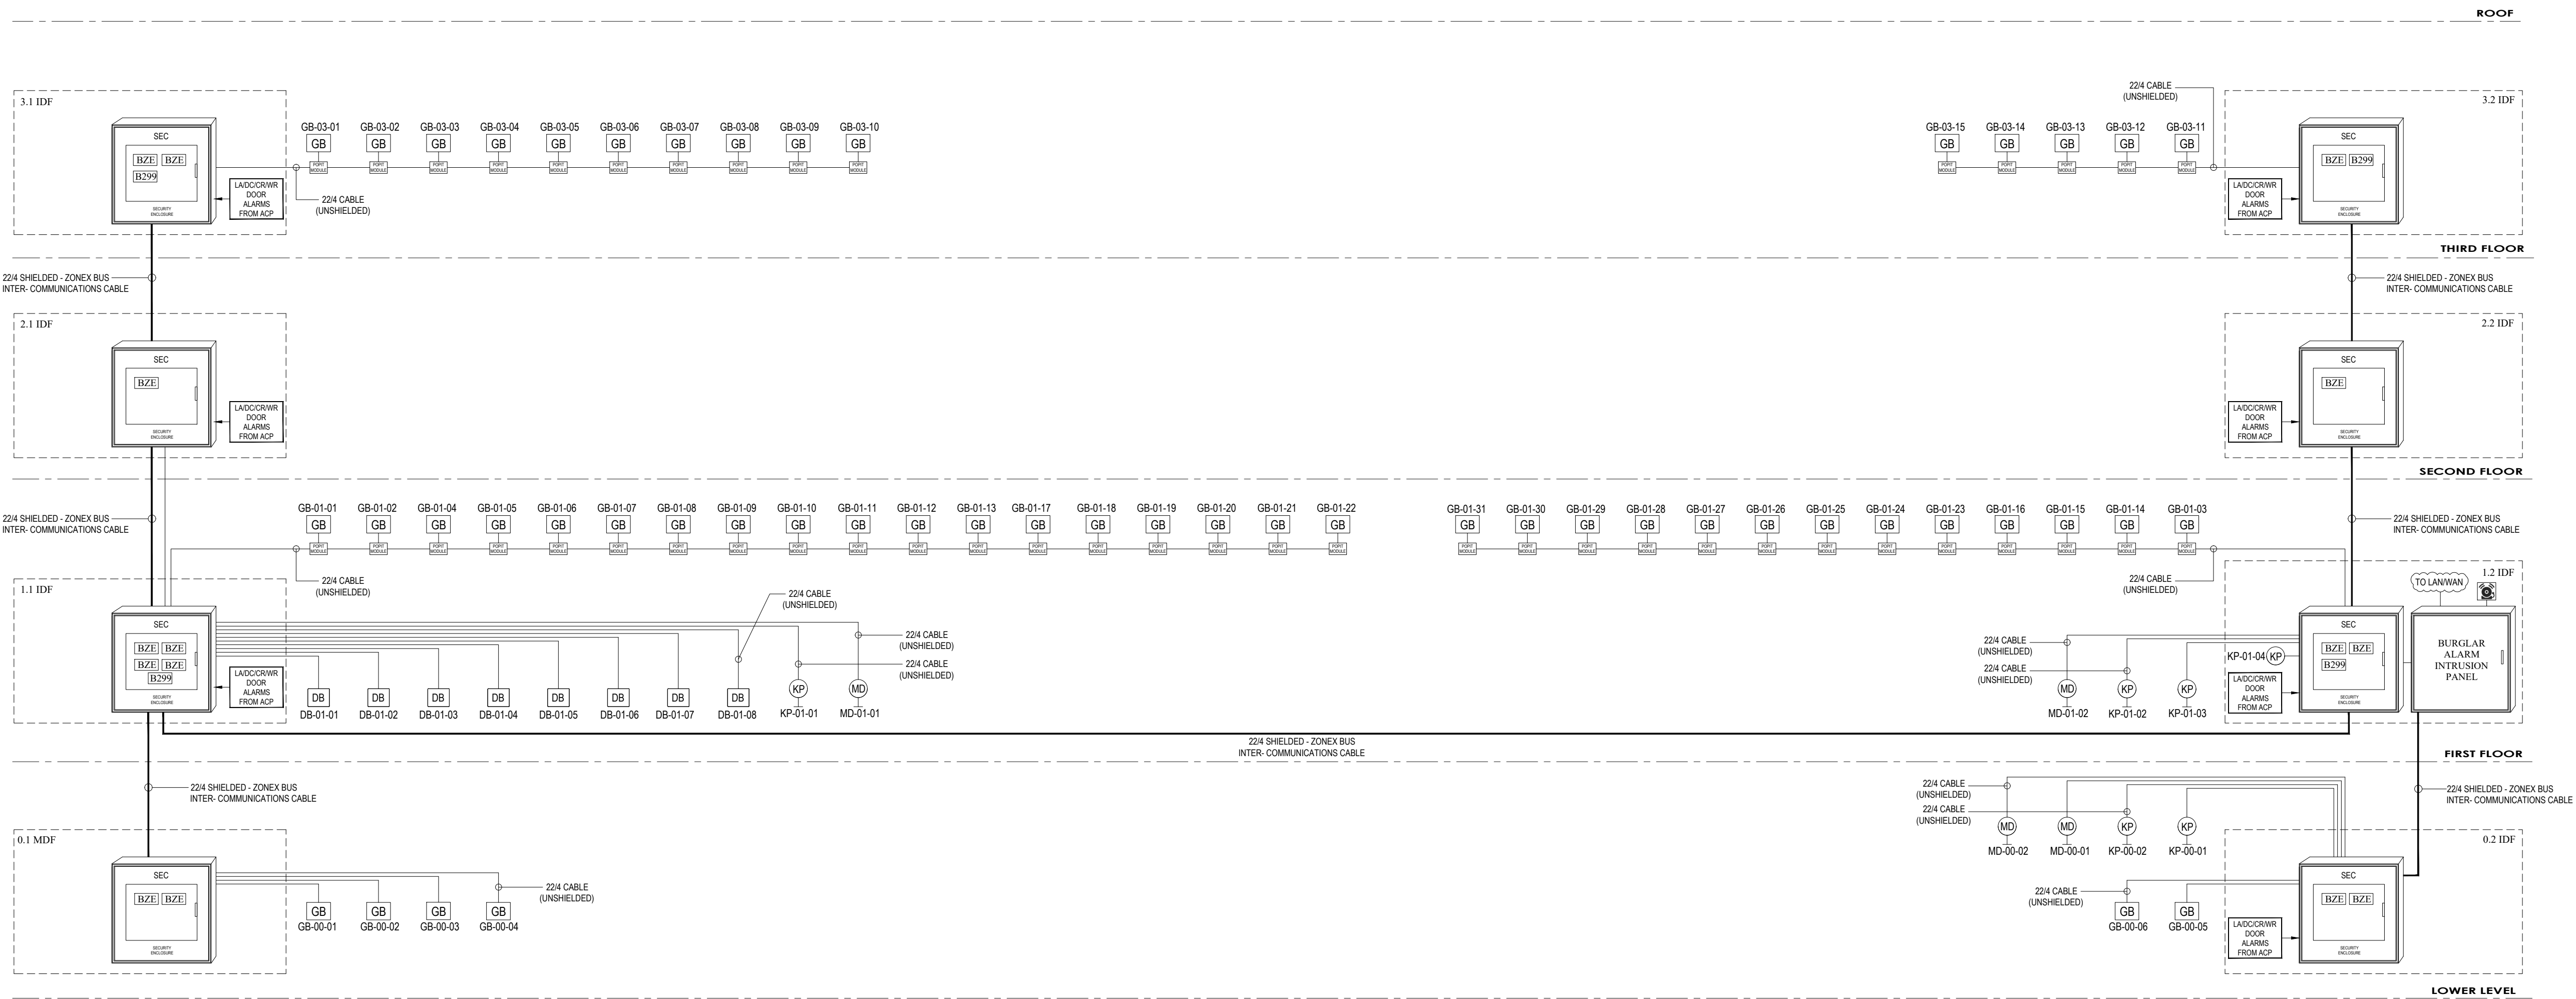

INTRUSION ALARM SYSTEM RISER DIAGRAM

SCALE: N.T.S