



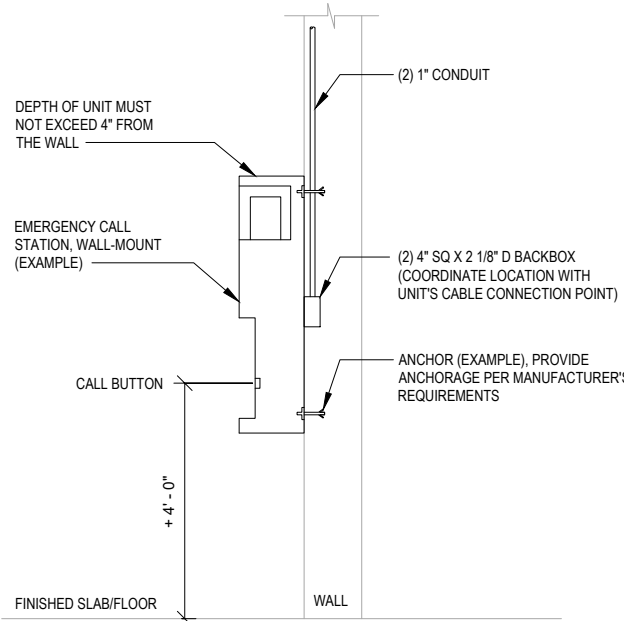

- NOTES:
1. INSTALL TO MANUFACTURER SPECIFICATIONS AND DIMENSIONS.
 2. DIMENSIONS SHOWN ARE IN COMPLIANCE WITH ADA REQUIREMENTS.
 3. REFER TO ARCHITECTURAL DRAWINGS FOR WALL TYPE BY LOCATION.
 4. COORDINATE WITH DIVISION 26 FOR 120VAC CONNECTION.

EMERGENCY CALL STATION - WALL MOUNTED

SCALE: NONE

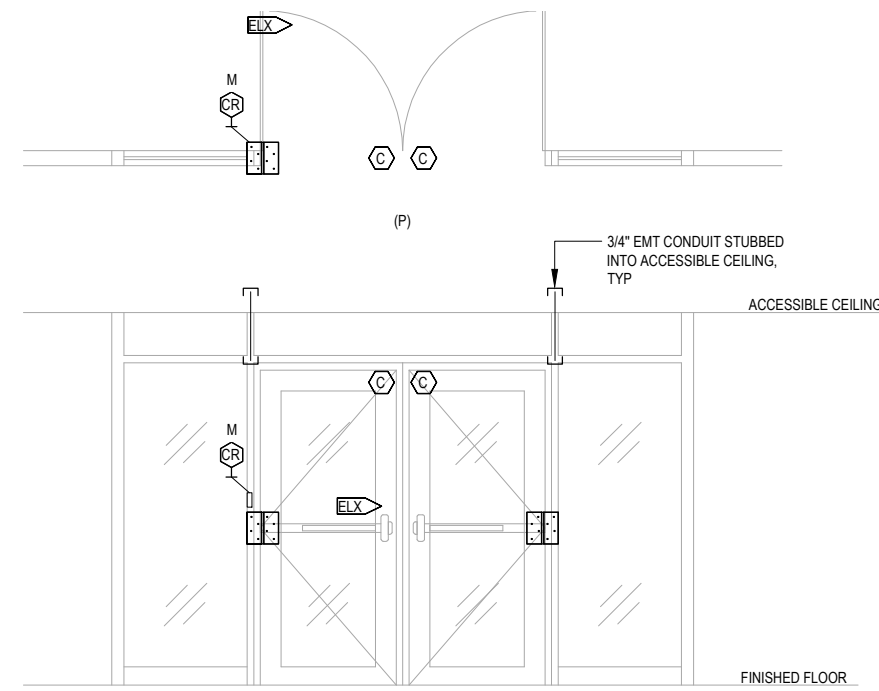


THEORY OF OPERATION:
- NORMAL DOOR STATE IS CLOSED.
- DOOR IS LOCKED ON THE NON-PROTECTED SIDE AND UNLOCKED ON THE PROTECTED SIDE.
- TO OPEN DOOR FROM NON-PROTECTED SIDE, CARD MUST BE PRESENTED TO UNLOCK DOOR.
- INTEGRAL REQUEST TO EXIT BYPASSES ALARM ON EXIT.

- NOTES:
1. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.

DOUBLE DOOR - ELECTRIC LOCK, CARD READER

SCALE: NONE

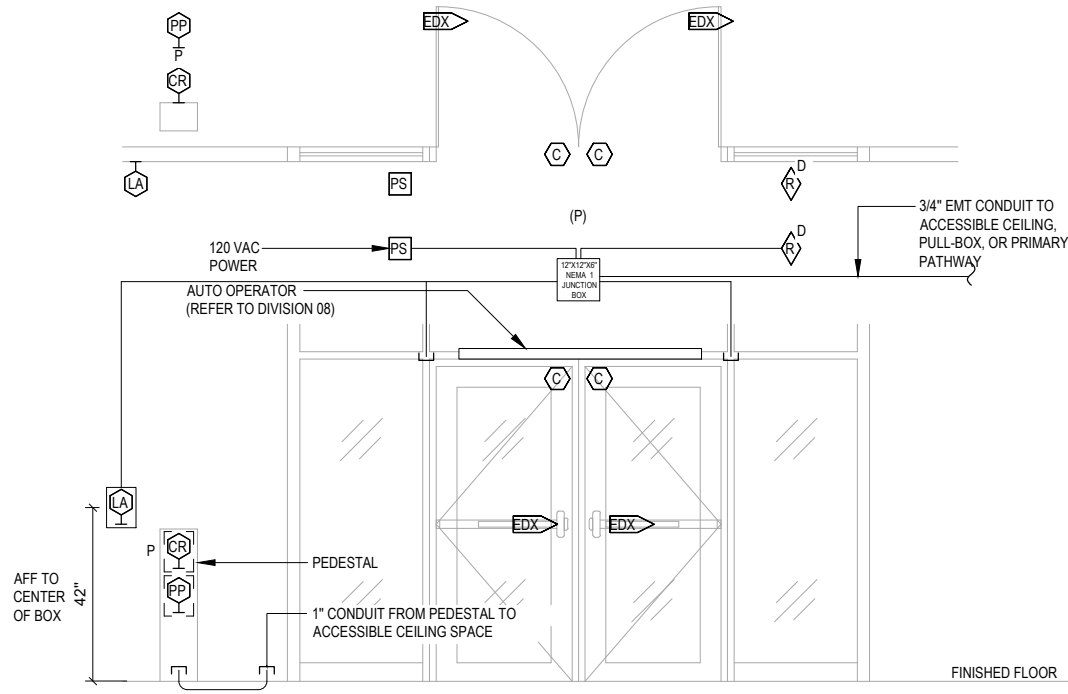


THEORY OF OPERATION:
- DOOR IS UNLOCKED DURING BUSINESS HOURS AND LOCKED AFTER HOURS.
- DOOR IS LOCKED ON THE NON-PROTECTED SIDE AND UNLOCKED ON THE PROTECTED SIDE.
- TO OPEN DOOR FROM THE NON-PROTECTED SIDE AFTER HOURS, CARD MUST BE PRESENTED TO UNLOCK DOOR.
- INTEGRAL REQUEST TO EXIT BYPASSES ALARM ON EXIT.
- EXTERIOR ADA ACTUATOR IS INTERLOCKED WITH DOOR LOCKS AND DISABLED WHEN LOCKED.
- INTERIOR ADA ACTUATOR BYPASSES ALARM CONTACT AND OPERATES DOOR.
- REFER TO WIRING SCHEMATIC FOR INTEGRATION TO OPERATOR.

- NOTES:
1. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
 2. REFER TO ARCHITECTURAL DRAWINGS FOR PEDESTAL DETAILS.
 3. COORDINATE CARD READER AND PUSH PLATE WITH ARCHITECTURAL DRAWINGS (SEE T6.11F(2)). PUSH PLATE IS SHOWN FOR REFERENCE.
 4. LA GETS A 3-GANG SUPER DEEP BACKBOX WITH 3-GANG RING.

DOUBLE DOOR - AUTO-OPERATOR, CARD READER - LOCAL ALARM


SCALE: NONE

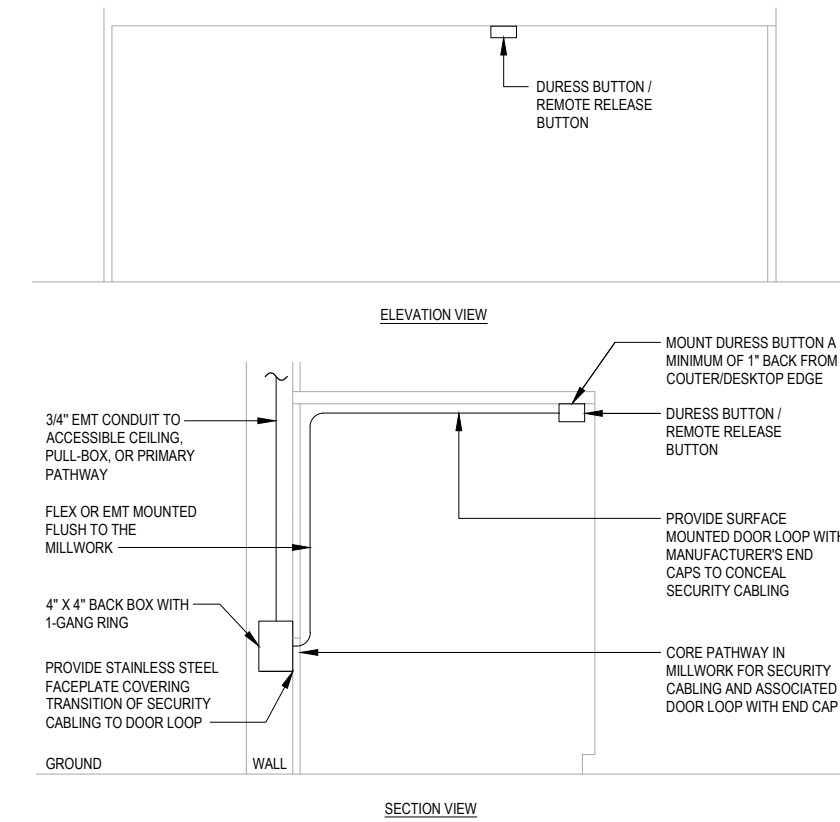

- NOTES:
1. PRIOR TO INSTALLATION, COORDINATE WITH THE OWNERS REPRESENTATIVE, ARCHITECT AND THE CASEWORK CONTRACTOR TO FIELD DETERMINE THE EXACT LOCATION OF THE BUTTON.
 2. PROVIDE SURFACE MOUNTED RACEWAY TO CONCEAL SECURITY CABLEING TO BE SUPPORTED BY METAL P-CRAMPS.

DURESS BUTTON / REMOTE RELEASE BUTTON - DESK MOUNT, WALL CABLED

SCALE: NONE

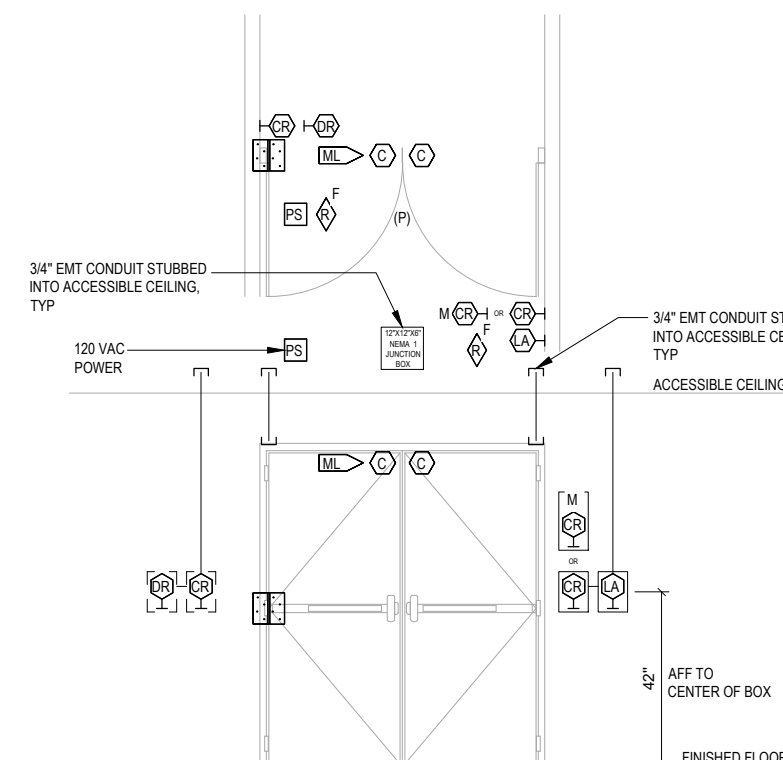


THEORY OF OPERATION:
- DOOR IS LOCKED ON THE NON-PROTECTED AND PROTECTED SIDE DURING OFF HOURS.
- TO OPEN DOOR FROM EITHER SIDE, CARD MUST BE PRESENTED TO SEND UNLOCK SIGNAL TO RELEASE MAGLOCK.
- DURING LIFE SAFETY EVENT, POWER IS OUT TO MAGLOCKS ALLOWING FREE EGRESS.
- MAGLOCK CAN ALSO BE RELEASED THROUGH ACTIVATION OF DOOR RELEASE BUTTON.

- NOTES:
1. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
 2. USE INTERIOR MULLION READER FOR DOOR 383A. USE INTERIOR STANDARD WALL MOUNT READER FOR DOOR 379A.
 3. SHASE LOCAL ALARM WITH DOOR 383B. PROVIDES DESIGNATED LOCAL ALARM WITH DOOR 379A.
 4. DR AND OR GET 4" X 4" STANDARD BACKBOX WITH SINGLE RING.
 5. LA GETS A 3-GANG SUPER DEEP BACKBOX WITH 3-GANG RING.

DOUBLE DOOR - EXIT DEVICE, CARD-IN-CARD-OUT, MAGLOCK

SCALE: NONE

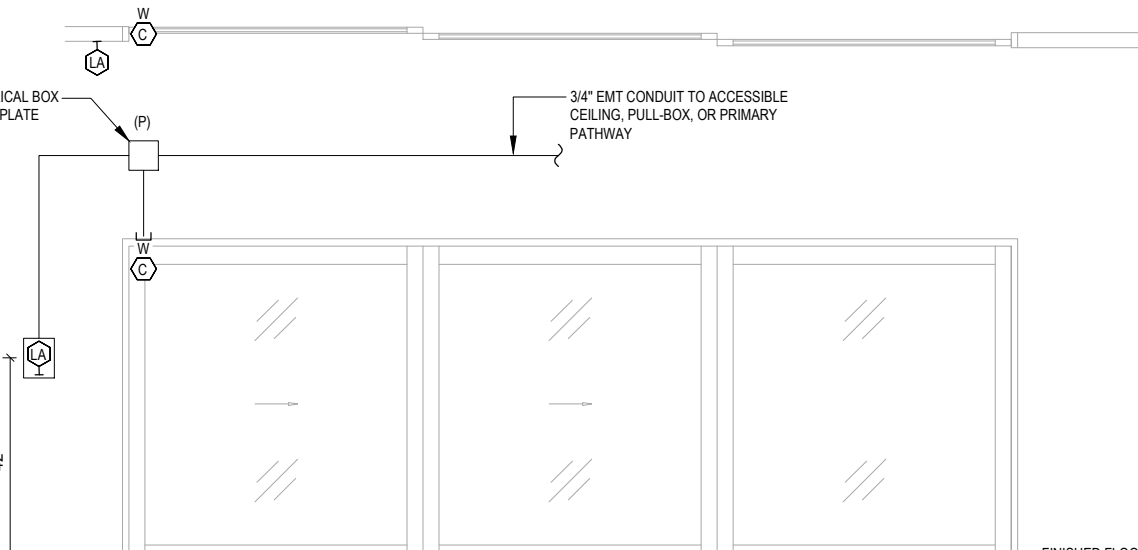


THEORY OF OPERATION:
- DOOR IS MONITORED ON A PROGRAMMED SCHEDULE FOR OPEN/CLOSED STATUS.

NOTES:

1. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
2. COORDINATE WITH DIVISION 8 CONTRACTOR TO ENSURE A SECURELY FASTENED AND AESTHETICALLY SUFFICIENT ALARM CONTACT INSTALLATION.
3. LA GETS A 3-GANG SUPER DEEP BACKBOX WITH 3-GANG RING.


SLIDING PARTITION - MONITORED - LOCAL ALARM

SCALE: NONE

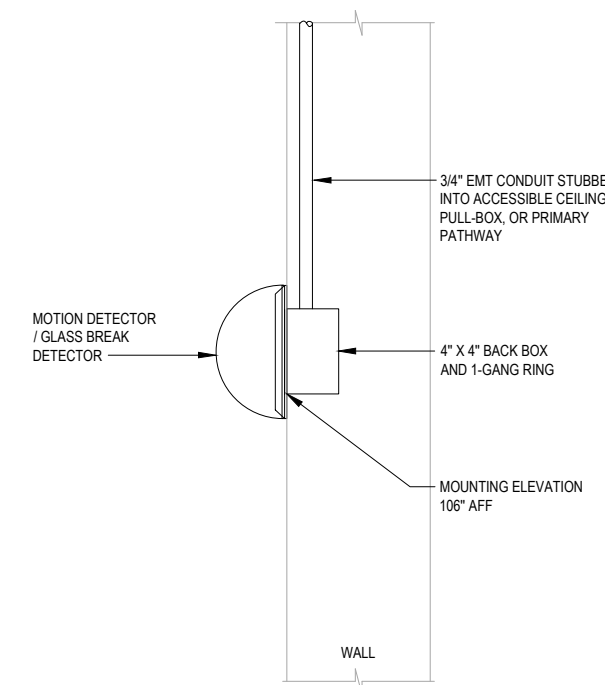

MOTION DETECTOR / GLASS BREAK DETECTOR - WALL-MT

SCALE: NONE

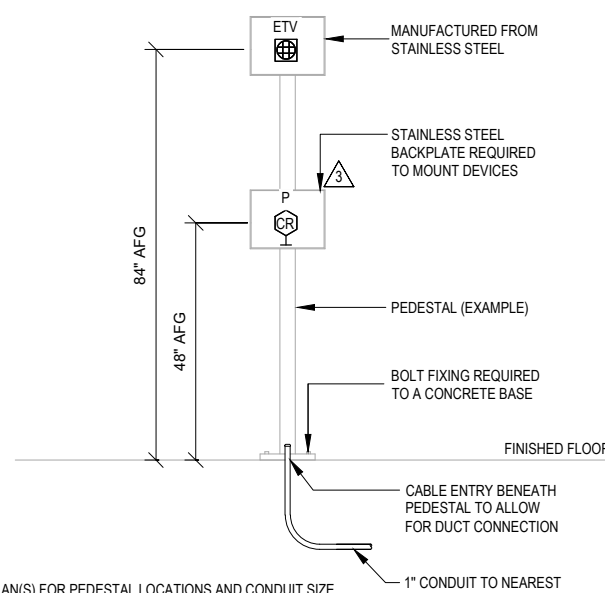

- NOTES:
1. REFER TO PLANS FOR PEDESTAL LOCATIONS AND CONDUIT SIZE.
 2. REFER TO ARCHITECTURAL DRAWINGS FOR PEDESTAL DETAILS.
 3. COORDINATE DEVICE MOUNTING WITH THE PEDESTAL INSTALLATION.

FRONT VIEW

SCALE: NONE


- NOTES:
- PEDESTALS ARE TO BE PRE-FABRICATED WHERE POSSIBLE. BESPOKE PEDESTALS WILL REQUIRE THE INTEGRATOR TO SUBMIT DESIGNS TO THE CLIENT FOR APPROVAL PRIOR TO ORDERING.
 - AN ALLOWANCE SHOULD BE MADE FOR THE EXTERNAL PEDESTALS TO MATCH THE SURROUNDING ARCHITECTURE. CLIENT TO PROVIDE REQUIRED COLOUR.
 - CABLEING TO BE EXTERNAL DUCT GRADE.

THEORY OF OPERATION:
- VISITORS WITHOUT AN ACCESS CONTROL CARD, OR USERS THAT EXPERIENCE ANY ISSUES ENTERING SITE ARE TO USE THE INTERCOM TO SPEAK DIRECTLY TO SECURITY.

- SINGLE FACTOR AUTHENTICATION CARD READ REQUIRED FOR VALID USERS TO ENTER THROUGH VEHICLE RESTRICTIONS METHODS.

PEDESTAL - DUAL HEIGHT, READER AND INTERCOM


SCALE: NONE

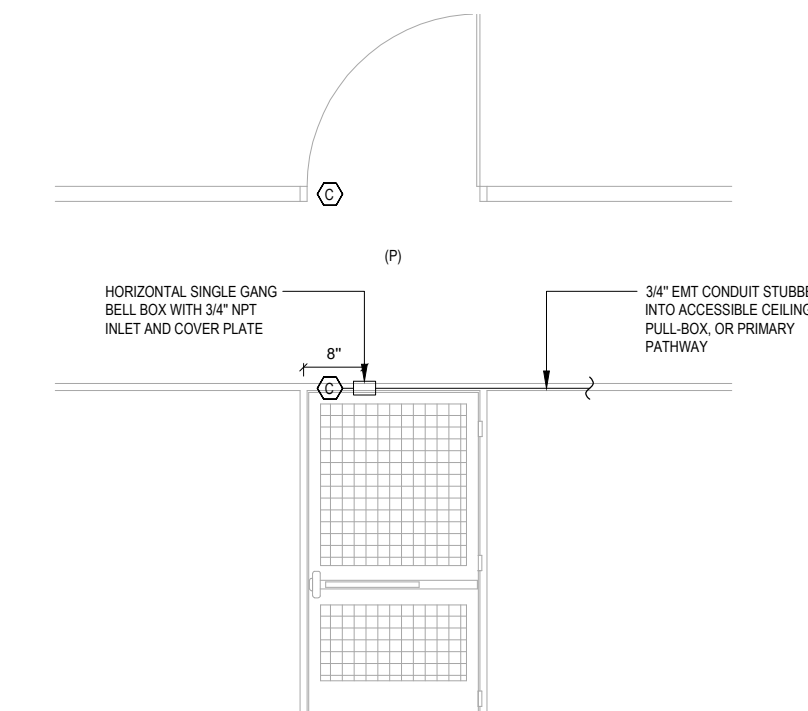

THEORY OF OPERATION:
- NORMAL GATE STATE IS CLOSED AND LOCKED.
- GATE IS MONITORED FOR ENTRANCE AND EXIT.


GATE - MONITORED

SCALE: NONE

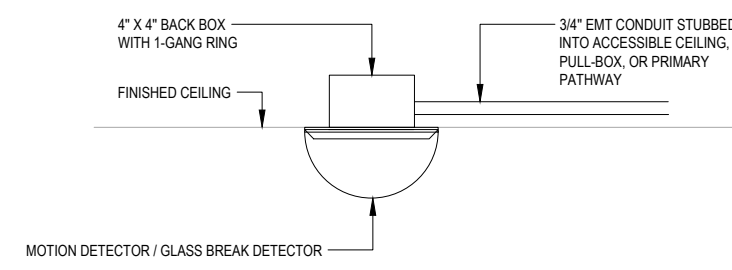

MOTION DETECTOR / GLASS BREAK DETECTOR - CEILING-MT


SCALE: NONE

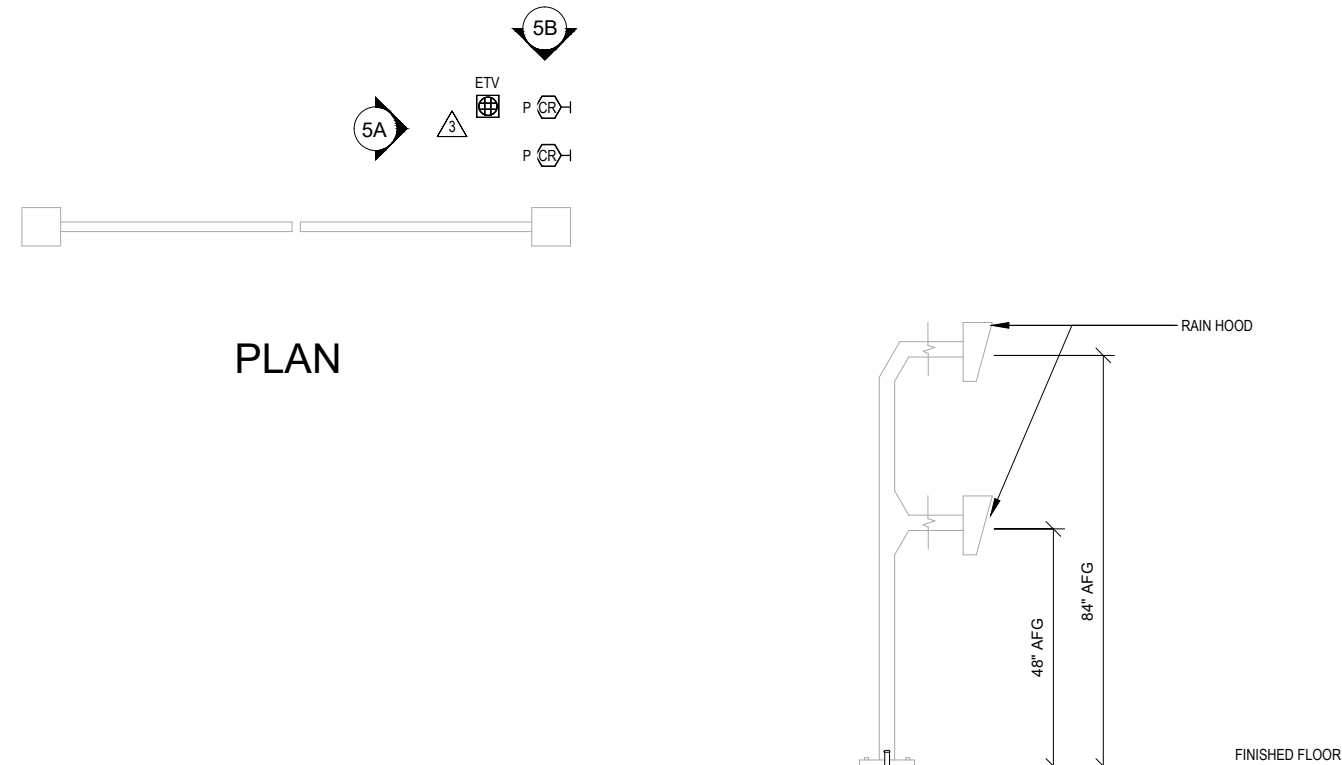

- NOTES:
1. REFER TO PLANS FOR PEDESTAL LOCATIONS AND CONDUIT SIZE.
 2. REFER TO ARCHITECTURAL DRAWINGS FOR PEDESTAL DETAILS.
 3. COORDINATE DEVICE MOUNTING WITH THE PEDESTAL INSTALLATION.

SIDE VIEW

SCALE: NONE

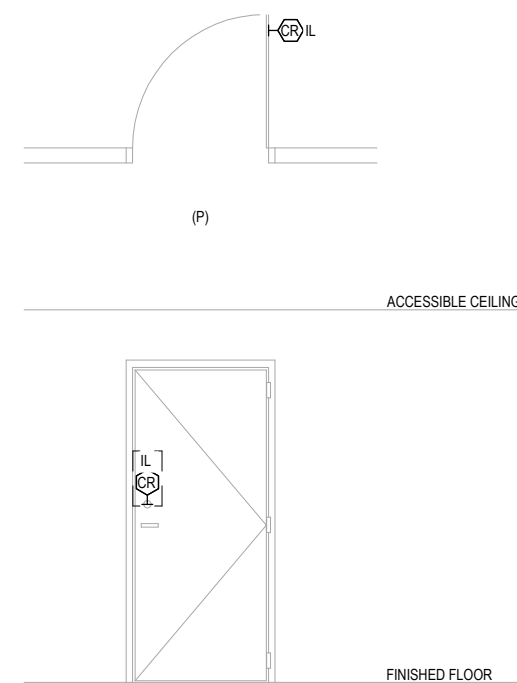

THEORY OF OPERATION:
- NORMAL DOOR STATE IS CLOSED.
- DOOR IS LOCKED ON THE NON-PROTECTED SIDE AND UNLOCKED ON THE PROTECTED SIDE.
- TO OPEN DOOR FROM NON-PROTECTED SIDE, CARD MUST BE PRESENTED TO UNLOCK DOOR.
- WIRELESS INTEGRATED READER/LOCKSET IS EQUIPPED WITH OCCUPANCY INDICATOR AND PRIVACY THUMB TURN.
- PROGRAM INTEGRATED DOOR POSITION SWITCH AND REQUEST TO EXIT FOR ALARM MONITORING.

- NOTES:
1. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.

SINGLE DOOR - INTEGRATED LOCK ASSEMBLY, WIRELESS CARD READER

SCALE: NONE



REV	DATE	DESCRIPTION	ISSUED FOR PERMIT
1	04/14/2024	ADDITIONAL ISSUED FOR PERMIT	
2	04/14/2024	REVISIONS	
3	04/14/2024	REVISIONS	
4	04/14/2024	REVISIONS	

ST. IGNATIUS COLLEGE PREPARATORY

2001 37th Ave, San Francisco, CA 94116

DETAILS - SECURITY

NONE

T6.11