



STAMP



DBI STAMP

REV. DATE DESCRIPTION
1. 01/2026 DYNAMIC SECURITY PLAN

ST. IGNATIUS COLLEGE PREPARATORY

2001 37th Ave. San Francisco, CA 94116

ACCESS CONTROL SYSTEM RISER DIAGRAM

1/8" = 1'-0"

T6.08

NUMBERED NOTES	
01	INFRASTRUCTURE TO SUPPORT FUTURE PROJECTOR.
02	HALL CALL ELEVATOR CARD READER CONTROL.
03	WALL OUTLET FOR MECHANICAL CONTROLS PANEL.

SHEET NOTES	
A.	REFER TO SHEET T0.01 FOR ABBREVIATIONS, GENERAL NOTES, AND SYMBOL DEFINITIONS.
B.	REFER TO SHEET T0.02 FOR PRIMARY PATHWAY REQUIREMENTS AND DEFINITIONS.
C.	REFER TO SHEET T0.03 AND T0.04 FOR OUTLETS/DEVICES SECONDARY PATHWAY AND CABLING REQUIREMENTS.
D.	SERVE OUTLETS/DEVICES ON THIS SHEET FROM TELECOM ROOMS AS NOTED.
E.	REFER TO SECURITY INSTALLATION DETAILS FOR SECONDARY PATHWAY REQUIREMENTS, SYSTEM INTERFACES, AND COMPONENT CONFIGURATIONS.
F.	INSTALL SECONDARY PATHWAYS ALONG THE MOST DIRECT ROUTES TO PRIMARY PATHWAYS OR SERVING ROOM.
G.	INSTALL HORIZONTAL CABLES ALONG THE MOST DIRECT PRIMARY PATHWAY ROUTE TO THE SERVING TELECOM ROOM.
H.	PROVIDE APPROVED FIRESTOP SYSTEMS AT PENETRATIONS THROUGH FIRE BARRIERS, SMOKE BARRIERS, AND SMOKE PARTITIONS TO MAINTAIN RATINGS.
I.	ACP (ACCESS CONTROL PANELS) WILL BE WIRED TO LOG AND PROGRAMMED TO FORWARD CRITICAL ALARM SIGNALS FROM SELECT, INTRUSION-RELATED SECURITY DEVICES INTO THE BURGLAR/INTRUSION ALARM SYSTEM. THIS INCLUDES SIGNALS FROM LA (LOCAL AUDIBLE SOUNDER) DEVICES, EMERGENCY DC (DOOR CONTACTS), AND CARD READER FO (CARD READERS - FORCED OPEN) ALARMS. THE SYSTEMS INTEGRATION WILL BE SYNCHRONIZED VIA HARDWIRED JUMPERS FROM ACP RELAY OUTPUTS OVER TO BZE (BURGLAR ZONE EXPANDER) INPUTS. THE INTERCONNECTING WIRING WILL BE MADE WITHIN THE SECURITY ENCLOSURES AT EACH CORRESPONDING MDF/IDF CLOSET.






ROOF

THIRD FLOOR

SECOND FLOOR

FIRST FLOOR

LOWER LEVEL

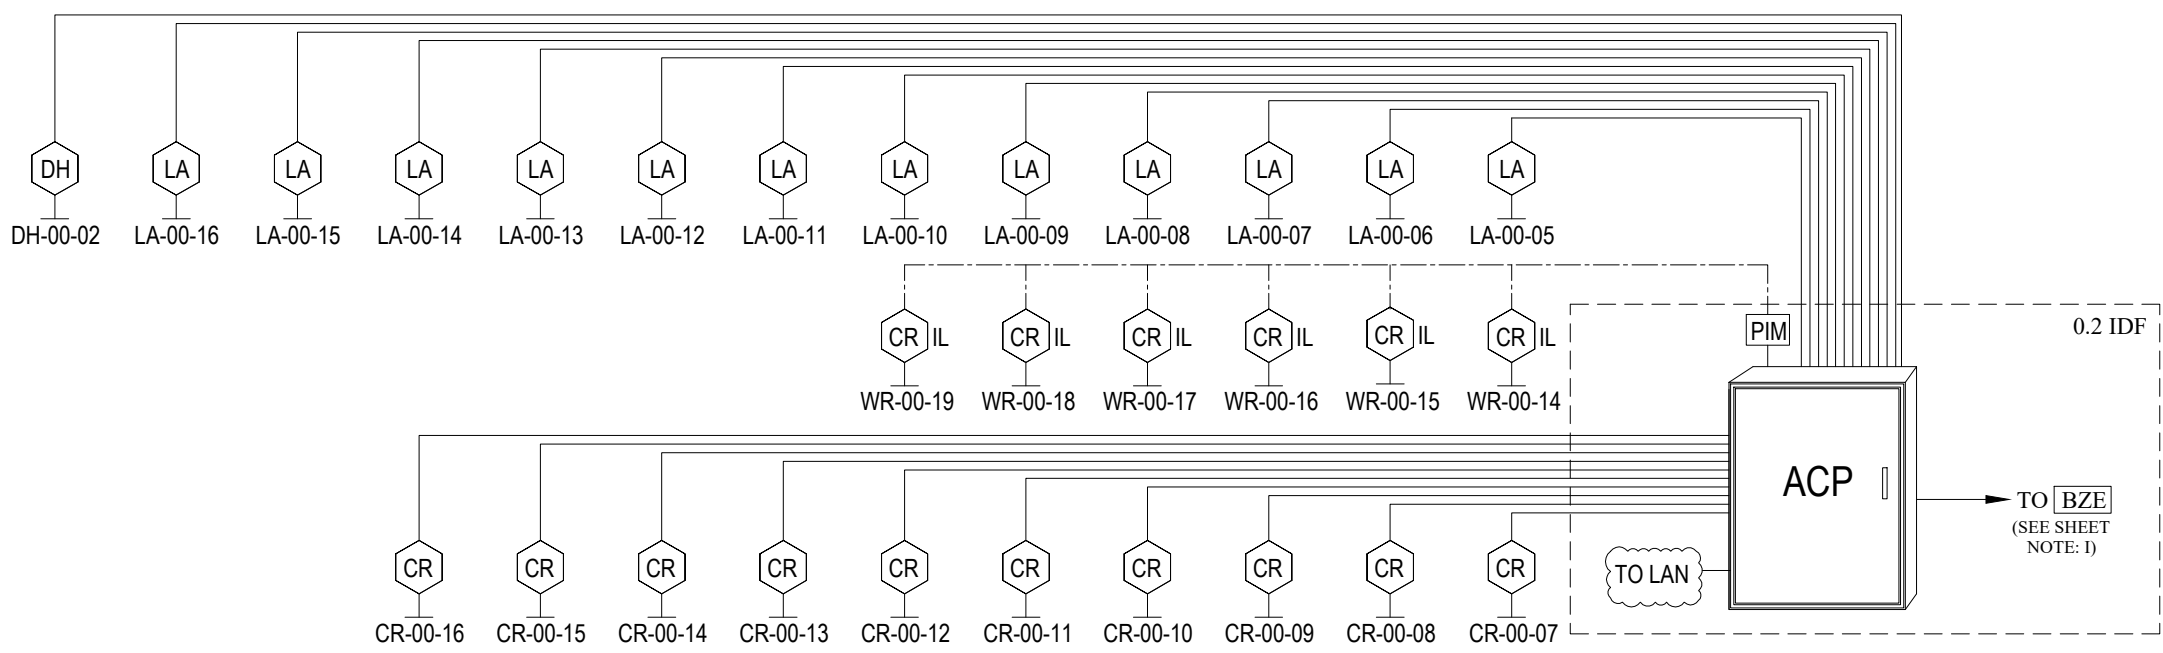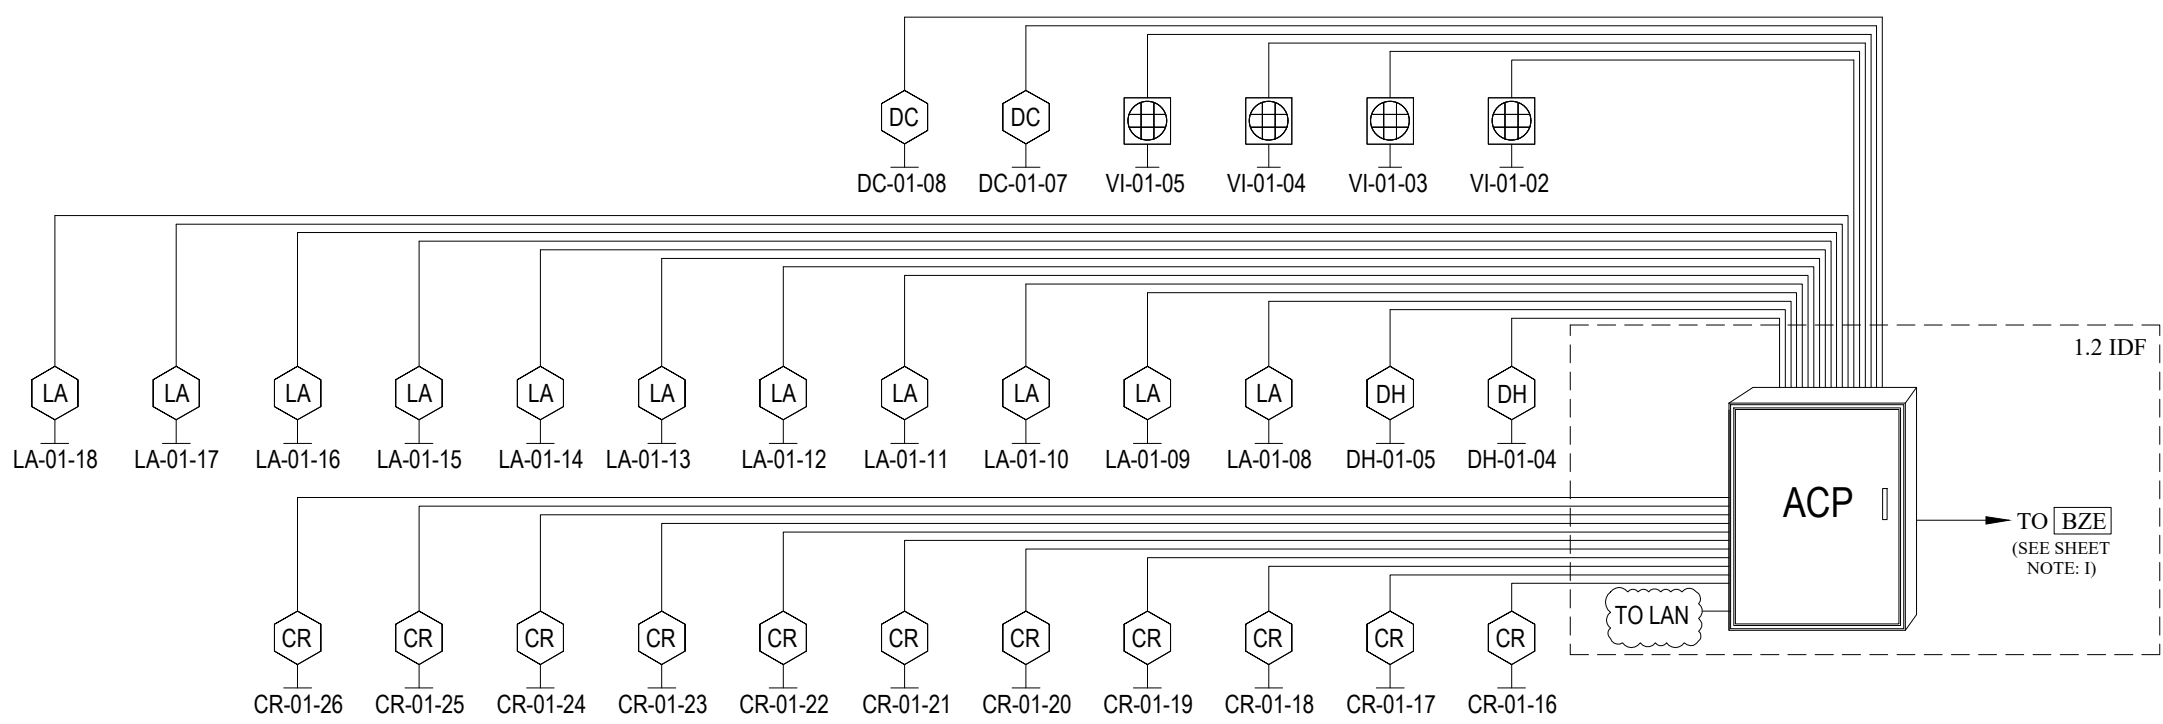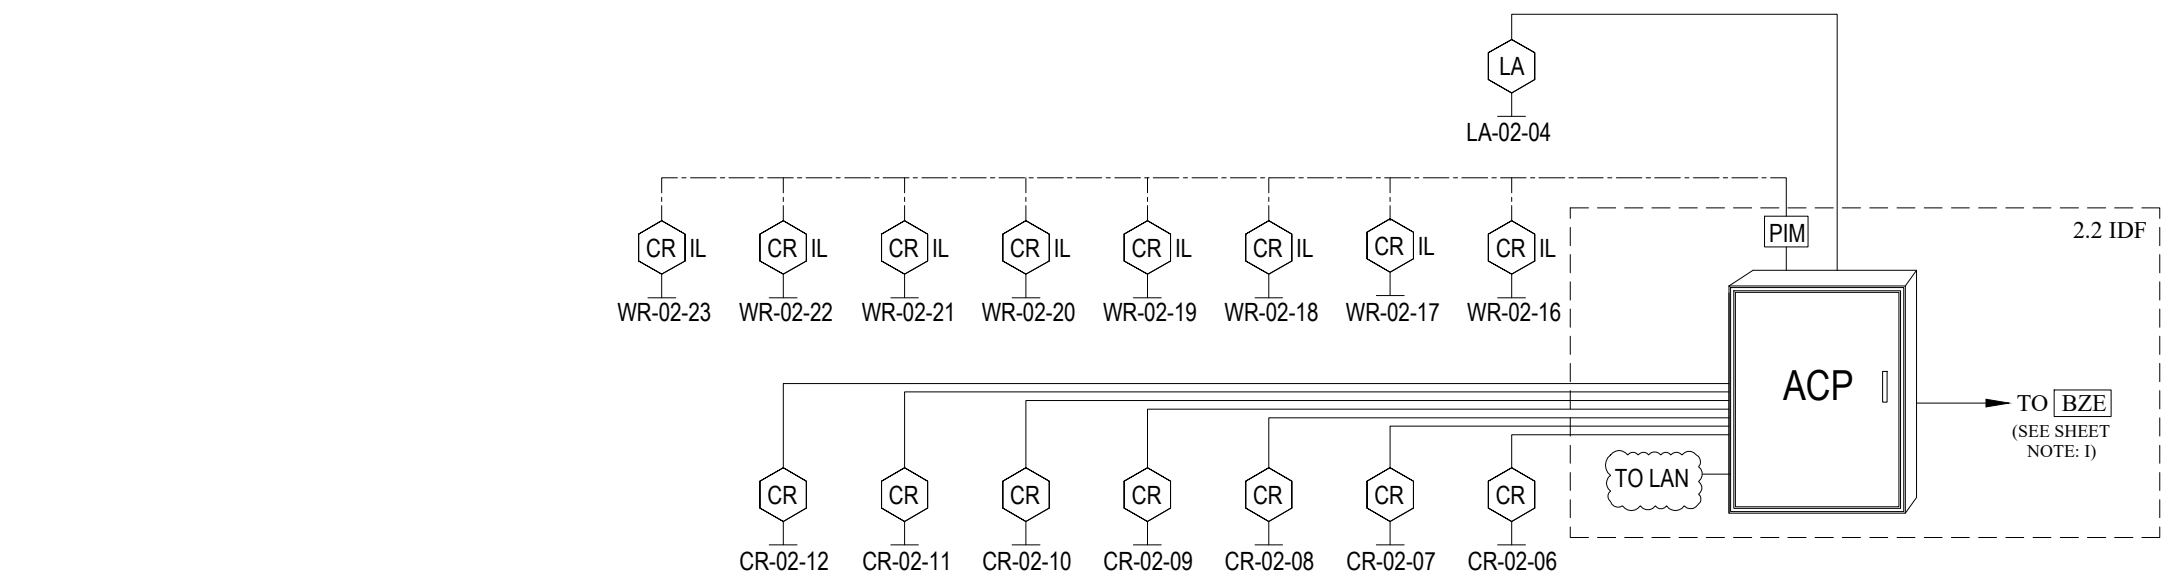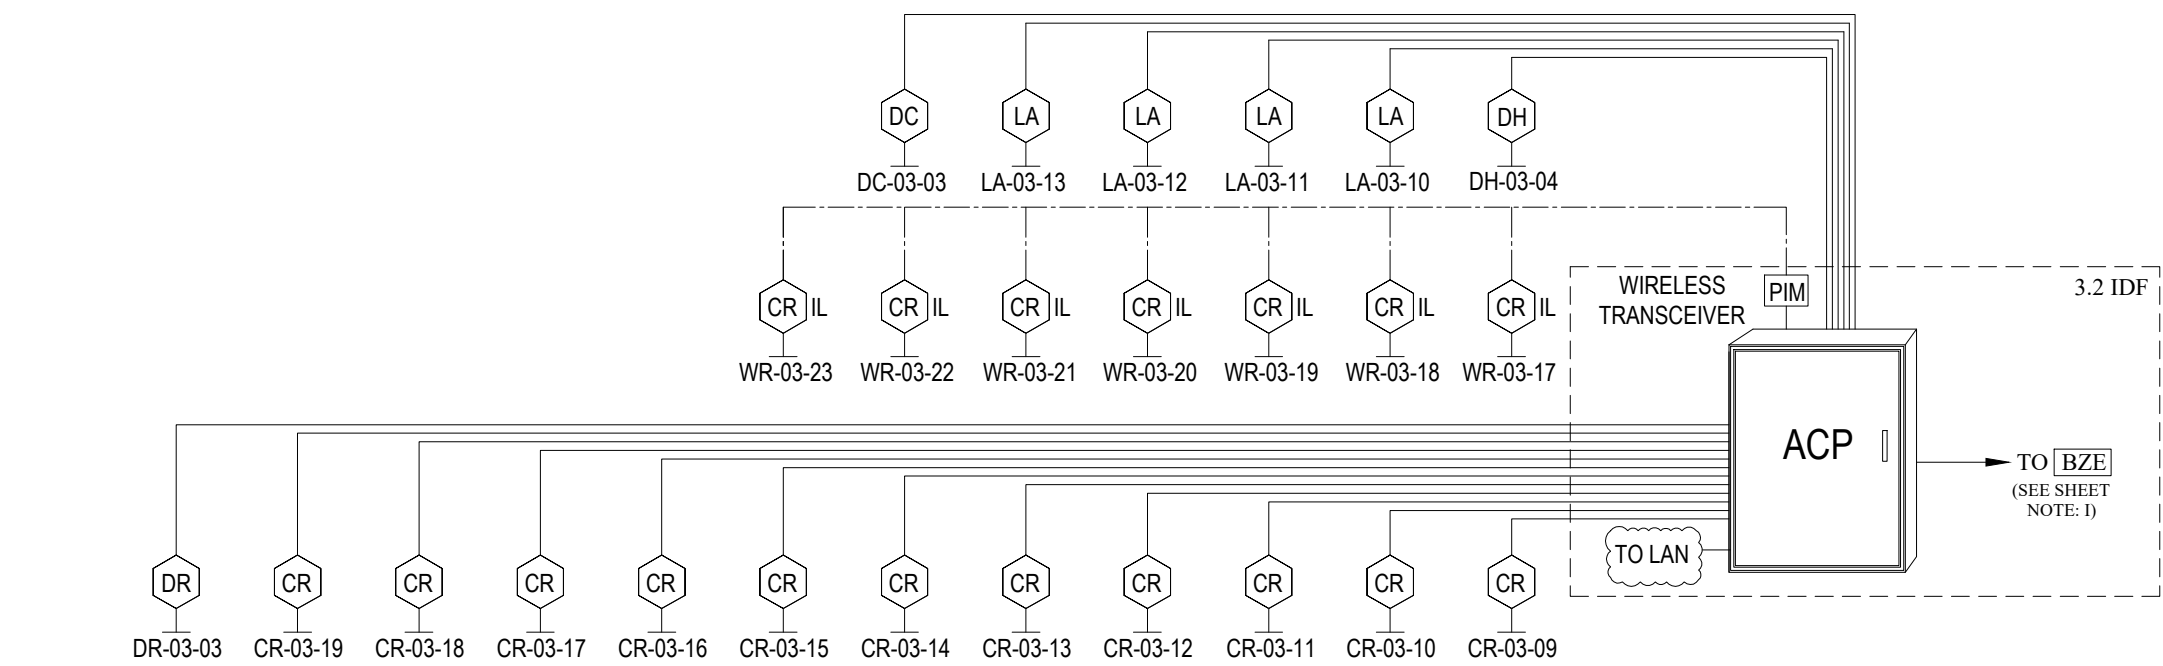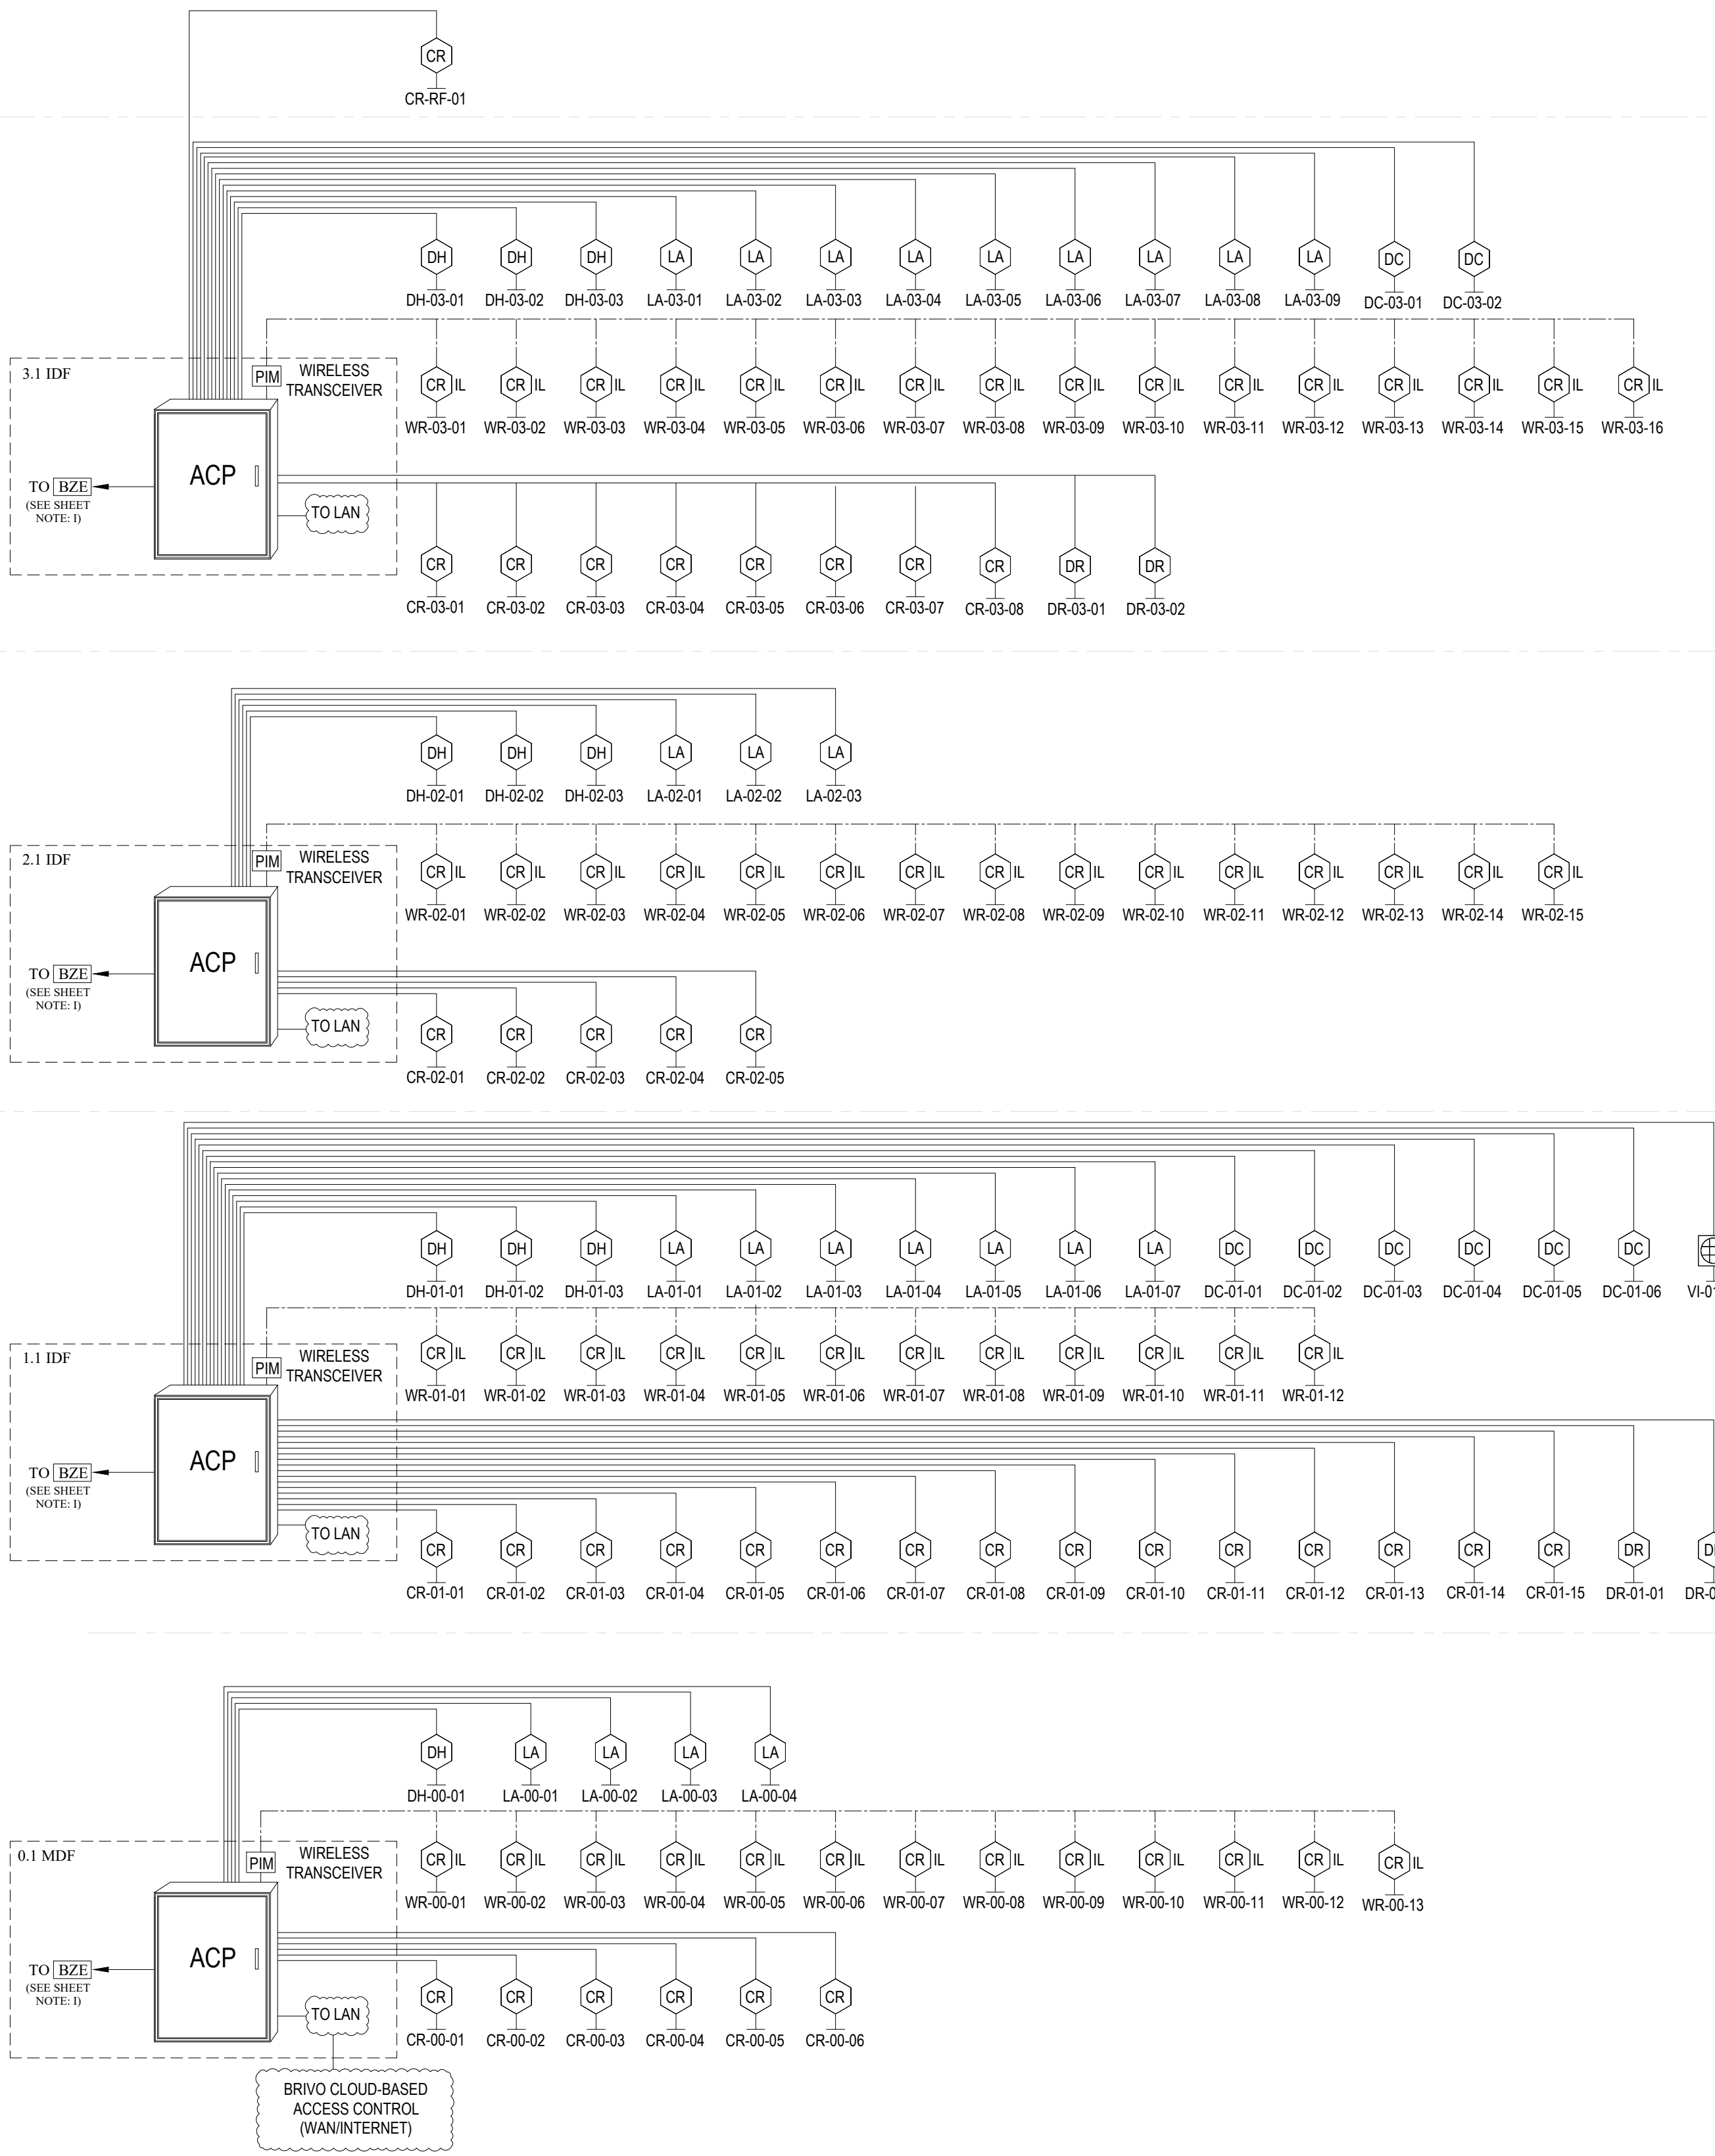

ACCESS CONTROL SYSTEM RISER DIAGRAM
SCALE: N.T.S.

