


7/11/2024 4:46:22 PM



SHEET NOTES

- A. REFER TO SHEET T3.01 FOR ABBREVIATIONS, GENERAL NOTES, AND SYMBOL DEFINITIONS.
- B. REFER TO SHEET T3.02 FOR PRIMARY PATHWAY REQUIREMENTS AND DEFINITIONS.
- C. REFER TO SHEET T3.03 AND T3.04 FOR OUTLETS/DEVICES SECONDARY PATHWAY AND CABLING REQUIREMENTS.
- D. SERVE OUTLETS/DEVICES ON THIS SHEET FROM TELECOM ROOMS AS NOTED.
- E. REFER TO ARCHITECTURAL PLANS FOR EXACT LOCATIONS OF OUTLETS/DEVICES, WHERE SHOWN. OUTLETS/DEVICES ON THIS SHEET ARE SHOWN DIAGRAMMATICALLY.
- F. REFER TO SECURITY INSTALLATION DETAILS FOR SECONDARY PATHWAY REQUIREMENTS, SYSTEM INTERFACES, AND COMPONENT CONFIGURATIONS.
- G. PATHWAYS SHOWN ARE DEDICATED FOR TECHNOLOGY CABLING.
- H. INSTALL SECONDARY PATHWAYS ALONG THE MOST DIRECT ROUTES TO PRIMARY PATHWAYS OR SERVING ROOM.
- I. INSTALL HORIZONTAL CABLES ALONG THE MOST DIRECT PRIMARY PATHWAY ROUTE TO THE SERVING TELECOM ROOM.
- J. PROVIDE APPROVED FIRESTOP SYSTEMS AT PENETRATIONS THROUGH FIRE BARRIERS, SMOKE BARRIERS, AND SMOKE PARTITIONS TO MATCH RATINGS.
- K. PROVIDE AN ALLOWANCE OF (2) CATEGORY 6A DROPS PER 1000 SQUARE FEET FOR WIRELESS ACCESS POINTS. DESIGN OF WIRELESS ACCESS POINTS TO BE COORDINATED WITH OWNERS IT DEPARTMENT.

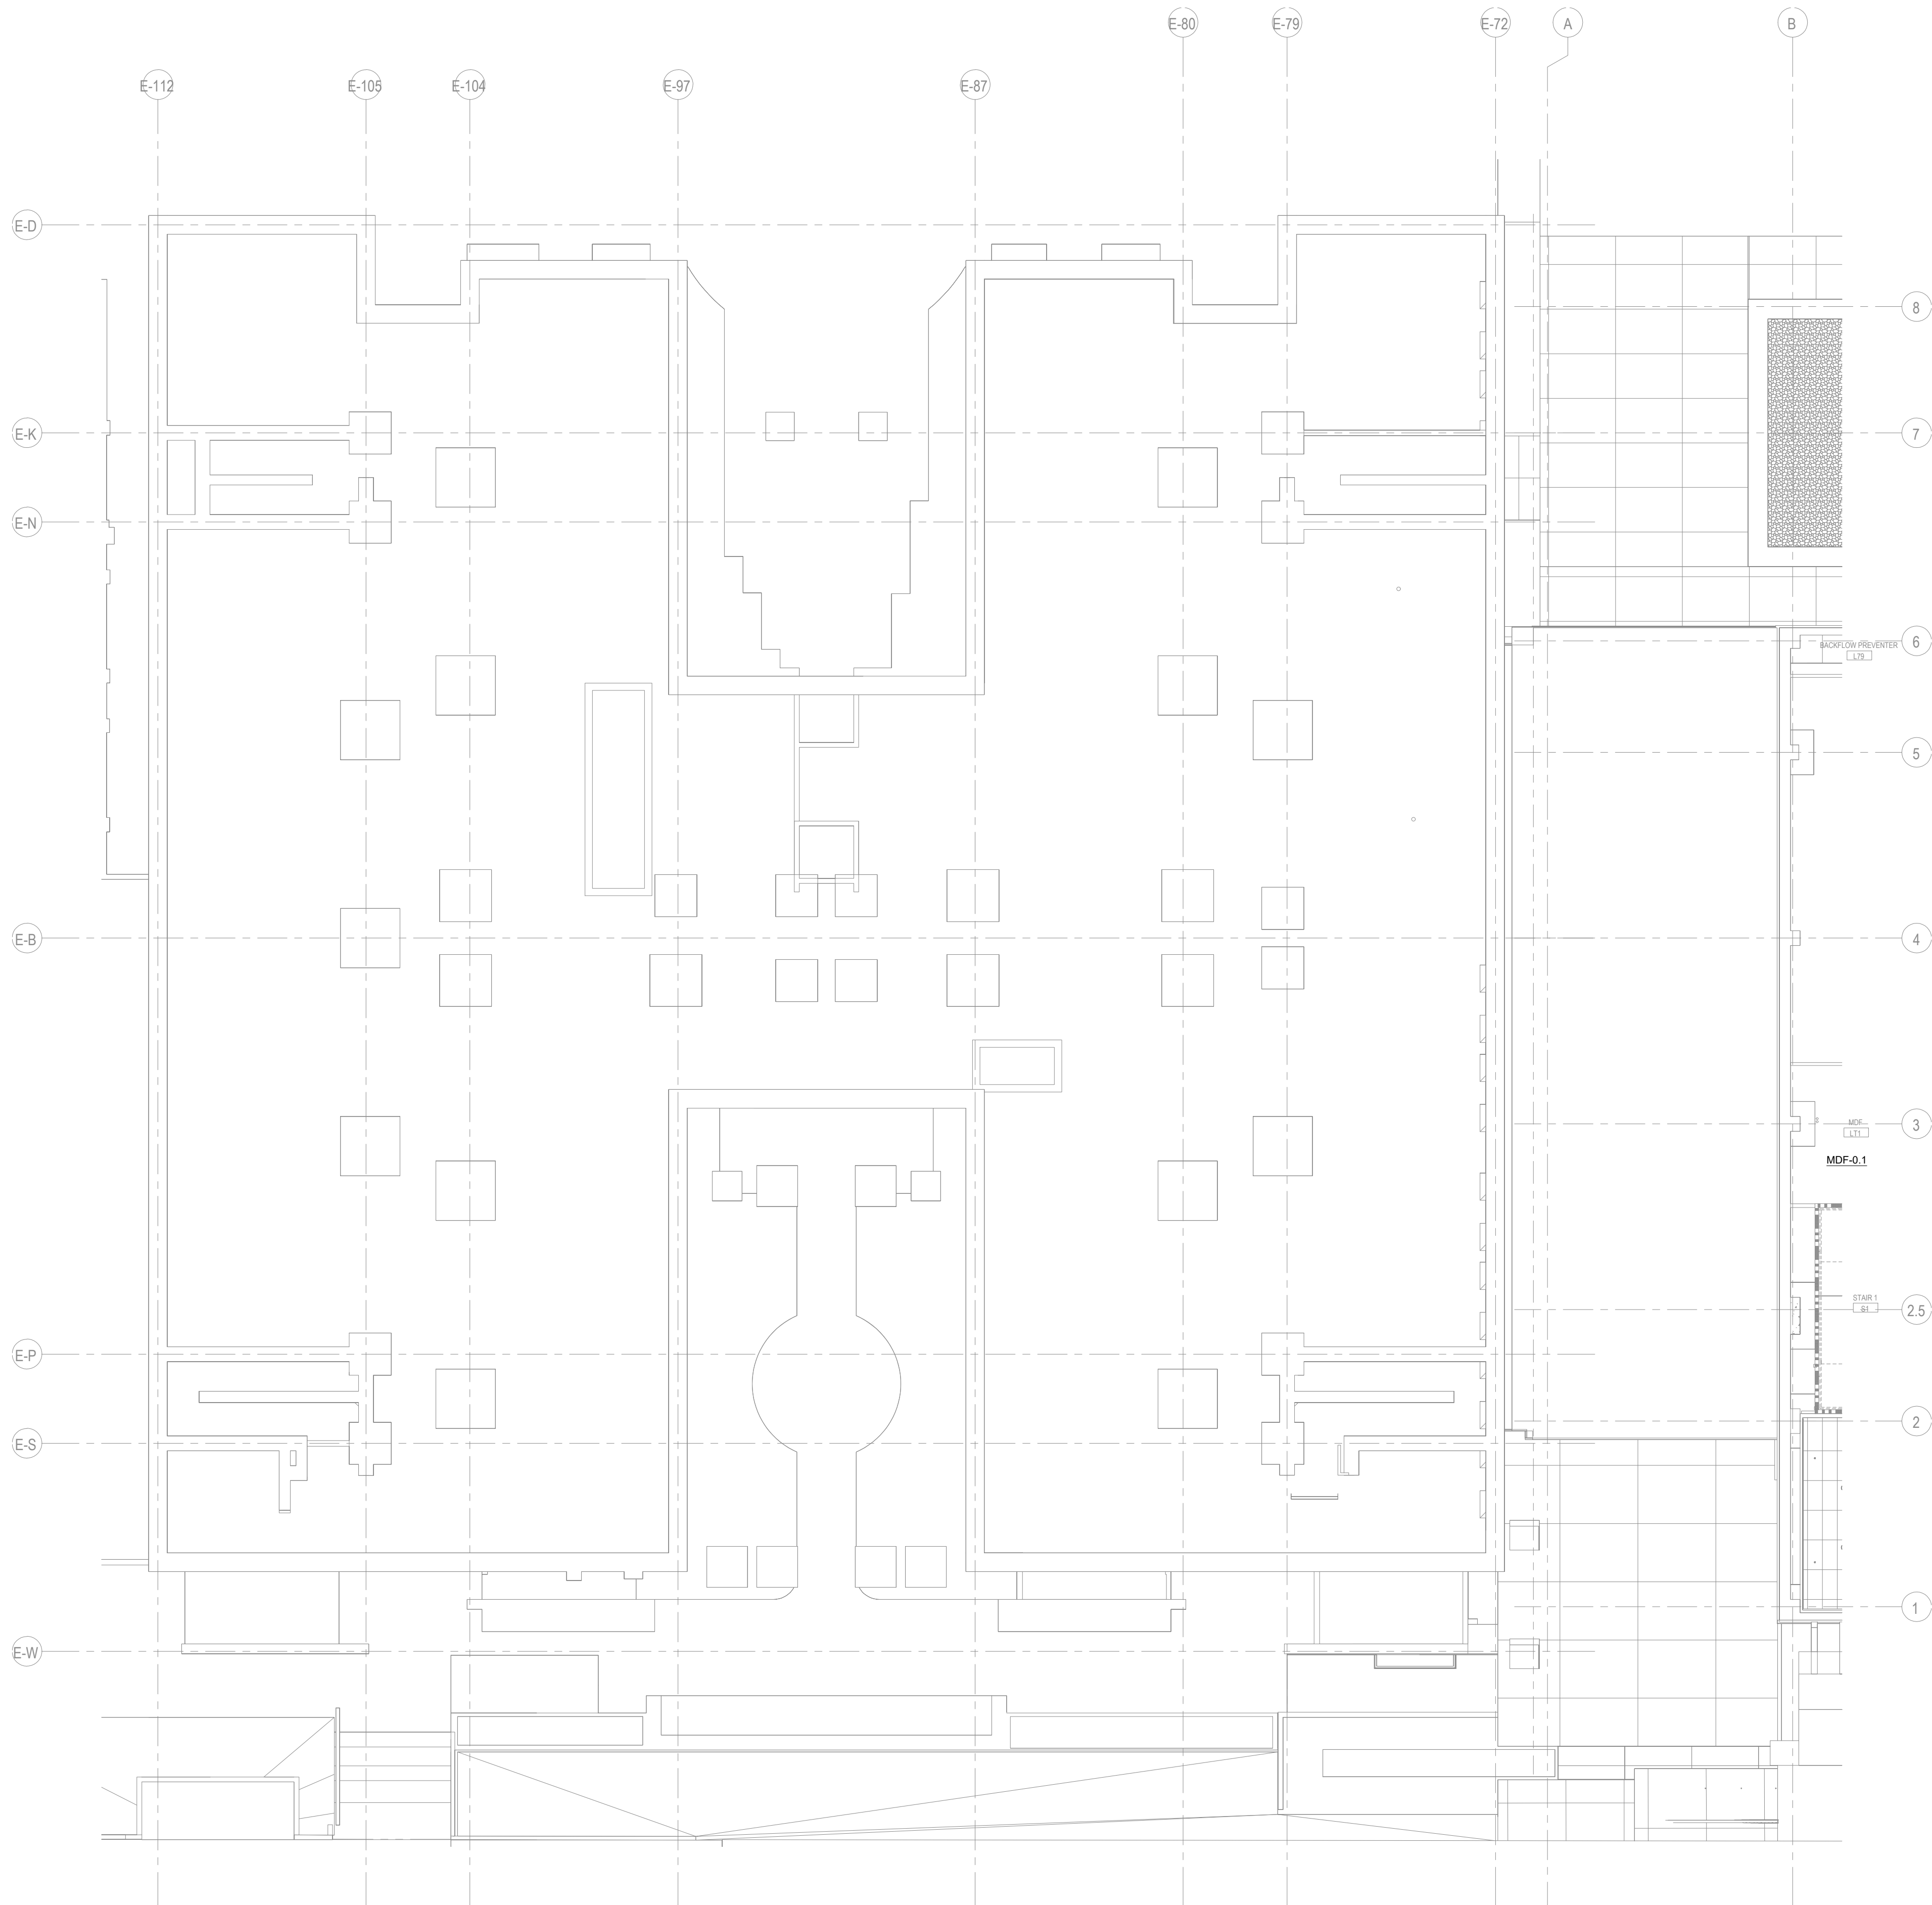

STAMP



DB STAMP


REV	DATE	DESCRIPTION
1	06/11/2024	100% DESIGN DEVELOPMENT
2	06/11/2024	100% DESIGN DEVELOPMENT
3	06/11/2024	100% DESIGN DEVELOPMENT
4	06/11/2024	100% DESIGN DEVELOPMENT
5	06/11/2024	100% DESIGN DEVELOPMENT
6	06/11/2024	100% DESIGN DEVELOPMENT
7	06/11/2024	100% DESIGN DEVELOPMENT
8	06/11/2024	100% DESIGN DEVELOPMENT
9	06/11/2024	100% DESIGN DEVELOPMENT
10	06/11/2024	100% DESIGN DEVELOPMENT
11	06/11/2024	100% DESIGN DEVELOPMENT
12	06/11/2024	100% DESIGN DEVELOPMENT
13	06/11/2024	100% DESIGN DEVELOPMENT
14	06/11/2024	100% DESIGN DEVELOPMENT
15	06/11/2024	100% DESIGN DEVELOPMENT
16	06/11/2024	100% DESIGN DEVELOPMENT
17	06/11/2024	100% DESIGN DEVELOPMENT
18	06/11/2024	100% DESIGN DEVELOPMENT
19	06/11/2024	100% DESIGN DEVELOPMENT
20	06/11/2024	100% DESIGN DEVELOPMENT

ST. IGNATIUS COLLEGE PREPARATORY

2001 37th Ave, San Francisco, CA 94116

SECTOR REFLECTED CEILING PLAN - LOWER LEVEL (SOUTH)

1/8" = 1'-0"



T3.10A