


CERTIFICATION
OF THE QUALITY
SYSTEM OF THE
COMPANIES


UNI EN 29001
ISO 9001
Member of



According to law CENTRO AUTOMATION SpA considers this document to be a company secret and therefore prohibits any person to reproduce or disclose it in whole or part to third parties, without specific written authorization of CENTRO AUTOMATION SpA Management


AutoCAD-COMPUTER AIDED DESIGN
3302486



| | | | | | | | | | | | | | |
|---|-------------------|--------|---------|---------|------------|--------------|-----------------|--|-----------------------------------|--------------------------------|------------------|------------|-----------|
| 3 | | | | Fecha | 27/01/1997 | SIPAR | |  DANIELI AUTOMATION | CARRITOS EXTRACCION ESTRATOS 2 | Servicios auxiliares acabadora | | = 30BB.F02 | |
| 2 | DESP. PRUEBAS | ABR 97 | GLEREAN | Encarg. | VENDRAME | | | | | + | | | |
| 1 | EMISION PARA CONE | ENE 97 | GLEREAN | Contr. | VENDRAME | | | | | | | | |
| | Modificacion | Fecha | Nombre | Norma | IEC | Obtenido de: | Reemplazo para: | Reemplaz. por: | Descript. | 30620 | N°3062-D30-E3302 | Hoja 186 | 188 Sigue |


—A4

TABLERO CONVERTIDORES

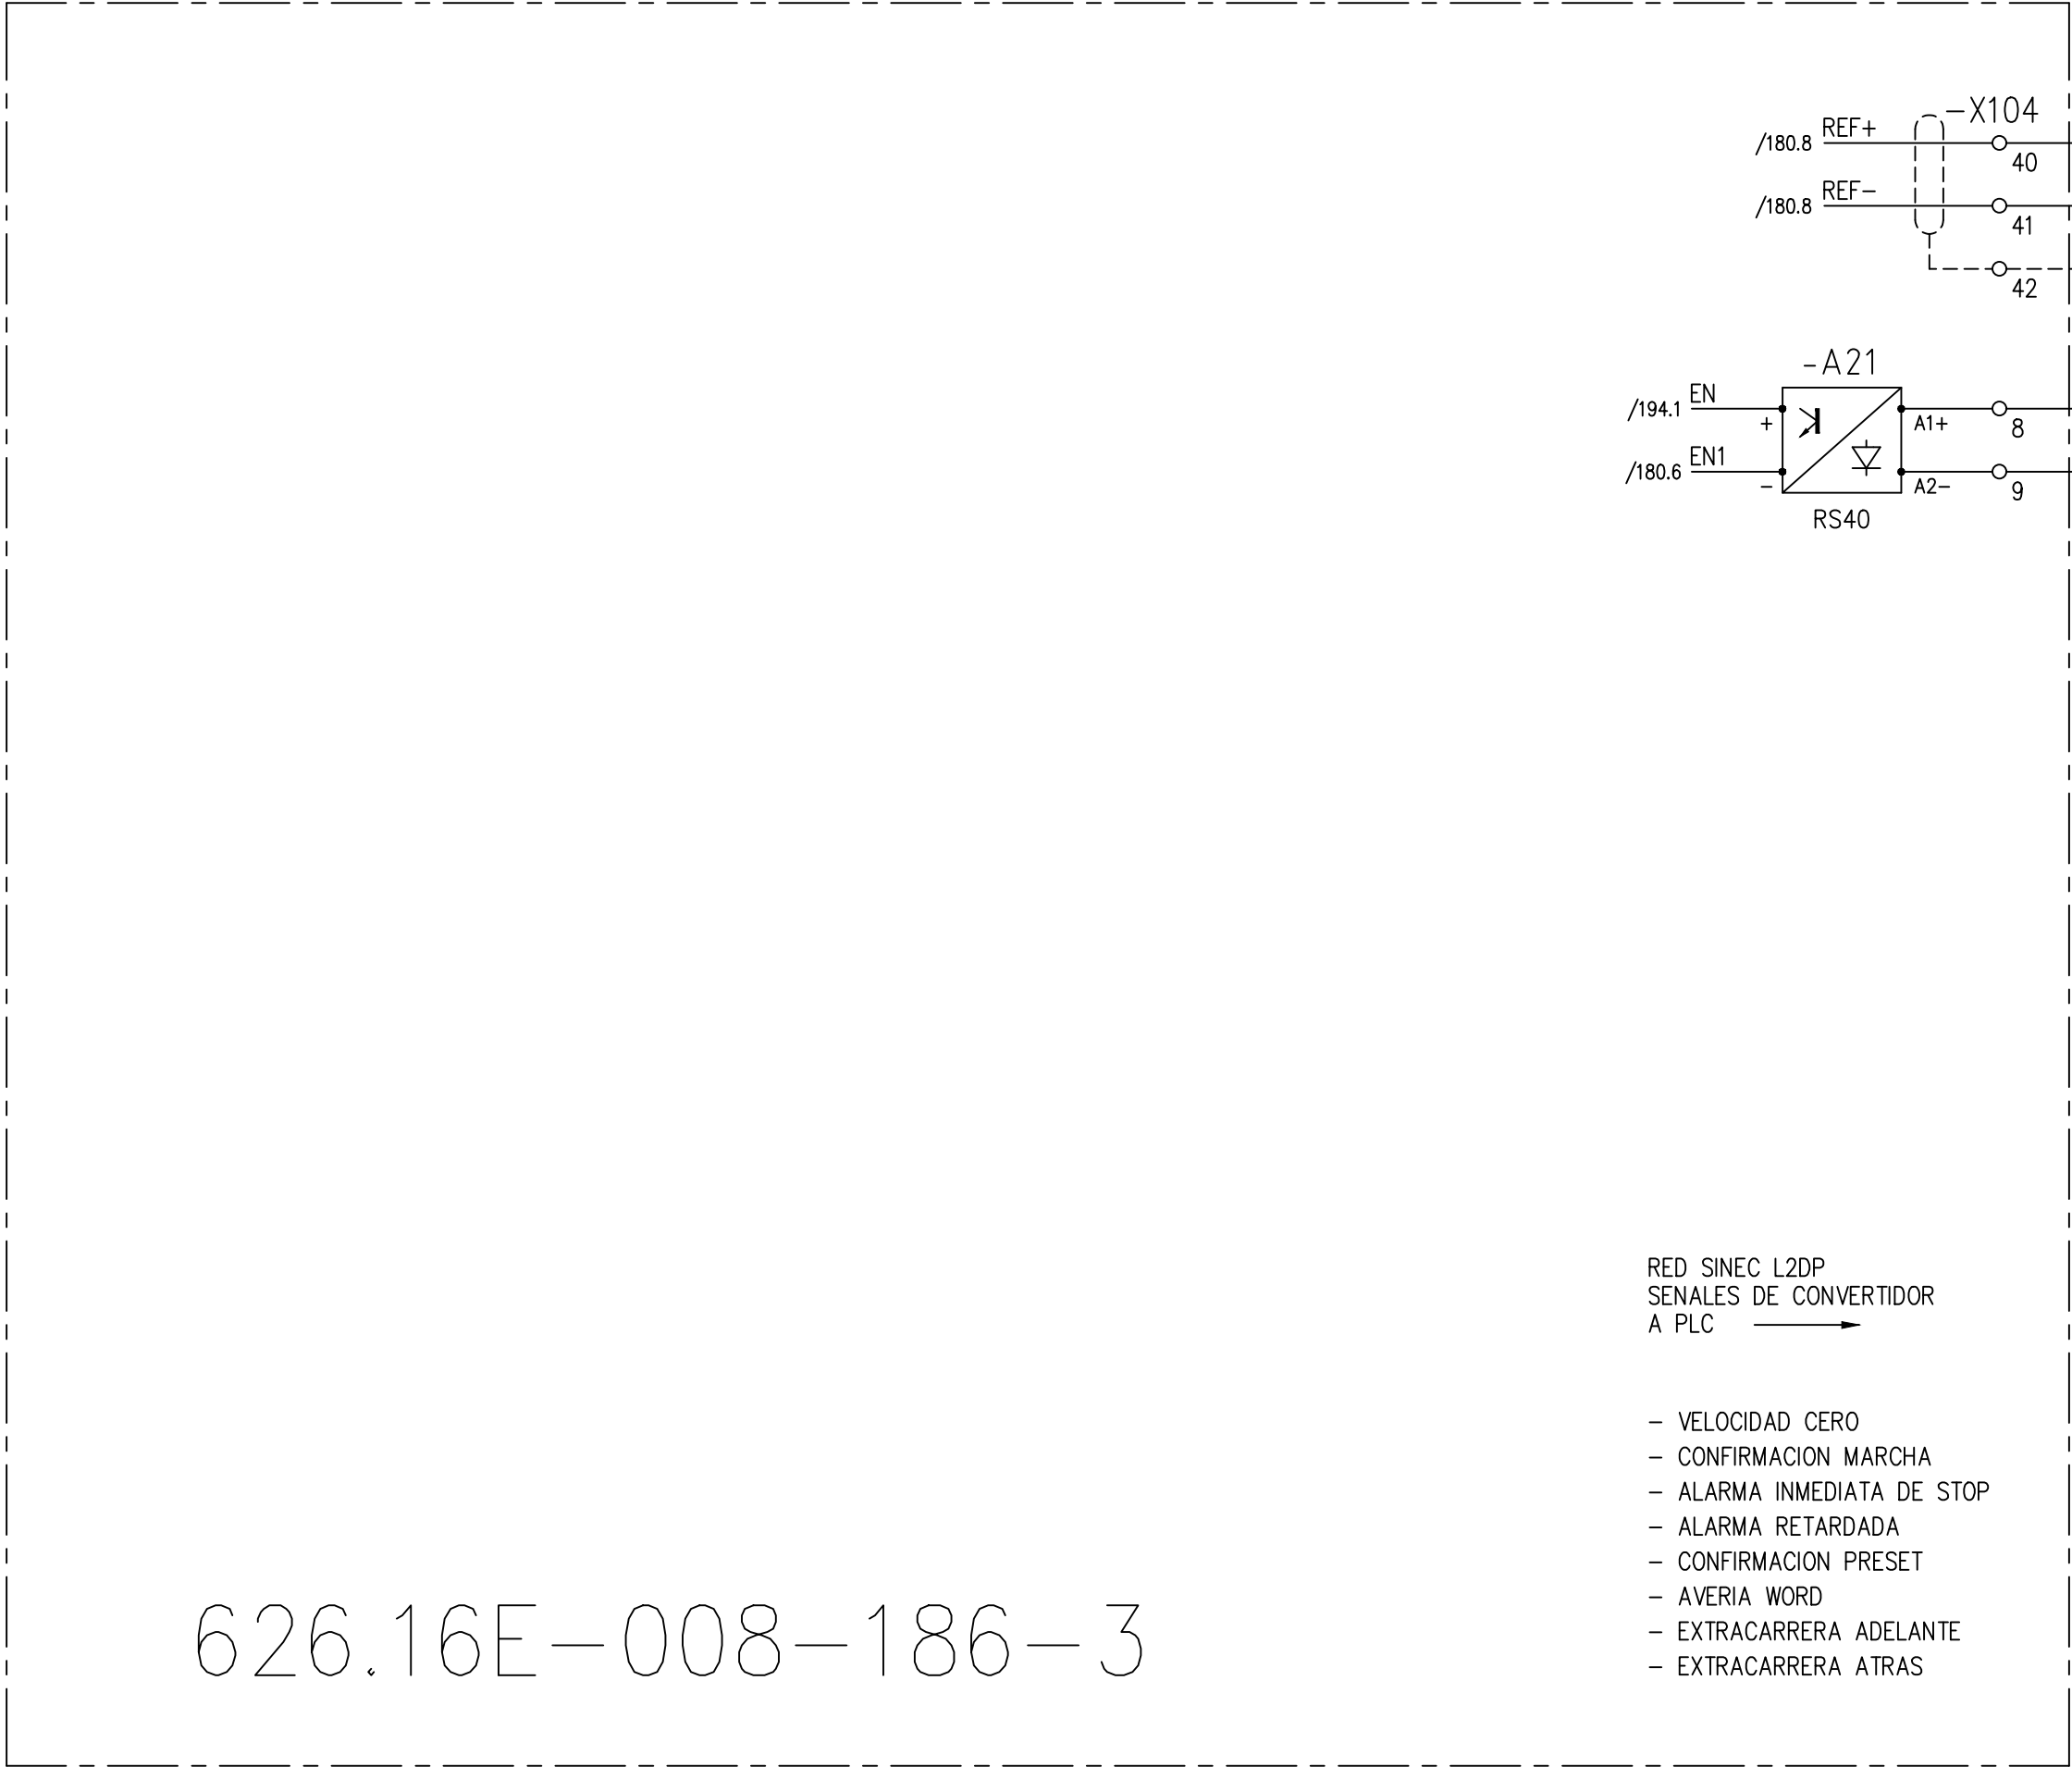

.L50

TABLERO AUTOMATIZACION

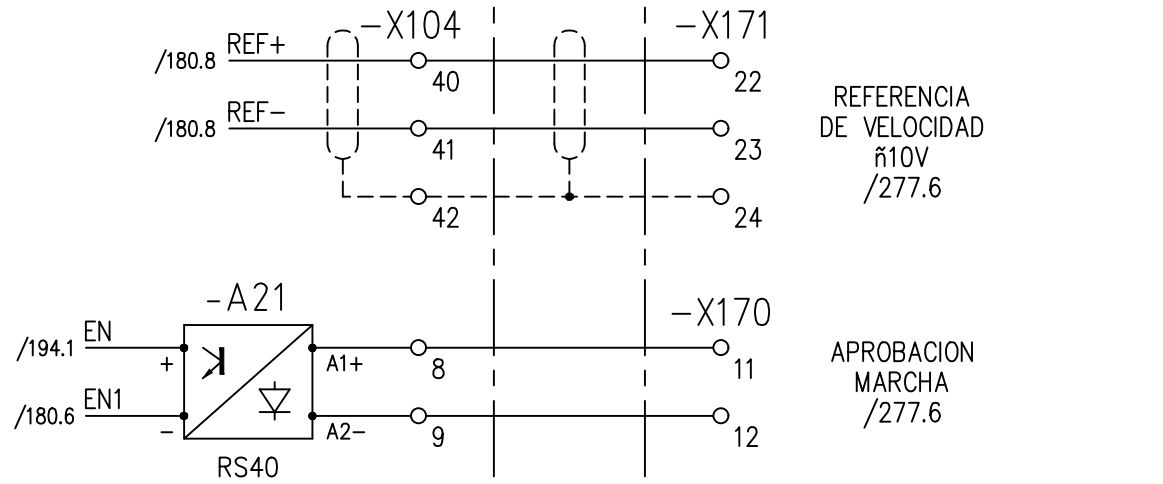

RED SINEC L2DP
SENALES DE CONVERTIDOR
A PLC →

- VELOCIDAD CERO
- CONFIRMACION MARCHA
- ALARMA INMEDIATA DE STOP
- ALARMA RETARDADA
- CONFIRMACION PRESET
- AVERIA WORD
- EXTRACARRERA ADELANTE
- EXTRACARRERA ATRAS

RED SINEC L2DP
SENALES DE PLC
← A CONVERTIDOR

- PRESET ON
- PRESET OFF
- EXTRACARRERA BY-PASS

626.16E-008-186-3