Set Up - TDS (Total Dissolved Solids)

The TDS* function provides an indication of the water purity. The TDS values displayed are in ppm** (impurities in parts per million). The TDS meter is intended to check pure water and has a max reading of 50ppm.

We recommend TDS1 probe be fitted after the RO (reverse osmosis) filter. You can then check the RO is working correctly.

We recommend TDS2 probe be fitted after the DI (de-ionising) vessels. You can then check DI vessels are working.

For good cleaning a TDS of below 5ppm after the DI is recommended.

Press TDS1 to monitor TDS1 reading (in ppm).



Press TDS2 to monitor TDS2 reading (in ppm).



A TDS reading greater than 50ppm will display high.




* Unit must be installed by a competant electrician or technician. Failure to comply with these instructions could invalidate your warranty.

** Probe must be undamaged, clean and free from dirt. Readings are only accurate to +/-2.5% of displayed value when dissolved solid is NaCl.

Additional Wiring

Fit the TDS probes in John Guest 1/2" equal tee (not supplied) as shown on the diagram.

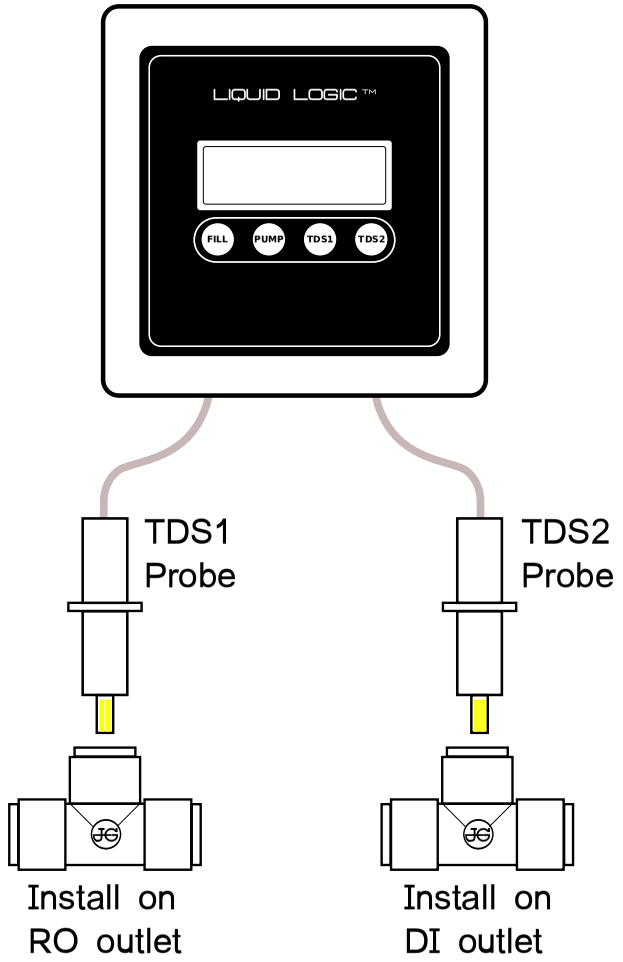

Take care when handling TDS probes. Do not damage gold plated contacts as this will affect TDS accuracy.
Ensure gold plated contacts are clean before use. Clean with ISOPROPANOL alcohol (IPA) and a soft cloth.
Dirty contacts will affect TDS accuracy, clean with IPA if readings appear to deviate over time.