

HHpro

User Guide

Mechanical schedules, submittals and documentation for HVAC equipment

<https://hhpro-hvac.com>

Revised August 2026

Contents

1. Getting Started.....	4
1.1 What HHpro is.....	4
1.2 Getting to the site	4
1.3 Signing in	4
1.4 The header	5
1.5 The overview page	5
2. Product Pages	7
2.1 The picture picker	7
2.2 Filtering	8
2.3 Reading the schedule.....	9
2.4 Dropdowns inside the schedule.....	9
2.5 Select, Submittal and Docs.....	10
2.6 Notes on individual products	11
Gas Pack RTUs	11
Mini Splits and Multi Position Splits.....	12
Gas Splits	13
VFDs	13
Diffusers and Grilles	14
3. Projects and the Cart	16
3.1 Your first Select	16
3.2 The cart panel	17
3.3 The Projects page.....	18
3.4 Where your projects live.....	19
4. The Project View	20
4.1 Tabs	20
4.2 The toolbar	20
4.3 Auto Tag	21
4.4 Add / Remove Columns	21
4.5 Edit Schedule.....	22
4.6 Schedule notes.....	23
4.7 Undo, Redo and leaving	24
4.8 Exporting the schedule	24
5. The Refrigerant Tab	25

6. The Files Tab.....	26
6.1 Choosing what to download	26
6.2 Project Schedules	26
6.3 Downloading	26
7. Design Search.....	28
7.1 Running a search.....	28
7.2 Performance at design conditions	28
7.3 Gas Pack RTUs	29
8. Finding a Model Number	32
9. Appendix	33
9.1 Privacy and your data	33
9.2 Quick reference.....	33
9.3 Things to watch for	34
9.4 Getting help	34

1. Getting Started

1.1 What HHpro is

HHpro is Hoffman & Hoffman's equipment site for mechanical engineers. It holds pre-engineered mechanical schedules for the HVAC equipment we sell, along with the documentation that goes with them. From one browser tab you can:

- Filter a product line down to the units that fit your application.
- Collect complete systems into a named project.
- Tag the units, choose which columns appear, edit any value, and add schedule notes.
- Export the finished schedule as Excel, CAD (DXF) or PDF, ready to drop into a drawing set.
- Download submittals, engineering and installation manuals, operation manuals, Revit families and CAD files as a single ZIP.
- Work out refrigerant line-set lengths and charge for split systems.
- Search by design load instead of by model number.

Everything you create stays in your own browser. There are no accounts and nothing is uploaded — see section 9.1.


1.2 Getting to the site

- **Address:** <https://hhpro-hvac.com>
- Nothing to install, and no VPN. The site is a set of static files, so it works from any network.

Browser: Use a current version of Chrome or Edge on a desktop-sized window. The schedules are wide — they scroll sideways on a small screen and are not practical on a phone.

1.3 Signing in

The site opens on a single password prompt. Type the password and click Enter. There is no user name and no account behind it — the password only unlocks the site.

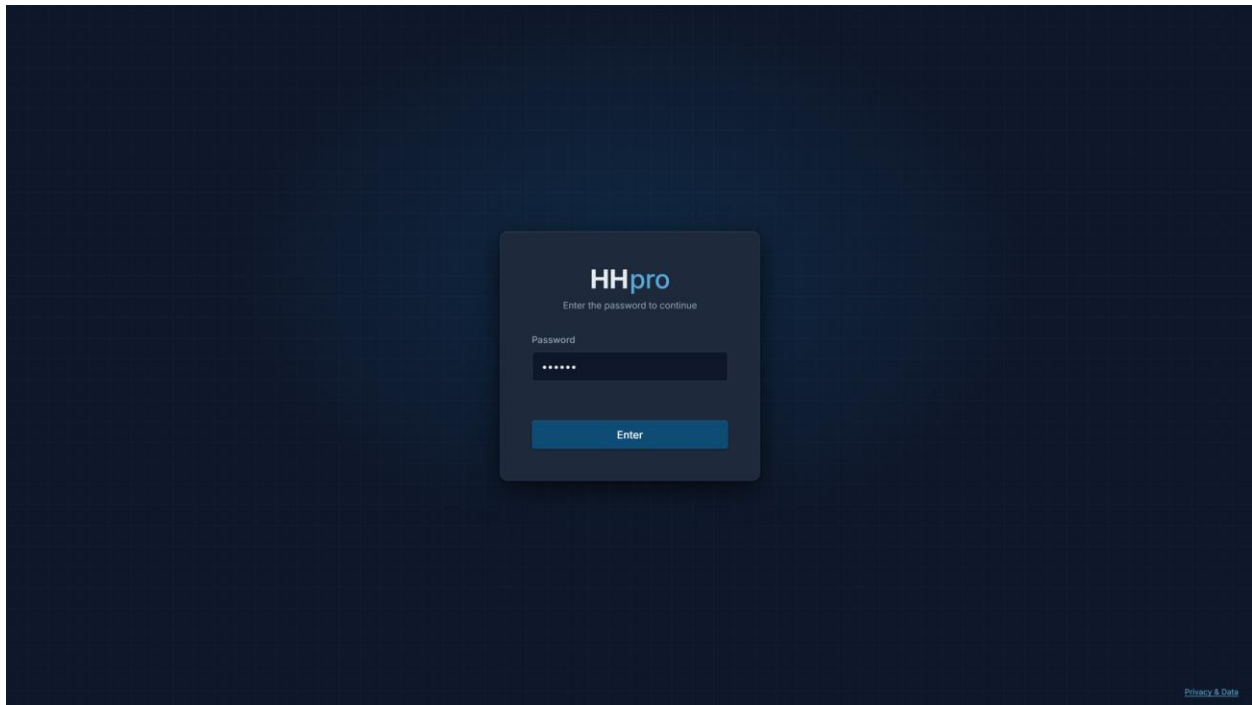

The password prompt. The standard password is Mellon.

The password is remembered for the rest of the browser session, so a page refresh will not send you back here. Closing the browser ends the session and you will be asked again next time. Log out (top right of every page) ends it immediately.

1.4 The header

The blue bar at the top of every page holds the three controls that are always available.




The header: the HHpro logo, the model search box and Log out.

- **HHpro logo** (left) — shows where you are. Once you are inside a product or a project, the page name appears beside it as a breadcrumb.
- **Find a model number** (center) — searches every product for a model number and jumps straight to it. See section 8.
- **Log out** (right) — returns to the password prompt. Your projects are not deleted; they are still there next time you sign in on this browser.

1.5 The overview page

After signing in you land on the overview. Everything in the site starts from one of these tiles.

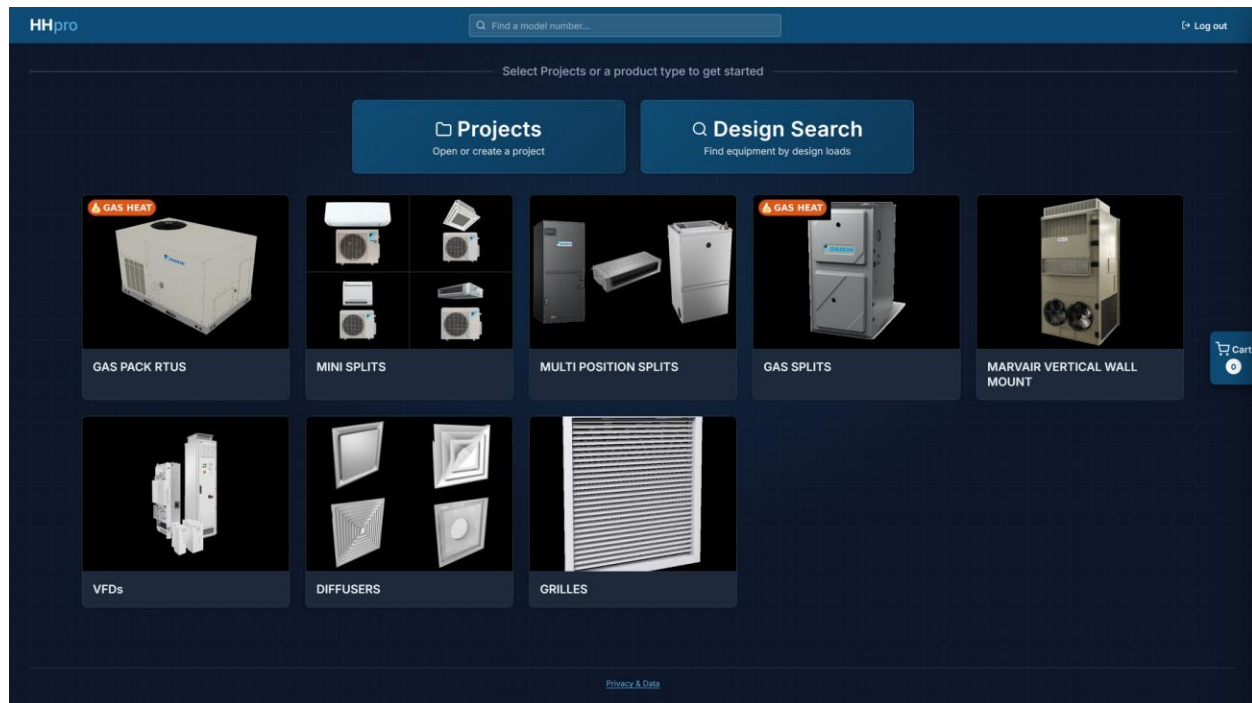

The overview page: Projects and Design Search on top, one tile per product type below.

- **Projects** — open a saved project, create a new one, or back your work up to CSV (section 3.3).
- **Design Search** — find equipment by entering design loads rather than by browsing (section 7).
- **Product tiles** — open a product's schedule to browse and select equipment (section 2). The eight product types are Gas Pack RTUs, Mini Splits, Multi Position Splits, Gas Splits, Marvair Vertical Wall Mount, VFDs, Diffusers and Grilles.

The Cart tab on the right edge is always visible. It shows what you have collected so far and gets you into the project view in one click (section 3.2).

2. Product Pages

Every product tile opens the same kind of page: an optional picture picker at the top, a row of filter dropdowns, and the schedule itself. Each row of the schedule is a complete, pre-engineered selection with capacities, airflow, electrical data and weights already filled in.

HHpro > MINI SPLITS

MINI SPLITS
SPLIT SYSTEM SCHEDULE

Back to Products

Wall Mounted Cassette Ducted Concealed Floor Mounted (Black) Floor Mounted (White)

SIZE (OUTDOOR UNIT) COOLING ONLY OR HEAT PUMP ELECTRICAL NUMBER OF INDOOR UNITS

Clear all filters

Showing all 394 items

Actions	CFM	COOLING CAPACITY				HEAT PUMP HEATING CAPACITY		OPERATING WEIGHT	INDOOR UNIT TYPE	ELECTRICAL			MAKE & MODEL		QA AMBIENT (COOLING)	QA AMBIENT (HEATING)	OPERATING WEIGHT	SEER2/EER2/HSPF2	ELECTRICAL	
		EDB	EWB	TOTAL CAPACITY	SENSIBLE CAPACITY	EDB	TOTAL CAPACITY			Voltage	MCA	MOP	MAKE	MODEL					Voltage	Amperage
		Select Submittal Docs	381	80	67	11200	8250			70	16000	19	Wall Mounted	Indoor Powered From Outdoor Unit					DAIKIN	FTXF08BVJU9
Select Submittal Docs	399	80	67	14600	9880	70	18000	19	Wall Mounted	Indoor Powered From Outdoor Unit	DAIKIN	FTXF12BVJU9	95	47	77	21.0 / 12.5 / 10.2	208/60/1	21.4		
Select Submittal Docs	565	80	67	22000	14590	70	28000	37	Wall Mounted	Indoor Powered From Outdoor Unit	DAIKIN	FTXF18BVJU9	95	47	121	21.0 / 12.0 / 9.6	208/60/1	21.8		
Select Submittal Docs	629	80	67	26400	16660	70	32000	37	Wall Mounted	Indoor Powered From Outdoor Unit	DAIKIN	FTXF24BVJU9	95	47	121	21.0 / 12.0 / 9.5	208/60/1	21.8		
Select Submittal Docs	925	80	67	31400	20390	70	34800	42	Wall Mounted	Indoor Powered From Outdoor Unit	DAIKIN	FTXV30AVJU9	95	47	128	19.0 / 10.0 / 8.1	208/60/1	22		
Select Submittal Docs	971	80	67	34400	21960	70	36000	42	Wall Mounted	Indoor Powered From Outdoor Unit	DAIKIN	FTXV36AVJU9	95	47	128	18.0 / 9.8 / 8.0	208/60/1	22		
Select Submittal Docs	322	80	67	11200	8250	-	-	25	Wall Mounted	Indoor Powered From Outdoor Unit	DAIKIN	FTKF08BVJU9	95	-	68	21.0 / 12.5 / -	208/60/1	11.6		
Select Submittal Docs	399	80	67	14600	9880	-	-	25	Wall Mounted	Indoor Powered From Outdoor Unit	DAIKIN	FTKF12BVJU9	95	-	76	21.0 / 12.5 / -	208/60/1	14.6		
Select Submittal Docs	565	80	67	22000	14590	-	-	37	Wall Mounted	Indoor Powered From Outdoor Unit	DAIKIN	FTKF18BVJU9	95	-	113	21.0 / 12.0 / -	208/60/1	21.4		
Select Submittal Docs	629	80	67	26400	16660	-	-	37	Wall Mounted	Indoor Powered From Outdoor Unit	DAIKIN	FTKF24BVJU9	95	-	113	21.0 / 12.0 / -	208/60/1	21.6		
Select Submittal Docs	925	80	67	31400	19980	-	-	42	Wall Mounted	Indoor Powered From Outdoor Unit	DAIKIN	FTXV30AVJU9	95	-	128	19.0 / 10.0 / -	208/60/1	21.8		
Select Submittal Docs	971	80	67	34400	21960	-	-	42	Wall Mounted	Indoor Powered From Outdoor Unit	DAIKIN	FTXV36AVJU9	95	-	128	18.0 / 9.8 / -	208/60/1	21.9		
Select Submittal Docs	424	80	67	10500	8140	70	12000	18	Wall Mounted	Indoor Powered From Outdoor Unit	DAIKIN	FTXQ09ASBU9	95	47	59	20.0 / 12.0 / 9.0	115/60/1	14.9		

A product page — picture picker, filter bar, and the schedule below.

2.1 The picture picker

Mini Splits, Diffusers and Grilles open with a strip of photographs above the filters. Clicking a picture filters the schedule to that style, which is usually the quickest way to cut a long list down. Click the same picture again to release it.

- **Mini Splits** — indoor unit style: wall mounted, cassette, ducted concealed, floor mounted (black or white).
- **Diffusers** — model family: SPD, SCD, SPD (Return), SCDA, SMD/AMD, SMD w/ SR, PDDR.
- **Grilles** — family: 150, 20/30, 300, 500/600/700, 900 gym, linear bar, egg crate, perforated, lattice, transfer and the rest.

When an SMD-family diffuser is picked, a second row of core-style icons appears. Each icon is a filter button for that core style; icons that are dimmed are shown for reference but are not in the data.

HHpro > DIFFUSERS Find a model number... Log out

DIFFUSERS

PRICE DIFFUSER SCHEDULE

[Back to Products](#)

CORE STYLE

DESCRIPTION: MODULAR LOUVERED FACE DIFFUSER

CFM: All

CORE STYLE: All

DUCT SIZE: All

[Clear all filters](#)

Showing 1029 of 1953 items

Actions	MANUFACTURER	MODEL	DESCRIPTION	DUCT SIZE (IN)	DUCT AREA (SQ FT)	CORE STYLE	NECK VELOCITY (FPM)	VELOCITY PRESSURE (IN WG)	TOTAL PRESSURE (IN WG)	TOTAL FLOW RATE (CFM)	CFM/SIDE - A	CFM/SIDE - B	SOUND (NC)	THROW A (150-100-50 FT)	THROW B (150-100-50 FT)
Select Submit Docs	PRICE	SMD/AMD	MODULAR LOUVERED FACE DIFFUSER	6 x 6	0.25	4A	300	0.006	0.036	75	19		<15	4-6-12	
Select Submit Docs	PRICE	SMD/AMD	MODULAR LOUVERED FACE DIFFUSER	6 x 6	0.25	4A	400	0.01	0.065	100	25		<15	5-8-15	
Select Submit Docs	PRICE	SMD/AMD	MODULAR LOUVERED FACE DIFFUSER	6 x 6	0.25	4A	500	0.016	0.099	125	31		17	7-10-16	
Select Submit Docs	PRICE	SMD/AMD	MODULAR LOUVERED FACE DIFFUSER	6 x 6	0.25	4A	600	0.022	0.144	150	38		23	8-12-18	
Select Submit Docs	PRICE	SMD/AMD	MODULAR LOUVERED FACE DIFFUSER	6 x 6	0.25	4A	700	0.031	0.196	175	44		27	9-14-19	
Select Submit Docs	PRICE	SMD/AMD	MODULAR LOUVERED FACE DIFFUSER	6 x 6	0.25	4A	800	0.04	0.256	200	50		31	11-15-21	
Select Submit Docs	PRICE	SMD/AMD	MODULAR LOUVERED FACE DIFFUSER	6 x 6	0.25	4A	900	0.05	0.324	225	56		36	12-16-22	
Select Submit Docs	PRICE	SMD/AMD	MODULAR LOUVERED FACE DIFFUSER	6 x 6	0.25	3A	300	0.006	0.036	75	19	28	<15	4-6-12	5-7-14
Select Submit Docs	PRICE	SMD/AMD	MODULAR LOUVERED FACE DIFFUSER	6 x 6	0.25	3A	400	0.01	0.065	100	25	38	<15	5-8-15	6-10-16
Select Submit Docs	PRICE	SMD/AMD	MODULAR LOUVERED FACE DIFFUSER	6 x 6	0.25	3A	500	0.016	0.099	125	31	47	17	7-10-16	8-12-18
Select Submit Docs	PRICE	SMD/AMD	MODULAR LOUVERED FACE DIFFUSER	6 x 6	0.25	3A	600	0.022	0.144	150	38	56	23	8-12-18	10-14-20
Select Submit Docs	PRICE	SMD/AMD	MODULAR LOUVERED FACE DIFFUSER	6 x 6	0.25	3A	700	0.031	0.196	175	44	66	27	9-14-19	11-15-22
Select Submit Docs	PRICE	SMD/AMD	MODULAR LOUVERED FACE DIFFUSER	6 x 6	0.25	3A	800	0.04	0.256	200	50	75	31	11-15-21	13-16-23

The Diffusers page: model gallery on top, core-style icons below it, then the filters.

2.2 Filtering

The filter bar sits above the schedule. Set the dropdowns left to right and the list narrows as you go; the dropdowns are linked, so each one only ever offers values that are still achievable given the others.

SIZE: 3
 COOLING ONLY OR HEAT PUMP: HEAT PUMP
 NOMINAL EFFICIENCY: All
 ELECTRICAL: All
 STAGES: All
 FAN TYPE: All
[Clear all filters](#)

The filter bar. A dropdown that is doing work is highlighted; Clear all filters resets them.

- If a filter is left with only one possible value, the site picks it for you. Change any dropdown yourself and the auto-picks re-evaluate.
- Some filters only appear once they are relevant. On Mini Splits, for example, the indoor-unit type filters appear after you set the number of indoor units.
- Clear all filters puts the page back to the full list.

The status line under the filters always tells you where you stand — "Showing 10 of 394 items".

HHpro > MINI SPLITS

Find a model number.

Log out

MINI SPLITS

SPLIT SYSTEM SCHEDULE

Back to Products

Wall Mounted

Cassette

Ducted Concealed

Floor Mounted (Black)

Floor Mounted (White)

SIZE (OUTDOOR UNIT)

COOLING ONLY OR HEAT PUMP

ELECTRICAL

NUMBER OF INDOOR UNITS

TYPE (INDOOR UNIT #1)

Clear all filters

1.5

HEAT PUMP

All

All

Wall Mounted

Showing 10 of 394 items

Actions	CFM	INDOOR UNIT						OUTDOOR UNIT														
		COOLING CAPACITY				HEAT PUMP HEATING CAPACITY		OPERATING WEIGHT	INDOOR UNIT TYPE	ELECTRICAL			MAKE & MODEL		OA AMBIENT (COOLING)	OA AMBIENT (HEATING)	OPERATING WEIGHT	SEER2/EEER2/HSPF2	ELECTRICAL			M/J
		EDB	EWB	TOTAL CAPACITY	SENSIBLE CAPACITY	EDB	TOTAL CAPACITY			Voltage	MCA	MOP	MAKE	MODEL					Voltage	MCA	MOP	
Select Submittal Docs	565	80	67	22000	14590	70	28000	37	Wall Mounted	Indoor Powered From Outdoor Unit			DAIKIN	FTXF18BVJU9	95	47	121	21.0 / 12.0 / 9.6	208/60/1	21.4	25	
Select Submittal Docs	512	80	67	18000	13700	70	20000	35.3	Wall Mounted	208/1	0.5	15	DAIKIN	FAA18AAVJU	95	47	234	17.8 / 12.8 / 7.6	208/60/1	19.8	20	DAIKIN
Select Submittal Docs	332	80	67	7000	-	70	7650	19	Wall Mounted	Indoor Powered From Outdoor Unit			DAIKIN	CTXV07AVJU9	95	47	127	21.0 / 12.0 / 10.0	208/60/1	15.6	20	DAIKIN
Select Submittal Docs	332	80	67	7000	-	70	7650	19	Wall Mounted	Indoor Powered From Outdoor Unit			DAIKIN	CTXV07AVJU9	95	47	127	21.0 / 12.0 / 10.0	208/60/1	15.6	20	DAIKIN
Select Submittal Docs	332	80	67	6870	-	70	7440	19	Wall Mounted	Indoor Powered From Outdoor Unit			DAIKIN	CTXV07AVJU9	95	47	127	21.0 / 12.0 / 10.0	208/60/1	15.6	20	DAIKIN
Select Submittal Docs	381	80	67	8830	-	70	9560	19	Wall Mounted	Indoor Powered From Outdoor Unit			DAIKIN	FTXV09AVJU9	95	47	127	21.0 / 12.0 / 10.0	208/60/1	15.6	20	DAIKIN
Select Submittal Docs	332	80	67	6340	-	70	6820	19	Wall Mounted	Indoor Powered From Outdoor Unit			DAIKIN	CTXV07AVJU9	95	47	127	21.0 / 12.0 / 10.0	208/60/1	15.6	20	DAIKIN
Select Submittal Docs	392	80	67	10860	-	70	11680	19	Wall Mounted	Indoor Powered From Outdoor Unit			DAIKIN	FTXV12AVJU9	95	47	127	21.0 / 12.0 / 10.0	208/60/1	15.6	20	DAIKIN
Select Submittal Docs	332	80	67	5470	-	70	5890	19	Wall Mounted	Indoor Powered From Outdoor Unit			DAIKIN	CTXV07AVJU9	95	47	127	21.0 / 12.0 / 10.0	208/60/1	15.6	20	DAIKIN
Select Submittal Docs	540	80	67	11730	-	70	12610	27	Wall Mounted	Indoor Powered From Outdoor Unit			DAIKIN	FTXV15AVJU9	95	47	127	21.0 / 12.0 / 10.0	208/60/1	15.6	20	DAIKIN
Select Submittal Docs	381	80	67	8600	-	70	9250	19	Wall Mounted	Indoor Powered From Outdoor Unit			DAIKIN	FTXV09AVJU9	95	47	127	21.0 / 12.0 / 10.0	208/60/1	15.6	20	DAIKIN
Select Submittal Docs	381	80	67	8600	-	70	9250	19	Wall Mounted	Indoor Powered From Outdoor Unit			DAIKIN	FTXV09AVJU9	95	47	127	21.0 / 12.0 / 10.0	208/60/1	15.6	20	DAIKIN
Select Submittal Docs	381	80	67	7370	-	70	7930	19	Wall Mounted	Indoor Powered From Outdoor Unit			DAIKIN	FTXV09AVJU9	95	47	127	21.0 / 12.0 / 10.0	208/60/1	15.6	20	DAIKIN
Select Submittal Docs	392	80	67	9830	-	70	10570	19	Wall Mounted	Indoor Powered From Outdoor Unit			DAIKIN	FTXV12AVJU9	95	47	127	21.0 / 12.0 / 10.0	208/60/1	15.6	20	DAIKIN
Select Submittal Docs	381	80	67	6450	-	70	6940	19	Wall Mounted	Indoor Powered From Outdoor Unit			DAIKIN	FTXV09AVJU9	95	47	127	21.0 / 12.0 / 10.0	208/60/1	15.6	20	DAIKIN
Select Submittal Docs	540	80	67	10750	-	70	11560	27	Wall Mounted	Indoor Powered From Outdoor Unit			DAIKIN	FTXV15AVJU9	95	47	127	21.0 / 12.0 / 10.0	208/60/1	15.6	20	DAIKIN

Mini Splits filtered to 1.5-ton wall-mounted heat pumps.

Grilles: The grille schedule holds over 32,000 selections, so the page only draws the first 500 that match. A notice tells you when that cap is in effect — narrow the filters (or pick a family from the gallery) and it goes away.

2.3 Reading the schedule

Columns vary by product, but the layout is consistent. Grouped headers (INDOOR UNIT, OUTDOOR UNIT, COOLING CAPACITY, ELECTRICAL and so on) sit above the individual data columns, and the Actions column is pinned to the left.

One selection, several rows: For split systems a single selection covers the outdoor unit and every indoor unit on it, so one selection can occupy two or more rows. The Actions buttons appear once, on the first row of the group — clicking Select takes the whole system, not just the row you clicked.

Schedules are wider than most screens. Scroll the table sideways to reach the columns on the right; the header rows stay put as you scroll down.

2.4 Dropdowns inside the schedule

Some cells are dropdowns rather than fixed numbers. Changing one re-reads the manufacturer's capacity tables and updates every value that depends on it, so the row always shows performance at the condition you actually selected.

INDOOR AIR HANDLING UNIT													
MAKE	MODEL	SUPPLY FAN			COOLING					HEAT PUMP TOTAL CAPACITY	AUX. ELECTRIC HEAT		ELECTRIC / PHASE
		AIRFLOW (CFM)	MOTOR (HP)	MOTOR TYPE	EAT (DB)	EAT (WB)	LAT (DB)	TOTAL CAPACITY	SENSIBLE CAPACITY		kW	TEMPERATURE RISE (DB)	
DAIKIN	FTA36AAVJUD	1050	0.5	Variable Speed ECM	80	67	59	35000	23700	40500	-	-	208/1
DAIKIN	AMST36CU1300	1190	0.75	ECM	80	67	59	35000	26600	35000	-	-	208/1
DAIKIN	AMST36CU1300	1000	0.75	ECM	80	67	58	35500	25205	36200	-	-	208/1

Multi Position Splits: airflow, entering-air and kW dropdowns feed the capacity columns.

- **Multi Position Splits** — airflow (CFM), entering air dry bulb and wet bulb, outdoor ambient for heating, and auxiliary electric heat kW. Total, sensible and leaving-air temperature follow the cooling dropdowns; temperature rise follows the kW and airflow pair.
- **Marvair** — electric heat kW, which swaps MCA and MOCP to the values for that kW.

The dropdowns only offer combinations that exist in the tables, so you cannot build an invalid selection. Whatever is showing when you click Select is what gets carried into your project and out to the exports.

HHpro > MARVAIR VERTICAL WALL MOUNT

Find a model number...

Log out

MARVAIR VERTICAL WALL MOUNT

VERTICAL WALL MOUNTED PACKAGED AIR HANDLING UNIT SCHEDULE

Back to Products

TONS

ELECTRICAL

STAGES

HEAT PUMP OR AC

Clear all filters

Showing all 490 items

Actions	MAKE	MODEL	NOMINAL SIZE (TONS)	CFM	TOTAL CAPACITY	SENSIBLE CAPACITY	COOLING STAGES	OUTSIDE AIR (°F)	ENTERING AIR DB/WB (°F)	HEAT PUMP CAPACITY (47°F AMBIENT)	AUX. ELECTRIC HEAT (kW)	VOLTS-HZ-PH	MCA	MOCP	REFRIGERANT	EER	IEER
Select Submittal Docs	MARVAIR	MGH3090AA	7.5	3500	89000	69092	2	95	80/67	-	0	208/60/1	54.5	60	R-454B	11.2	11.8
Select Submittal Docs	MARVAIR	MGH3090AC	7.5	3500	89000	69092	2	95	80/67	-	0	208/60/3	38.5	40	R-454B	11.2	11.8
Select Submittal Docs	MARVAIR	MGH3090AD	7.5	3500	89000	69092	2	95	80/67	-	0	460/60/3	21.4	25	R-454B	11.2	11.8
Select Submittal Docs	MARVAIR	MGH3120AA	10	4000	118000	91706	2	95	80/67	-	0	208/60/1	82.3	90	R-454B	11.6	11.5
Select Submittal Docs	MARVAIR	MGH3120AC	10	4000	118000	91706	2	95	80/67	-	0	208/60/3	57.5	60	R-454B	11.6	11.5
Select Submittal Docs	MARVAIR	MGH3120AD	10	4000	118000	91706	2	95	80/67	-	0	460/60/3	28.5	30	R-454B	11.6	11.5
Select Submittal Docs	MARVAIR	MGH3150AC	12.5	4500	146000	106434	2	95	80/67	-	0	208/60/3	81	90	R-454B	10.2	10.9
Select Submittal Docs	MARVAIR	MGH3150AD	12.5	4500	146000	106434	2	95	80/67	-	0	460/60/3	35	35	R-454B	10.2	10.9
Select Submittal Docs	MARVAIR	MGH3180AC	15	6000	182000	136830	2	95	80/67	-	0	208/60/3	100.4	110	R-454B	9.8	11.1
Select Submittal Docs	MARVAIR	MGH3180AD	15	6000	182000	136830	2	95	80/67	-	0	460/60/3	47.7	50	R-454B	9.8	11.1
Select Submittal Docs	MARVAIR	MAH1018A	1.5	660	17500	13472	1	95	80/67	-	0	208/60/1	14.8	20	R-454B	11	-
Select Submittal Docs	MARVAIR	MAH1020A	1.66	760	20000	15619	1	95	80/67	-	0	208/60/1	19.2	25	R-454B	11	-
Select Submittal Docs	MARVAIR	MAH1024A	2	850	24000	17703	1	95	80/67	-	0	208/60/1	21.2	30	R-454B	11	-
Select Submittal Docs	MARVAIR	MAH1030A	2.5	1070	29000	21994	1	95	80/67	-	0	208/60/1	23.2	35	R-454B	11	-
Select Submittal Docs	MARVAIR	MAH1036A	3	1200	35000	24980	1	95	80/67	-	0	208/60/1	24.7	35	R-454B	11	-
Select Submittal Docs	MARVAIR	MAH1042A	3.5	1250	41000	29022	1	95	80/67	-	0	208/60/1	32.7	50	R-454B	11.5	-
Select Submittal Docs	MARVAIR	MAH1048A	4	1400	45000	31964	1	95	80/67	-	0	208/60/1	39.3	60	R-454B	11	-


The Marvair schedule, with the electric-heat kW dropdown in each row.

2.5 Select, Submittal and Docs

Every row carries three buttons in the Actions column.

- **Select** — adds that unit (or complete system) to your project or cart. The first Select of a session asks where it should go; see section 3.1.
- **Submittal** — opens the submittal PDF for that selection in a new tab. A split system opens the outdoor unit sheet plus one sheet per distinct indoor unit.

- **Docs** — lists every document available for that selection, with View and Download beside each one.

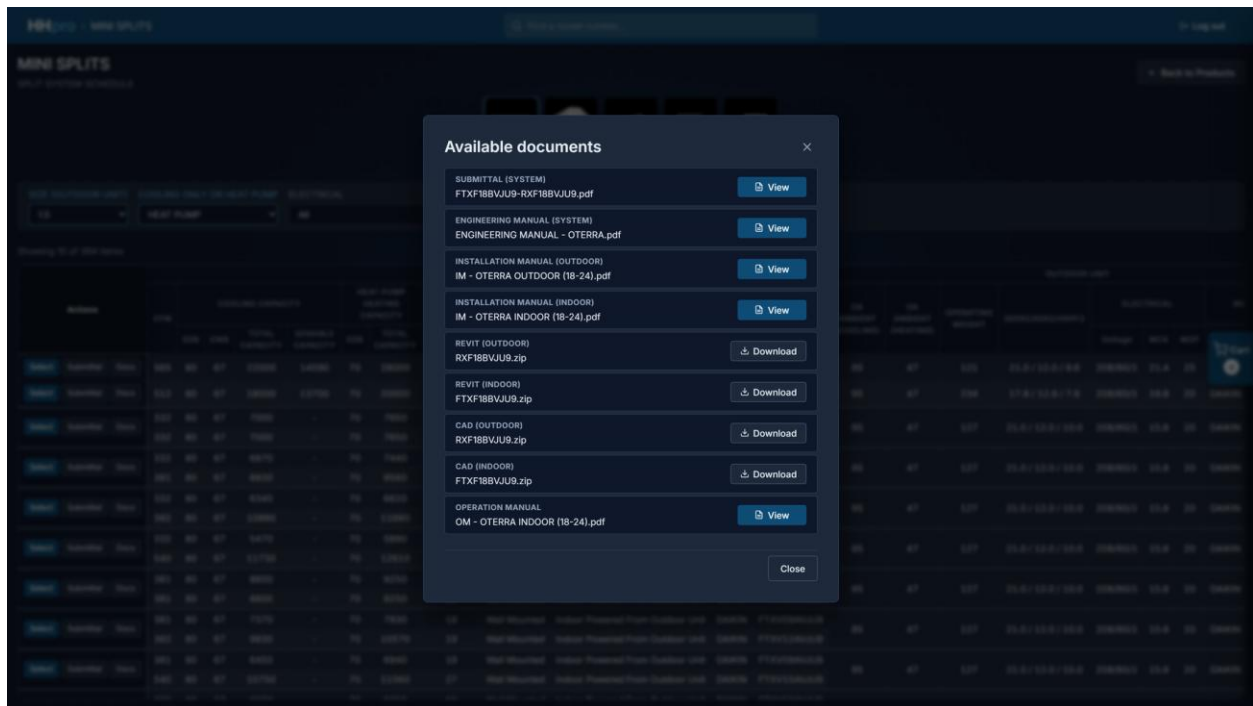

The Docs popup lists everything published for the selection.

Pop-ups: Submittal and View open PDFs in new browser tabs. If nothing happens, allow pop-ups for hhpro-hvac.com.

2.6 Notes on individual products

Gas Pack RTUs

Packaged rooftop units, filtered by size, electrical, efficiency, cooling stages, gas heat level and hot gas reheat. Their schedule values come from selections run at one set of conditions — if your conditions differ, use Design Search (section 7.3), which reads the published capacity tables instead.

HHpro > GAS PACK RTUS

Q Find a model number...

Log out

GAS PACK RTUS

PACKAGED ROOFTOP UNITS

Back to Products

SIZE

5

ELECTRICAL

All

EFFICIENCY

All

COOLING STAGES

All

HIGH/MEDIUM/LOW GAS HEAT

All

HGRH

All

Clear all filters

Showing 18 of 162 items

Actions	MAKE	MODEL NUMBER	NOM TONS	Fan Data			Cooling Performance					Heating Performance					Electrical Data				Weight (lbs)				
				CFM	ESP (IWG)	TESP (IWG)	TOTAL CAPACITY (BTU/h)	SENSIBLE CAPACITY (BTU/h)	EFFICIENCY (AT AHR)	EDB (°F)	EWB (°F)	LDB (°F)	LWB (°F)	INPUT (MBH)	OUTPUT (MBH)	Stages	EAT (°F)	LAT (°F)	MODULATING HOT GAS REHEAT	COOLING STAGES		VOLT/PH	INDOOR MOTOR HP	Unit MCA	Unit MOCP
Select Submittal Docs	DAIKIN	DSG0603DL	5	2090	0.5	0.5	58474	45127	13.7 SEER2/11.8 EER2	80	67	60.4	58.2	90	72.9	2	55	86.9	NO	1	208/3	1	28.1	40	537
Select Submittal Docs	DAIKIN	DSG0603DM	5	2090	0.5	0.5	58474	45127	13.7 SEER2/11.8 EER2	80	67	60.4	58.2	115	93.15	2	55	95.8	NO	1	208/3	1	28.1	40	537
Select Submittal Docs	DAIKIN	DSG0603DH	5	2090	0.5	0.5	58474	45127	13.7 SEER2/11.8 EER2	80	67	60.4	58.2	140	113.4	2	55	104.6	NO	1	208/3	1	28.1	40	537
Select Submittal Docs	DAIKIN	DSG0604DL	5	2115	0.5	0.5	58580	45470	13.7 SEER2/11.8 EER2	80	67	60.5	58.3	90	72.9	2	55	86.5	NO	1	460/3	1.2	13	20	641
Select Submittal Docs	DAIKIN	DSG0604DM	5	2115	0.5	0.5	58580	45470	13.7 SEER2/11.8 EER2	80	67	60.5	58.3	115	93.15	2	55	95.3	NO	1	460/3	1.2	13	20	641
Select Submittal Docs	DAIKIN	DSG0604DH	5	2115	0.5	0.5	58580	45470	13.7 SEER2/11.8 EER2	80	67	60.5	58.3	140	113.4	2	55	104	NO	1	460/3	1.2	13	20	641
Select Submittal Docs	DAIKIN	DHG0603DL	5	2022	0.5	0.5	59669	44976	16.2 SEER2/12.2 EER2	80	67	59.8	57.7	70	56.7	2	55	80.6	NO	2	208/3	1	28.5	40	655
Select Submittal Docs	DAIKIN	DHG0603DM	5	2022	0.5	0.5	59669	44976	16.2 SEER2/12.2 EER2	80	67	59.8	57.7	115	93.15	2	55	97.1	NO	2	208/3	1	28.5	40	655
Select Submittal Docs	DAIKIN	DHG0603DH	5	2022	0.5	0.5	59669	44976	16.2 SEER2/12.2 EER2	80	67	59.8	57.7	140	113.4	2	55	106.3	NO	2	208/3	1	28.5	40	655
Select Submittal Docs	DAIKIN	DHG0604DL	5	2045	0.5	0.5	59777	45285	16.2 SEER2/12.2 EER2	80	67	59.9	57.8	70	56.7	2	55	80.4	NO	2	460/3	1.2	13.3	20	655
Select Submittal Docs	DAIKIN	DHG0604DM	5	2045	0.5	0.5	59777	45285	16.2 SEER2/12.2 EER2	80	67	59.9	57.8	115	93.15	2	55	96.7	NO	2	460/3	1.2	13.3	20	655
Select Submittal Docs	DAIKIN	DHG0604DH	5	2045	0.5	0.5	59777	45285	16.2 SEER2/12.2 EER2	80	67	59.9	57.8	140	113.4	2	55	105.7	NO	2	460/3	1.2	13.3	20	655
Select Submittal Docs	DAIKIN	DHG0603DL	5	2100	0.5	0.64	60037	46024	16.2 SEER2/12.2 EER2	80	67	60.1	58	70	56.7	2	55	79.7	YES	2	208/3	1	28.5	40	655
Select Submittal Docs	DAIKIN	DHG0603DM	5	2100	0.5	0.64	60037	46024	16.2 SEER2/12.2 EER2	80	67	60.1	58	115	93.15	2	55	95.6	YES	2	208/3	1	28.5	40	655
Select Submittal Docs	DAIKIN	DHG0603DH	5	2100	0.5	0.64	60037	46024	16.2 SEER2/12.2 EER2	80	67	60.1	58	140	113.4	2	55	104.4	YES	2	208/3	1	28.5	40	655
Select Submittal Docs	DAIKIN	DHG0604DL	5	2100	0.5	0.64	60037	46024	16.2 SEER2/12.2 EER2	80	67	60.1	58	70	56.7	2	55	79.7	YES	2	460/3	1.2	13.3	20	655
Select Submittal Docs	DAIKIN	DHG0604DM	5	2100	0.5	0.64	60037	46024	16.2 SEER2/12.2 EER2	80	67	60.1	58	115	93.15	2	55	95.6	YES	2	460/3	1.2	13.3	20	655
Select Submittal Docs	DAIKIN	DHG0604DH	5	2100	0.5	0.64	60037	46024	16.2 SEER2/12.2 EER2	80	67	60.1	58	140	113.4	2	55	104.4	YES	2	460/3	1.2	13.3	20	655

The Gas Pack RTU schedule filtered to 5-ton units.

Mini Splits and Multi Position Splits

Both are split systems, so both feed the Refrigerant tab (section 5) once they are in a project. Mini Split selections cover the outdoor unit and up to five indoor units; the number of indoor units is a filter of its own.

HHpro > MULTI POSITION SPLITS

Q Find a model number...

Log out

MULTI POSITION SPLITS

SPLIT SYSTEM SCHEDULE

Back to Products

SIZE

3

COOLING ONLY OR HEAT PUMP

HEAT PUMP

NOMINAL EFFICIENCY

All

ELECTRICAL

All

STAGES

All

FAN TYPE

All

Clear all filters

Showing 60 of 580 items

Actions	MAKE	MODEL	INDOOR AIR HANDLING UNIT														HEAT PUMP HEATING DATA				
			SUPPLY FAN			COOLING					HEAT PUMP TOTAL CAPACITY	AUX. ELECTRIC HEAT		ELECTRICAL DATA			WEIGHT	MAKE	MODEL	HEAT PUMP HEATING DATA	
			AIRFLOW (CFM)	MOTOR (HP)	MOTOR TYPE	EAT (DB)	EAT (WB)	LAT (DB)	TOTAL CAPACITY	SENSIBLE CAPACITY		kW	TEMPERATURE RISE (DB)	VOLTAGE / PHASE	MCA	MOP				OUTDOOR AMBIENT (DB)	EFFICIENCY
Select	DAIKIN	FTA36AAVJUD	1050	0.5	Variable Speed ECM	80	67	59	35000	23700	40500	-	-	208/1	4.9	15	118	DAIKIN	RZA36AAVJU	47	9.0 HSP
Select	DAIKIN	AMST36CU1300	1190	0.75	ECM	80	67	59	35000	26600	35000	-	-	208/1	7.1	15	153	DAIKIN	DH4SEA3610	47	7.5 HSP
Select	DAIKIN	AMST36CU1300	1000	0.75	ECM	80	67	58	35500	25205	36200	-	-	208/1	7.1	15	153	DAIKIN	DH5SEA3610	47	7.5 HSP
Select	DAIKIN	DFVE42CP1300	1260	0.75	Variable Speed ECM	80	67	61	34200	26334	34600	-	-	208/1	6.5	15	140	DAIKIN	DH6VSA3610	47	8.1 HSP
Select	DAIKIN	DMVT42CP1300	1190	0.75	Variable Speed ECM	80	67	58	34800	27144	34400	-	-	208/1	6.5	15	153	DAIKIN	DH7TCA3610	47	8.1 HSP
Select	DAIKIN	DFVE48DP1300	1320	0.75	Variable Speed ECM	80	67	58	35000	27650	35000	-	-	208/1	6.5	15	150	DAIKIN	DH7VSA3610	47	8.8 HSP
Select	DAIKIN	DFVE48CP1300	1260	0.75	Variable Speed ECM	80	67	59.391534	34200	28044	32000	-	-	115/1	6.5	15	155	DAIKIN	DH9VSA361C	17	9.2 HSP
Select	DAIKIN	AMST36CU1300	1190	0.75	ECM	80	67	59	35000	26600	34400	-	-	208/1	7.1	15	153	DAIKIN	DH4SEA3630	47	7.5 HSP
Select	DAIKIN	AMST36CU1300	1190	0.75	ECM	80	67	59	35000	26600	34400	-	-	208/1	7.1	15	153	DAIKIN	DH4SEA3640	47	7.5 HSP

The Multi Position Split schedule filtered to 3-ton heat pumps.

Gas Splits

Condensing unit plus gas furnace. The filter row carries the furnace side as well — gas stages, gas input, gas output and AFUE — alongside size, efficiency, compressor stages and coil orientation.

HHproGAS SPLITS

Find a model number...

Log out

GAS SPLITS

SPLIT SYSTEM SCHEDULE

Back to Products

SIZE

NOMINAL EFFICIENCY

COMPRESSOR STAGES

COIL ORIENTATION

GAS STAGES

GAS INPUT

GAS OUTPUT

AFUE (%)

Clear all filters

Showing all 737 items

Actions	MAKE	MODEL (COIL / FURNACE)	INDOOR AIR HANDLING UNIT													OUTDOOR CONDENSING UNIT								
			SUPPLY FAN			COOLING			GAS HEATING			ELECTRICAL DATA			WEIGHT (COIL & FURNACE)	MAKE	MODEL	ELECTRICAL DATA			OUTDOOR AMBIENT (COOLING)			
			AIRFLOW (CFM)	MOTOR (HP)	MOTOR TYPE	EAT (DB)	EAT (WB)	TOTAL CAPACITY	GAS INPUT	GAS OUTPUT	STAGES	AFUE (%)	VOLTAGE / PHASE	MCA	MOP			VOLTAGE / PHASE	MCA	MOP				
Select	Submittal	Docs	DAIKIN	CAPEA2418B3 / DR80TC0603BN	800	0.5	ECM	80	67	23200	60000	48000	2	80	115/60/1	7.75	15	156	DAIKIN	DC6VSS2410	208/60/1	16.8	20	95
Select	Submittal	Docs	DAIKIN	CAPEA3022B3 / DR80TC0603BN	1010	0.5	ECM	80	67	28400	60000	48000	2	80	115/60/1	7.75	15	163	DAIKIN	DC6VSS3010	208/60/1	22.4	25	95
Select	Submittal	Docs	DAIKIN	CAPEA3022B3 / DR80TC0603BN	610	0.5	ECM	80	67	17100	60000	48000	2	80	115/60/1	7.75	15	163	DAIKIN	DC6VSS1810	208/60/1	12.8	15	95
Select	Submittal	Docs	DAIKIN	CAPEA3626B3 / DR80TC0603BN	1260	0.5	ECM	80	67	33600	60000	48000	2	80	115/60/1	7.75	15	168	DAIKIN	DC6VSS3610	208/60/1	22.4	25	95
Select	Submittal	Docs	DAIKIN	CAPTA2422B3 / DR80TC0603BN	840	0.5	ECM	80	67	24000	60000	48000	2	80	115/60/1	7.75	15	158	DAIKIN	DC7TCA2410	208/60/1	15	20	95
Select	Submittal	Docs	DAIKIN	CAPTA3626B3 / DR80TC0603BN	1120	0.5	ECM	80	67	35000	60000	48000	2	80	115/60/1	7.75	15	165	DAIKIN	DC7TCA3610	208/60/1	20.8	35	95
Select	Submittal	Docs	DAIKIN	CHPEA2422B3 / DR80TC0603BN	800	0.5	ECM	80	67	23200	60000	48000	2	80	115/60/1	7.75	15	168	DAIKIN	DC6VSS2410	208/60/1	16.8	20	95
Select	Submittal	Docs	DAIKIN	CHPEA2422B3 / DR80TC0603BN	610	0.5	ECM	80	67	17100	60000	48000	2	80	115/60/1	7.75	15	168	DAIKIN	DC6VSS1810	208/60/1	12.8	15	95
Select	Submittal	Docs	DAIKIN	CHPEA3026B3 / DR80TC0603BN	1010	0.5	ECM	80	67	28400	60000	48000	2	80	115/60/1	7.75	15	176	DAIKIN	DC6VSS3010	208/60/1	22.4	25	95
Select	Submittal	Docs	DAIKIN	CHPEA3626B3 / DR80TC0603BN	1260	0.5	ECM	80	67	33600	60000	48000	2	80	115/60/1	7.75	15	178	DAIKIN	DC6VSS3610	208/60/1	22.4	25	95
Select	Submittal	Docs	DAIKIN	CHPTA2426B3 / DR80TC0603BN	840	0.5	ECM	80	67	23600	60000	48000	2	80	115/60/1	7.75	15	170	DAIKIN	DC7TCA2410	208/60/1	15	20	95
Select	Submittal	Docs	DAIKIN	CHPTA3630B3 / DR80TC0603BN	1120	0.5	ECM	80	67	34600	60000	48000	2	80	115/60/1	7.75	15	180	DAIKIN	DC7TCA3610	208/60/1	20.8	35	95
Select	Submittal	Docs	DAIKIN	CAPEA2418B3 / DR80TC0604BN	800	0.75	ECM	80	67	23200	60000	48000	2	80	115/60/1	12.1	15	157	DAIKIN	DC6VSS2410	208/60/1	16.8	20	95
Select	Submittal	Docs	DAIKIN	CAPEA3022B3 / DR80TC0604BN	1010	0.75	ECM	80	67	28400	60000	48000	2	80	115/60/1	12.1	15	164	DAIKIN	DC6VSS3010	208/60/1	22.4	25	95
Select	Submittal	Docs	DAIKIN	CAPEA3022B3 / DR80TC0604BN	610	0.75	ECM	80	67	17100	60000	48000	2	80	115/60/1	12.1	15	164	DAIKIN	DC6VSS1810	208/60/1	12.8	15	95
Select	Submittal	Docs	DAIKIN	CAPEA3626B3 / DR80TC0604BN	1260	0.75	ECM	80	67	33600	60000	48000	2	80	115/60/1	12.1	15	169	DAIKIN	DC6VSS3610	208/60/1	22.4	25	95
Select	Submittal	Docs	DAIKIN	CAPTA2422B3 / DR80TC0604BN	840	0.75	ECM	80	67	24000	60000	48000	2	80	115/60/1	12.1	15	159	DAIKIN	DC7TCA2410	208/60/1	15	20	95

The Gas Split schedule. Furnace filters sit alongside the outdoor unit filters.

VFDs

Filtered by horsepower, electrical, enclosure, bypass and harmonic mitigation. VFD schedules work slightly differently from the equipment schedules: the notes are a fixed list you cannot edit, the schedule carries a per-item Notes column instead of an Accessories column, and the project schedule adds a Serves column you fill in yourself. Auto Tag defaults to the VFD- prefix.

HHpro > VFDs

Find a model number...

Log out

VFDs

VFD SCHEDULE

Back to Products

HP

ELECTRICAL

ENCLOSURE

BYPASS

HARMONIC MITIGATION

Clear all filters

Showing all 176 items

Actions	Qty	Voltage	HP (est)	Enclosure Rating	Harmonic Mitigation	Disconnect	Bypass	Communications	VFD Min. SCGR	Manufacturer	Model	Notes
Select Submittal Docs	1	460V	1	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-02A1-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	1.5	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-03A0-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	2	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-03A5-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	3	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-04A8-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	5	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-07A6-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	7.5	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-012A-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	10	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-014A-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	15	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-023A-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	20	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-027A-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	25	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-034A-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	30	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-044A-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	40	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-052A-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	50	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-065A-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	60	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-077A-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	75	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-096A-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	100	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-124A-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	125	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-156A-4	1, 2, 3, 4, 5, 6, 10
Select Submittal Docs	1	460V	150	UL Type 1	5% Impedance	Circuit Breaker	None	BACnet MS/TP	100 KA	ABB	ABB ACH580-PCR-180A-4	1, 2, 3, 4, 5, 6, 10

Cart

The VFD schedule.

Diffusers and Grilles

These sheets hold many model families at once, so columns that do not apply to anything currently in view are hidden automatically — the schedule you see (and the one you export) only carries columns that have data. Auto Tag defaults to D- for diffusers and G- for grilles.

HHpro > GRILLES

Find a model number...

Log out

GRILLES

PRICE GRILLE SCHEDULE

Back to Products

150

20/30

300

500/600/700

900 GYM

540/640

LINEAR BAR

LINEAR BAR HD

500/600/700 RTN

60/70

EGG CRATE

PERFORATED

90 GYM RTN

LATTICE

TRANSFER

DESCRIPTION

APPLICATION

CFM

SIZE

CORE STYLE

DUCT SIZE

Clear all filters

Showing all 32200 items

Showing the first 500 of 32,200 matching selections - use the filters or the model cards above to narrow the list.

Actions	MANUFACTURER	MODEL	DESCRIPTION	APPLICATION	MATERIAL	SIZE (IN)	CORE AREA (SQ FT)	CORE VELOCITY (FPM)	FLOW RATE (CFM)	VELOCITY PRESSURE (IN WG)	TOTAL PRESSURE - 0" (IN WG)	TOTAL PRESSURE - 15" (IN WG)	TOTAL PRESSURE - 45" (IN WG)	SOUND (NC)	THROW - 0" (150-100-50 FT)	THROW - 15" (150-100-50 FT)	THROW - 45" (150-100-50 FT)	BLADE SP
Select Submittal Docs	PRICE	150	HEAVY DUTY LOUVERED SUPPLY GRILLE	SUPPLY	ALUMINUM	7 x 4	0.15	300	45	0.006	0.011	0.014	0.031	<15	4-6-11	3-5-9	2-3-6	
Select Submittal Docs	PRICE	150	HEAVY DUTY LOUVERED SUPPLY GRILLE	SUPPLY	ALUMINUM	7 x 4	0.15	400	60	0.01	0.02	0.025	0.055	<15	5-8-14	4-6-11	3-4-7	1.5
Select Submittal Docs	PRICE	150	HEAVY DUTY LOUVERED SUPPLY GRILLE	SUPPLY	ALUMINUM	7 x 4	0.15	500	75	0.016	0.031	0.039	0.085	16	6-9-15	5-8-12	3-5-8	1.5
Select Submittal Docs	PRICE	150	HEAVY DUTY LOUVERED SUPPLY GRILLE	SUPPLY	ALUMINUM	7 x 4	0.15	600	90	0.022	0.045	0.056	0.123	21	8-11-17	6-9-13	4-6-8	1.5
Select Submittal Docs	PRICE	150	HEAVY DUTY LOUVERED SUPPLY GRILLE	SUPPLY	ALUMINUM	7 x 4	0.15	700	105	0.031	0.061	0.077	0.167	26	9-13-18	7-10-14	4-6-9	1.5
Select Submittal Docs	PRICE	150	HEAVY DUTY LOUVERED SUPPLY GRILLE	SUPPLY	ALUMINUM	7 x 4	0.15	800	120	0.04	0.08	0.1	0.219	30	10-14-19	8-11-15	5-7-10	1.5
Select Submittal Docs	PRICE	150	HEAVY DUTY LOUVERED SUPPLY GRILLE	SUPPLY	ALUMINUM	7 x 4	0.15	1000	150	0.062	0.125	0.156	0.341	36	12-15-21	10-12-17	6-8-11	1.5
Select Submittal Docs	PRICE	150	HEAVY DUTY LOUVERED SUPPLY GRILLE	SUPPLY	ALUMINUM	7 x 4	0.15	1200	180	0.09	0.18	0.225	0.492	41	14-17-23	11-13-19	7-8-12	1.5
Select Submittal Docs	PRICE	150	HEAVY DUTY LOUVERED SUPPLY GRILLE	SUPPLY	ALUMINUM	7 x 4	0.15	1400	210	0.122	0.246	0.307	0.669	46	15-18-25	12-14-20	7-9-13	1.5
Select Submittal Docs	PRICE	150	HEAVY DUTY LOUVERED SUPPLY GRILLE	SUPPLY	ALUMINUM	7 x 4	0.15	1600	240	0.16	0.321	0.401	0.874	50	16-19-27	12-15-22	8-10-14	1.5
Select Submittal Docs	PRICE	150	HEAVY DUTY LOUVERED SUPPLY GRILLE	SUPPLY	ALUMINUM	7 x 4	0.15	1800	270	0.202	0.406	0.507	1.106	53	17-20-29	13-16-23	8-10-14	1.5
Select Submittal Docs	PRICE	150	HEAVY DUTY LOUVERED SUPPLY GRILLE	SUPPLY	ALUMINUM	6 x 5	0.15	300	45	0.006	0.011	0.014	0.031	<15	4-6-11	3-5-9	2-3-6	1.5
Select Submittal Docs	PRICE	150	HEAVY DUTY LOUVERED SUPPLY GRILLE	SUPPLY	ALUMINUM	6 x 5	0.15	400	60	0.01	0.02	0.025	0.055	<15	5-8-14	4-6-11	3-4-7	1.5


Cart

The Grille schedule with the family gallery above it.

3. Projects and the Cart


3.1 Your first Select

The first time you click Select, the site asks where the item should go.

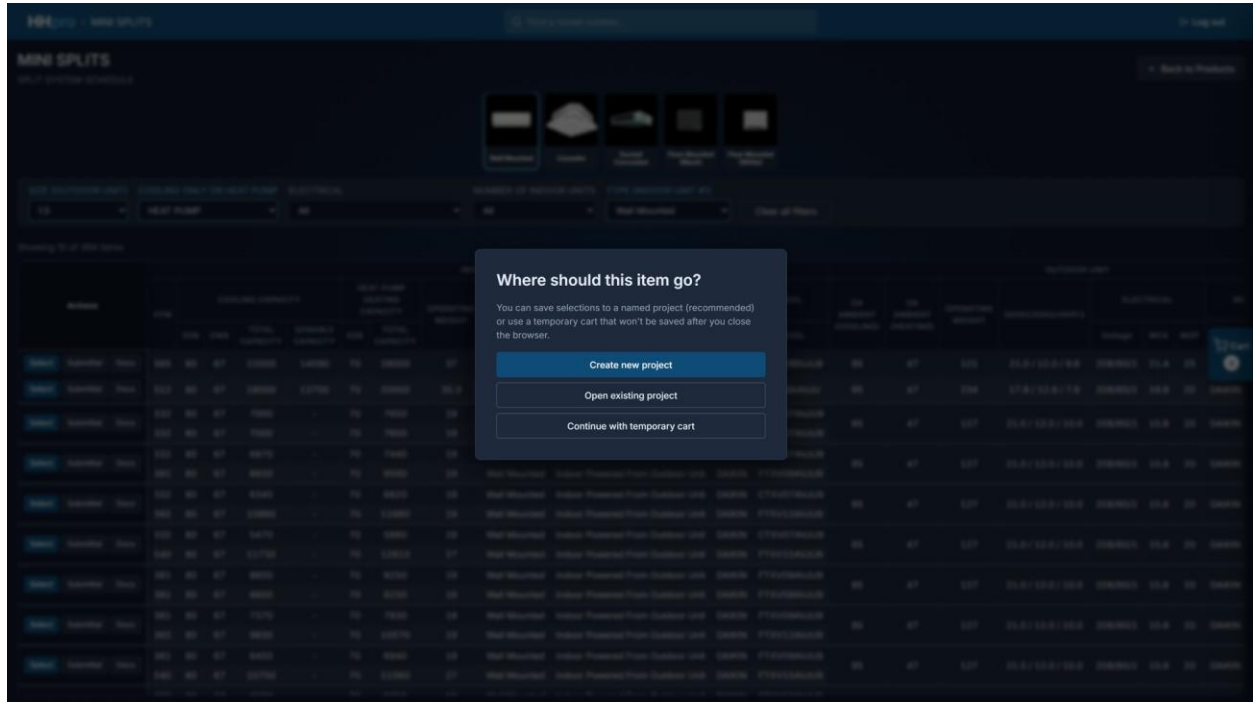

The first Select asks whether this is a project or a temporary cart.

- **Create new project** — recommended. Name it and it is saved in your browser from then on; every later Select goes straight into it.
- **Open existing project** — pick up a project you already started.
- **Continue with temporary cart** — a scratch list. It works exactly like a project, but it is not saved and is gone when you close the browser.

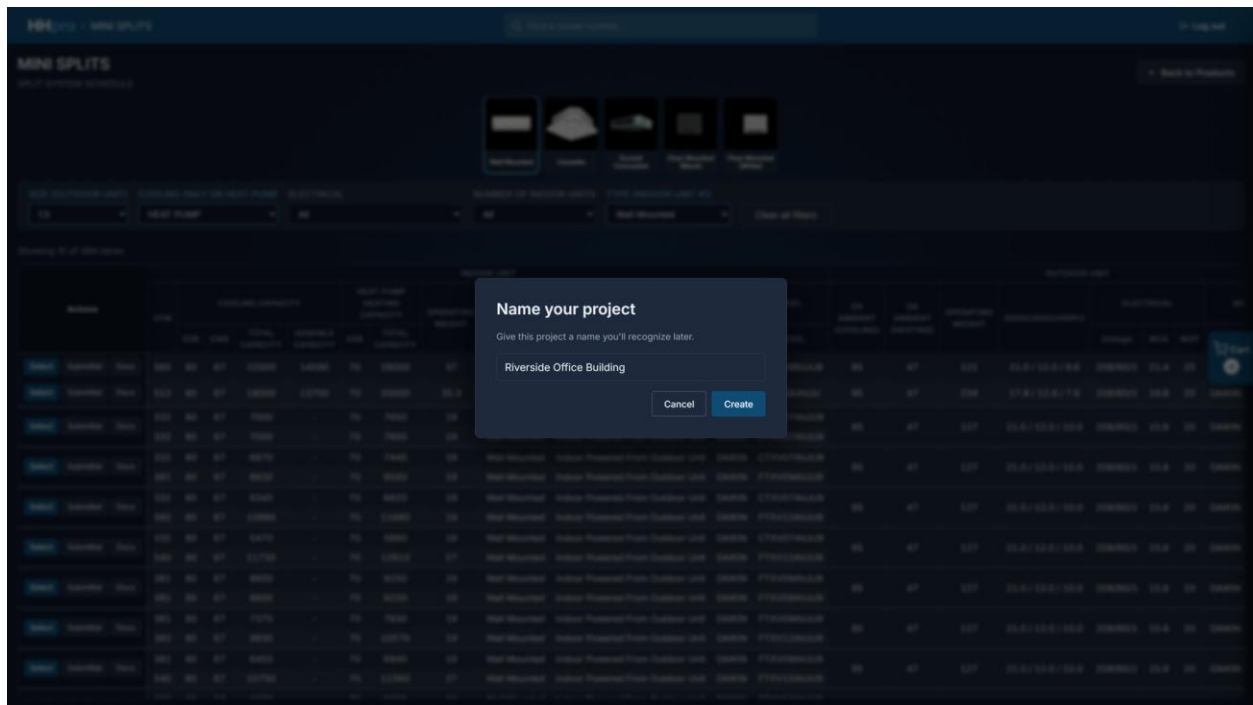

Naming a new project.

After that the prompt does not come back; Select simply adds to whatever is active. The name of the active project shows on the cart tab at the right edge of the screen.

3.2 The cart panel

Click the cart tab on the right edge to slide the panel open. It lists what you have collected, grouped by product type, with the size and model of each item.

HHpro

GAS PACK RTUS

Q. Find a model number...

GAS PACK RTUS

PACKAGED ROOFTOP UNITS

SIZE

5

ELECTRICAL

All

EFFICIENCY

All

COOLING STAGES

All

HIGH/MEDIUM/LOW GAS HEAT

All

HGRH

All

Clear all filters

Showing 18 of 162 items

Actions	MAKE	MODEL NUMBER	NOM TONS	Fan Data			Cooling Performance					Heating Performance					MODULATING HOT GAS REHEAT	CC	ST	
				CFM	ESP (IWG)	TESP (IWG)	TOTAL CAPACITY (BTU/h)	SENSIBLE CAPACITY (BTU/h)	EFFICIENCY (AT AHR)	EDB (°F)	EWB (°F)	LDB (°F)	LWB (°F)	INPUT (MBH)	OUTPUT (MBH)	Stages				EAT (°F)
Select Submittal Docs	DAIKIN	DSG0603DL	5	2090	0.5	0.5	58474	45127	13.7 SEER2/11.8 EER2	80	67	60.4	58.2	90	72.9	2	55	86.9	NO	
Select Submittal Docs	DAIKIN	DSG0603DM	5	2090	0.5	0.5	58474	45127	13.7 SEER2/11.8 EER2	80	67	60.4	58.2	115	93.15	2	55	95.8	NO	
Select Submittal Docs	DAIKIN	DSG0603DH	5	2090	0.5	0.5	58474	45127	13.7 SEER2/11.8 EER2	80	67	60.4	58.2	140	113.4	2	55	104.6	NO	
Select Submittal Docs	DAIKIN	DSG0604DL	5	2115	0.5	0.5	58580	45470	13.7 SEER2/11.8 EER2	80	67	60.5	58.3	90	72.9	2	55	86.5	NO	
Select Submittal Docs	DAIKIN	DSG0604DM	5	2115	0.5	0.5	58580	45470	13.7 SEER2/11.8 EER2	80	67	60.5	58.3	115	93.15	2	55	95.3	NO	
Select Submittal Docs	DAIKIN	DSG0604DH	5	2115	0.5	0.5	58580	45470	13.7 SEER2/11.8 EER2	80	67	60.5	58.3	140	113.4	2	55	104	NO	
Select Submittal Docs	DAIKIN	DHG0603DL	5	2022	0.5	0.5	59669	44976	16.2 SEER2/12.2 EER2	80	67	59.8	57.7	70	56.7	2	55	80.6	NO	
Select Submittal Docs	DAIKIN	DHG0603DM	5	2022	0.5	0.5	59669	44976	16.2 SEER2/12.2 EER2	80	67	59.8	57.7	115	93.15	2	55	97.1	NO	
Select Submittal Docs	DAIKIN	DHG0603DH	5	2022	0.5	0.5	59669	44976	16.2 SEER2/12.2 EER2	80	67	59.8	57.7	140	113.4	2	55	106.3	NO	
Select Submittal Docs	DAIKIN	DHG0604DL	5	2045	0.5	0.5	59777	45285	16.2 SEER2/12.2 EER2	80	67	59.9	57.8	70	56.7	2	55	80.4	NO	
Select Submittal Docs	DAIKIN	DHG0604DM	5	2045	0.5	0.5	59777	45285	16.2 SEER2/12.2 EER2	80	67	59.9	57.8	115	93.15	2	55	96.7	NO	
Select Submittal Docs	DAIKIN	DHG0604DH	5	2045	0.5	0.5	59777	45285	16.2 SEER2/12.2 EER2	80	67	59.9	57.8	140	113.4	2	55	105.7	NO	
Select Submittal Docs	DAIKIN	DHG0603DL	5	2100	0.5	0.64	60037	46024	16.2 SEER2/12.2 EER2	80	67	60.1	58	70	56.7	2	55	79.7	YES	
Select Submittal Docs	DAIKIN	DHG0603DM	5	2100	0.5	0.64	60037	46024	16.2 SEER2/12.2 EER2	80	67	60.1	58	115	93.15	2	55	95.6	YES	
Select Submittal Docs	DAIKIN	DHG0603DH	5	2100	0.5	0.64	60037	46024	16.2 SEER2/12.2 EER2	80	67	60.1	58	140	113.4	2	55	104.4	YES	
Select Submittal Docs	DAIKIN	DHG0604DL	5	2100	0.5	0.64	60037	46024	16.2 SEER2/12.2 EER2	80	67	60.1	58	70	56.7	2	55	79.7	YES	
Select Submittal Docs	DAIKIN	DHG0604DM	5	2100	0.5	0.64	60037	46024	16.2 SEER2/12.2 EER2	80	67	60.1	58	115	93.15	2	55	95.6	YES	
Select Submittal Docs	DAIKIN	DHG0604DH	5	2100	0.5	0.64	60037	46024	16.2 SEER2/12.2 EER2	80	67	60.1	58	140	113.4	2	55	104.4	YES	

View Project

MINI SPLITS

1.5 TON / RXF18BVJU9

Duplicate Delete

1.5 TON / 2MXM18AVJUS / (2 indoor units)

Duplicate Delete

MULTI POSITION SPLITS

3 TON / DH4SEA3610

Duplicate Delete

3 TON / DH7VSA3610

Duplicate Delete

GAS PACK RTUS

5 TON / DSG0603DL


Duplicate Delete

The cart panel, holding five selections across three product types.

- **Duplicate** — adds a second copy of that item, for when the same unit appears several times on the job.
- **Delete** — removes it.
- **View Project** — opens the full project view, where the schedule is built (section 4).

3.3 The Projects page

The Projects tile lists every project saved in this browser, newest first, with its item count and when it was last touched. The active project is badged.

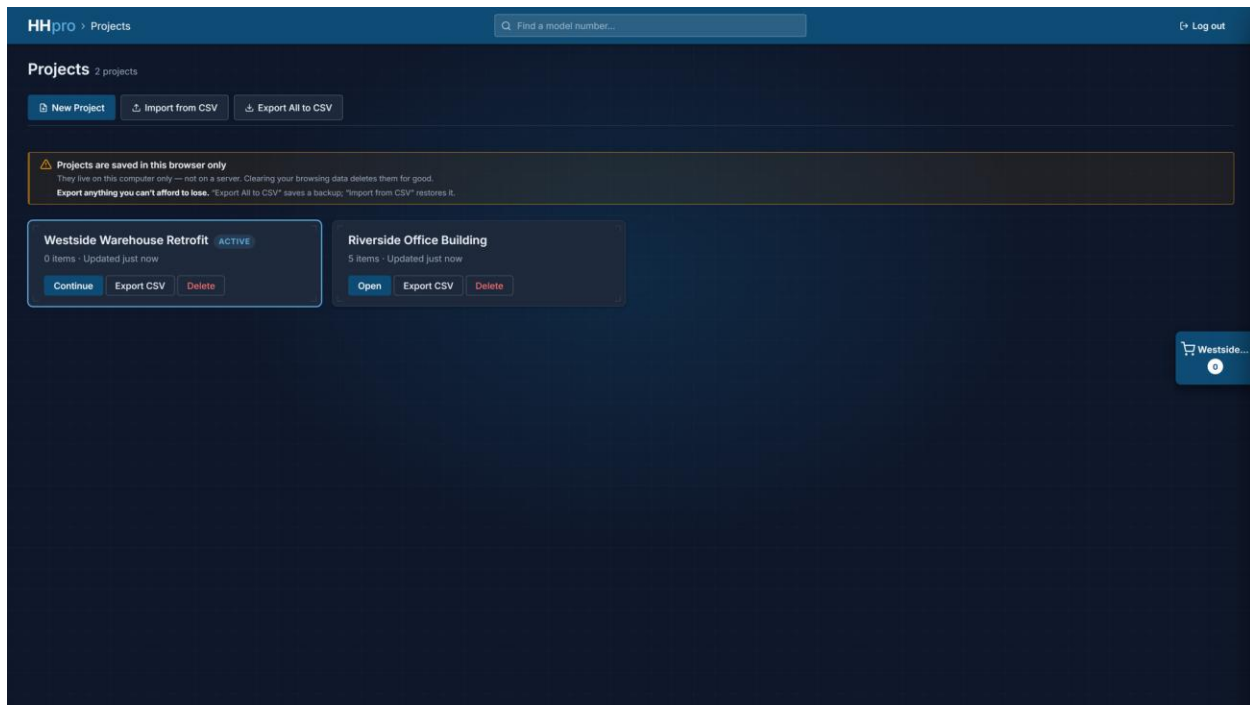

The Projects page.

- **New Project** — creates an empty project and makes it active.
- **Open / Continue** — makes that project active and opens its project view.
- **Export CSV** — saves that one project to a file.
- **Export All to CSV** — saves every project to a single file. This is your backup.
- **Import from CSV** — restores projects from a file, whether it is your own backup or one someone sent you.
- **Delete** — removes a project. This cannot be undone.

3.4 Where your projects live

Projects are stored by your own browser, on your own computer. Nothing is uploaded and there is no copy on a server — which also means a project saved on your desktop will not appear on your laptop, and clearing your browsing data deletes them for good.

Back your work up: Use Export All to CSV whenever a project matters. That file is the only copy that survives a cleared cache, a new computer, or a different browser — and it is also how you hand a project to someone else.

4. The Project View

View Project is where a pile of selections becomes a mechanical schedule. Open it from the cart panel, or from Open on the Projects page.

Riverside Office Building

Project: 5 items

MINI SPLITS (2) MULTI POSITION SPLITS (2) GAS PACK RTUS (1) REFRIGERANT (4) FILES

Auto Tag Add / Remove Columns Excel CAD PDF Edit Schedule

Outdoor Tag	Indoor Tag	CFM	COOLING CAPACITY		HEAT PUMP HEATING CAPACITY		OPERATING WEIGHT	INDOOR UNIT TYPE	ELECTRICAL			MAKE & MODEL		OA AMBIENT (COOLING)	OA AMBIENT (HEATING)	OPERATING WEIGHT	SEER2/EER2/HSPF2	ELECTRICAL		
			EDB	EWB	TOTAL CAPACITY	SENSIBLE CAPACITY			EDB	TOTAL CAPACITY	Voltage	MCA	MOP					MAKE	MODEL	Voltage
X Docs Outdoor	Indoor T.	565	80	67	22000	14590	70	28000	37	Wall Mounted	Indoor Powered From Outdoor Unit	DAIKIN	FTXF18BVJU9	95	47	121	21.0 / 12.0 / 9.6	208/60/1	21.4	21
X Docs Outdoor	Indoor T.	332	80	67	6870	-	70	7440	19	Wall Mounted	Indoor Powered From Outdoor Unit	DAIKIN	CTXV07AVJU9	95	47	127	21.0 / 12.0 / 10.0	208/60/1	15.6	21

SCHEDULE NOTES:

1. Provide with 7-day programmable thermostat
2. Provide with 7-day programmable BACnet thermostat
3. Provide with low ambient wind baffle for cooling down to 0°F
4. Provide with field installed condensate pump
5. Provide with field installed disconnect. Disconnect shall be provided and installed by electrical contractor

CUSTOM PROJECT NOTES

Type a note, then click the + button to add it to the schedule notes above. Up to 10 text rows.

1. + Custom note 1	2. + Custom note 2
3. + Custom note 3	4. + Custom note 4
5. + Custom note 5	6. + Custom note 6
7. + Custom note 7	8. + Custom note 8
9. + Custom note 9	10. + Custom note 10

The project view: product tabs, the toolbar, the schedule, and the notes below it.

4.1 Tabs

The project gets one tab per product type you have selected from, each showing how many items it holds, plus two extra tabs.

MINI SPLITS (2) MULTI POSITION SPLITS (2) GAS PACK RTUS (1) REFRIGERANT (4) FILES

Product tabs, then Refrigerant and Files.

- **Product tabs** — one schedule each. They are independent: tags, columns, notes and exports are all per tab.
- **Refrigerant** — appears only when the project holds split systems (section 5).
- **Files** — every document for everything in the project (section 6).

4.2 The toolbar


Auto Tag Add / Remove Columns Excel CAD PDF Edit Schedule

The toolbar sits above every product schedule.

Auto Tag and Add / Remove Columns set the schedule up; Excel, CAD and PDF take it out of the site; Edit Schedule lets you change anything by hand.

4.3 Auto Tag

Auto Tag fills in equipment tags for every item on the tab, in the order they appear.

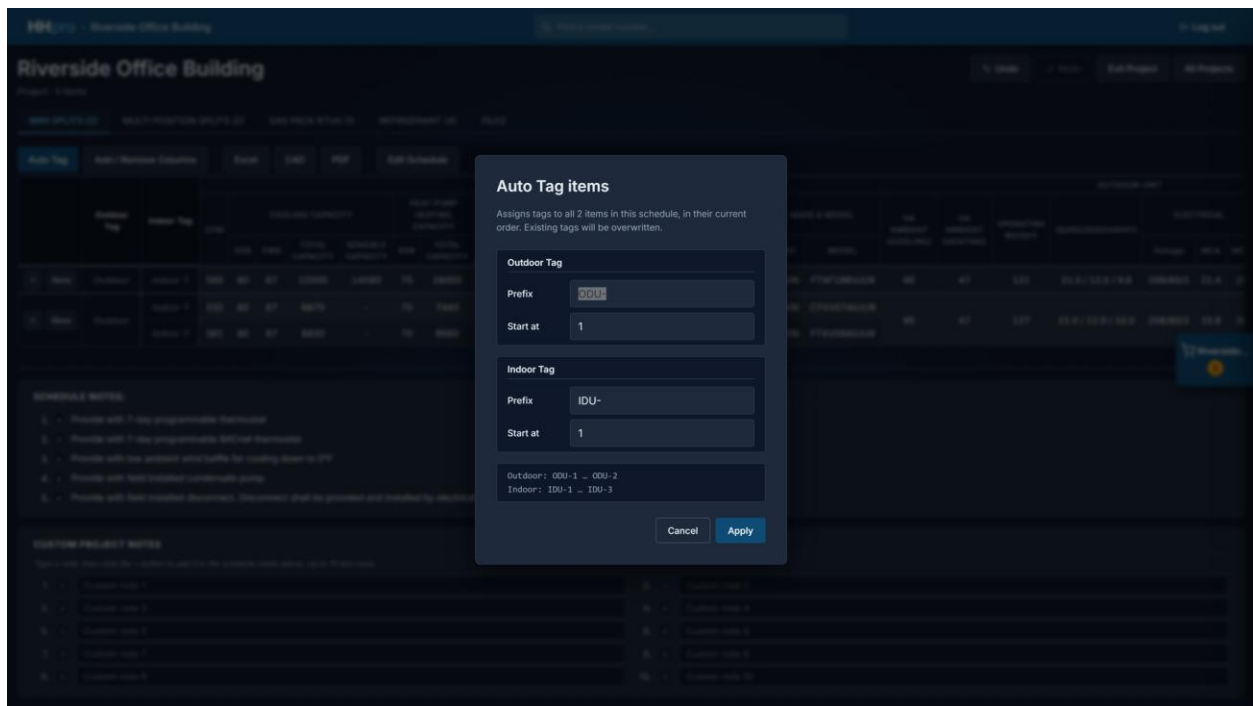


Auto Tag: set a prefix and a starting number, and the preview shows what you will get.

- Set the prefix and the number to start at. The preview under the boxes shows the tags that will be applied.
- Split-system schedules tag outdoor and indoor units separately — ODU-1, ODU-2 for the outdoor units and IDU-1, IDU-2, IDU-3 running through the indoor units. Other products use a single tag, defaulting to VFD-, D- or G- where that fits.
- Applying Auto Tag overwrites the tags already on the tab. Any tag can also simply be typed into its cell.

The prefix and start you used are remembered with the project, so the next run picks up where you left off.

4.4 Add / Remove Columns

Not every column belongs on every set of drawings. This popup lists every data column on the tab with a checkbox: uncheck what you do not want and click Apply. Show all and Hide all are there for the extremes.

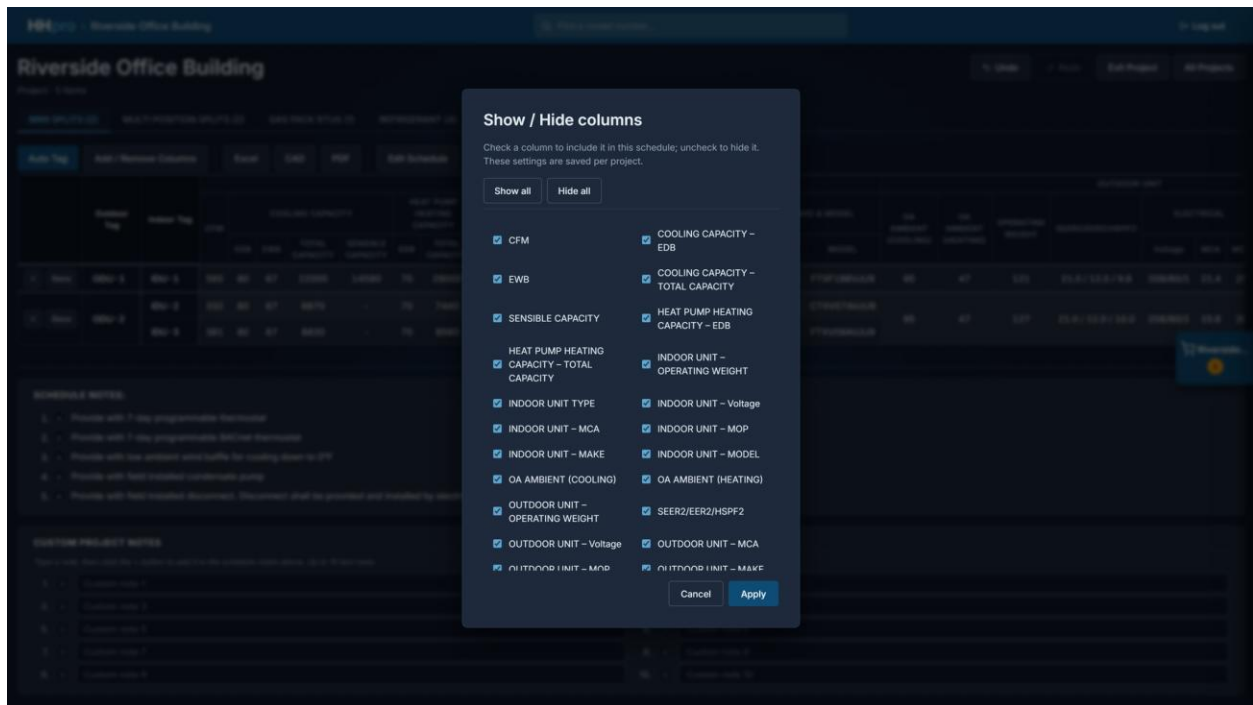

Choosing which columns appear on the finished schedule.

The choice is saved per project and per product tab, and it carries through to the Excel, CAD and PDF exports — what you see is what you get.

4.5 Edit Schedule

Edit Schedule turns every cell on the tab into a text box, so any value can be corrected or overwritten — tags, capacities, electrical data, accessories, anything. Changes save as you type and appear in the exports. Click Done Editing to leave the mode.

HHpro > Riverside Office Building Q Find a model number... Log out

Riverside Office Building

Project - 5 items

MINI SPLITS (2) MULTI POSITION SPLITS (2) GAS PACK RTUS (1) REFRIGERANT (4) FILES

Auto Tag Add / Remove Columns Excel CAD PDF Done Editing

Editing every cell — changes save automatically and appear in the Excel/CAD/PDF downloads. Click "Done Editing" when finished.

		INDOOR UNIT									
Outdoor Tag	Indoor Tag	CFM	EDB	EWB	COOLING CAPACITY		HEAT PUMP HEATING CAPACITY		OPERATING WEIGHT	INDOOR UNIT TYPE	ELECTRICAL
					TOTAL CAPACITY	SENSIBLE CAPACITY	EDB	TOTAL CAPACITY			Voltage MCA MOP
ODU-1	IDU-1	565	80	67	22000	14590	70	28000	37	Wall Mounted	Indoor Powered From Outdoor Unit
ODU-2	IDU-2	332	80	67	6870	-	70	7440	19	Wall Mounted	Indoor Powered From Outdoor
	IDU-3	381	80	67	8830	-	70	9560	19	Wall Mounted	Indoor Powered From Outdoor

SCHEDULE NOTES:

1. Provide with 7-day programmable thermostat
2. Provide with 7-day programmable BACnet thermostat
3. Provide with low ambient wind baffle for cooling down to 0°F
4. Provide with field installed condensate pump
5. Provide with field installed disconnect. Disconnect shall be provided and installed by electrical contractor

Created with HHpro-HVAC.com

Edit mode: every cell becomes editable.

Edits stick: A value you type by hand stays as you typed it. If you later change a capacity dropdown on the browse page, the hand-edited cell is not recalculated — check it before exporting.

4.6 Schedule notes

Below the schedule is the notes block that prints with it. Each product comes with a standard set of notes already filled in.

SCHEDULE NOTES:

1. Provide with 7-day programmable thermostat
2. Provide with 7-day programmable BACnet thermostat
3. Provide with low ambient wind baffle for cooling down to 0°F
4. Provide with field installed condensate pump
5. Provide with field installed disconnect. Disconnect shall be provided and installed by electrical contractor

CUSTOM PROJECT NOTES

Type a note, then click the + button to add it to the schedule notes above. Up to 10 text rows.

1. + Custom note 1	2. + Custom note 2
3. + Custom note 3	4. + Custom note 4
5. + Custom note 5	6. + Custom note 6
7. + Custom note 7	8. + Custom note 8
9. + Custom note 9	10. + Custom note 10

Schedule notes, with the custom-note boxes underneath.

- Remove a note that does not apply with the × beside it. Removed notes collect into a row of pills under the list — click one to put it back.
- Add your own with the Custom Project Notes boxes: type the text, click +, and it joins the numbered list above. Up to ten custom notes per schedule.

- Diffuser notes are matched to the models actually in the project, and an SMD/AMD core-style legend is placed beside the notes when one of those models is present. VFD notes are a fixed list and cannot be edited.

4.7 Undo, Redo and leaving

- **Undo / Redo** (top right) — step back through anything you have changed in the project view. Ctrl+Z and Ctrl+Shift+Z do the same.
- **Exit Project** — closes the project without deleting it and returns to the overview. Reopen it any time from Projects.
- **All Projects** — back to the Projects page with the project still open.

4.8 Exporting the schedule

The three export buttons act on the tab you are looking at, using the columns you left visible and the edits you made.

- **Excel** — downloads a formatted .xlsx workbook named after the project and the tab, with the merged headers, borders and schedule notes intact.
- **CAD** — downloads a .dxf. Under the schedule it adds an EQUIPMENT DRAWINGS block: front, side and top views of every unit in the project, drawn at true size (1 drawing unit = 1 inch) with the overall width, height and depth called out and a scale bar for reference. It opens in AutoCAD and in LibreCAD; column widths can be adjusted with Stretch.
- **PDF** — opens a clean print-ready window laid out for landscape letter and triggers the print dialog. Choose Save as PDF (or send it straight to a printer).

To export everything at once instead of tab by tab, use the Project Schedules entries on the Files tab (section 6).

5. The Refrigerant Tab

Any project holding split systems gets a Refrigerant tab. It carries the factory data for each system and works out the charge from the line-set lengths you measured.

HHpro > Riverside Office Building [Log out](#)

Riverside Office Building [Undo](#) [Redo](#) [Exit Project](#) [All Projects](#)

Project - 5 items

MINI SPLITS (2) MULTI POSITION SPLITS (2) GAS PACK RTUS (1) **REFRIGERANT (4)** FILES

Enter the actual line-set distances for each split system in the "Field Measurements" columns. The site validates against each system's allowable maximums and computes the refrigerant charge to add (line-set length minus the factory pre-charge length, multiplied by the manufacturer's oz/ft) plus the total system charge.

[PDF Report](#)

SYSTEM		REFRIGERANT	LINE SIZES	FACTORY VALUES			FACTORY CHARGE	ADDITIONAL	FIELD MEASUREMENTS		CALCULATED CHARGE		REFERENCE	
OUTDOOR	INDOOR(S)			MAX VERT ODU-IDU	MAX VERT IDU-IDU	MAX TOTAL			ACTUAL VERT ODU-IDU (')	ACTUAL TOTAL (')	ACTUAL VERT IDU-IDU (')	TO ADD		TOTAL CHARGE
ODU-1 RXF18BVUJ9	IDU-1 FTXF18BVUJ9	R-32	Liquid: 0.25" Suction: 0.5"	66 ft	N/A	99 ft	39.2 oz 2.45 lbs 49 ft	0.22 oz/ft	25	60	N/A	2.42 oz 0.151 lbs	41.62 oz 2.601 lbs	Outdoor Unit IOM
ODU-2 2MXM18AVUJ9	IDU-2 CTXV07AVUJ9 IDU-3 FTXV06AVUJ9	R-32	Liquid: 0.25" Suction: 0.375"	49.25 ft	82 ft	164 ft	52.8 oz 3.3 lbs 98.4 ft	0.22 oz/ft	20	45	90	—	—	Outdoor Riverside...
— DH42EA3610	— AMGT36CU1300	R-32	Liquid: 0.375" Suction: 0.875"	79 ft	N/A	200 ft	83 oz 5.1875 lbs 15 ft	0.58 oz/ft	30	55	N/A	23.20 oz 1.450 lbs	106.20 oz 6.638 lbs	Long Line Set Guide
— DH7VSA3610	— DFVE4BDP1300	Refer to outdoor unit installation manual for refrigerant calculations.												Outdoor Unit IOM

PROJECT TOTAL REFRIGERANT

147.82 oz
9.239 lbs

The Refrigerant tab with field measurements entered.

Reading across a row:

- **System** — the outdoor unit and the indoor unit(s) on it, with the tags you assigned.
- **Factory values** — refrigerant type, line sizes, the maximum vertical and total lengths the system allows, the factory charge and the length it covers, and the additional charge per foot.
- **Field measurements** — the boxes you fill in: actual vertical rise between outdoor and indoor unit, actual total line length, and for multi-zone systems the vertical separation between indoor units.
- **Calculated charge** — refrigerant to add (line length beyond the factory pre-charge, times the per-foot figure) and the total system charge.
- **Reference** — a link to the outdoor unit IOM or the long line-set guide for that system.


Anything you enter that exceeds the system's allowable maximum is flagged in the cell as you type. The project total for all systems is shown under the table.

PDF Report produces a print-ready refrigerant report for the whole project, with the same figures laid out for the drawing set. It is also available from the Files tab.

Not every system: Some systems publish their charge calculation only in the installation manual. Those rows say so and link to the manual instead of showing boxes.

6. The Files Tab

The Files tab gathers every document published for everything in the project and packages the ones you want into a single ZIP.

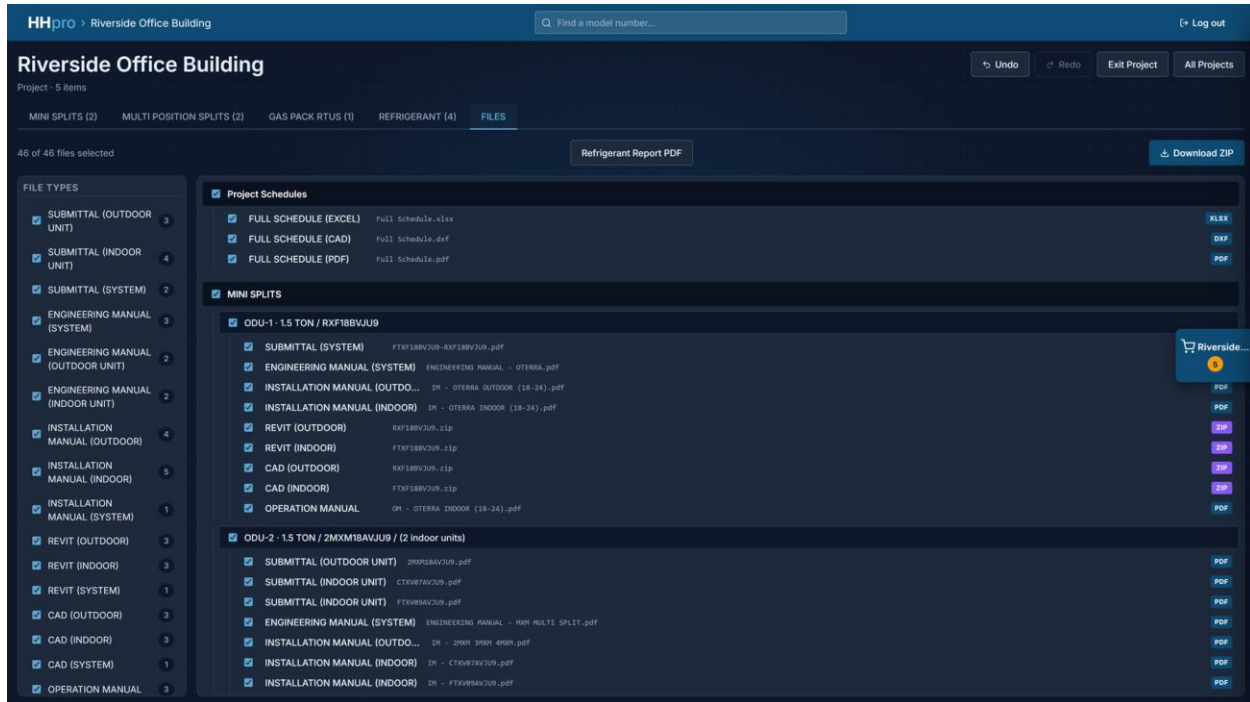

The Files tab: file types on the left, the full tree on the right.

6.1 Choosing what to download

- **File types** (left panel) — every kind of document in the project with a count: submittals, engineering manuals, installation manuals, operation manuals, Revit families, CAD files. Unchecking a type drops it everywhere at once — the quickest way to say "submittals only".
- **The tree** (right) — product, then item, then file. Every level has a checkbox, so you can take everything for one unit, or one document for one unit.
- Everything starts checked. The counter at the top left tracks what you have selected.

6.2 Project Schedules

The first group in the tree is generated rather than downloaded: Full Schedule.xlsx, Full Schedule.dxf and Full Schedule.pdf, each holding every product tab in the project in one file. That is the fastest way to get the whole job out at once — the DXF also carries the unit drawings described in section 4.8.

6.3 Downloading

Download ZIP builds the archive and saves it as "<Project Name> - HHpro - <date>.zip", keeping the file names as published. A progress bar runs while it works; large projects with Revit and CAD content take a moment.

Refrigerant Report PDF, beside the download button, produces the report described in section 5 without leaving the tab.

Missing files: If a document listed in the data has not been published yet, it is skipped and reported in a summary at the end rather than failing the whole download.

7. Design Search

Design Search works the opposite way round from browsing: enter the loads you need to hit and the site returns the equipment that meets them, ranked by how close it comes.

7.1 Running a search

1. Choose a product category. The form rebuilds itself around that product.
2. Enter your design targets — cooling total and sensible capacity, heating capacity, airflow, and whatever else that product carries. Beside each target is the tolerance you can live with, as a $\pm$ percentage. Leave a row blank to ignore it.
3. Set any hard constraints under Constraints — size, electrical, efficiency, stages. A result has to match these exactly.
4. Click Find matches. Reset clears the form.

The screenshot shows the 'Design Search' interface for 'MULTI POSITION SPLITS'. The form is divided into several sections: 'COOLING CONDITIONS' with inputs for OA Ambient (95 °F), Coil EAT (DB) (80 °F), and Coil EAT (WB) (67 °F); 'HEAT PUMP HEATING CONDITIONS' with inputs for OA Ambient (blank) and Coil EAT (DB) (70 °F); 'Performance at Design Conditions' with inputs for Cooling Total Capacity (36000 BTUH ± 10 %), Cooling Sensible Capacity (27000 BTUH ± 10 %), and Heat Pump Heating Capacity (blank BTUH ± 10 %); and 'OTHER DESIGN TARGETS' with inputs for Aux. Electric Heat (blank kW ± 10 %) and Indoor Airflow (blank CFM ± 10 %). A large central area displays 'No search run yet' with a magnifying glass icon and the instruction 'Enter design targets and click "Find matches" to see equipment that fits.' The top navigation bar includes 'HHpro > Design Search', a search bar, and a 'Log out' link. A 'Cart' icon with a '0' is visible on the right.

The Multi Position Split form: design conditions on top, then targets and constraints.

Results are sorted by closeness to your targets, with the targets you searched on shown as chips above the table. Each result carries the same Select, Submittal and Docs buttons as a product page, so a match can go straight into your project.

7.2 Performance at design conditions

For products with published capacity tables, the form opens with a Performance at design conditions block: outdoor ambient, entering air dry bulb and wet bulb for cooling, and outdoor ambient for heat

pump heating. Fill those in and the search is answered at your condition rather than at the rating point stored in the schedule.

Results then come back in two groups:

- **Verified at design conditions** — systems whose capacity tables cover your condition. The capacity columns show performance at that condition, and the condition dropdowns stay live on each row so you can compare neighbouring rated points.
- **Possible solutions — compared by nominal ratings** — systems with no table covering your condition. They were matched against the nominal schedule values, so treat them as candidates to check rather than as verified selections.

Design Search
Pick a product category, enter your design targets with the tolerance you can accept, then find matching equipment.

Product category: **MULTI POSITION SPLITS**

Conventional split systems with a multi-position air handler + outdoor condensing unit. Enter design loads and the page returns models that meet the targets within your tolerance.

PERFORMANCE AT DESIGN CONDITIONS
Systems with capacity tables are verified at these conditions. A condition between rated points is evaluated at the bracketing rated points with the worst case shown. Leave the conditions blank to compare nominal ratings instead.

COOLING CONDITIONS
OA Ambient: 95 °F, Coil EAT (DB): 80 °F
Coil EAT (WB): 67 °F

HEAT PUMP HEATING CONDITIONS
OA Ambient: — °F, Coil EAT (DB): 70 °F
Cooling Total Capacity: 36000 BTU/H ± 10 %
Cooling Sensible Capacity: 27000 BTU/H ± 10 %
Heat Pump Heating Capacity: — BTU/H ± 10 %

OTHER DESIGN TARGETS
Leave a row blank to skip it. Tolerance is the +/- percent the result can differ from your target.
Aux. Electric Heat: — kW ± 10 %
Indoor Airflow: — CFM ± 10 %

Results 100 matches
Sorted by closeness to: Cooling @ 95°F OA, 80/67°F EAT, Cooling Total Capacity 36000 BTU/H ±10%, Cooling Sensible Capacity 27000 BTU/H ±10%

Verified at design conditions (69)
Capacity columns show rated performance at your design conditions -- worst-case rated point when a condition falls between rated points. Adjust the condition dropdowns on any row to compare nearby rated points.

Actions	MAKE	MODEL	SUPPLY FAN			INDOOR AIR HANDLING UNIT					AUX. ELECTRIC HEAT		
			AIRFLOW (CFM)	MOTOR (HP)	MOTOR TYPE	EAT (DB)	EAT (WB)	LAT (DB)	TOTAL CAPACITY	SENSIBLE CAPACITY	HEAT PUMP TOTAL CAPACITY	kW	TEMP. RISE
Select Submittal Docs	DAIKIN	AMST36CU1300	1165	0.75	ECM	80	67	59	36000	28080	36200	-	-
Select Submittal Docs	DAIKIN	AMST36CU1300	1190	0.75	ECM	80	67	59	35000	26800	35000	-	-
Select Submittal Docs	DAIKIN	AMST36CU1300	1190	0.75	ECM	80	67	59	35000	26600	34400	-	-
Select Submittal Docs	DAIKIN	AMST36CU1300	1190	0.75	ECM	80	67	59	35000	26600	34400	-	-
Select Submittal Docs	DAIKIN	DFVE48DP1300	1320	0.75	Variable Speed ECM	80	67	58	35000	27650	35000	-	-
Select Submittal Docs	DAIKIN	DFVE48DP1300	1260	0.75	Variable Speed ECM	80	67	58	35000	27650	-	-	-
Select Submittal Docs	DAIKIN	DFVE42CP1300	1260	0.75	Variable Speed ECM	80	67	61	34200	26334	34600	-	-
Select Submittal Docs	DAIKIN	DFVE36CP1300	1260	0.75	Variable Speed ECM	80	67	61	34200	26334	-	-	-
Select Submittal Docs	DAIKIN	AWVE36LU1300	1320	0.5	Variable Speed ECM	80	67	60	34100	27621	34400 (standard), 35400 (boost)	-	-

Possible solutions -- compared by nominal ratings (31)
These systems have no capacity table covering the entered conditions, so they were matched on nominal schedule values. Actual performance at your design conditions may differ.

Verified results on top, nominal-only candidates below.

Between rated points: A condition that falls between two rated points is evaluated at both and the worse of the two is shown, so the capacity you see is never optimistic. Leave the condition boxes blank to go back to comparing nominal ratings.

7.3 Gas Pack RTUs

Gas Pack RTUs get a form of their own, because every number on their schedule came from a selection run by hand at one condition. Here the whole answer is read from Daikin's published capacity tables instead.

HHpro > Design Search

Q Find a model number...

Log out

Design Search

Pick a product category, enter your design targets with the tolerance you can accept, then find matching equipment.

Product category
GAS PACK RTUS

Packaged rooftop units. Enter design loads and the page returns models that meet the targets within your tolerance.

PERFORMANCE AT DESIGN CONDITIONS

Results come from Daikin's published capacity tables, not from the schedule's stored selection. A condition between rated points is evaluated at the harsher bracketing point, so the capacity shown is never optimistic.

Nominal Tons
All

Efficiency
All

Electrical
All

Motor
All

Hot Gas Reheat
All

Outdoor Ambient (°F)
95

COOLING ENTERING AIR

Cooling EAT (DB) 80 °F

Cooling EAT (WB) 67 °F

Leave a row blank to skip it. Tolerance is the +/- percent the result can differ from your target.

No search run yet

Enter design targets and click "Find matches" to see equipment that fits.

Cart

The Gas Pack RTU form: cabinet constraints on the left, then conditions and targets.

- Constrain the cabinet first if you need to: nominal tons, efficiency, electrical, motor and hot gas reheat.
- Set the outdoor ambient and the cooling entering-air dry bulb and wet bulb. The defaults reproduce the conditions the stored schedule was selected at.
- Enter targets for supply CFM, cooling total and sensible capacity, and gas heating temperature rise, each with its own tolerance.
- Tick any electrical options that are required — powered convenience outlet, power exhaust.

Results show the full cooling and heating picture at your condition, with the model each row resolves to on the schedule. Any cabinet with no published cooling data is listed under the results as not evaluated, so you know it was not silently dropped.

HHpro > Design Search

Q Find a model number...

Log out

Design Search

Pick a product category, enter your design targets with the tolerance you can accept, then find matching equipment.

Product category

GAS PACK RTUS

Packaged rooftop units. Enter design loads and the page returns models that meet the targets within your tolerance.

PERFORMANCE AT DESIGN CONDITIONS

Results come from Daikin's published capacity tables, not from the schedule's stored selection. A condition between rated points is evaluated at the harsher bracketing point, so the capacity shown is never optimistic.

Nominal Tons

All

Efficiency

All

Electrical

All

Motor

All

Hot Gas Reheat

All

Outdoor Ambient (°F)

95

COOLING ENTERING AIR

Cooling EAT (DB)

80 °F

Cooling EAT (WB)

67 °F

Leave a row blank to skip it. Tolerance is the +/- percent the result can differ from your target.

Results36 matches

Evaluated at:80/67 °F EAT DB/WB95 °F ambientSupply CFM 2000 CFM ±10%Cooling Total Capacity 60000 BTU/h ±10%

DG0150 (12.5 ton) was not evaluated: no published cooling data.

								Cooling					Heating							
	Model	Nom Tons	Efficiency	Volt/PH	Motor	HGRH	CFM	OA DB (°F)	EDB (°F)	EWB (°F)	LDB (°F)	Total (BTU/h)	Sensible (BTU/h)	Gas Heat	High In (MBH)	High Out (MBH)	High Rise (°F)	Low In (MBH)	Low Out (MBH)	Low Rise (°F)
Select	DHG0603DH	5	High	208/3	Standard Static	NO	1880	95	80	67	59.1	59,000	43,070	High	140	113.4	55.9	105	85.05	41.
Select	DHG0603DH	5	High	208/3	Standard Static	YES	1880	95	80	67	59.1	59,000	43,070	High	140	113.4	55.9	105	85.05	
Select	DHG0603DL	5	High	208/3	Standard Static	NO	1880	95	80	67	59.1	59,000	43,070	Low	70	56.7	27.9	52.5	42.53	20.
Select	DHG0603DL	5	High	208/3	Standard Static	YES	1880	95	80	67	59.1	59,000	43,070	Low	70	56.7	27.9	52.5	42.53	20.
Select	DHG0603DM	5	High	208/3	Standard Static	NO	1880	95	80	67	59.1	59,000	43,070	Medium	115	93.15	45.9	86.25	69.86	34.
Select	DHG0603DM	5	High	208/3	Standard Static	YES	1880	95	80	67	59.1	59,000	43,070	Medium	115	93.15	45.9	86.25	69.86	34.
Select	DHG0603WH	5	High	208/3	High Static	NO	1880	95	80	67	59.1	59,000	43,070	High	140	113.4	55.9	105	85.05	41.
Select	DHG0603WH	5	High	208/3	High Static	YES	1880	95	80	67	59.1	59,000	43,070	High	140	113.4	55.9	105	85.05	41.
Select	DHG0603WL	5	High	208/3	High Static	NO	1880	95	80	67	59.1	59,000	43,070	Low	70	56.7	27.9	52.5	42.53	20.
Select	DHG0603WL	5	High	208/3	High Static	YES	1880	95	80	67	59.1	59,000	43,070	Low	70	56.7	27.9	52.5	42.53	20.


Cart0

Gas Pack results, evaluated from the capacity tables.

HHpro User Guide · 31

8. Finding a Model Number

The search box in the header searches every product at once. Type all or part of a model number — the dropdown shows the matches with the product each one belongs to, and highlights the part you typed.

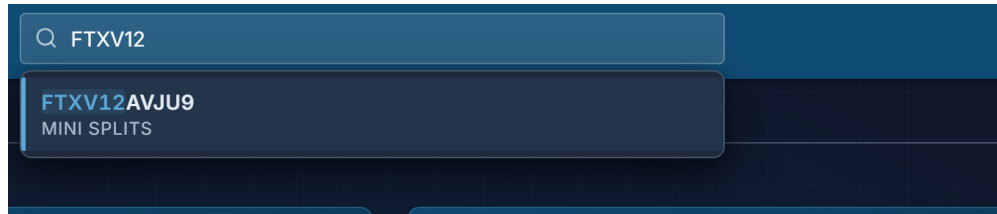

Searching for a model number from the header.

Click a result and the site opens that product's page with the schedule already narrowed to the model, shown as a chip under the filters. Clear on the chip drops back to the full list; the normal filters work alongside it.



The product page opens filtered to the model you picked.

The first search of a session takes a few seconds while the index is built across every product; after that it is instant.

9. Appendix


9.1 Privacy and your data

HHpro has no accounts, no cookies, no analytics and no third-party requests. There is no server to send anything to — the site is a set of static files and everything runs inside your browser. Projects, selections and preferences are written to your browser's own storage on your own device and never leave it.

The practical consequences are worth knowing:

- Clearing your browsing data deletes your projects. Export to CSV first.
- Projects do not follow you between computers, browsers, or private windows. Move them with Export / Import CSV.
- Nobody — including us — can see what you have selected unless you send it to them.

The Privacy & Data link at the bottom of the page has the full account, and it is reachable before you sign in.

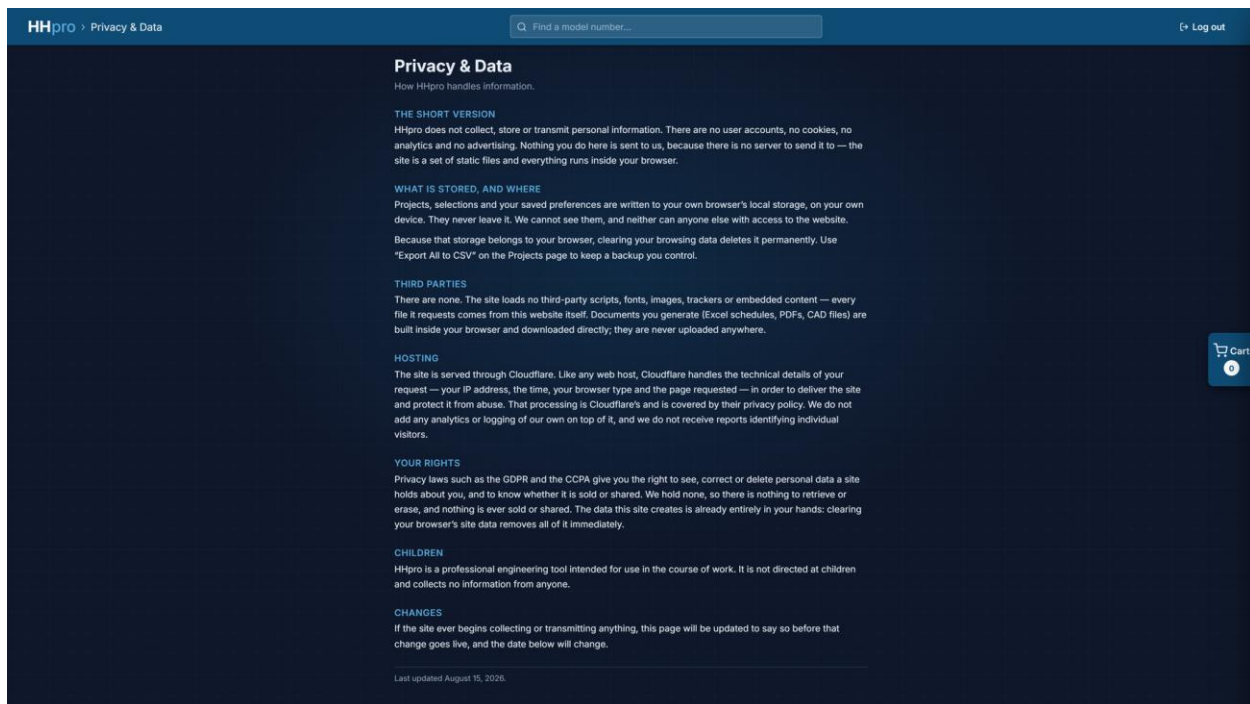

The Privacy & Data page.

9.2 Quick reference

- **Build a schedule** — product tile → filter → Select the systems you need → cart → View Project → Auto Tag → Add / Remove Columns → Excel / CAD / PDF.
- **Find a unit by load** — Design Search → category → conditions and targets → Find matches → Select.
- **Find a unit by model** — type it in the header search box and click the result.

- **Get the paperwork** — project view → Files → untick what you do not need → Download ZIP.
- **Size the refrigerant charge** — project view → Refrigerant → enter line-set lengths → PDF Report.
- **Back up your work** — Projects → Export All to CSV.

9.3 Things to watch for

- Projects live in this browser only. Nothing is on a server, so an exported CSV is your only backup.
- The Grille schedule only draws the first 500 matching rows — narrow the filters to see the rest.
- Cells you edit by hand stay as you typed them and are not recalculated afterwards.
- In Design Search, "Possible solutions" were matched on nominal ratings, not verified against a capacity table at your condition.
- For split systems, one selection covers the outdoor unit and its indoor units — you do not select them separately.
- Submittals and documents open in new tabs; allow pop-ups for the site.

9.4 Getting help

If something looks wrong — a capacity, a document that will not open, a model that should be there and is not — contact Eric Creel at eric.creel@hoffman-hoffman.com.