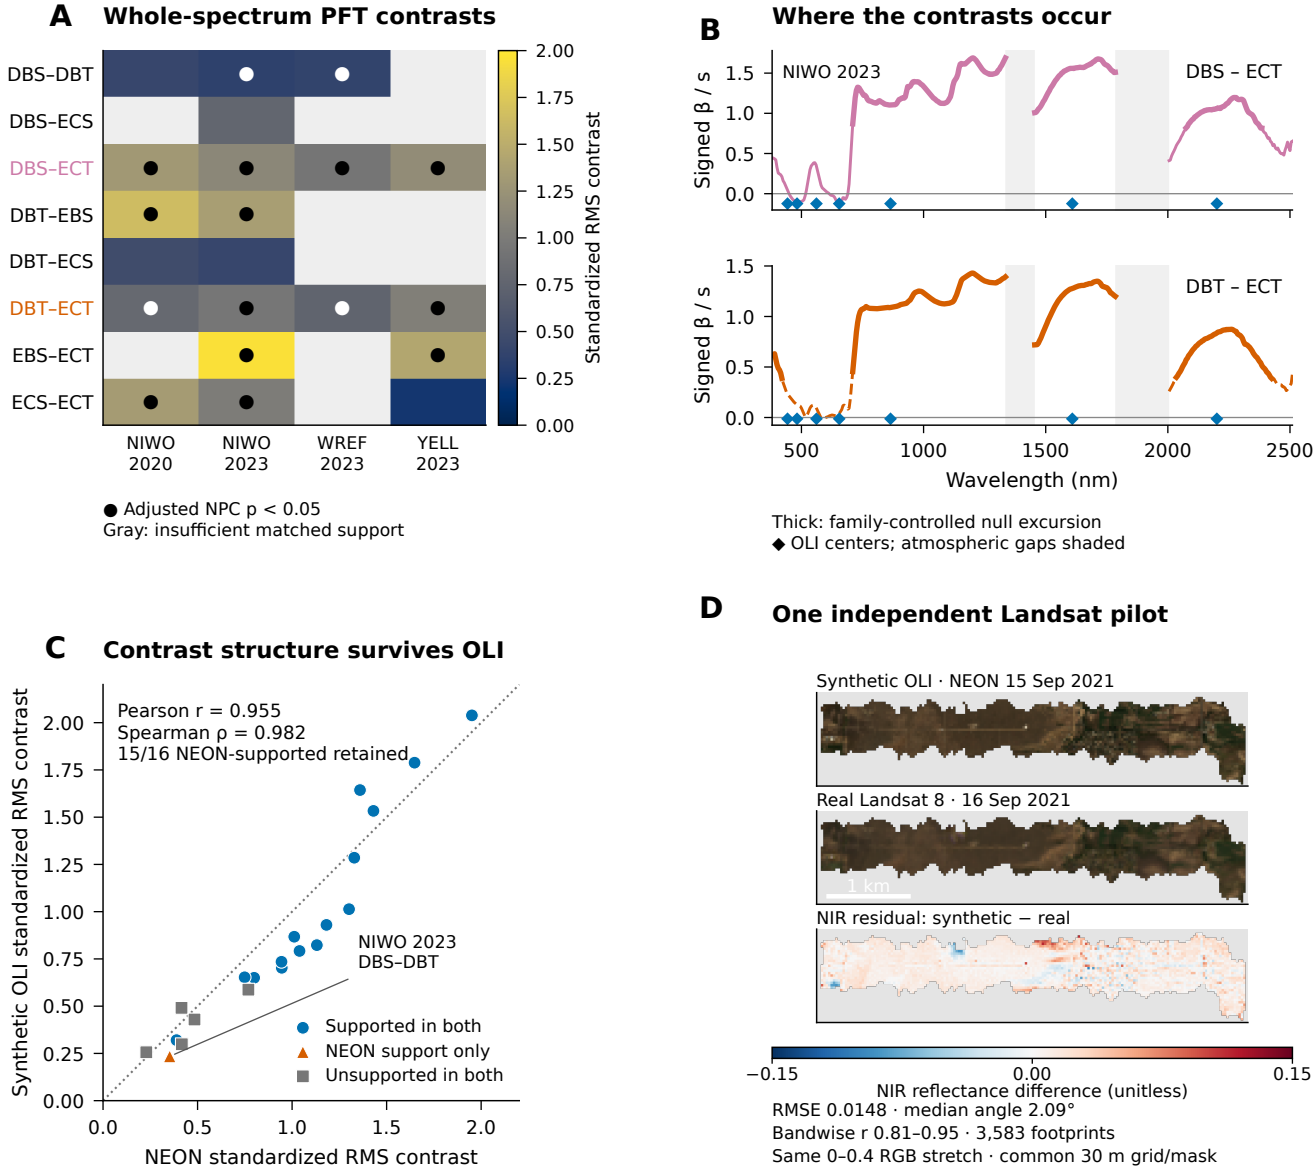

A
Whole-spectrum PFT contrasts
DBS–DBT
DBS–ECS
DBS–ECT
DBT–EBS
DBT–ECS
DBT–ECT
EBS–ECT
ECS–ECT
NIWO 2020
NIWO 2023
WREF 2023
YELL 2023
Standardized RMS contrast
2.00
1.75
1.50
1.25
1.00
0.75
0.50
0.25
0.00
● Adjusted NPC p < 0.05
Gray: insufficient matched support
B
Where the contrasts occur
NIWO 2023
DBS – ECT
DBT – ECT
Signed β / s
Wavelength (nm)
Thick: family-controlled null excursion
◆ OLI centers; atmospheric gaps shaded
C
Contrast structure survives OLI
Pearson r = 0.955
Spearman ρ = 0.982
15/16 NEON-supported retained
NIWO 2023
DBS–DBT
Supported in both
NEON support only
Unsupported in both
Synthetic OLI standardized RMS contrast
NEON standardized RMS contrast
D
One independent Landsat pilot
Synthetic OLI · NEON 15 Sep 2021
Real Landsat 8 · 16 Sep 2021
1 km
NIR residual: synthetic − real
−0.15
0.00
0.15
NIR reflectance difference (unitless)
RMSE 0.0148 · median angle 2.09°
Bandwise r 0.81–0.95 · 3,583 footprints
Same 0–0.4 RGB stretch · common 30 m grid/mask