


Scenario 4: with availability zones and without externalities

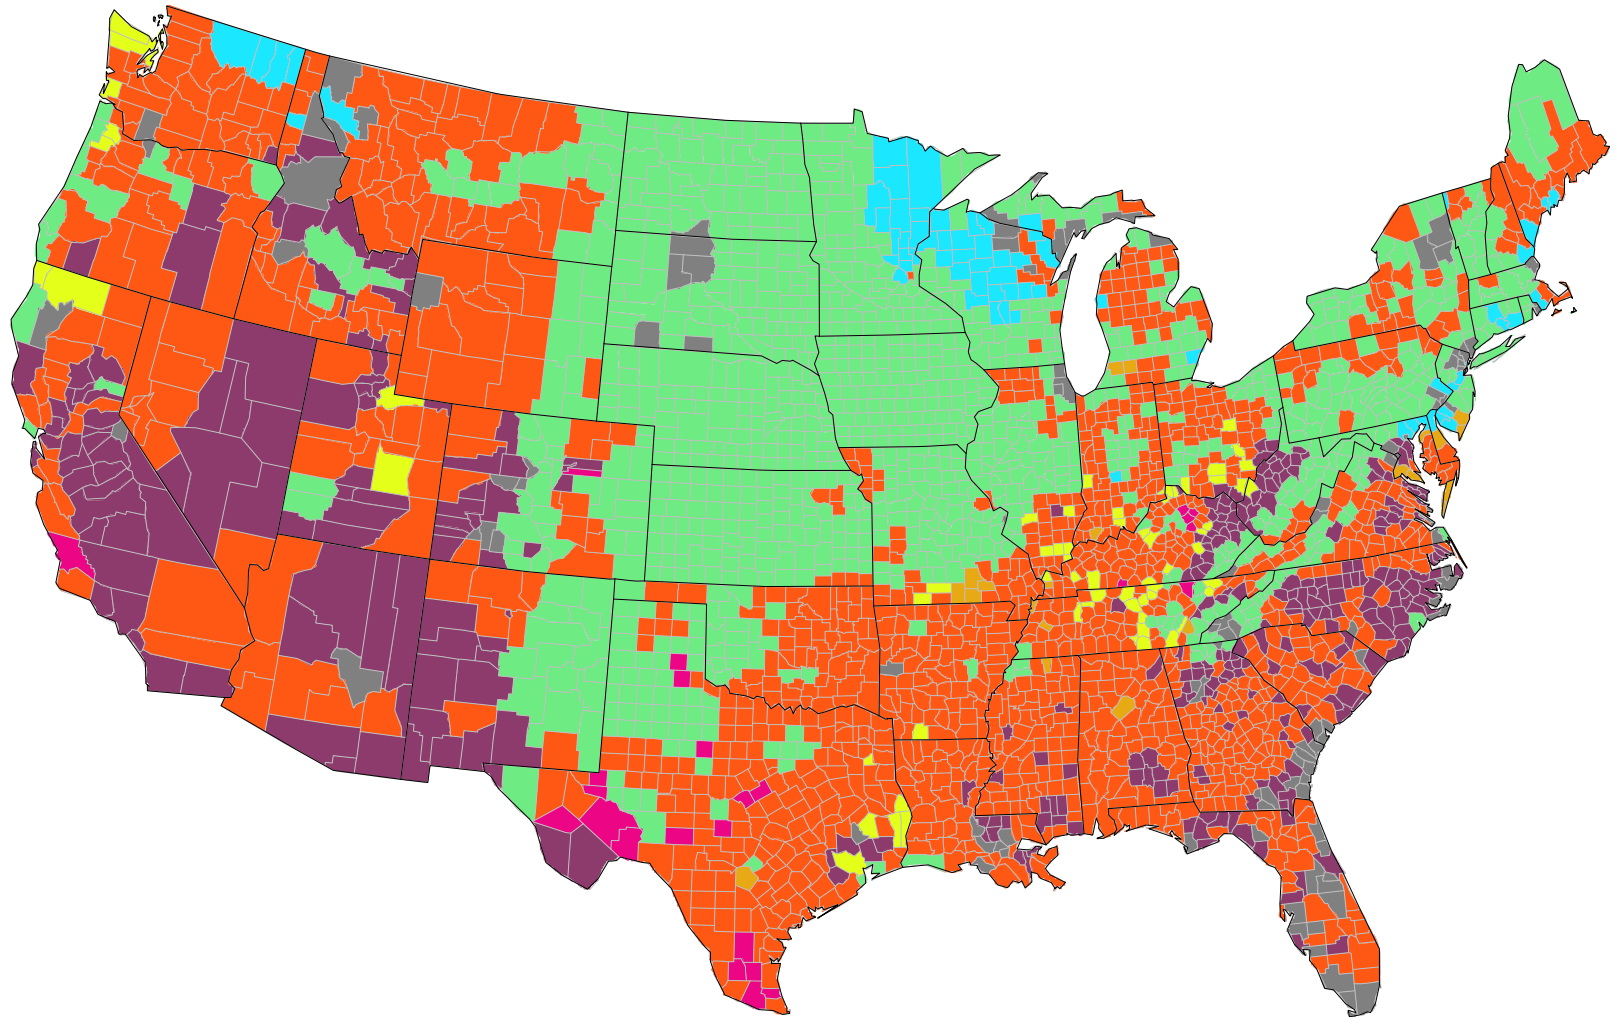

- | | | | |
|------------------------|------------------------|------------------|-----------------------------|
| Coal (BIT) (n = 67) | Coal (SUB) CCS (n = 0) | NGCC CCS (n = 0) | Solar PV, resid. (n = 147) |
| Coal (BIT) CCS (n = 0) | CSP (n = 0) | NGCT (n = 25) | Solar PV, utility (n = 335) |
| Coal (SUB) (n = 22) | NGCC (n = 1319) | Nuclear (n = 70) | Wind (n = 1125) |