


Scenario 1: without availability zones and without externalities

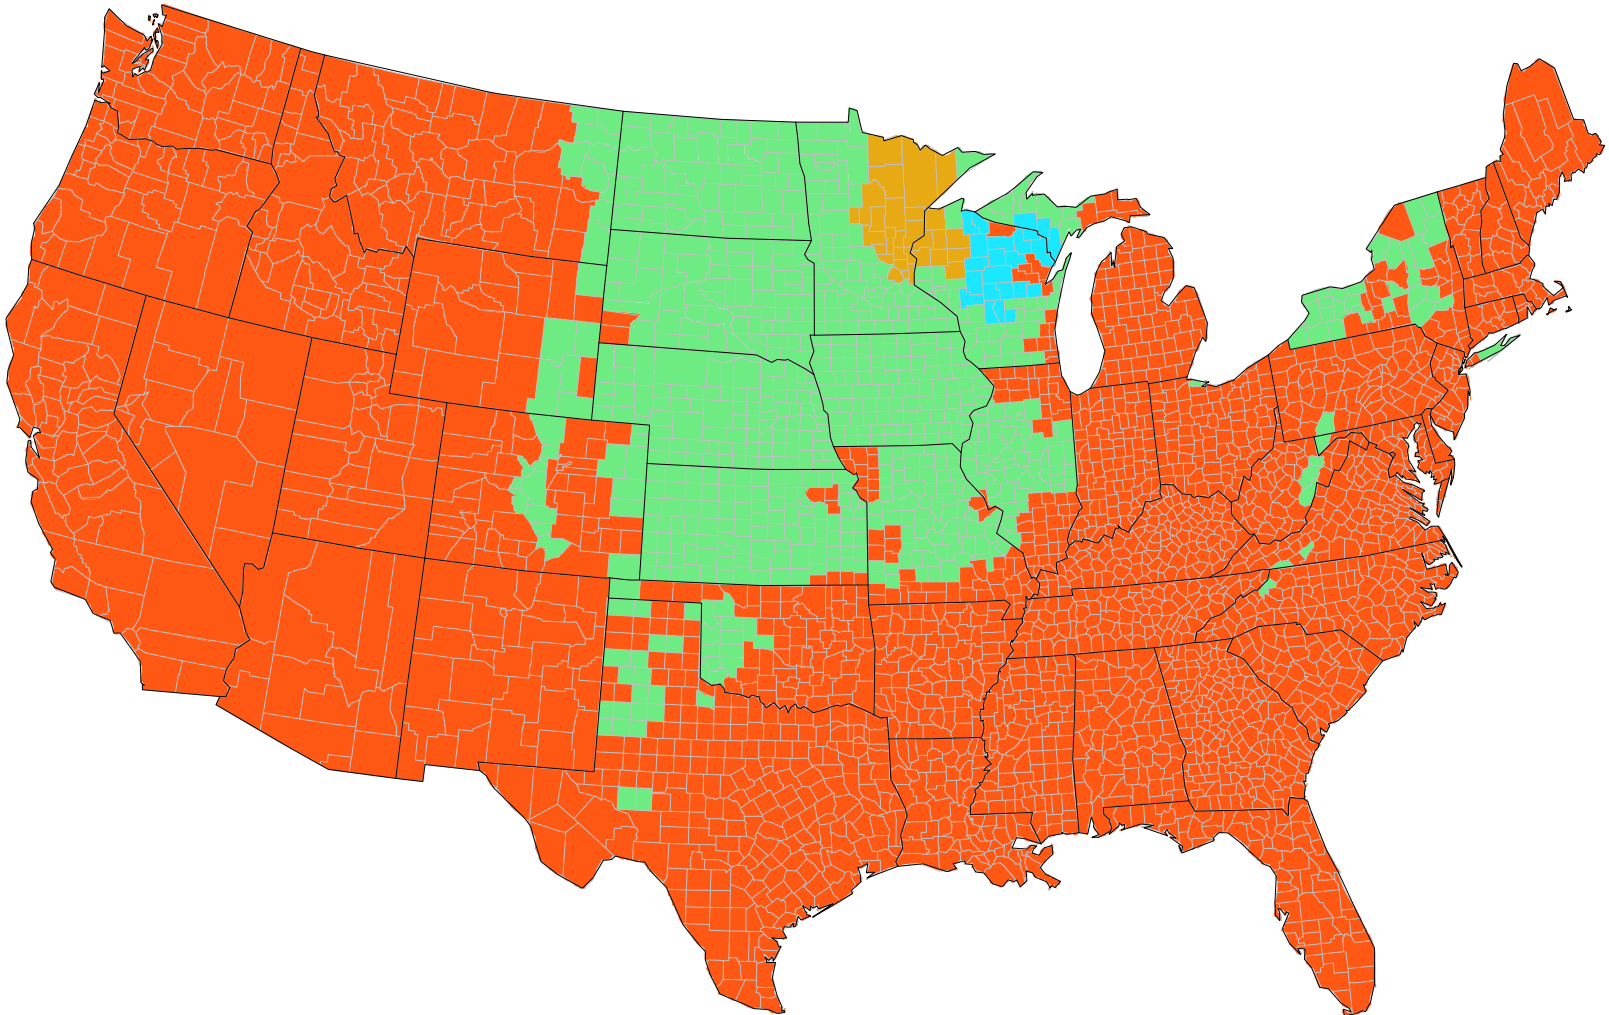

- | | | | |
|------------------------|------------------------|------------------|---------------------------|
| Coal (BIT) (n = 0) | Coal (SUB) CCS (n = 0) | NGCC CCS (n = 0) | Solar PV, resid. (n = 0) |
| Coal (BIT) CCS (n = 0) | CSP (n = 0) | NGCT (n = 0) | Solar PV, utility (n = 0) |
| Coal (SUB) (n = 29) | NGCC (n = 2316) | Nuclear (n = 23) | Wind (n = 742) |