


Note: NOT INSTALLED *
J4, J9, TP1, TP2, R1, R2
J2-1&2, J6-1&2, J7-2&3, J8-2&3

CONTROL INPUTS (C)	SWITCH
L	OFF
H	ON



Copyright ©2010 Exar Corporation. All rights reserved.		
Schematic		
Title		
XR21B1411 SP337 Evaluation Board		
Size	Document Number	Rev
Custom	XR21B1411 SP337	1.4
Date: Monday, February 14, 2011		
Sheet 2 of 3		

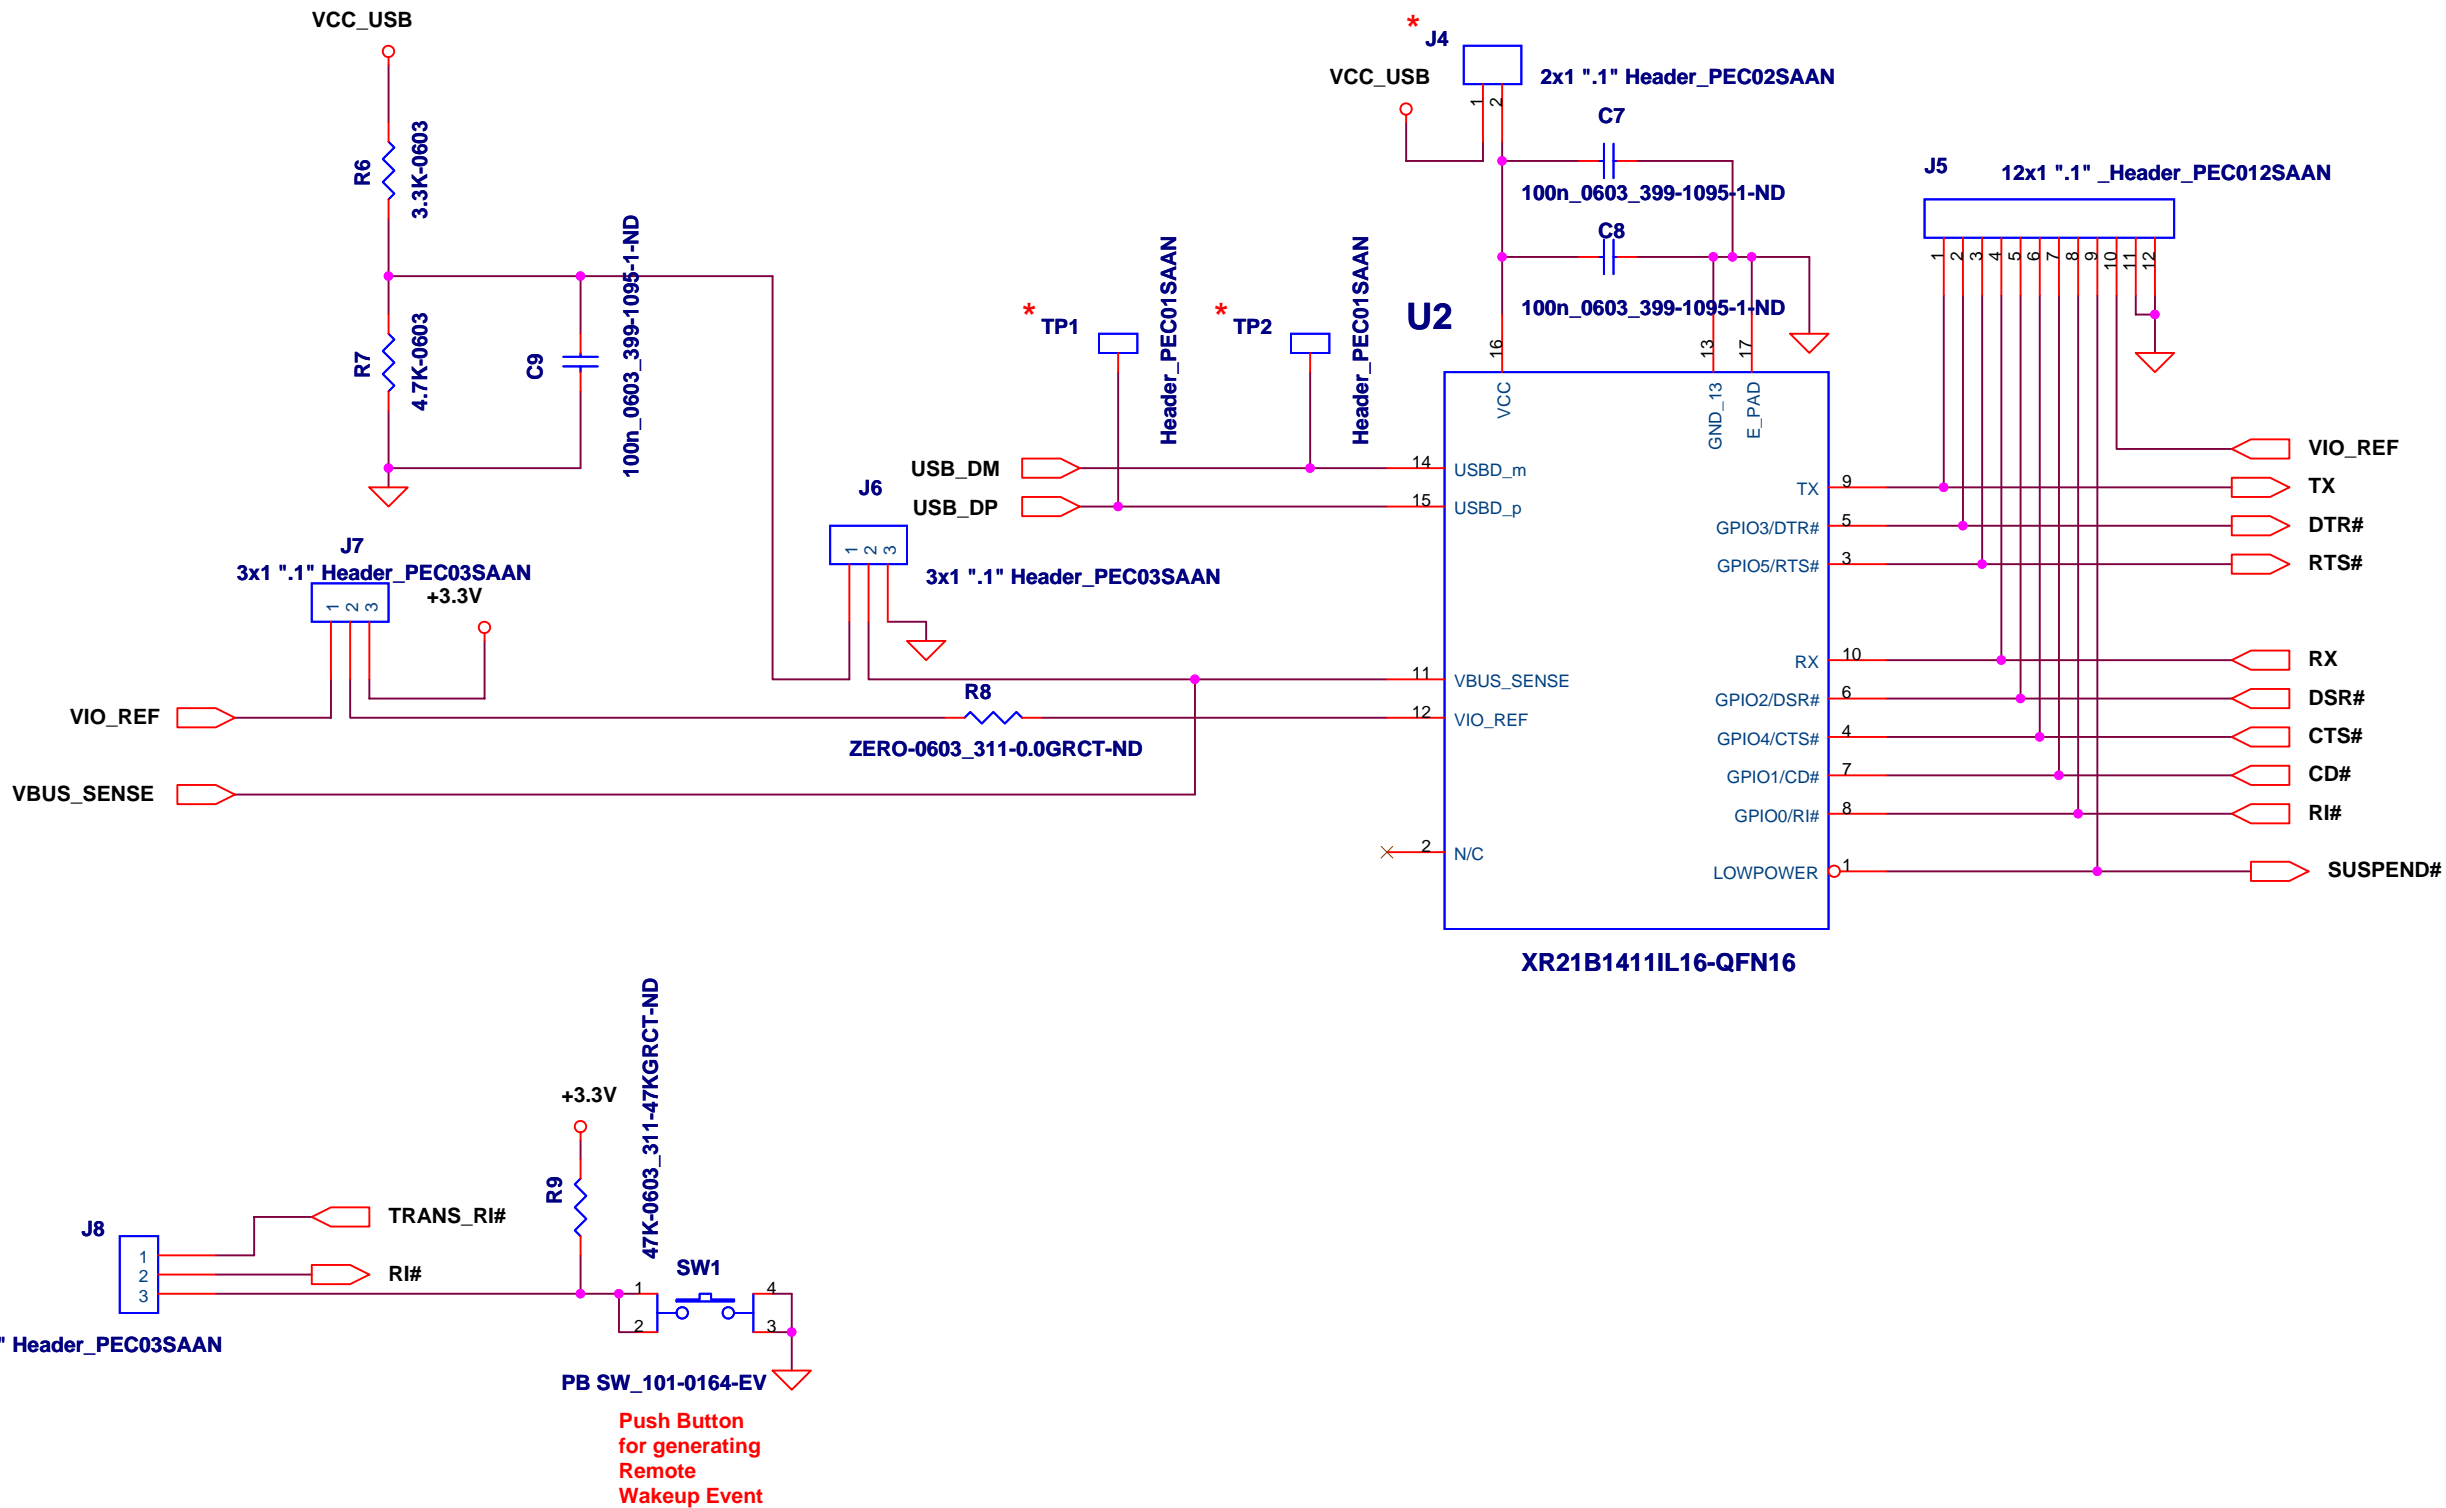