Client:	**Eco Brick Innovio Ltd.**	CTLGroup Project No:	**201338**
Project:	**Lightweight Aggregate Testing**	CTLGroup Project Manager:	**P. Vaddey**
Contact:	**Shlomi Perry**	Technician:	**T. Hercules**
Date Reported:	**April 20, 2023**	Approved:	**J. Rose**

ASTM C142 — Standard Test Method for Clay Lumps and Friable Particles in Aggregates

Client Sample ID	Crumb Rubber
CTLGroup Sample ID	5605301
Sample Source	Eco Brick

Clay Lumps and Friable Particles	**2.0%**

Notes:

1. This report may not be reproduced except in its entirety.
2. The results refer specifically to the submitted samples.
3. The test sample was received on April, 4, 2023.
4. Testing was conducted on April, 12, 2023.

Client:	**Eco Brick Innovio Ltd.**	CTLGroup Project No:	**201338**
Project:	**Lightweight Aggregate Testing**	CTLGroup Project Manager:	**P. Vaddey**
Contact:	**Shlomi Perry**	Technician:	**T. Hercules**
Date Reported:	**April 20, 2023**	Approved:	**J. Rose**

ASTM C136 — Standard Test Method for Sieve Analysis of Fine and Coarse Aggregate

Client Sample ID	Crumb Rubber
CTLGroup Sample ID	5605301
Sample Source	Eco Brick
Aggregate Type	Fine Aggregate
Weight of Oven Dry Sample, g	333.50

Sieve Size	Retained on Individual Sieve, grams	Retained on Individual Sieve, %	Cumulative Retained on Sieve, %	Cumulative Passing Sieve, %	ASTM C33 FA Specification Limit Cumulative Passing Sieve, %
⅜"	0.0	0.0	0	100	100 - 100
#4	102.9	30.9	31	69	95 - 100
#8	104.3	31.3	62	38	80 - 100
#16	85.0	25.5	88	12	50 - 85
#30	26.2	7.9	95	5	25 - 60
#50	8.3	2.5	98	2	5 - 30
#100	3.9	1.2	99	1	0 - 10
#200	1.3	0.4	100	0.5	0 - 3
Pan	1.5	0.4	100	0	0 - 0

Fineness Modulus = 4.73

Notes:

1. This report may not be reproduced except in its entirety.
2. The results refer specifically to the submited sample.
3. The test sample was received on April 4, 2023.
4. Testing was conducted from April 10, 2023 to April 10, 2023.

Client:	**Eco Brick Innovio Ltd.**	CTLGroup Project No:	**201338**
Project:	**Lightweight Aggregate Testing**	CTLGroup Project Manager:	**P. Vaddey**
Contact:	**Shlomi Perry**	Technician:	**T. Hercules**
Date Reported:	**April 20, 2023**	Approved:	**J. Rose**

ASTM C128 — Standard Test Method for Density, Relative Density (Specific Gravity), and Absorption of Fine Aggregate

Client Sample ID	Crumb Runner
CTLGroup Sample ID	5605301
Sample Source	Eco Brick

Relative Density (Specific Gravity) at OD[1]	1.39
Relative Density (Specific Gravity) at SSD[2]	1.48
Apparent Relative Density (Apparent Specific Gravity)	1.53

[1] *Oven Dry*
[2] *Saturated-Surface Dry*

Oven-Dry (OD) Density	86.5 lb/ft³
Saturated Surface Dry (SSD) Density	92.5 lb/ft³
Apparent Saturated Surface Dry (SSD) Density	95.5 lb/ft³

Absorption, %	6.6%

Notes:
1. This report may not be reproduced except in its entirety.
2. The results refer specifically to the submitted samples.
3. The test sample was received on April, 4, 2023.
4. Testing was conducted from April, 10, 2023 to April, 14, 2023.
5. Density was calculated on the basis of water at 75°F.

Client:	**Eco Brick Innovio Ltd.**	CTLGroup Project No:	**201338**
Project:	**Lightweight Aggregate Testing**	CTLGroup Project Manager:	**P. Vaddey**
Contact:	**Shlomi Perry**	Technician:	**T. Hercules**
Date Reported:	**April 20, 2023**	Approved:	**J. Rose**

ASTM C29 — Bulk Density ("Unit Weight") and Voids in Aggregates

Client Sample ID	Crumb Rubber
CTLGroup Sample ID	5605301
Sample Source	Eco Brick

Aggregate Type	Fine Aggregate
Procedure	Shoveling
Size of Measure	0.500 ft^3

Bulk Density	**28 lbs/ft^3**

Notes:

1. This report may not be reproduced except in its entirety.
2. The results refer specifically to the submitted samples.
3. The test sample was received on April, 4, 2023.
4. Testing was conducted on April, 19, 2023.

Client:	**Eco Brick Innovio Ltd.**	CTLGroup Project No:	**201338**
Project:	**Lightweight Aggregate Testing**	CTLGroup Project Manager:	**P. Vaddey**
Contact:	**Shlomi Perry**	Technician:	**T. Hercules**
Date Reported:	**April 20, 2023**	Approved:	**J. Rose**

ASTM C40 — Organic Impurities in Fine Aggregates for Concrete

Client Sample ID	Crumb Rubber
CTLGroup Sample ID	5605301
Sample Source	Eco Brick

Sample Reduction Method	Splitter
Procedure	Standard Color Solution

Results	**Organic Color Plate No. 1** **Does Not Contain Injurious Organic Impurities**

Test Results Interpretation (per Section 11.1):
When a sample subjected to this procedure produces a color darker than the standard color, Circular Disk No. 14 or Organic Plate No. 3 (Gardner Color Standard No. 14), the fine aggregate under test shall be considered to possibly contain injurious organic impurities. It is advisable to perform further tests before approving the fine aggregate for use in concrete.

Notes:
1. This report may not be reproduced except in its entirety.
2. This report represents specifically the samples provided.
3. The test sample was received on April, 4, 2023.
4. Testing was conducted on April, 11, 2023.


Client:	**Eco Brick Innovio Ltd.**	CTL Project No:	**201338**
Project:	**Lightweight Aggregate Testing**	CTL Project Mgr.:	**P. Vaddey**
Contact:	**Shlomi Perry**	Technician:	**T. Hercules**
Date Reported:	**April 20, 2023**	Approved:	**J. Rose**


REPORT of ANALYSIS

ASTM C641, Standard Test Method for Iron Staining Materials in Lightweight Concrete Aggregate

Client Sample Identification	Crumb Rubber
CTLGroup Sample Identification	5605301
Sample Source	Eco Brick
Procedure	Visual Procedure

Stain Index **20**

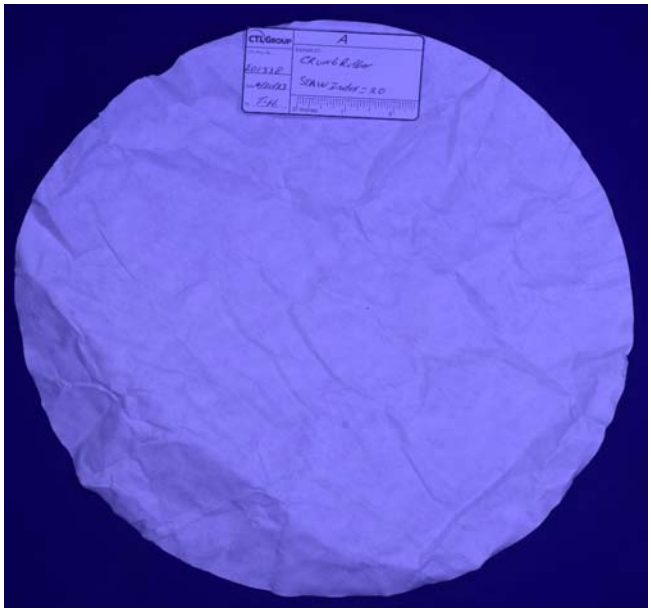

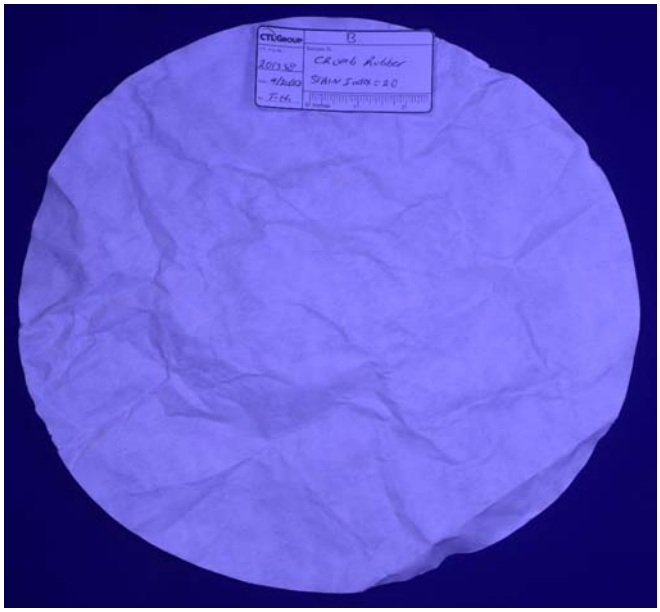

Notes:

1. Results refer specifically to the sample submitted.
2. Visual rating based on standard index images presented in ASTM C641-17.
3. This report may not be reproduced except in its entirety.