
Retrofit Doctor

Pump diagnostics and retrofit review

Synthetic benchmark demonstration
Since AI 2026

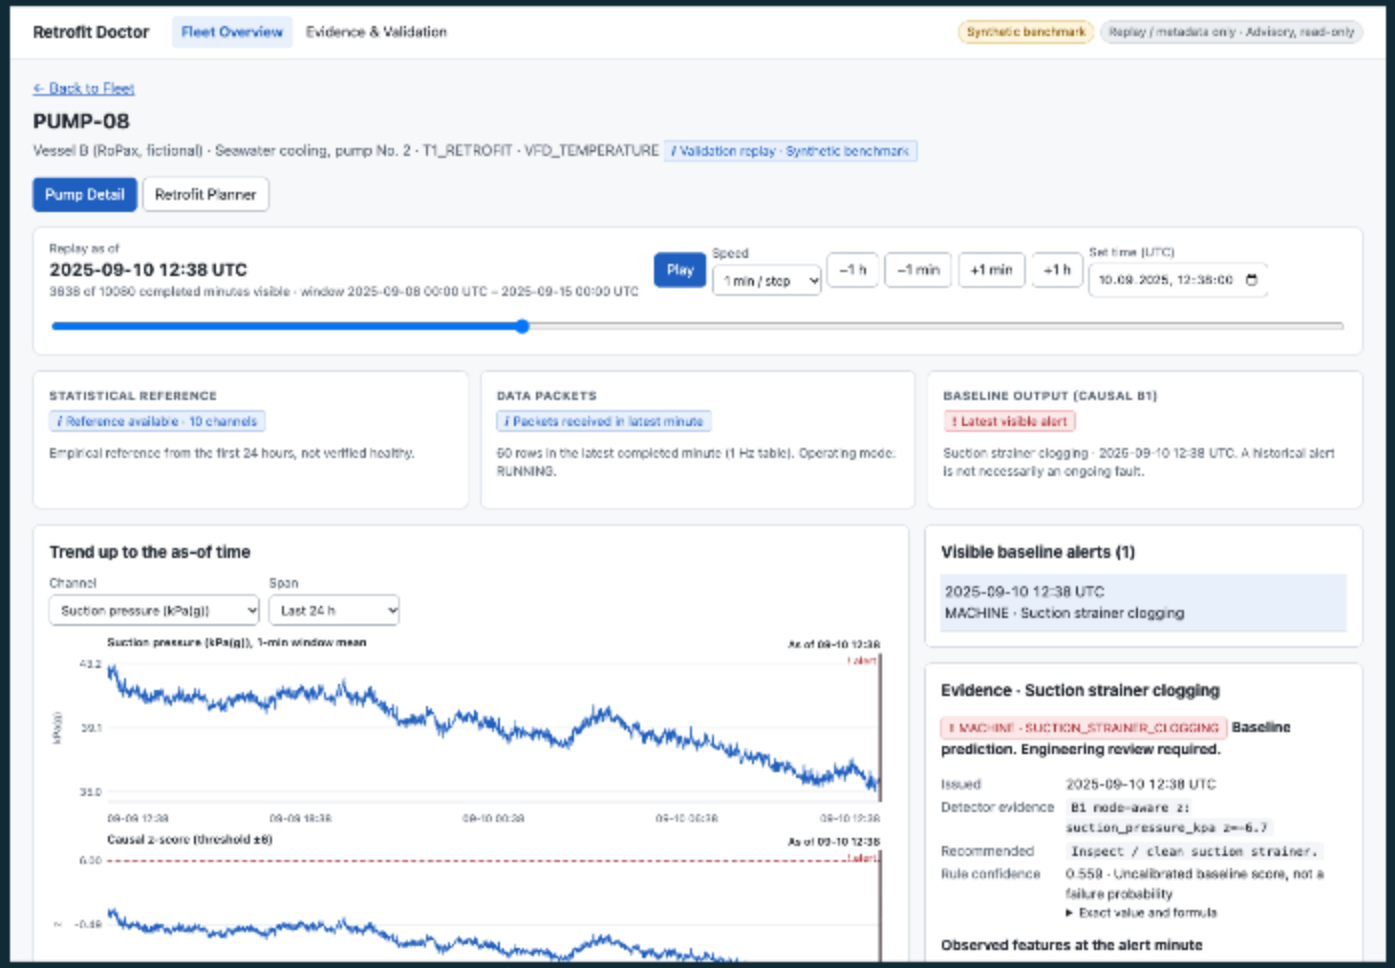

Twelve independent pump assets

Split	Assets	Demo access
Training	PUMP-01–07	Development and selection
Validation	PUMP-08–09	Labeled replay and evaluation
Blind test	PUMP-10–12	Equipment metadata only

Different sensor coverage and observation weeks.
Site grouping does not imply hydraulic coupling.

Diagnostic evidence and limits

Validation example	Causal B1 output	Retrospective result
PUMP-08-E01	Suction strainer clogging	Correct fault type
PUMP-08-E02	Unknown cause	Event matched; unresolved
PUMP-08-E04	No matched alert	Pressure-sensor noise missed

Detection does not establish the correct cause.

Synthetic validation. Evaluation labels stay separate from live-clock evidence.

Causal baseline validation

Metric	Causal B1	Original B1
Composite score	76.01	78.01
Events detected	8 / 9	8 / 9
Correct fault type	4 / 9	4 / 9
False alert episodes	1	1

Original B1 used future reference data in early predictions.

Five B2 candidates rejected on train: fewer correct fault types and higher alert burden. Causal B1 retained.

Synthetic validation, 9 scored events. No field validation.

A retrofit must justify its full cost

PUMP-08 has no flow channel. Flow assessment is a hypothesis:
pipe suitability, reference checks and diagnostic value remain unverified.

Illustrative redundant-pump case	EUR
Initial incremental installation cost	4,500
Annual benefit / nuisance checks / upkeep	300 / 1,800 / 700
Annual net effect	−2,200
Five-year incremental value (0% discount)	−15,500

Defer permanent retrofit under these assumptions.

Hypothetical standby case; not this pump’s topology, a quote or measured savings.

Pilot pathway

01 Observe existing data in shadow mode

02 Check whether warnings support useful action

03 Trial the smallest measurement that resolves a gap

04 Verify installation, integration and maintenance

05 Decide using evidence, full cost and nuisance burden

Proposed pilot. Benefits, physical feasibility and applicable approvals remain unvalidated.