

Submarine Cable Analysis for Marine Renewable Energy Development

Contents

1	Background	1
2	Methods	2
2.1	Study Area and Submarine Cables	2
2.2	tbl_eez-usa	2
2.3	Depth	4
2.4	Renewable Energy	4
2.5	Avoidance Zones for Siting New Facilities	4
2.6	Separation Zones for Routing New Cables	5
2.7	Depth-Varying Buffer	6
3	Results	6
3.1	Overlay with Renewable Energy from NREL	7
3.2	Next Steps	9
4	Conclusions	9
4.1	Communication with Stakeholders	9
	References	9

1 Background

Demand for abundant and diverse resources in the oceans is growing, necessitating marine spatial planning. To inform development of Marine Hydrokinetic (MHK) and Offshore Wind (OSW) resources, DOE has asked NREL to identify — and mitigate where possible — the competing uses between MHK/OSW technologies and subsea power/telecoms cables. The first step in this work is to identify and quantify the overlap between the MHK/OSW resource availability and existing cable routes. Several publicly available data layers are available that identify cable routes (e.g. MarineCadastre.gov currently hosts an offshore cables geographical information system (GIS) data layer) and MHK/OSW resource density (MHK Atlas, Wind Prospector). The cable route linear features, however, do not indicate the setback distance necessary to accommodate subsea cable maintenance requirements. Preliminary work was done within NREL to evaluate the influence of subsea cable setback distance on the overlap with MHK/OSW for the west coast of the U.S (Amante, Kilcher, Roberts, & Draxl, 2016). Industry reports (Communications Security, Reliability and Interoperability Council IV, 2014, 2016) from the International Cable Protection Committee (ICPC) of the North American Submarine Cable Association (NASCA; n-a-s-c-a.org) advise on setback distances that inform this analysis.

Table 1: Data sources from preliminary report.

Data	Source	Website
Offshore Cables	National Oceanic and Atmospheric Administration (NOAA)	http://marinecadastre.gov/data/
Bathymetry	General Bathymetric Chart of the Oceans (GEBCO)	http://www.gebco.net/data_and_products/
U.S. Shoreline	NOAA	http://shoreline.noaa.gov/data/data.html
Tide	Georgia Tech Research Corporation	http://www1.eere.energy.gov/water/infrastructure/georgia_tech_research_corporation/
Wave	Electric Power Research Institute	http://www1.eere.energy.gov/water/infrastructure/electric_power_research_institute/
Wind (100m height)	AWS Truepower, LLC for windNavigator	http://apps2.eere.energy.gov/wind/infrastructure/aws_truepower/

2 Methods

2.1 Study Area and Submarine Cables

The study area included the 200 nm extent of US waters downloaded from MarineRegions.org¹ and overlapping the offshore cable data layer available through MarineCadastre.gov.² See Figure 1.

TODO: add citations to bibliography:

- MarineRegions.org > Exclusive Economic Zones Boundaries (EEZ), version: World EEZ v9 (2016-10-21, 123 MB). Suggested citation:
 - Flanders Marine Institute (2016). Maritime Boundaries Geodatabase, version 1. Available online at <http://www.marineregions.org/>. Consulted on 2017-04-25.
- MarineCadastre.gov cable metadata

See Table 1.

2.2 tbl_eez-usa

TODO:

- python - Shapely polygons crossing the antimeridian - Geographic Information Systems Stack Exchange
- r - Use different center than the prime meridian in plotting a world map - Stack Overflow
- ogr - How to change shapefile longitude from -180 - 180 to 0 - 360? - Geographic Information Systems Stack Exchange
- sf::st_transform not honoring +lon_wrap · Issue #280 · edzer/sf
- Moving The Earth (well, Alaska & Hawaii) With R | rud.is
- Administrative Maps and Projections in R - AriLamstein.com
- Mapping Data in R · Adam Olson
- Mapping All Fifty U.S. States
- fiftystater/make_mapfile.R at master · wmurphyrd/fiftystater
- Mapping All Fifty U.S. States
- r - Relocating Alaska and Hawaii on thematic map of the USA with ggplot2 - Stack Overflow
- ohiprep/model_create_regions.py at 66bcf4e39b63b154437dda55aec6ed825ac47f05 · OHI-Science/ohiprep

¹MarineRegions.org US exclusive economic zone (EEZ) data, version World_EEZ_v9_20161021

²MarineCadastre.gov cable metadata: <https://coast.noaa.gov/dataservices/Metadata/TransformMetadata?u=https://coast.noaa.gov/data/Documents/Metadata/harvest/MarineCadastre/NOAAChartedSubmarineCables.xml&f=html>

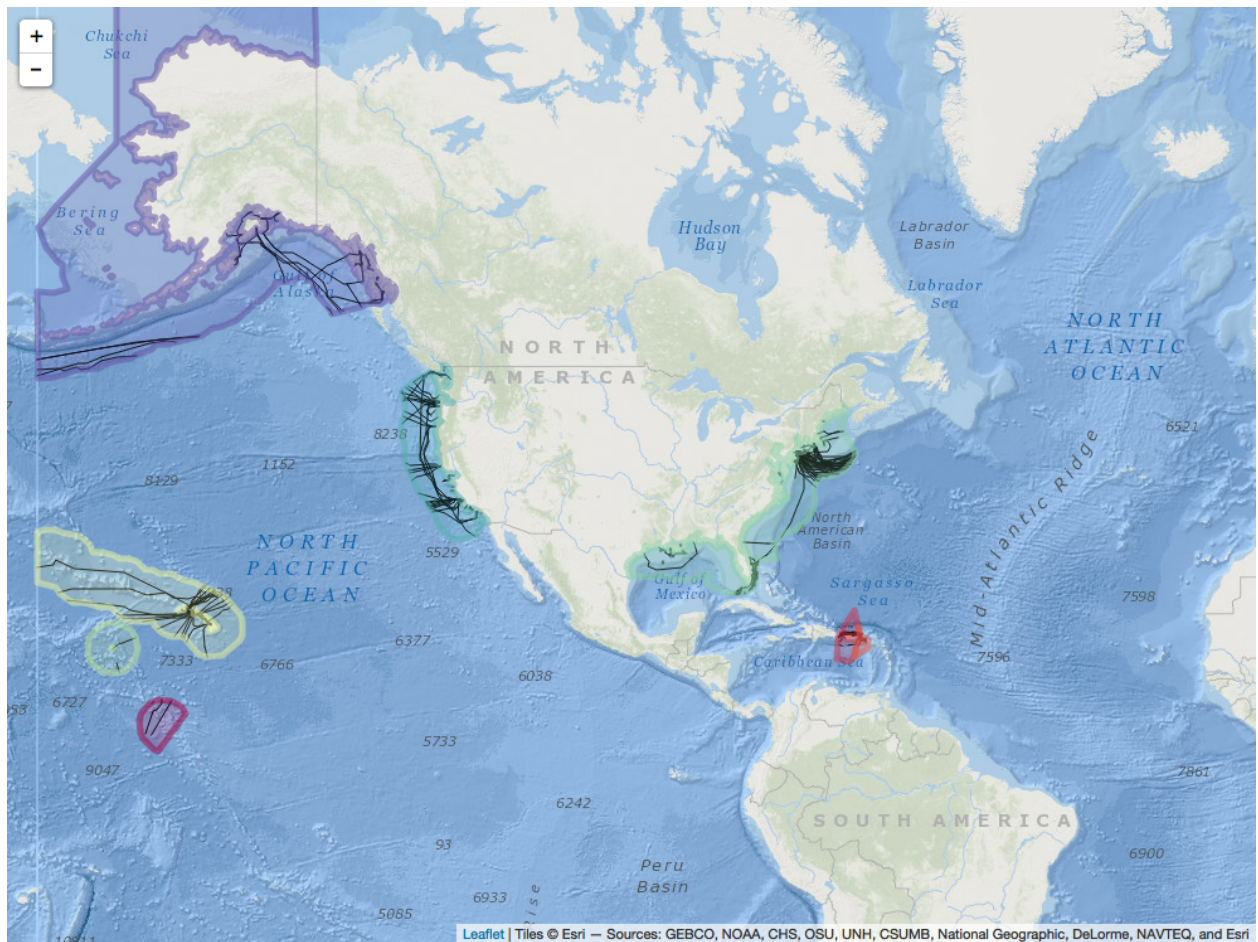


Figure 1: Map of NOAA Charted Submarine cables in the United States as of December 2012.

Table 2: EEZ parts for USA.

eez	eez_part	area_km2
American Samoa	1	405844.22
Palmyra Atoll	2	353739.68
Puerto Rico	3	154652.24
United States Virgin Islands	4	38290.06
Guam	5	208211.49
Northern Mariana Islands	6	763555.01
Wake Island	7	407153.96
Jarvis Island	8	323173.12
Howland and Baker islands	9	434885.34
United States	10	8462.82
United States	11	8462.82
United States	12	8462.82
United States	13	8462.82
Hawaii	14	2474713.61
Hawaii	15	2474713.61
Puerto Rico	16	18298.65
Johnston Atoll	17	442442.95
United States	18	2451978.74
United States	19	2451978.74
Alaska	20	3682949.92
Alaska	21	3682949.92

2.3 Depth

The bathymetric depth comes from the GEBCO 30 arc-second grid. Here's there requested attribution:

GEBCO_2014 Grid, version 20150318, www.gebco.net

2.4 Renewable Energy

NREL.

2.5 Avoidance Zones for Siting New Facilities

“ICPC Recommendation 13 No. 2, which establishes a methodology for determining site-specific proximity limits between submarine cables and offshore wind facilities and a default separation distance in shallower waters of 500 meters on either side of an in-service submarine cable — a separation standard the principles of which also apply to other offshore renewable energy projects.”

“Subsea Cables UK Guideline No. 6 (endorsed by NASCA), which establishes principles for determining safe proximity distances and negotiating proximity agreements between offshore wind farms and submarine cables and reflects extensive experience in the United Kingdom with managing spatial conflicts between offshore wind farms and submarine cables.”

“endorse a default separation distance of 500 meters in water depths of less than 75 meters and the greater of 500 meters or two times the depth of water in greater water depths.”

1. Default separation distance by depth:

- ≤ 250 m: 500 m

- > 250 m: 2 x depth

Pseudocode:

```
# buffer based on depth
cables_buffers = list()
for (x in unique(cable_cells$depth)){

  cables_buffers[str(x)] = cable_cells %>%
    subset(depth == x) %>%
    buffer(x)

}
cable_buf = merge(cables_buffers)

# smooth out jagged edges between cells
cable_buf = simplify(cable_buf)
```

2.6 Separation Zones for Routing New Cables

“ICPC Recommendation 2 No. 10: parallel submarine cables maintain a separation distance of the lesser of 3 times depth of water or (where not achievable) 2 times the depth of water following consultation and agreement between affected parties — a separation standard the principles of which also apply to spacing of submarine cables and other marine infrastructure”

At least 2 separation zones based on depth:

1. **Minimum:** 2 times the depth of water
2. **Recommended:** 3 times depth of water

Pseudocode:

```
# convert depth (GEBCO 30 sec resolution) to polygons of cells
depth_cells = as.polygon(depth_raster)

# intersect cables with depth cells
cable_cells = intersect(cables_lines, depth_cells)

# buffer based on depth
cables_buffers = list()
for (x in unique(cable_cells$depth)){


  cables_buffers[str(x)] = cable_cells %>%
    subset(depth == x) %>%
    buffer(x)

}
cable_buf = merge(cables_buffers)

# smooth out jagged edges between cells
cable_buf = simplify(cable_buf)
```

2.7 Depth-Varying Buffer

A depth-varying buffer to the offshore cables, $2 * \text{depth}$ for “minimum” and $3 * \text{depth}$ for “recommended” separation zones for routing new cables, by first intersecting depth with cables, then iterating over each depth to apply the appropriate buffers before finally dissolving all buffers. In order to apply the buffer, I needed to project from geographic coordinates to a projection that minimizes area distortion, so chose Albers Equal Area and applied the “one-sixth rule” based on the extent of the cable features to minimize distortion.

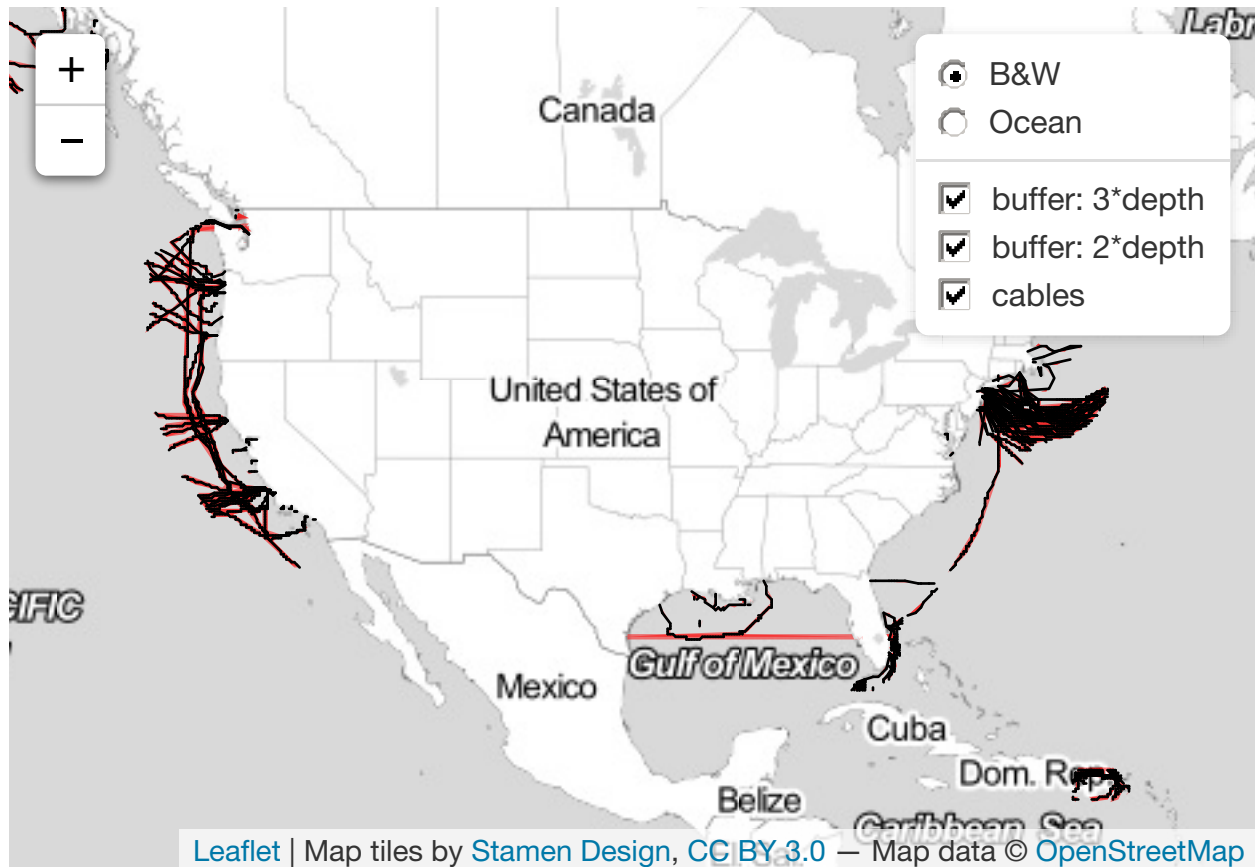

3 Results

Generated by:

- create_cable-buffer.R
- extract_cable-energy.R

Google Earth files (*.kml):

- buf_2xdepth-incr100m.kml
- buf_3xdepth-incr100m.kml
- lns_d1x.kml

Table 3: Constraints of cable (minimum - recommended) categories of wind speed (m/s) at 90m hub height.

region	speed m/s	cable (km2)	cable (%)	region_km2
Atlantic	≤ 7	49.6 - 69.9	0.01 - 0.01%	8,006.1
Atlantic	7-8	240.0 - 352.1	0.00 - 0.01%	48,890.3
Atlantic	8-9	2,990.5 - 4,212.7	0.02 - 0.03%	124,946.1
Atlantic	9-10	3,235.3 - 4,734.8	0.04 - 0.06%	75,695.4
Atlantic	10-11	0.0 - 0.0	0.00 - 0.00%	40.8
Gulf of Mexico	≤ 7	12.2 - 21.0	0.00 - 0.00%	6,082.7
Gulf of Mexico	7-8	1,107.4 - 1,725.1	0.01 - 0.02%	90,253.6
Gulf of Mexico	8-9	2,212.7 - 3,416.1	0.08 - 0.12%	28,855.4
Hawaii	≤ 7	5,870.9 - 7,664.1	0.15 - 0.20%	38,997.8
Hawaii	7-8	20,335.2 - 24,876.0	0.34 - 0.42%	59,130.7
Hawaii	8-9	13,399.7 - 17,090.6	0.29 - 0.37%	45,787.3
Hawaii	9-10	488.3 - 865.8	0.03 - 0.06%	14,099.1
Hawaii	10-11	771.6 - 1,004.0	0.18 - 0.24%	4,184.4
Hawaii	11-12	217.2 - 304.0	0.40 - 0.56%	545.5
Pacific	≤ 7	4,278.4 - 5,731.4	0.08 - 0.11%	50,335.4
Pacific	7-8	3,955.9 - 5,222.6	0.09 - 0.12%	45,118.8
Pacific	8-9	8,823.7 - 12,216.1	0.10 - 0.14%	88,522.5
Pacific	9-10	6,201.0 - 8,386.0	0.14 - 0.20%	42,917.9
Pacific	10-11	2,004.6 - 2,519.7	0.15 - 0.19%	13,190.2

3.1 Overlay with Renewable Energy from NREL

Extract average and area of overlap between zones and renewable energy potential areas, possibly at various depth bins.

3.1.1 Wind

units: wind speed (m/s) at 90m hub height

TODO: - Visualise sf objects — ggsp • ggplot2

3.1.2 Wave

units: wave energy flux (kW/m)



Show 10 entries


Search:

	flux kW/m	area_km2	pct_all	cable2_km2	cable2_pct	cable2_pct_all	cable3_km2	cable3_pct	cable3_pct_all
1	0-10	1,062,566.3	46.2%	48,036.7	4.5%	209.0%	67,393.6	6.3%	2.9%
2	10-20	330,647.8	14.4%	26,449.0	8.0%	115.1%	33,046.1	10.0%	1.4%
3	20-30	368,799.0	16.0%	19,296.4	5.2%	84.0%	24,959.5	6.8%	1.1%
4	>30	536,401.2	23.3%	28,415.3	5.3%	123.6%	38,134.0	7.1%	1.7%

Showing 1 to 4 of 4 entries

Previous 1 Next

- plotly - stacked bar chart
- plotly - horizontal bar chart
- plotly - percentages bar chart

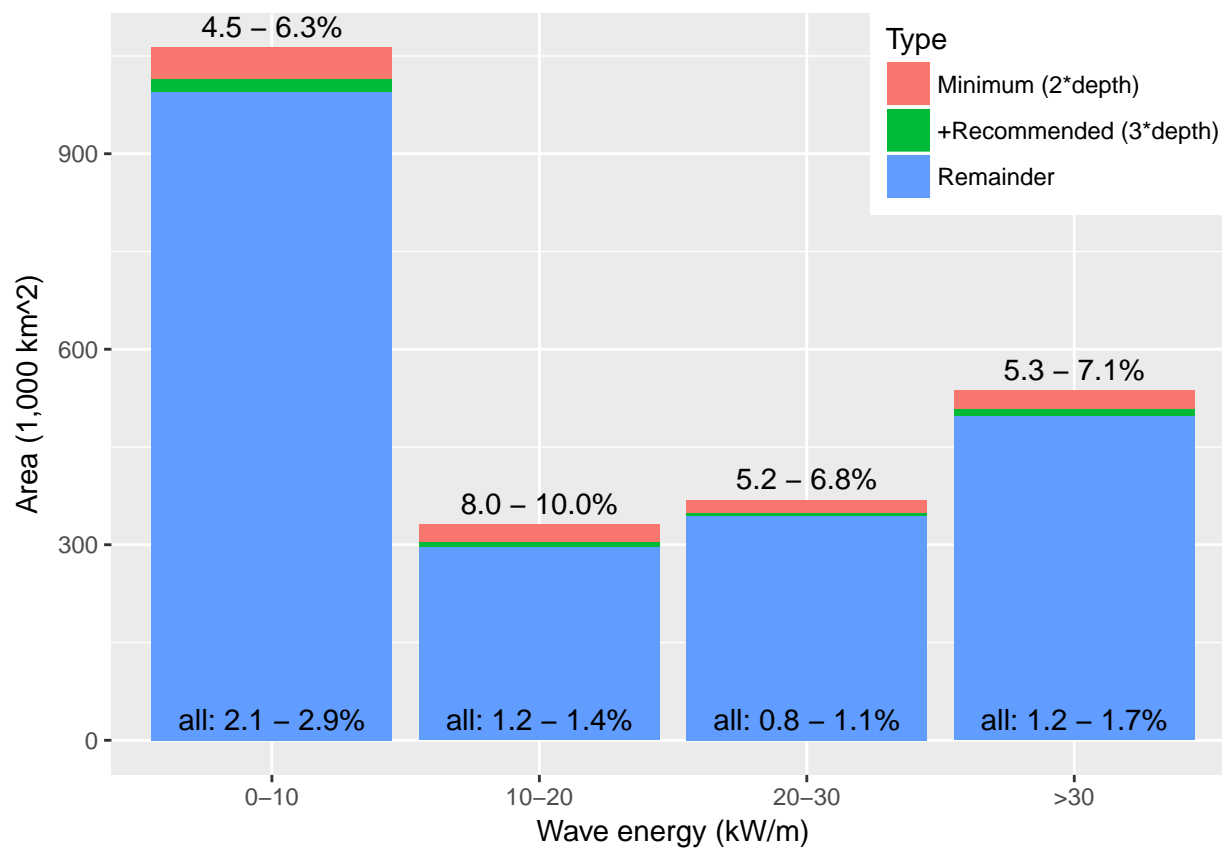

3.1.3 Tidal

units: mean power (W/m²)

TODO: seporate tif into east and west for display in leaflet

Show 10 entries

Search:

	region	power W/m2	area_km2	pct_all	cable2_km2	cable2_pct	cable2_pct_all	cable3_km2	cable3_pct	cable3_pct_all
1	East	0-500	195,383.6	31.4%	6,176.1	3.2%	99.1%	8,725.4	4.5%	1.4%
2	East	500-1000	458.6	0.1%	4.6	1.0%	0.1%	6.5	1.4%	0.0%
3	East	1000-1500	138.2	0.0%	0.9	0.7%	0.0%	0.9	0.7%	0.0%
4	East	>1500	88.8	0.0%	0.0	0.0%	0.0%	0.0	0.0%	0.0%
5	West	0-500	423,888.7	68.0%	9,171.5	2.2%	147.2%	12,778.4	3.0%	2.1%
6	West	500-1000	2,091.4	0.3%	139.9	6.7%	2.2%	192.2	9.2%	0.0%
7	West	1000-1500	555.1	0.1%	25.5	4.6%	0.4%	36.5	6.6%	0.0%
8	West	>1500	306.0	0.0%	15.0	4.9%	0.2%	24.7	8.1%	0.0%

Showing 1 to 8 of 8 entries

Previous 1 Next

3.2 Next Steps

- stacked histogram by cbl2/(cbl3-cbl2)/other; hist(wind\$Speed_90)
- simplify as native geojson

Musial et al (2016):

- wind speed (m/s) – Table A-3 (p. 48): <7, 7-8, 8-9, 9-10, 10-11, total
- depth classes (m) – Table B-1 (p. 49): <30, 30-60, 60-700, 700-1000, >1000, total
- distance to shore (nm) – Table B-2 (p. 50): <3, 3-12, 12-50, 50-200, total
- by states

4 Conclusions

4.1 Communication with Stakeholders

Products will be online and readily digestable by stakeholders.

References

- Amante, C., Kilcher, L., Roberts, B., & Draxl, C. (2016). *Offshore Cable Analysis: Pilot Study*.
- Communications Security, Reliability and Interoperability Council IV. (2014). *Protection of Submarine Cables Through Spatial Separation*.
- Communications Security, Reliability and Interoperability Council IV. (2016). *Clustering of Cables and Cable Landings*.