




Project: AutographPC example for gassy wells
Customer: Unknown
Well: HPS
Engineer: Carlos Villacres
Country: Ecuador
State: orellana
County: Unknown
Well API#: Unknown
Reservoir Name: Unknown

Pump: 39-675HC27000Standard
ThChmbr: HDTC
Motor: Teco TEFC 800 HP 460 V/ 867 A (60 Hz)
Controller: VSD 8900-VT 1000kVA 480V/ 1203A
Sensor: none

Comments:

39-675HC27000Standard

HEAD (psi)

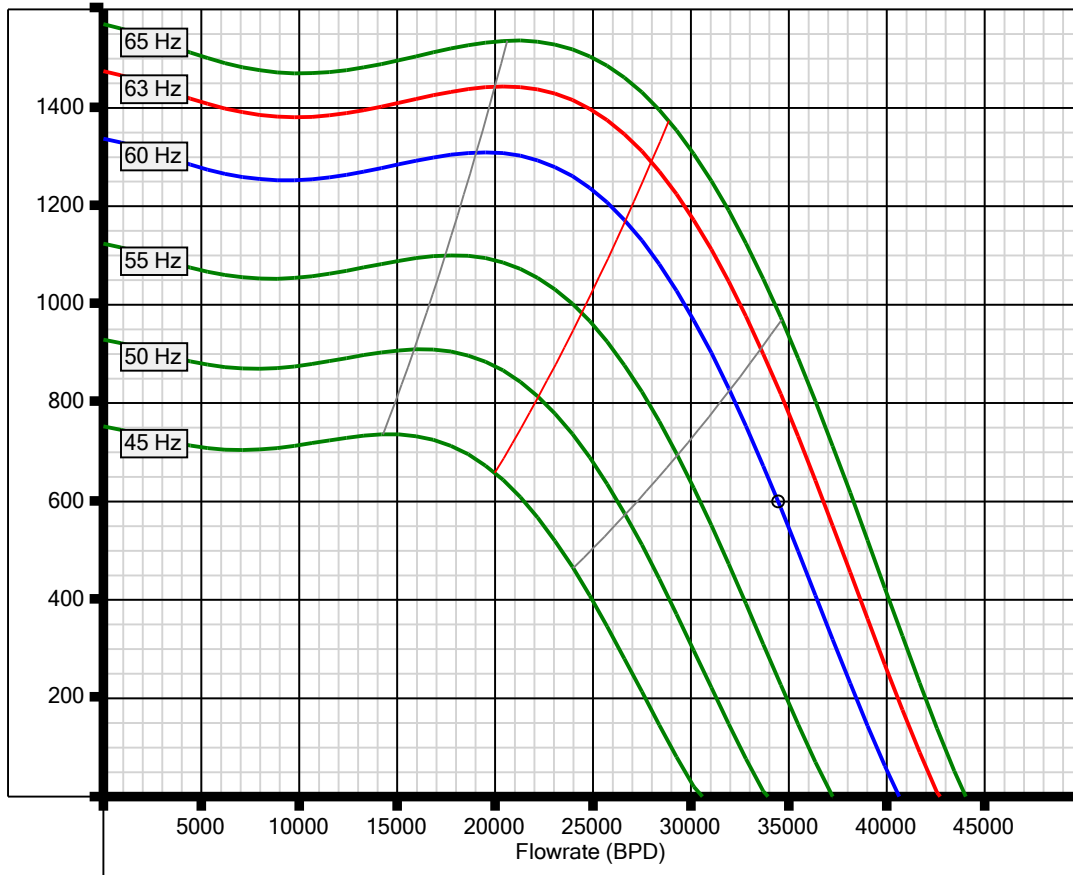



Project: AutographPC example for gassy wells
Customer: Unknown
Well: HPS
Engineer: Carlos Villacres
Country: Ecuador
State: orellana
County: Unknown
Well API#: Unknown
Reservoir Name: Unknown

Pump: 39-675HC27000Standard
ThChmbr: HDTC
Motor: Teco TEFC 800 HP 460 V/ 867 A (60 Hz)
Controller: VSD 8900-VT 1000kVA 480V/ 1203A
Sensor: none

Comments:**Operating Parameters / Selection:**Design Point:

Desired flow (total) 34445 BPD
Frequency 60.0 Hz
Boost Pressure 600.0 psi

Pump Selection:

	<u>Intake</u>	<u>Discharge</u>
Pressure	120.0 psi	720.0 psi
Flowrate	34445 BPD	34445 BPD
Specific Gravity	0.92 rel-H2O	0.92 rel-H2O
Viscosity	50.0Cp	50.0Cp

Pump Selected:

39-675HC27000Standard
Pump eff = 44.56%
Pshaft RPM = 3580
Shft HP @ 60.0 Hz = 788.1
Shaft load =(Std 96%) / (HS 62%)
Required Motor HP at 60.0 Hz = 794.1

Thrust Chamber Selection:

Type HDTC
No sand present
Pump uses fixed-type stages
Thrust Load 28.4 %
ShaftHPcap 1225 HP

Pressure Data:

Max Working Pressure 1458 psi
Max Allowable Working Pressure 1700 psi

Surface Motor Selection

Motor Selected =Teco TEFC 800 HP 460 V 867 A
Terminal Voltage =460 V
Motor Current =862.2 A
Load acc to N.P. =99.3 %

Max Elevation = 3300ft
Max Amb Temp =104.0°F
Power Type =UNFILT
Frame =6808A

No comments

Controller Selection:

Surface KW 625.9kW
Input kVA 740.5kVA
System kW 638.7kW
Max Ctrl Current 862.2A
Power Cost/kWH 0.05\$/kWH
Total Power Cost = \$22994/month

Voltage Input 480.0V
Max Well Head Volts 460.0V
Target Frequency 60.0Hz (8.00V/Hz)
Step-up Trafo 1.0 ratio
Selected: VSD 8900-VT 1000kVA/ 480V/ 1203A

No comments