



300 Series Iron Pipe Swivel Ring

SIZE RANGE:

1/2" through 8" pipe sizes

MATERIAL:

Pre-galvanized Carbon Steel with a Zinc Electroplate insert nut

FINISH:

Pre-Galvanized.

ORDERING:


Specify rod size; finish; and model number and pipe size.

APPROVALS:

UL Listing and FM Approved. Complies with Federal Specification WW-H-171E (Type 10) and A-A-1192A (Type 10) and Manufacturers Standardization Society SP- 69 (Type 10) and NFPA standards for reduced rod sizes.

FUNCTION:

Design and recommended for the suspension of non-insulated stationary pipe lines. The hanger may be installed prior to the erection of piping and also allows for vertical adjustment after installation

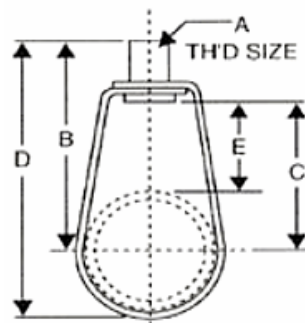

Item #	Pipe Size	A	B	C	D	E	Max. Recommended Load
300 - 204	1/2 inches	3/8 inches	2 1/2 inches	1 1/2 inches	3 inches	1 1/8 inches	400 lbs
300 - 206	3/4 inches	3/8 inches	2 5/8 inches	1 3/4 inches	3 1/8 inches	1 1/8 inches	400 lbs
300 - 210	1 inches	3/8 inches	2 3/4 inches	1 7/8 inches	3 3/8 inches	1 1/8 inches	400 lbs
300 - 212	1 1/4 inches	3/8 inches	2 7/8 inches	2 1/8 inches	3 3/4 inches	1 1/8 inches	400 lbs
300 - 214	1 1/2 inches	3/8 inches	3 inches	2 1/4 inches	4 inches	1 1/8 inches	400 lbs
300 - 220	2 inches	3/8 inches	3 3/8 inches	2 1/2 inches	4 5/8 inches	1 1/8 inches	400 lbs
300 - 224	2 1/2 inches	1/2 inches	4 inches	3 1/8 inches	5 1/2 inches	1 3/8 inches	600 lbs
300 - 230	3 inches	1/2 inches	4 5/8 inches	3 5/8 inches	6 3/8 inches	1 5/8 inches	600 lbs
300 - 234	3 1/2 inches	1/2 inches	5 inches	4 inches	7 inches	1 3/4 inches	600 lbs
300 - 240	4 inches	5/8 inches	5 1/4 inches	4 1/8 inches	7 1/2 inches	1 5/8 inches	1000 lbs
300 - 250	5 inches	5/8 inches	6 inches	5 inches	8 3/4 inches	1 7/8 inches	1000 lbs
300 - 260	6 inches	3/4 inches	7 inches	6 inches	10 3/8 inches	2 1/8 inches	1250 lbs
300 - 280	8 inches	7/8 inches	8 1/4 inches	7 1/8 inches	12 5/8 inches	2 3/8 inches	1250 lbs

**VFXT.EX1006
Hangers, Pipe**[Page Bottom](#)**Hangers, Pipe**[See General Information for Hangers, Pipe](#)**GLOBE PIPE HANGER PRODUCTS INC**
14601 INDUSTRIAL PKY
CLEVELAND, OH 44135 USA

EX1006

Pipe hangers

Model	Hanger Type	Rod Size	NPS*	Comments
300	Band Hanger	3/8 in.	1/2, 3/4, 1, 1-1/4, 1-1/2, 2	—
300	Band Hanger	1/2 in.	2-1/2, 3, 3-1/2, 4, 5, 6, 8	—
304	Band Hanger	10 mm	1/2, 3/4, 1, 1-1/4, 1-1/2, 2, 3, 3-1/2, 4	—
304	Band Hanger	12 mm	5, 6, 8	—
103	Top Beam Clamp	3/8 in.	Up to 4	—
104	Beam Clamp	1/2 in.	Up to 5	—
105	Beam Clamp	1/2 in.	Up to 6	—
107	Beam Clamp	7/8 in.	Up to 8	—
113	Top Beam Clamp	3/8 in.	Up to 4	—
203	C-clamp	3/8 in.	Up to 4	—
204	C-clamp	3/8 in.	Up to 6	—
205	C-clamp	5/8 in.	Up to 6	—
206	C-clamp	3/4 in.	Up to 6	—
207	C-clamp	7/8 in.	Up to 12	—
400	Clevis Hanger	3/8 in.	1/2, 3/4, 1, 1-1/4, 1-1/2, 2	—
400	Clevis Hanger	1/2 in.	2-1/2, 3, 3-1/2	—
400	Clevis Hanger	5/8 in.	4, 5, 6, 8	—
726-106	Concrete Insert	3/8 in.	Up to 4	—
726-106	Concrete Insert	1/2 in.	Up to 8	—
726-106	Concrete Insert	5/8 in.	Up to 8	—
726-107	Concrete Insert	3/8 in.	Up to 4	—
726-107	Concrete Insert	1/2 in.	Up to 8	—
726-107	Concrete Insert	5/8 in.	Up to 8	—
719T	Side Beam Bracket	3/8 in.	Up to 4	—
310	Wire Hanger	3/8 in.	1/2, 3/4, 1, 1-1/4, 1-1/2, 2	—
314	Wire Hanger	3/8 in.	2-1/2, 3, 3-1/2, 4	—

* NPS = Nominal pipe size

[Last Updated](#) on 2007-03-21[Questions?](#)[Print this page](#)[Notice of Disclaimer](#)[Page Top](#)

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Listed and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Designs and/or Listings (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from Underwriters Laboratories Inc." must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "Copyright © 2010 Underwriters Laboratories Inc.®"

An independent organization working for a safer world with integrity, precision and knowledge.

