


①

1/5/2010

Public Safety Center



York
Optiview
Control
Center
Max E
Screw Chiller

Unit Model: YRTCTDT ϕ - 46C

V: 460 V

LRA: 1488 A

RLA: 194 A

230 ton

Siemens

Pumps on VFDs

Dan Harris - CDM

Project Manager - Public Safety Center


O: (703) 485-8488

C: (703) 638-8696

Dam

High-H₂O NG pressure


Fulton
Model: PHTW-2000

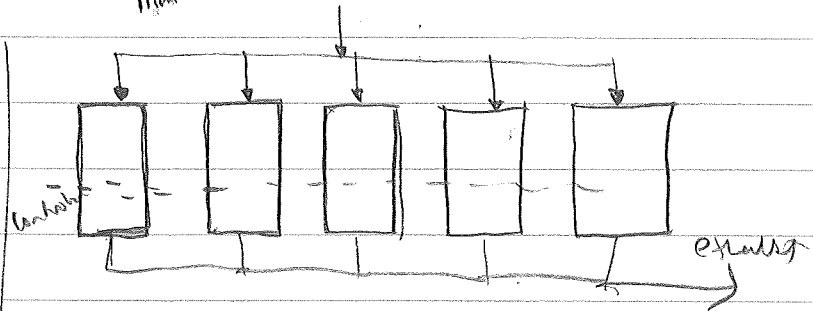

2 mmbtu/burner

10 mmbtu total

2500 gal Storage
Capacity

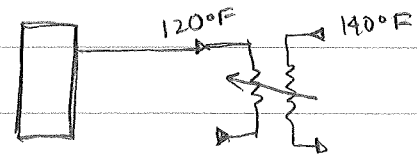


State-man.

Class lined


2" insul w/ fiberglass

Alum. shield

3 min showers - 600 persons

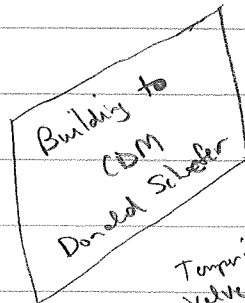

What they want to do

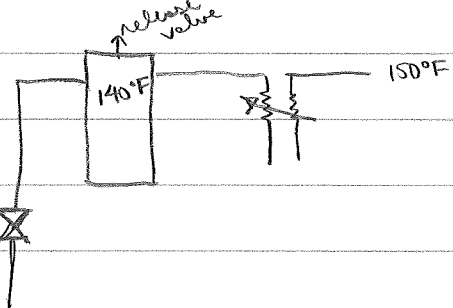

OR

Min Input/hr - 400k

Max. BR Input/hr - 2000k

Min BR Output/hr - 360k

Max BR Output/hr - 1800k