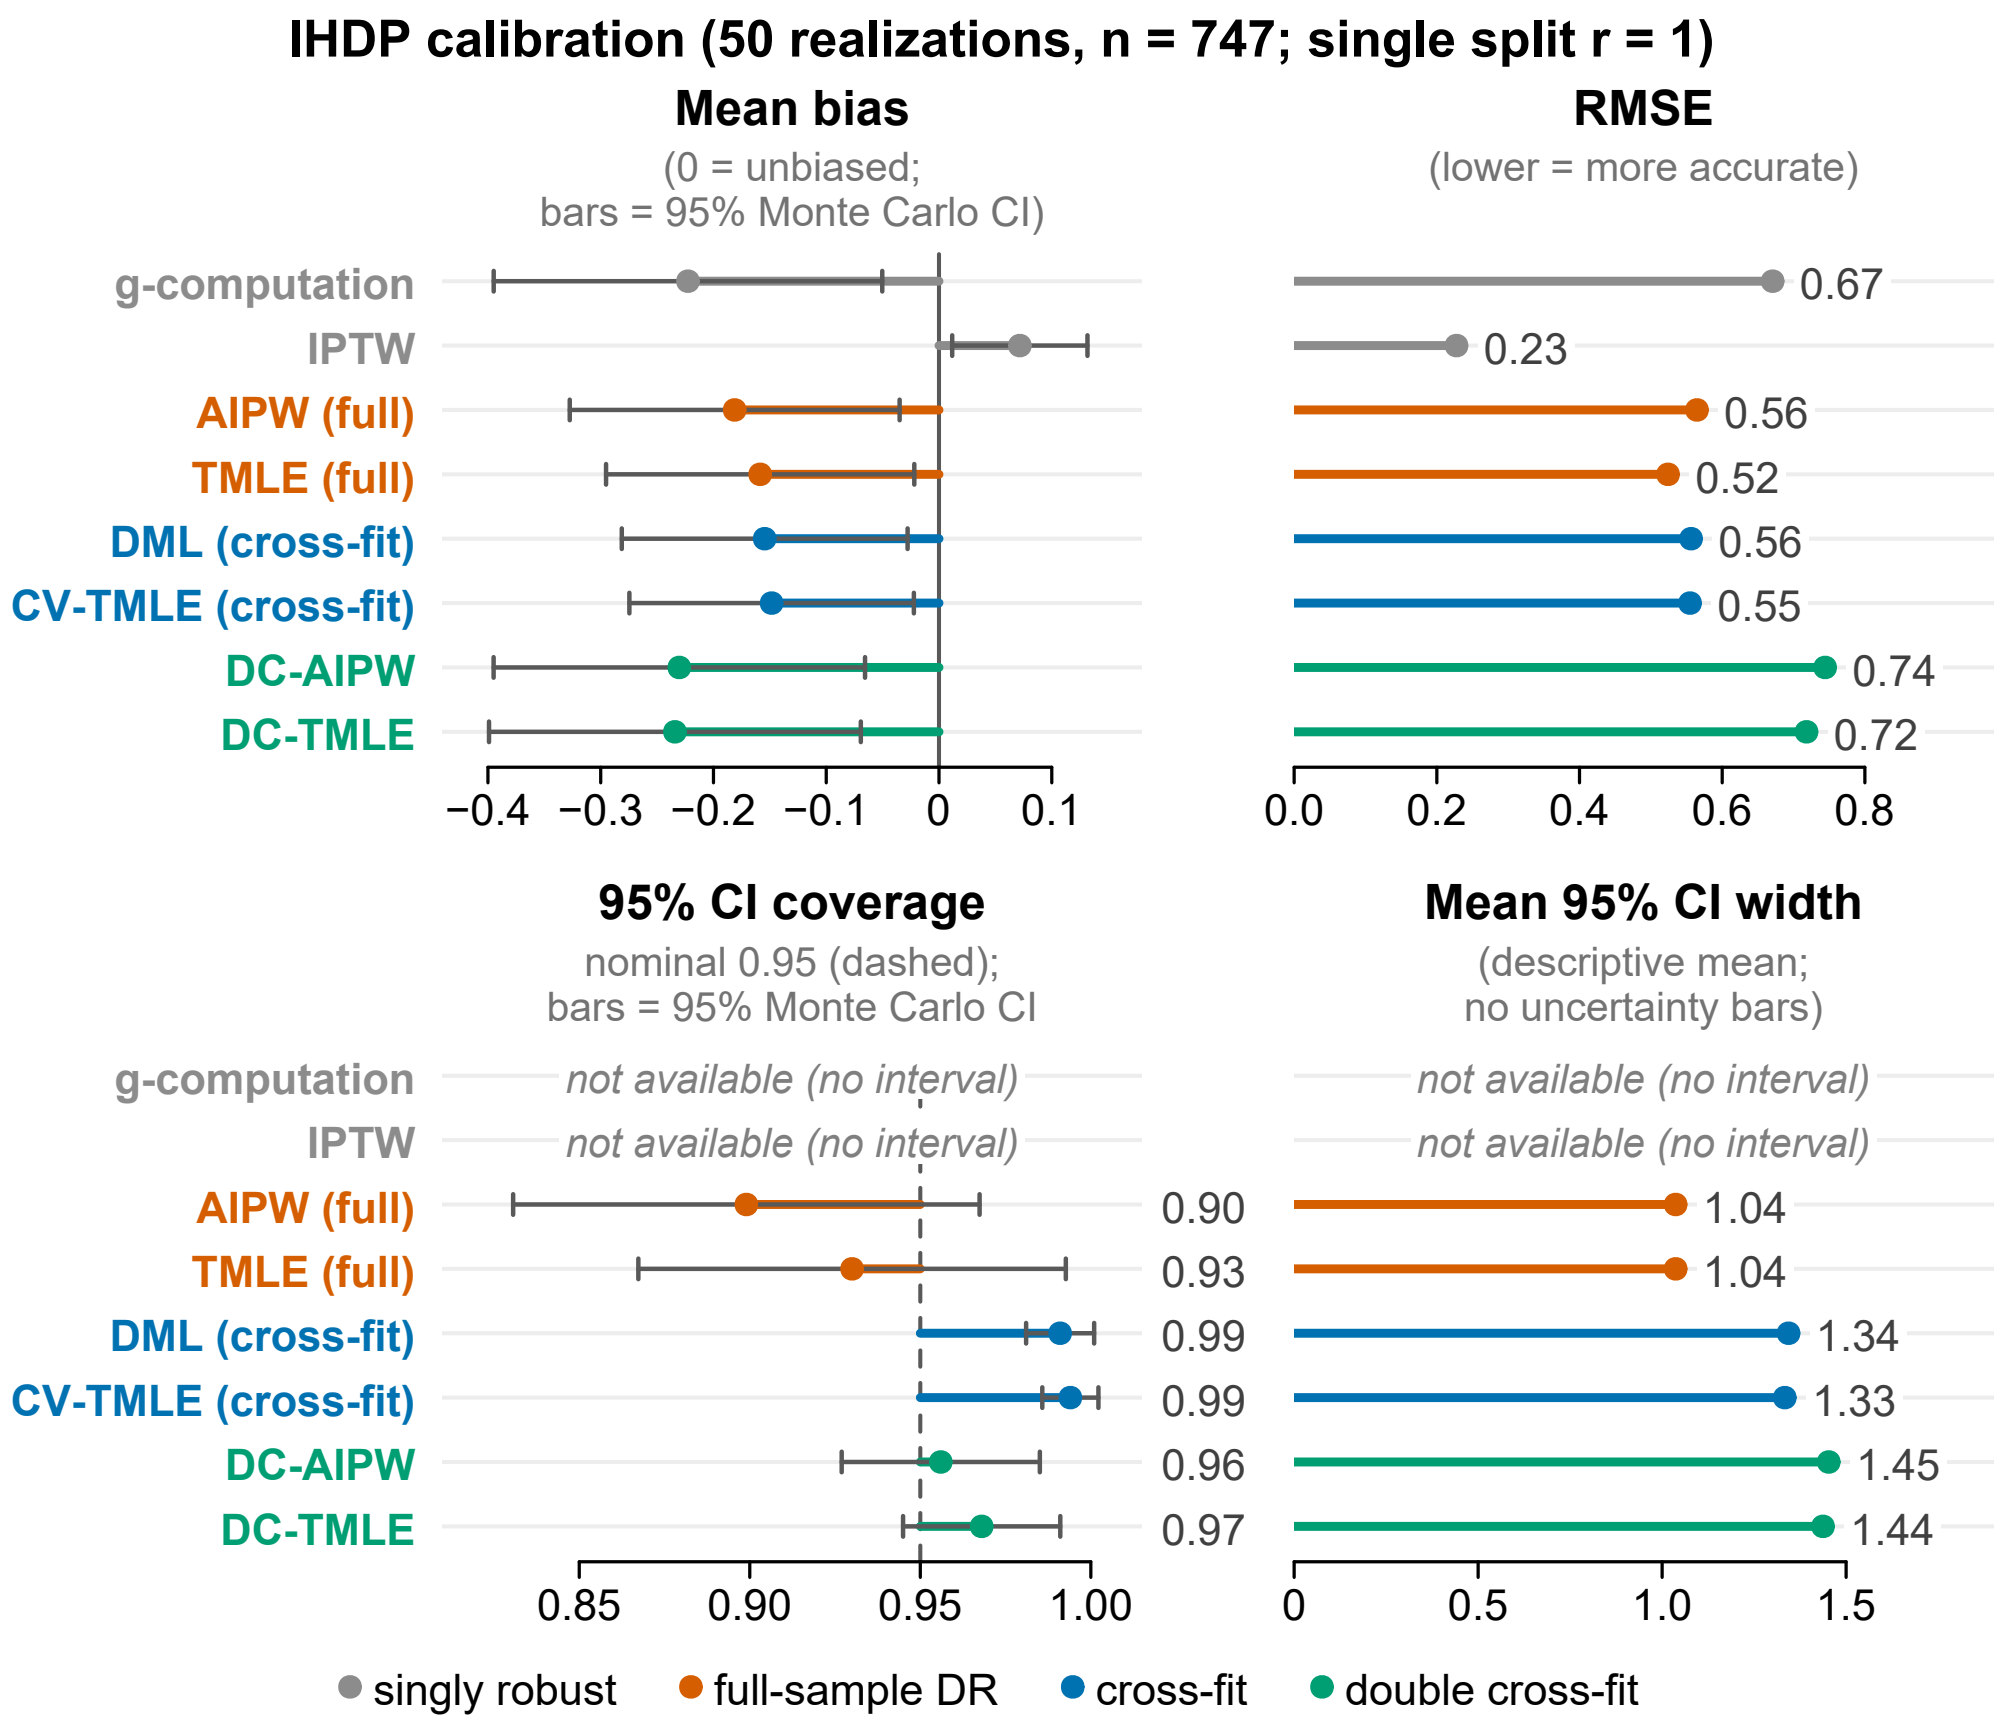

IHDP calibration (50 realizations, n = 747; single split r = 1)
Mean bias
(0 = unbiased;
bars = 95% Monte Carlo CI)
RMSE
(lower = more accurate)
g-computation
IPTW
AIPW (full)
TMLE (full)
DML (cross-fit)
CV-TMLE (cross-fit)
DC-AIPW
DC-TMLE
−0.4
−0.3
−0.2
−0.1
0
0.1
0.67
0.23
0.56
0.52
0.56
0.55
0.74
0.72
0.0
0.2
0.4
0.6
0.8
95% CI coverage
nominal 0.95 (dashed);
bars = 95% Monte Carlo CI
Mean 95% CI width
(descriptive mean;
no uncertainty bars)
not available (no interval)
not available (no interval)
not available (no interval)
not available (no interval)
0.90
0.93
0.99
0.99
0.96
0.97
1.04
1.04
1.34
1.33
1.45
1.44
0.85
0.90
0.95
1.00
0
0.5
1.0
1.5
singly robust
full-sample DR
cross-fit
double cross-fit